

LEBANON VAMC
NEW ENTRYWAY FOR BUILDING 17
LEBANON, PENNSYLVANIA

VOLUME 1 DIVISION 00-14
SPECIFICATIONS
BID DOCUMENTS
OCTOBER 24, 2022

VA Project 595-668
AEW # VLEB-010

Prepared by



**DEPARTMENT OF VETERANS AFFAIRS
 VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS
 Section 00 01 10**

SECTION NO.	DIVISION AND SECTION TITLES	DATE
	DIVISION 00 - SPECIAL SECTIONS	
00 01 15	List of Drawing Sheets	05-20
	DIVISION 01 - GENERAL REQUIREMENTS	
01 00 00	General Requirements	11-21
01 32 16.15	Project Schedules	03-20
01 33 23	Shop Drawings, Product Data, and Samples	06-21
01 35 26	Safety Requirements	11-21
01 42 19	Reference Standards	11-20
01 45 00	Quality Control	02-21
01 45 29	Testing Laboratory Services	11-18
01 45 35	Special Inspections	06-21
01 45 35	Statement of Special Inspections	
01 57 19	Temporary Environmental Controls	01-21
01 58 16	Temporary Interior Signage	07-15
01 74 19	Construction Waste Management	11-21
01 81 13	Sustainable Construction Requirements	10-17
01 81 13.02	Sustainability Certification Requirements - LEED NC V4	01-21
01 91 00	General Commissioning Requirements	10-15
	DIVISION 02 - EXISTING CONDITIONS	
02 41 00	Selective Demolition	08-17
	DIVISION 03 - CONCRETE	
03 30 00	Cast-in-Place Concrete	01-21
	DIVISION 04 - MASONRY	
04 05 13	Masonry Mortaring	10-17
04 05 16	Masonry Grouting	01-21
04 20 00	Unit Masonry	08-17
04 72 00	Cast Stone Masonry	01-21
	DIVISION 05 - METALS	
05 12 00	Structural Steel Framing	11-18

SECTION NO.	DIVISION AND SECTION TITLES	DATE
05 31 00	Steel Decking	01-21
05 40 00	Cold-Formed Metal Framing	01-21
05 50 00	Metal Fabrications	08-18
	DIVISION 06 - WOOD, PLASTICS AND COMPOSITES	
06 06 60	Translucent Resin Panel	
06 10 00	Rough Carpentry	10-17
06 16 00	Sheathing	
	DIVISION 07 - THERMAL AND MOISTURE PROTECTION	
07 14 16.11	Cold Fluid Applied Waterproofing	
07 21 13	Thermal Insulation	01-21
07 22 00	Roof and Deck Insulation	01-21
07 24 00	Exterior Insulation and Finish Systems	01-21
07 26 00	Under Slab Vapor Barrier	
07 27 27	Fluid-Applied Membrane Air Barrier, Vapor Retarding	01-21
07 41 00	Metal Roof Panels	
07 42 13.13	Metal Wall Panels	
07 53 23	Ethylene-Propylene-Diene-Monomer Roofing	01-21
07 60 00	Flashing and Sheet Metal	01-21
07 71 00	Roof Specialties	01-21
07 72 00	Roof Accessories	01-21
07 81 00	Applied Fireproofing	10-17
07 84 00	Firestopping	01-21
07 92 00	Joint Sealants	10-17
07 95 13	Expansion Joint Cover Assemblies	01-21
	DIVISION 08 - OPENINGS	
08 11 13	Hollow Metal Doors and Frames	01-21
08 14 00	Interior Wood Doors	01-21
08 31 13	Access Doors and Frames	01-21
08 41 13	Aluminum-Framed Entrances and Storefronts	01-21
08 42 29.23	Sliding Automatic Entrances	
08 44 13	Glazed Aluminum Curtain Walls	04-20
08 45 23	Translucent Skylight	
08 71 00	Door Hardware	01-21
08 71 13	Automatic Door Operators	01-21
08 80 00	Glazing	01-21
	DIVISION 09 - FINISHES	
09 05 16	Subsurface Preparation for Floor Finishes	01-21
09 06 00	Schedule for Finishes	01-21
09 22 16	Non-Structural Metal Framing	06-18
09 29 00	Gypsum Board	04-20

SECTION NO.	DIVISION AND SECTION TITLES	DATE
09 51 00	Acoustical Ceilings	12-18
09 56 24	Acoustic Wall Panels	
09 65 13	Resilient Base and Accessories	01-21
09 65 16	Resilient Sheet Flooring	05-18
09 65 19	Resilient Tile Flooring	05-18
09 66 16	Terrazzo Floor Tile	01-21
09 91 00	Painting	01-21
	DIVISION 10 - SPECIALTIES	
10 14 00	Signage	01-21
10 26 00	Wall and Door Protection	01-21
10 44 13	Fire Extinguisher Cabinets	08-18
10 74 13	Exterior Clock	
	DIVISION 11 - EQUIPMENT	
	DIVISION 12 - FURNISHINGS	
12 32 00	Manufactured Wood Casework	09-15
12 36 00	Countertops	12-18
12 48 40	Foot grille Entrance System	
	DIVISION 13 - SPECIAL CONSTRUCTION	
	DIVISION 14- CONVEYING EQUIPEMENT	
14 24 00	Hydraulic Elevator	08-20
	DIVISION 21- FIRE SUPPRESSION	
21 08 00	Commissioning of Fire Suppression System	
21 13 13	Wet-Pipe Sprinkler Systems	06-15
21 13 16	Dry-Pipe Sprinkler Systems	
	DIVISION 22 - PLUMBING	
22 05 11	Common Work Results for Plumbing	09-20
22 05 23	General-Duty Valves for Plumbing Piping	09-20
22 07 11	Plumbing Insulation	09-19
22 08 00	Commissioning of Plumbing Systems	
22 11 00	Facility Water Distribution	05-21
22 13 00	Facility Sanitary and Vent Piping	09-20
22 14 00	Facility Storm Drainage	09-15
22 14 29	Sump Pumps	09-15
22 33 00	Electric Domestic Water Heaters	09-20
22 40 00	Plumbing Fixtures	09-15

SECTION NO.	DIVISION AND SECTION TITLES	DATE
	DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)	
23 05 11	Common Work Results for HVAC	02-20
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment	02-20
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	02-20
23 05 93	Testing, Adjusting, and Balancing for HVAC	02-20
23 07 11	HVAC and Boiler Plant Insulation	02-20
23 08 00	Commissioning of HVAC Systems	02-20
23 09 23	Direct-Digital Control System for HVAC	09-11
23 21 13	Hydronic Piping	02-20
23 22 13	Steam and Condensate Heating Piping	02-20
23 31 00	HVAC Ducts and Casings	02-20
23 34 00	HVAC Fans	02-20
23 36 00	Air Terminal Units	02-20
23 37 00	Air Outlets and Inlets	02-20
23 81 00	Decentralized Unitary HVAC Equipment	03-20
23 82 00	Convection Heating Units	02-20
	DIVISION 25 - INTEGRATED AUTOMATION	
	DIVISION 26 - ELECTRICAL	
26 01 00	Basic Electrical Requirements	
26 02 00	Quality Requirements	
26 05 00	Common Work Results for Electrical	
26 05 11	Requirements for Electrical Installations	01-16
26 05 19	Low-Voltage Electrical Power Conductors and Cables	01-17
26 05 26	Grounding and Bonding for Electrical Systems	01-17
26 05 33	Raceway and Boxes for Electrical Systems	01-18
26 09 23	Lighting Controls	01-18
26 22 00	Low-Voltage Transformers	01-18
26 24 16	Panelboards	01-18
26 27 26	Wiring Devices	01-18
26 29 11	Motor Controllers	01-18
26 29 21	Enclosed Switches and Circuit Breakers	01-17
26 51 00	Interior Lighting	01-18
26 56 00	Exterior Lighting	01-18
	DIVISION 27 - COMMUNICATIONS	
27 05 11	Requirements for Communications Installations	09-19
27 05 26	Grounding and Bonding for Communications Systems	06-15
27 05 33	Raceways and Boxes for Communications Systems	10-18
27 08 00	Commissioning of Communications Systems	11-16
27 15 00	Communications Structured Cabling	01-16

SECTION NO.	DIVISION AND SECTION TITLES	DATE
	DIVISION 28 - ELECTRONIC SAFETY AND SECURITY	
28 13 00	Physical Access Control System	10-11
28 16 00	Intrusion Detection System	10-11
28 23 00	Video Surveillance	09-11
28 26 00	Electronic Personal Protection System	09-11
28 31 00	Fire Detection and Alarm	10-11
	DIVISION 31 - EARTHWORK	
31 20 00	Earthwork	07-16
	DIVISION 32 - EXTERIOR IMPROVEMENTS	
32 05 23	Cement and Concrete for Exterior Improvements	08-16
32 12 16	Asphalt Paving	09-15
32 17 23	Pavement Markings	08-16
32 31 00	Equipment Screen	
32 90 00	Planting	08-16
	DIVISION 33 - UTILITIES	
33 40 00	Storm Drainage Utilities	12-17
	DIVISION 34 - TRANSPORTATION	
	DIVISION 48 - Electrical Power Generation	

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
05-01-20

SECTION 00 01 15
LIST OF DRAWING SHEETS

The drawings listed on the cover sheet of the drawing set which accompany
this specification form a part of the contract.

- - - E N D - - -

SECTION 01 00 00
GENERAL REQUIREMENTS

1.1 SAFETY REQUIREMENTS

- A. Refer to section 01 35 26, SAFETY REQUIREMENTS for safety and infection control requirements.

1.2 GENERAL INTENTION

- A. New building addition of approximately 6,000 SF with interior connecting corridors to the future primary care additions on each side of the main building. The design will include site modifications for a new driveway approaching the entrance with a canopy covering the new patient drop off area.
- B. Visits to the site by Bidders may be made in accordance with what is listed in the solicitation and at the discretion of the Contracting Officer.
- C. Offices of AE Works, LTD 418 Beaver Street, Sewickley Pa., as Architect-Engineers, will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- D. Before placement and installation of work subject to tests by testing laboratory retained by Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable testing laboratory personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three workdays unless otherwise designated by the COR .
- E. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.

1.3 STATEMENT OF BID ITEM(S)

A. ITEM I, GENERAL CONSTRUCTION: Work includes general construction, alterations, roads, walks, grading, drainage, necessary removal of existing structures and construction and certain other items.

ITEM II, Electrical Work: Work includes all labor, material, equipment and supervision to perform the required electrical construction work.

ITEM III, Mechanical Work: Work includes all labor, material, equipment and supervision to perform the required Mechanical construction work.

A. ALTERNATE NO.1: Remove 2 dormers in the reception area.

B. ALTERNATE NO. 2: Build both elevator shafts only install 1 elevator

C. ALTERNATE NO. 3: Future site electrical duct bank - The duct bank from the transformer, around the Primary Care to the manhole near the main driveway. Install the duct bank under the entry drive in this scope.

D. ALTERNATE NO. 4: Canopy - remove translucent panels, provide lighting in lieu of base bid translucent panels.

1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR

A. Drawings and contract documents may be obtained from the website where the solicitation is posted. Additional copies will be at Contractor's expense.

1.5 CONSTRUCTION SECURITY REQUIREMENTS

A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. Before starting work the General Contractor shall give one week's notice to the Contracting Officer so that security escort arrangements can be provided for the employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Guards:

1. The Contractor shall provide the guards and VA police with communication devices as directed.
2. The general Contractor shall install equipment for recording guard rounds to ensure systematic checking of the premises.

D. Key Control:

1. The General Contractor shall provide duplicate keys and lock combinations to the Contracting officers representative (COR) for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.
2. The General Contractor shall turn over all permanent lock cylinders to the VA locksmith for permanent installation. See Section 08 71 00, DOOR HARDWARE and coordinate.

E. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the

approach to following goals and maintaining confidentiality of "sensitive information".

2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.
3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
 - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
 - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

F. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.

2. A limited number of (2 to 5) permits shall be issued for General Contractor and its employees for parking in designated areas only.

1.6 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.

(FAR 52.236-10)

- D. Working space and space available for storing materials shall be as determined by the COR .

E. Workers are subject to rules of Medical Center applicable to their conduct.

F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COR where required by limited working space.

1. Do not store materials and equipment in other than assigned areas.

2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.

3. Where access by Medical Center Cemetery personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.

G. Phasing:

The Medical Center must maintain its operation 24 hours a day 7 days a week. Therefore, any interruption in service must be scheduled and coordinated with the COR to ensure that no lapses in operation occur. It is the CONTRACTOR'S responsibility to develop a work plan and schedule detailing, at a minimum, the procedures to be employed, the equipment and materials to be used, the interim life safety measure to be used during the work, and a schedule defining the duration of the work with milestone subtasks. The work to be outlined shall include, but not be limited to:

To ensure such executions, Contractor shall furnish the COR with a schedule of approximate phasing dates on which the Contractor intends to accomplish work in each specific area of site, building or portion

thereof. In addition, Contractor shall notify the COR two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof. Arrange such phasing dates to ensure accomplishment of this work in successive phases mutually agreeable to COR and Contractor, as follows:

- H. Building (s) No. (s) Part of Bldg. _____ will be vacated by Government in accordance with above phasing beginning immediately after date of receipt of Notice to Proceed and turned over to Contractor.
- H. Building will be occupied during performance of work. ; but immediate areas of alterations will be vacated.
 - 1. Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. These routes whether access or egress shall be isolated from the construction area by temporary partitions and have walking surfaces, lighting etc to facilitate patient and staff access. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
 - 2. Immediate areas of alterations not mentioned in preceding Subparagraph 1 will be temporarily vacated while alterations are performed.
- I. Construction Fence: Before construction operations begin, Contractor shall provide a chain link construction fence, 2.1m (seven feet) minimum height, around the construction area indicated on the drawings. Provide gates as required for access with necessary hardware, including hasps and padlocks. Fasten fence fabric to terminal posts with tension bands and to line posts and top and bottom rails with tie wires spaced at maximum 375mm (15 inches). Bottom of fences shall extend to 25mm (one inch) above grade. Remove the fence when directed by COR .

- J. When a building and/or construction site is turned over to Contractor, Contractor shall accept entire responsibility including upkeep and maintenance therefore:
1. Contractor shall maintain a minimum temperature of 4 degrees C (40 degrees F) at all times, except as otherwise specified.
 2. Contractor shall maintain in operating condition existing fire protection and alarm equipment. In connection with fire alarm equipment, Contractor shall make arrangements for pre-inspection of site with Fire Department or Company (Department of Veterans Affairs or municipal) whichever will be required to respond to an alarm from Contractor's employee or watchman.
- K. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR .
1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COR . Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without a detailed work plan, the Medical Center Director's prior knowledge and written approval. Refer to specification Sections 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, 27 05 11 REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS and 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY for additional requirements.
 2. Contractor shall submit a request to interrupt any such services to COR , in writing, 7 days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.

3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center . Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.
 4. Major interruptions of any system must be requested, in writing, at least 15 calendar days prior to the desired time and shall be performed as directed by the COR .
 5. In case of a contract construction emergency, service will be interrupted on approval of COR . Such approval will be confirmed in writing as soon as practical.
 6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- L. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged at the main, branch or panel they originate from. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- M. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles. Wherever excavation for new utility lines cross existing roads, at least one lane must be open to traffic at all times with approval.
 2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the COR .

N. Coordinate the work for this contract with other construction operations as directed by COR . This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

1.7 ALTERATIONS

A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COR and a representative of VA Supply Service, of buildings areas of buildings in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, all three, to the Contracting Officer. This report shall list by rooms and spaces:

1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of building.
2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
3. Shall note any discrepancies between drawings and existing conditions at site.
4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR .

B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR and/or Supply Representative , to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4).

C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:

1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workers in executing work of this contract.

D. Protection: Provide the following protective measures:

1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

1.8 DISPOSAL AND RETENTION

A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:

1. Reserved items which are to remain property of the Government are identified by attached tags or noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to

re-installation and reuse. Store such items where directed by COR

2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center .
3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.

1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workers, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.

(FAR 52.236-9)

- C. Refer to Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, for additional requirements on protecting vegetation, soils and the environment. Refer to Articles, "Alterations", "Restoration", and "Operations and Storage Areas" for additional instructions concerning repair of damage to structures and site improvements.
- D. Refer to FAR clause 52.236-7, "Permits and Responsibilities," which is included in General Conditions. A National Pollutant Discharge Elimination System (NPDES) permit is required for this project. The Contractor is considered an "operator" under the permit and has extensive responsibility for compliance with permit requirements. VA will make the permit application available at the (appropriate medical center) office. The apparent low bidder, contractor and affected subcontractors shall furnish all information and certifications that are required to comply with the permit process and permit requirements. Many of the permit requirements will be satisfied by completing construction as shown and specified. Some requirements involve the Contractor's method of operations and operations planning and the Contractor is responsible for employing best management practices. The affected activities often include, but are not limited to the following:
- Designating areas for equipment maintenance and repair;
 - Providing waste receptacles at convenient locations and provide regular collection of wastes;
 - Locating equipment wash down areas on site, and provide appropriate control of wash-waters;
 - Providing protected storage areas for chemicals, paints, solvents, fertilizers, and other potentially toxic materials; and
 - Providing adequately maintained sanitary facilities.

1.10 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR . Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workers to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

1.11 PHYSICAL DATA

- A. Data and information furnished or referred to below is for the Contractor's information. The Government shall not be responsible for any interpretation of or conclusion drawn from the data or information by the Contractor.

1. The indications of physical conditions on the drawings and in the specifications are the result of site investigations by

(FAR 52.236-4)

- B. Subsurface conditions have been developed by core borings and test pits. Logs of subsurface exploration are shown diagrammatically on drawings.
- C. A copy of the soil report will be made available for inspection by bidders upon request to the Engineering Officer at the VA Medical Center, and shall be considered part of the contract documents.
- D. Government does not guarantee that other materials will not be encountered nor that proportions, conditions or character of several materials will not vary from those indicated by explorations. Bidders are expected to examine site of work and logs of borings; and, after investigation, decide for themselves character of materials and make their bids accordingly. Upon proper application to Department of Veterans Affairs, bidders will be permitted to make subsurface explorations of their own at site.

1.12 PROFESSIONAL SURVEYING SERVICES

A registered professional land surveyor or registered civil engineer whose services are retained and paid for by the Contractor shall perform services specified herein and in other specification sections. The Contractor shall certify that the land surveyor or civil engineer is not one who is a regular employee of the Contractor, and that the land surveyor or civil engineer has no financial interest in this contract.

1.13 LAYOUT OF WORK

- A. The Contractor shall lay out the work from Government established base lines and bench marks, indicated on the drawings, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible

for executing the work to the lines and grades that may be established or indicated by the Contracting Officer. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the Contracting Officer until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the Contracting Officer may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor.

(FAR 52.236-17)

- B. Establish and plainly mark center lines for each building and corner of column lines and/or addition to each existing building, lines for each gravesite control monument, and such other lines and grades that are reasonably necessary to properly assure that location, orientation, and elevations established for each such structure and/or addition, roads, parking lots, gravesite control monuments, are in accordance with lines and elevations shown on contract drawings.
- C. Following completion of general mass excavation and before any other permanent work is performed, establish and plainly mark (through use of appropriate batter boards or other means) sufficient additional survey control points or system of points as may be necessary to assure proper alignment, orientation, and grade of all major features of work. Survey shall include, but not be limited to, location of lines and grades of footings, exterior walls, center lines of columns in both directions, major utilities and elevations of floor slabs:
 - 1. Such additional survey control points or system of points thus established shall be checked and certified by a registered land surveyor or registered civil engineer. Furnish such certification to the COR before any work (such as footings, floor slabs, columns, walls, utilities and other major controlling features) is placed.
- D. During progress of work, and particularly as work progresses from floor to floor, Contractor shall have line grades and plumbness of all major form work checked and certified by a registered land surveyor or registered civil engineer as meeting requirements of contract drawings. Furnish such certification to the COR before any major items of

concrete work are placed. In addition, Contractor shall also furnish to the COR certificates from a registered land surveyor or registered civil engineer that the following work is complete in every respect as required by contract drawings.

1. Lines of each building and/or addition.
2. Elevations of bottoms of footings and tops of floors of each building and/or addition.
3. Lines and elevations of sewers and of all outside distribution systems.

1.14 AS-BUILT DRAWINGS

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To ensure compliance, as-built drawings shall be made available for the 's COR review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings in the electronic version (scanned PDF) to the COR within 15 calendar days after each completed phase and after the acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

1.15 WARRANTY MANAGEMENT

- A. Warranty Management Plan: Develop a warranty management plan which contains information relevant to FAR 52.246-21 Warranty of Construction in at least 30 days before the planned pre-warranty conference, submit four sets of the warranty management plan. Include within the warranty management plan all required actions and documents to assure that the Government receives all warranties to which it is entitled. The plan must be in narrative form and contain sufficient detail to render it suitable for use by future maintenance and repair personnel, whether tradesman, or of engineering background, not necessarily familiar with this contract. The term "status" as indicated below must

include due date and whether item has been submitted or was approved. Warranty information made available during the construction phase must be submitted to the Contracting Officer for approval prior to each monthly invoice for payment. Assemble approved information in a binder and turn over to the Government upon acceptance of the work. The construction warranty period will begin on the date of the project acceptance and continue for the product warranty period. A joint 4 month and 9 month warranty inspection will be conducted, measured from time of acceptance, by the Contactor and the Contracting Officer. Include in the warranty management plan, but not limited to, the following:

1. Roles and responsibilities of all personnel associated with the warranty process, including points of contact and telephone numbers within the company of the Contractor, subcontractors, manufacturers or suppliers involved.
2. Furnish with each warranty the name, address and telephone number of each of the guarantor's representatives nearest project location.
3. Listing and status of delivery of all Certificates of Warranty for extended warranty items, to include roofs, HVAC balancing, pumps, motors, transformers and for all commissioned systems such as fire protection and alarm systems, sprinkler systems and lightning protection systems, etc.
4. A list for each warranted equipment item, feature of construction or system indicating:
 - a. Name of item.
 - b. Model and serial numbers.
 - c. Location where installed.
 - d. Name and phone numbers of manufacturers and suppliers.
 - e. Name and phone numbers of manufacturers or suppliers.
 - f. Names, addresses and phone numbers of sources of spare parts.

- g. Warranties and terms of warranty. Include one-year overall warranty of construction, including the starting date of warranty of construction. Items which have extended warranties must be indicated with separate warranty expiration dates.
 - h. Starting point and duration of warranty period.
 - i. Summary of maintenance procedures required to continue the warranty in force.
 - j. Cross-reference to specific pertinent Operation and Maintenance manuals.
 - k. Organizations, names and phone numbers of persons to call for warranty service.
 - l. Typical response time and repair time expected for various warranted equipment.
5. The plans for attendance at the 4 and 9-month post construction warranty inspections conducted by the government.
6. Procedure and status of tagging of all equipment covered by extended warranties.
7. Copies of instructions to be posted near selected pieces of equipment where operation is critical for warranty and/or safety reasons.
- B. Performance Bond: The Performance Bond must remain effective throughout the construction period
- 1. In the event the Contractor fails to commence and diligently pursue any construction warranty work required, the Contracting Officer will have the work performed by others, and after completion of the work, will charge the remaining construction warranty funds of expenses incurred by the Government while performing the work, including, but not limited to administrative expenses.
 - 2. In the event sufficient funds are not available to cover the construction warranty work performed by the Government at the

contractor's expenses, the Contracting Officer will have the right to recoup expenses from the bonding company.

3. Following oral or written notification of required construction warranty repair work, the Contractor shall respond in a timely manner. Written verification will follow oral instructions. Failure to respond will be cause for the Contracting Officer to proceed against the Contractor.

C. Pre-Warranty Conference: Prior to contract completion, and at a time designated by the Contracting Officer, the Contractor shall meet with the Contracting Officer to develop a mutual understanding with respect to the requirements of this section. Communication procedures for Contractor notification of construction warranty defects, priorities with respect to the type of defect, reasonable time required for Contractor response, and other details deemed necessary by the Contracting Officer for the execution of the construction warranty will be established/ reviewed at this meeting. In connection with these requirements and at the time of the Contractor's quality control completion inspection, furnish the name, telephone number and address of a licensed and bonded company which is authorized to initiate and pursue construction warranty work action on behalf of the Contractor. This point of contract will be located within the local service area of the warranted construction, be continuously available and be responsive to Government inquiry on warranty work action and status. This requirement does not relieve the Contractor of any of its responsibilities in conjunction with other portions of this provision.

D. Contractor's Response to Construction Warranty Service Requirements:

Following oral or written notification by the Contracting Officer, the Contractor shall respond to construction warranty service requirements in accordance with the "Construction Warranty Service Priority List" and the three categories of priorities listed below. Submit a report on any warranty item that has been repaired during the warranty period. Include within the report the cause of the problem, date reported, corrective action taken, and when the repair was completed. If the Contractor does not perform the construction warranty within the

timeframe specified, the Government will perform the work and back charge the construction warranty payment item established.

1. First Priority Code 1. Perform onsite inspection to evaluate situation, and determine course of action within 4 hours, initiate work within 6 hours and work continuously to completion or relief.
2. Second Priority Code 2. Perform onsite inspection to evaluate situation, and determine course of action within 8 hours, initiate work within 24 hours and work continuously to completion or relief.
3. Third Priority Code 3. All other work to be initiated within 3 work days and work continuously to completion or relief.
4. The "Construction Warranty Service Priority List" is as follows:

Code 1-Life Safety Systems

- a. Fire suppression systems.
- b. Fire alarm system(s).

Code 1-Air Conditioning Systems

- a. Air conditioning leak in part of the building, if causing damage.
- b. Air conditioning system not cooling properly.

Code 1 Doors

- a. Overhead doors not operational, causing a security, fire or safety problem.
- b. Interior, exterior personnel doors or hardware, not functioning properly, causing security, fire or safety problem.

Code 3-Doors

- a. Overhead doors not operational.
- b. Interior/exterior personnel doors or hardware not functioning properly.

Code 1-Electrical

- a. Power failure (entire area or any building operational after 1600 hours).
- b. Security lights.
- c. Smoke detectors.

Code 2-Electrical

- a. Power failure (no power to a room or part of building).
- b. Receptacles and lights not operational (in a room or part of building).

Code 3-Electrical

- a. Exterior lights not operational.

Code 1-Gas

- a. Leaks and pipeline breaks.

Code 1-Heat

- a. Power failure affecting heat.

Code 1-Plumbing

- a. Hot water heater failure.
- b. Leaking water supply pipes.

Code 2-Plumbing

- a. Flush valves not operating properly
- b. Fixture drain, supply line or any water pipe leaking.
- c. Toilet leaking at base.

Code 3- Plumbing

- a. Leaky faucets.

Code 3-Interior

- a. Floors damaged.

b. Paint chipping or peeling.

c. Casework damaged.

Code 1-Roof Leaks

a. Damage to property is occurring.

Code 2-Water (Exterior)

a. No water to facility.

Code 2-Water (Hot)

a. No hot water in portion of building listed.

Code 3

a. All work not listed above.

E. Warranty Tags: At the time of installation, tag each warranted item with a durable, oil and water-resistant tag approved by the Contracting Officer. Attach each tag with a copper wire and spray with a silicone waterproof coating. Also submit two ___ record copies of the warranty tags showing the layout and design. The date of acceptance and the QC signature must remain blank until the project is accepted for beneficial occupancy. Show the following information on the tag.

Type of product/material	
Model number	
Serial number	
Contract number	
Warranty period from/to	
Inspector's signature	
Construction Contractor	
Address	
Telephone number	
Warranty contact	
Address	
Telephone number	
Warranty response time priority code	

1.16 USE OF ROADWAYS

- A. For hauling, use only established public roads and roads on Medical Center Cemetery property and, when authorized by the COR , such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed and restoration performed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.
- B. When new permanent roads are to be a part of this contract, Contractor may construct them immediately for use to facilitate building operations. These roads may be used by all who have business thereon within zone of building operations.
- C. When certain buildings (or parts of certain buildings) are required to be completed in advance of general date of completion, all roads

leading thereto must be completed and available for use at time set for completion of such buildings or parts thereof.

1.17 'S FIELD OFFICE

- A. The Contractor shall, within fifteen (15) days after receipt of Notice to Proceed, provide where shown on the drawings a temporary field office, furniture, and two inch deep gravel surfaced area for use of the COR . Office and furniture shall be new.
- B. The field office shall provide not less than 67 square meters (720 gross square feet) 134 square meters (1440 gross square feet) of floor area in one unit. Installation of the office shall meet all local codes.
- C. Provide office with two, 900 mm (three foot) wide exterior doors, including hardware and OSHA approved platform and stairs leading to grade.
- D. Enclose the entire perimeter of the office from the floor to the ground and finish to match exterior. Provide R7 insulation and seal tight to ground with a painted 19 mm (3/4 inch) exterior grade plywood skirt.
- E. Exterior finishes shall be manufacturer's standards.
- F. Provide floor, wall, and roof with not less than R5 insulation.
- G. Interior finishes shall consist of resilient flooring, plywood paneling or painted wallboard on walls, and acoustical tile ceilings. Interior doors may be either painted or stained.
- H. Interior shall be subdivided with full height partitions to provide one office, two offices, one sample room, one toilet two separate toilets . Provide each space with 900 mm (three foot) wide door with master keyed locks. Section off an area with a low partition and counter for the secretary's desk s .
- I. Provide 750 mm (2-1/2 feet) wide by 900 mm (3 feet) high operable windows; two in each room (none required in sample room), except provide only one 600 mm (2 foot) high window in toilet room(s). Window openings shall be fitted with security bars to prevent any forced

entry. The doors of field office shall have a hasp and padlock and also deadbolts keyed from both sides.

J. Provide sufficient fluorescent lighting in each room to deliver 750 lux (70 foot-candles) of light at desk top height without the aid of daylight. Provide one light switch in each room.

K. Provide one duplex receptacle in each wall of each room. If a wall is 3.0 m (10 feet) long or more, provide two receptacles for each 3.0 m (10 feet), or portion thereof, of wall. Provide two duplex receptacles in low partition at secretary's desk.

L. The Contractor shall provide the following:

1. Electricity, hot and cold water, and necessary utility services (except telephone).
2. All necessary piping, power circuits network cabling, cat 5e or better cabling for phones and computers, electrical fixtures, lighting, and other items necessary to provide a habitable structure for the purpose intended. The number of network and electrical receptacles will be as per attached drawing of the field office.
3. Thermostatically controlled, centralized heating and air conditioning system designed to maintain the temperature between 21 and 27 degrees C (70 and 80 degrees F) with 50 percent relative humidity maintained during the air conditioning season.
4. One water closet, lavatory, mirror, toilet paper dispenser, paper towel dispenser, soap dispenser, towel bar, and two-prong coat hooks for each toilet room.
5. The contractor to install a suitable alarm system for the field office .

M. Contractor shall, for the duration of the COR occupancy, provide the following:

1. Satisfactory conditions in and around the field office and parking area.

2. Maintenance of gravel surfaced area, including the area for parking, in an acceptable condition for vehicle and foot traffic at all times.

3. Maintenance of utility services.

N. The Contractor shall provide the following new items:

QUANTITY REQUIRED

- 1 workstation with adjustable keying desk or drawer 738 mm H x 1.5 m W x 760 mm D (size 29-1/2" H x 60" W x 30" D)
- 1 Printer stand 663 mm H x 1.5 m W x 750 mm D (size 26-1/2" H x 60" W x 30" D)
- 3 Office desks, double pedestal
- 1 Conference table 900 mm x 1.8 m (size 3' x 6')
- 1 Plan table 1.2 m x 2.1 m (4' x 7')
- 3 Work tables 750 mm x 1.8 m (folding 30" x 72")
- 1 Office chair
- 4 Swivel chairs with arms
- 6 Conference chairs (armless & folding)
- 2 Arm Chairs
- 4 Lockable 5 drawer file cabinets, letter size
- 1 Drawing rack, with 12-750 mm (12-30 inch) "Plan Hold" drawing holders, freestanding
- 1 Shelves for sample room, 7 adjustable Shelves, 305 mm W x 900 mm L (12" W x 3' L)
- 3 Bookcases
- 1 Electric water cooler

- 1 Metal storage cabinet, 900 mm x 450 mm x 1.8 m (36" x 18" x 72")
with six shelves
 - 2 workstations with adjustable keying desk or drawer 738 mm H x 1.5 m
W 750 mm D (size 29-1/2" H x 60" W x 30" D)
 - 2 Printer stands 738 mm H x 1500 mm W x 750 mm D (size 29-1/2" H x 60"
H x 30" D)
 - 7 Office desks, double pedestal
 - 2 Conference tables 900 mm x 1800 mm (size 3' x 6')
 - 1 Plan table 1200 mm x 6 meters (4' x 20')
 - 7 Work tables 750 mm x 1800 mm (folding 30" x 72")
 - 2 Office chairs
 - 7 Swivel chairs with arms
 - 12 Conference chairs (armless and folding)
 - 7 Arm chairs
 - 8 Lockable 5 drawer file cabinets, letter-size
 - 2 Drawing racks, each with 12-750 mm (12-30 inch) "Plan Hold" drawing
holders, freestanding
 - 7 Bookcases
 - 1 Electric water cooler
 - 4 Shelves for sample 900 mm x 450 mm x 1.8 m (36" x 18" x 72") high, 7
adjustable shelves
- O. At the completion of all work, including the punch list, the 's COR
field office and facilities shall become the property of the
Contractor and Contractor shall remove same, including utility
connections, from the Medical Center Cemetery . The site shall be
restored to original condition and finished in accordance with contract
requirements. Government and be left intact, including utility
connections, for future use by Department of Veterans Affairs. All 5

drawer file cabinets provided shall become the property of the Government.

P The Contractor shall furnish floor plans for approval by the COR prior to furnishing the field office.

1.18 TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT

- A. Use of new installed mechanical and electrical equipment to provide heat, ventilation, plumbing, light and power will be permitted subject to written approval and compliance with the following provisions:
1. Permission to use each unit or system must be given by COR in writing. If the equipment is not installed and maintained in accordance with the written agreement and following provisions, the COR will withdraw permission for use of the equipment.
 2. Electrical installations used by the equipment shall be completed in accordance with the drawings and specifications to prevent damage to the equipment and the electrical systems, i.e. transformers, relays, circuit breakers, fuses, conductors, motor controllers and their overload elements shall be properly sized, coordinated and adjusted. Installation of temporary electrical equipment or devices shall be in accordance with NFPA 70, National Electrical Code, (2014 Edition), Article 590, *Temporary Installations*. Voltage supplied to each item of equipment shall be verified to be correct and it shall be determined that motors are not overloaded. The electrical equipment shall be thoroughly cleaned before using it and again immediately before final inspection including vacuum cleaning and wiping clean interior and exterior surfaces.
 3. Units shall be properly lubricated, balanced, and aligned. Vibrations must be eliminated.
 4. Automatic temperature control systems for preheat coils shall function properly and all safety controls shall function to prevent coil freeze-up damage.
 5. The air filtering system utilized shall be that which is designed for the system when complete, and all filter elements shall be

- replaced at completion of construction and prior to testing and balancing of system.
6. All components of heat production and distribution system, metering equipment, condensate returns, and other auxiliary facilities used in temporary service shall be cleaned prior to use; maintained to prevent corrosion internally and externally during use; and cleaned, maintained and inspected prior to acceptance by the Government. Boilers, pumps, feedwater heaters and auxiliary equipment must be operated as a complete system and be fully maintained by operating personnel. Boiler water must be given complete and continuous chemical treatment.
- B. Prior to final inspection, the equipment or parts used which show wear and tear beyond normal, shall be replaced with identical replacements, at no additional cost to the Government.
- C. This paragraph shall not reduce the requirements of the mechanical and electrical specifications sections.
- D. Any damage to the equipment or excessive wear due to prolonged use will be repaired replaced by the contractor at the contractor's expense.

1.21 TEMPORARY TOILETS

- A. Provide where directed, (for use of all Contractor's workers) ample temporary sanitary toilet accommodations with suitable sewer and water connections; or, when approved by COR , provide suitable dry closets where directed. Keep such places clean and free from flies, and all connections and appliances connected therewith are to be removed prior to completion of contract, and premises left perfectly clean.

1.22 AVAILABILITY AND USE OF UTILITY SERVICES

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to

the Government. The Contractor shall carefully conserve any utilities furnished without charge.

- B. The Contractor, at Contractor's expense and in a workmanlike manner, in compliance with code and as satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia and repair restore the infrastructure as required.
- C. Contractor shall install meters at Contractor's expense and furnish the Medical Center a monthly record of the Contractor's usage of electricity as hereinafter specified.
- D. Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
1. Obtain heat by connecting to Medical Center Cemetery heating distribution system.
 - a. Steam is available at no cost to Contractor.
- E. Electricity (for Construction and Testing): Furnish all temporary electric services.
1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.
- F. Water (for Construction and Testing): Furnish temporary water service.

1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection as per code. Water is available at no cost to the Contractor.
 2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COR discretion) of use of water from Medical Center's system.
- G. Fuel: Natural and LP gas and burner fuel oil required for boiler cleaning, normal initial boiler-burner setup and adjusting, and for performing the specified boiler tests will be furnished by the Government. Fuel required for prolonged boiler-burner setup, adjustments, or modifications due to improper design or operation of boiler, burner, or control devices shall be furnished and paid by the Contractor at Contractor's expense.

1.23 NEW TELEPHONE EQUIPMENT

The contractor shall coordinate with the work of installation of telephone equipment by others. This work shall be completed before the building is turned over to VA.

1.24 TESTS

- A. As per specification section 23 05 93 the contractor shall provide a written testing and commissioning plan complete with component level, equipment level, sub-system level and system level breakdowns. The plan will provide a schedule and a written sequence of what will be tested, how and what the expected outcome will be. This document will be submitted for approval prior to commencing work. The contractor shall document the results of the approved plan and submit for approval with the as built documentation.
- B. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.

- C. Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.
- D. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire system which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a system which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feedwater, condensate and other related components.
- E. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonable period of time during which operating and environmental conditions remain reasonably constant and are typical of the design conditions.
- F. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

1.25 INSTRUCTIONS

- A. Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals and one compact disc (four hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting,

maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

- C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR , does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

1.26 GOVERNMENT-FURNISHED PROPERTY

- A. The Government shall deliver to the Contractor, the Government-furnished property shown on the Schedule drawings .
- B. Equipment furnished by Government to be installed by Contractor will be furnished to Contractor at the Medical Center.
- C. Storage space for equipment will be provided by the Government and the Contractor shall be prepared to unload and store such equipment therein upon its receipt at the Medical Center
- D. Notify Contracting Officer in writing, 60 days in advance, of date on which Contractor will be prepared to receive equipment furnished by Government. Arrangements will then be made by the Government for delivery of equipment.
 - 1. Immediately upon delivery of equipment, Contractor shall arrange for a joint inspection thereof with a representative of the Government. At such time the Contractor shall acknowledge receipt of equipment described, make notations, and immediately furnish the Government representative with a written statement as to its condition or shortages.
 - 2. Contractor thereafter is responsible for such equipment until such time as acceptance of contract work is made by the Government.
- E. Equipment furnished by the Government will be delivered in a partially assembled (knock down) condition in accordance with existing standard commercial practices, complete with all fittings, fastenings, and appliances necessary for connections to respective services installed under contract. All fittings and appliances (i.e., couplings, ells, tees, nipples, piping, conduits, cables, and the like) necessary to make the connection between the Government furnished equipment item and the utility stub-up shall be furnished and installed by the contractor at no additional cost to the Government.
- F. Completely assemble and install the Government furnished equipment in place ready for proper operation in accordance with specifications and drawings.

- G. Furnish supervision of installation of equipment at construction site by qualified factory trained technicians regularly employed by the equipment manufacturer.

1.27 RELOCATED EQUIPMENT ITEMS

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment and items indicated by symbol "R" or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR .
- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, at the main whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".
- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.
- E. Contractor shall employ services of an installation engineer, who is an authorized representative of the manufacturer of this equipment to supervise assembly and installation of existing remote dictating machine, X-ray, dental and laundry equipment, required to be relocated.
- F. All service lines such as noted above for relocated equipment shall be in place at point of relocation ready for use before any existing equipment is disconnected. Make relocated existing equipment ready for operation or use immediately after reinstallation.

1.28 CONSTRUCTION SIGN

- A. Provide a Construction Sign where directed by the COR . All wood members shall be of framing lumber. Cover sign frame with 0.7 mm (24 gage) galvanized sheet steel nailed securely around edges and on all bearings. Provide three 100 by 100 mm (4 inch by 4 inch) posts (or equivalent round posts) set 1200 mm (four feet) into ground. Set bottom

of sign level at 900 mm (three feet) above ground and secure to posts with through bolts. Make posts full height of sign. Brace posts with 50 x 100 mm (two by four inch) material as directed.

- B. Paint all surfaces of sign and posts two coats of white gloss paint. Border and letters shall be of black gloss paint, except project title which shall be blue gloss paint.
- C. Maintain sign and remove it when directed by the COR .
- D. Detail Drawing of construction sign showing required legend and other characteristics of sign is attached hereto and made a part of this specification. shown on the drawings.

1.29 SAFETY SIGN

- A. Provide a Safety Sign where directed by COR . Face of sign shall be 19 mm (3/4 inch) thick exterior grade plywood. Provide two 100 mm by 100 mm (four by four inch) posts extending full height of sign and 900 mm (three feet) into ground. Set bottom of sign level at 1200 mm (four feet) above ground.
- B. Paint all surfaces of Safety Sign and posts with one prime coat and two coats of white gloss paint. Letters and design shall be painted with gloss paint of colors noted.
- C. Maintain sign and remove it when directed by COR .
- D. Standard Detail Drawing Number SD10000-02 (Found on VA TIL) of safety sign showing required legend and other characteristics of sign is attached hereto and is made a part of this specification. shown on the drawings.
- E. Post the number of accident free days on a daily basis.

Estimated Cost		No. of Photographs
Up to	\$250,000	50 to 100
" "	\$500,000	100 to 150
" "	\$1,000,000	150 to 200

" "	\$2,000,000	200 to 250
" "	\$5,000,000	250 to 300
" "	\$10,000,000	300 to 400
More than	\$10,000,000	400 to 500

1.30 PHOTOGRAPHIC DOCUMENTATION

A. During the construction period through completion, provide photographic documentation of construction progress and at selected milestones including electronic indexing, navigation, storage and remote access to the documentation, as per these specifications. The commercial photographer or the subcontractor used for this work shall meet the following qualifications:

1. Demonstrable minimum experience of three (3) years in operation providing documentation and advanced indexing/navigation systems including a representative portfolio of construction projects of similar type, size, duration and complexity as the Project.
2. Demonstrable ability to service projects throughout North America, which shall be demonstrated by a representative portfolio of active projects of similar type, size, duration and complexity as the Project.

B. Photographic documentation elements:

1. Each digital image shall be taken with a professional grade camera with minimum size of 6 megapixels (MP) capable of producing 200x250mm (8 x 10 inch) prints with a minimum of 2272 x 1704 pixels and 400x500mm (16 x 20 inch) prints with a minimum 2592 x 1944 pixels.
2. Indexing and navigation system shall utilize actual AUTOCAD construction drawings, making such drawings interactive on an on-line interface. For all documentation referenced herein, indexing and navigation must be organized by both time (date-stamped) and location throughout the project.

3. Documentation shall combine indexing and navigation system with inspection-grade digital photography designed to capture actual conditions throughout construction and at critical milestones. Documentation shall be accessible on-line through use of an internet connection. Documentation shall allow for secure multiple-user access, simultaneously, on-line.
4. Before construction, the building pad, adjacent streets, roadways, parkways, driveways, curbs, sidewalks, landscaping, adjacent utilities and adjacent structures surrounding the building pad and site shall be documented. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive architectural drawings. If site work or pad preparation is extensive, this documentation may be required immediately before construction and at several pre-determined intervals before building work commences.
5. Construction progress for all trades shall be tracked at pre-determined intervals, but not less than once every thirty (30) calendar days ("Progressions"). Progression documentation shall track both the exterior and interior construction of the building. Exterior Progressions shall track 360 degrees around the site and each building. Interior Progressions shall track interior improvements beginning when stud work commences and continuing until Project completion.
6. As-built condition of pre-foundation utilities and site utilities shall be documented prior to pouring footers, placing concrete and/or backfilling. This process shall include all underground and in-slab utilities within the building(s) envelope(s) and utility runs in the immediate vicinity of the building(s) envelope(s). This may also include utilities enclosed in slab-on-deck in multi-story buildings. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive site utility plans.
7. As-built conditions of mechanical, electrical, plumbing and all other systems shall be documented post-inspection and pre-

- insulation, sheet rock or dry wall installation. This process shall include all finished systems located in the walls and ceilings of all buildings at the Project. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive architectural drawings.
8. As-built conditions of exterior skin and elevations shall be documented with an increased concentration of digital photographs as directed by the COR in order to capture pre-determined focal points, such as waterproofing, window flashing, radiused steel work, architectural or Exterior Insulation and Finish Systems (EIFS) detailing. Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive elevations or elevation details.
 9. As-built finished conditions of the interior of each building including floors, ceilings and walls shall be documented at certificate of occupancy or equivalent, or just prior to occupancy, or both, as directed by the COR . Overlapping photographic techniques shall be used to ensure maximum coverage. Indexing and navigation accomplished through interactive architectural drawings.
 10. Miscellaneous events that occur during any Contractor site visit, or events captured by the Department of Veterans Affairs independently, shall be dated, labeled and inserted into a Section in the navigation structure entitled "Slideshows," allowing this information to be stored in the same "place" as the formal scope.
 11. Customizable project-specific digital photographic documentation of other details or milestones. Indexing and navigation accomplished through interactive architectural plans.
 12. Monthly (29 max) exterior progressions (360 degrees around the project) and slideshows (all elevations and building envelope). The slideshows allow for the inclusion of Department of Veterans Affairs pictures, aerial photographs, and timely images which do not fit into any regular monthly photopath.

13. Weekly (21 Max) Site Progressions - Photographic documentation capturing the project at different stages of construction. These progressions shall capture underground utilities, excavation, grading, backfill, landscaping and road construction throughout the duration of the project.
 14. Regular (8 max) interior progressions of all walls of the entire project to begin at time of substantial framed or as directed by the COR through to completion.
 15. Detailed Exact-Built of all Slabs for all project slab pours just prior to placing concrete or as directed by the COR .
 16. Detailed Interior exact built overlapping photos of the entire building to include documentation of all mechanical, electrical and plumbing systems in every wall and ceiling, to be conducted after rough-ins are complete, just prior to insulation and or drywall, or as directed by COR .
 17. Finished detailed Interior exact built overlapping photos of all walls, ceilings, and floors to be scheduled by COR prior to occupancy.
 18. In event a greater or lesser number of images than specified above are required by the COR , adjustment in contract price will be made in accordance with clause entitled "CHANGES" (FAR 52.243-4).
- C. Images shall be taken by a commercial photographer and must show distinctly, at as large a scale as possible, all parts of work embraced in the picture.
- D. Coordination of photo shoots is accomplished through COR . Contractor shall also attend construction team meetings as necessary. Contractor's operations team shall provide regular updates regarding the status of the documentation, including photo shoots concluded, the availability of new Progressions or Exact-Built viewable on-line and anticipated future shoot dates.
- E. Contractor shall provide all on-line domain/web hosting, security measures, and redundant server back-up of the documentation.

- F. Contractor shall provide technical support related to using the system or service.
- G. Upon completion of the project, final copies of the documentation (the "Permanent Record") with the indexing and navigation system embedded (and active) shall be provided in an electronic media format, typically a DVD or external hard-drive. Permanent Record shall have Building Information Modeling (BIM) interface capabilities. On-line access terminates upon delivery of the Permanent Record.

1.31 FINAL ELEVATION DIGITAL IMAGES

- A. A minimum of four (4) images of each elevation shall be taken with a minimum 6 MP camera, by a professional photographer with different settings to allow the COR to select the image to be printed. All images are provided to the RE on a CD.
- B. Photographs shall be taken upon completion, including landscaping. They shall be taken on a clear sunny day to obtain sufficient detail to show depth and to provide clear, sharp pictures. Pictures shall be 400 mm x 500 mm (16 by 20 inches), printed on regular weight paper, matte finish archival grade photographic paper and produced by a RA4 process from the digital image with a minimum 300 PPI. Identifying data shall be carried on label affixed to back of photograph without damage to photograph and shall be similar to that provided for final construction photographs.
- C. Furnish six (6) 400 mm x 500 mm (16 by 20 inch) color prints of the following buildings constructed under this project (elevations as selected by the RE from the images taken above). Photographs shall be artistically composed showing full front elevations. All images shall become property of the Government. Each of the selected six prints shall be place in a frame with a minimum of 2 inches of appropriate matting as a border. Provide a selection of a minimum of 3 different frames from which the SRE will select one style to frame all six prints. Photographs with frames shall be delivered to the COR in boxes suitable for shipping.

1.32 HISTORIC PRESERVATION

Where the Contractor or any of the Contractor's employees, prior to, or during the construction work, are advised of or discover any possible archeological, historical and/or cultural resources, the Contractor shall immediately notify the COR verbally, and then with a written follow up.

- - - E N D - - -

**SECTION 01 32 16.01
ARCHITECTURAL AND ENGINEERING CPM SCHEDULES**

PART 1- GENERAL

1.1 DESCRIPTION:

The Architect/Engineer of Record (A/E) shall develop a Critical Path Method (CPM Schedule) plan and schedule demonstrating fulfillment of the contract requirements as designated in VA PG 18-15, shall keep the CPM up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract. Conventional Critical Path Method (CPM) Precedence Diagramming Method (PDM) technique will be utilized to satisfy both time and cost applications. All schedule data and reports required under this specification section shall be based upon regular total float, not relative total float schedules.

1.2 A/E'S REPRESENTATIVE:

- A. The A/E shall designate an authorized representative in the firm who will be responsible for the preparation of the CPM Schedule, review and report progress of the project with and to the Project Manager and the Contracting Officer.
- B. The A/E's representative shall have direct project control and complete authority to act on behalf of the A/E in fulfilling the requirements of this specification section and such authority shall not be interrupted throughout the duration of the project.

1.3 A/E'S SCHEDULE PREPARATION:

- A. To prepare the CPM Schedule, and subsequent periodic updates, which reflects the A/E's project plan, the A/E shall either designate a qualified individual within their firm or engage an independent CPM consultant (CPM Developer) who is skilled in the time and cost application of scheduling using (PDM) network techniques for Design projects, the cost of which is included in the A/E's bid.
- B. Within 10 calendar days after award of the contract, the A/E shall submit to the Contracting Officer:
 - 1. The name of the CPM Developer.
 - 2. The Computer Software to be utilized.

3. Sufficient information to show that the CPM Developer has the qualifications to meet the requirements specified in the preceding paragraph.
- C. The Contracting Officer has the right to approve or disapprove the designated CPM developer, and will notify the A/E of the VA decision within seven calendar days from receipt of information. In case of disapproval, the A/E shall resubmit another CPM Developer within 10 calendar days for renewed consideration. The A/E must have their CPM Developer approved prior to submitting the Initial CPM Schedule

1.4 COMPUTER PRODUCED SCHEDULES

- A. The A/E shall provide to the VA Project Manager, Contracting Officer and CPM Schedule Analyst, monthly computer processing of all computer-produced time/cost schedules and reports generated from monthly project updates. A hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data. These reports shall be submitted with and substantively support the A/E's monthly payment request. The Project Manager shall identify the different report formats that the A/E shall provide based upon the monthly schedule updates.
- B. The A/E is responsible for the correctness and timeliness of the computer-produced reports. The A/E is also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.
- C. The VA shall report errors in computer-produced reports to the A/E's representative within ten calendar days from receipt of reports. The A/E will reprocess the computer-produced reports and associated compact disk(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

1.5 THE COMPLETE CPM SCHEDULE SUBMITTAL

- A. Within 45 calendar days after receipt of Notice to Proceed, the A/E shall submit for the Project Manager and Contracting Officer's review; three blue line copies of the complete CPM Schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file, (PDM) format. The submittal shall also include three copies of a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost. Each activity/event on the

computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, duration, predecessor and successor relationships, area code, description, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start and start-to-start without lead or lag constraints.

Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The A/E shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the CPM Schedule. The Contracting Officer's separate approval of the CPM Schedule shall not excuse the A/E of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working CPM Schedule shall reflect the A/E's approach to scheduling the complete project. **The final CPM Schedule in its original form shall contain no contract modifications or changes which may have been incurred during the final CPM Schedule development period and shall reflect the entire contract duration as defined in the bid documents.** These changes/delays shall be entered at the first update after the final CPM Schedule has been approved. The A/E should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.

- B. Within 30 calendar days after receipt of the complete project CPM Schedule, the Project Manager of Contracting Officer will do one or both of the following:
1. Notify the A/E concerning his actions, opinions, and objections.
 2. A meeting with the A/E at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the A/E shall revise and shall submit three blue line copies of the revised CPM Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be

reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.

- C. The approved baseline CPM Schedule and the corresponding computer-produced schedule(s) shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.

1.6 WORK ACTIVITY/EVENT COST DATA

The A/E shall cost load all work activities. The cost loading shall reflect the appropriate level of effort of the work activities/events. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The A/E shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. In the event of disapproval, the A/E shall revise and resubmit in accordance with Article, THE COMPLETE PROJECT CPM SCHEDULE SUBMITTAL. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.

1.7 CPM SCHEDULE REQUIREMENTS

- A. Show on the CPM Schedule the sequence and interdependence of work activities/events required for complete performance of all items of work. In preparing the CPM Schedule, the A/E shall:
1. Exercise sufficient care to produce a clear, legible and accurate CPM Schedule.
 2. Show the following on each work activity/event:
 - a. Activity/Event ID number.
 - b. Concise description of the work represented by the activity/event. (35 characters or less including spaces preferred).
 - c. Performance responsibility.
 - d. Duration (in work days.)
 - e. Cost (in accordance with Article, ACTIVITY/EVENT COST DATA of this section and less than \$99,999 per activity).
 - f. Manpower required (average number of men per day).

3. Show activities/events as:
 - a. A/E's time required for submittal of drawings.
 - b. VA review and approval of drawings, equipment schedules, samples, template, or similar items.
 - c. Interruption of VA Medical Center utilities, delivery of Government furnished equipment, project phasing and any other specification requirements.
 4. Show activities/events for work for each discipline.
 5. Break up the work into activities/events of duration no longer than 20 work days each, except for which the Project Manager and/or the Contracting Officer may approve the showing of a longer duration.
 6. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
 7. Uniquely number each activity/event with numbers ranging from 1 to 99998 only. The CPM Schedule should be generally numbered in such a way to reflect disciplines, phase or location of the work.
- B. Submit the following supporting data in addition to the CPM Schedule, activity/event ID schedule and electronic file (s). Failure of the A/E to include this data will delay the review of the submittal until the Contracting Officer is in receipt of the missing data:
1. The proposed number of working days per week.
 2. The holidays to be observed during the life of the contract (by day, month, and year).
- C. To the extent that the CPM Schedule or any revised CPM Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the Contracting Officer. Failure to include any element of work required for the performance of this contract shall not excuse the A/E from completing all work required within any applicable completion date of each phase regardless of the Contracting Officer's approval of the CPM Schedule.
- D. Compact Disk Requirements and CPM Activity/Event Record Specifications: Submit to the VA (Project Manager and CPM Schedule Analyst) an electronic file(s) containing one file of the data required.

1.8 PAYMENT TO THE A/E:

- A. Monthly, the A/E shall submit the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data. The A/E is entitled to a monthly progress payment upon approval of estimates as determined from the currently approved updated computer-produced calendar-dated schedule unless, in special situations, the Contracting Officer permits an exception to this requirement.
- B. When the A/E fails or refuses to furnish to the Contracting Officer the information, which, in the sole judgment of the Contracting Officer, is necessary for processing the monthly progress payment, the A/E shall not be deemed to have provided an estimate and supporting schedule data upon which progress payment may be made.

1.9 PAYMENT AND PROGRESS REPORTING

- A. Monthly progress meetings shall be held on dates mutually agreed to by the Project Manager and/or Contracting Officer and the A/E. The A/E shall update the project schedule and all other data required by this section shall be accurately filled in and completed prior to the monthly progress meeting. The A/E shall provide this information to VA three work days in advance of the progress meeting. Job progress will be reviewed to verify:
 - 1. Actual start and/or finish dates for updated/completed activities/events.
 - 2. Remaining duration, required to complete each activity/event started, or scheduled to start, but not completed.
 - 3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the CPM Schedule and computer-produced schedules. Changes in activity/event sequence and duration which have been made pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
 - 4. Percentage for completed and partially completed activities/events.
 - 5. Logic and duration revisions required by this section of the specifications.
 - 6. Activity/event duration and percent complete shall be updated independently.
- B. The A/E shall submit a narrative report as a part of his monthly review and update, in a form agreed upon by the A/E and the Contracting

Officer. The narrative report shall include a description of problem areas; current and anticipated delaying factors and their estimated impact on performance of other activities/events and completion dates; and an explanation of corrective action taken or proposed.

- C. After completion of the joint review and the Contracting Officer's approval of all entries, the A/E shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.
- D. After completing the monthly schedule update, the A/E's scheduling person shall rerun all current period contract change(s) against the prior approved monthly project schedule. The analysis shall only include original workday durations and schedule logic agreed upon by the A/E and Project Manager for the contract change(s). When there is a disagreement on logic and/or durations, the CPM Schedule update shall use the schedule logic and/or durations provided and approved by the Project Manager. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the COR within fourteen (14) calendar days of completing the regular schedule update. **Before inserting the contract changes durations, care must be taken to ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final CPM Schedule is approved, the A/E must recreate all manual progress payment updates on this approved CPM Schedule and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.**
- E. After VA acceptance and approval of the final CPM Schedule, and after each monthly update, the A/E shall submit to the Contracting Officer three blue line copies of a revised complete CPM Schedule showing all completed and partially completed activities/events, contract changes and logic changes made on the intervening updates or at the first update on the final diagram. The Contracting Officer may elect to have

the A/E do this on a less frequent basis, but it shall be done on a quarterly basis as a minimum.

1.10 RESPONSIBILITY FOR COMPLETION

- A. Whenever it becomes apparent from the current monthly progress review meeting or the monthly schedule that phasing or contract completion dates will not be met, the A/E shall execute some or all of the following remedial actions:
1. Increase manpower in such quantities and discipline as necessary to eliminate the backlog of work.
 2. Increase the number of working hours to eliminate the backlog of work.
 3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the A/E shall notify and obtain approval from the Project Manager and/or the Contracting Officer for the proposed schedule changes. If such actions are approved, the CPM revisions shall be incorporated by the A/E into the CPM Schedule before the next update, at no additional cost to the Government.

1.11 CHANGES TO CPM SCHEDULE AND SCHEDULE

- A. Within 30 calendar days after VA acceptance and approval of any updated computer-produced schedule, the A/E will submit a revised CPM Schedule
- B. Contracting Officer's approval for the revised CPM Schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- D. The cost of revisions to the CPM Schedule resulting from contract changes will be included in the proposal for changes in work as specified in Article, FAR 52.243 -4 (CHANGES), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- E. The cost of revisions to the CPM Schedule not resulting from contract changes is the responsibility of the A/E .

1.12 ADJUSTMENT OF CONTRACT COMPLETION

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the A/E shall be supported with a justification, CPM data and

supporting evidence as the Contracting Officer may deem necessary for determination as to whether or not the A/E is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the A/E has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.

- B. Actual delays in activities/events which, according to the computer-produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the A/E in writing of the Contracting Officer's decision.
- C. The A/E shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under Article, FAR 52.243 -4 (CHANGES). The A/E shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved CPM Schedule.
- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

1.13 PROJECT DESIGN SCHEDULE RISK ANALYSIS/MITIGATION PLAN

- A. Schedule Risk Analysis - The A/E shall conduct the statistical schedule risk analysis based on the above detailed construction activities in the Day 1 approved diagram, identifying major schedule risk areas and recommended risk mitigation plans as outlined below.
- B. The risk analysis shall be conducted by a person or firm skilled in the statistical method of schedule risk analysis based on the (PDM) CPM Schedule techniques for major projects, preferably in the major health

care related projects. The cost of this service shall be included in the A/E's proposal.

- C. The Contracting Officer has the right to approve or disapprove the Person or firm designated to perform the risk analysis.

1.14 RISK ANALYSIS FORMAT / REQUIREMENTS / SUBMITALS

- A. Risk Analysis Software / Format - Within 45 calendar days after receipt of Notice to Proceed, the A/E shall submit for the Contracting Officer's review; a Risk Analysis software to be utilized, the method of performing the analysis, the format of presenting the data and the reports for VA approval.
- B. Conduct Risk Analysis / **Submittals - Based on the approved software / format, the consultant shall** perform statistical risk analysis on the detailed approved Day 1 diagram. The A/E shall review and utilize any previous Risk analysis based on the "semi-detailed" schedule logic and schedule to ensure the continuity of previous schedule risk analysis. The A/E's project manager shall identify the major schedule risk areas and possible risk mitigation strategy/plan and record it in a narrative format, with **electronic file submission** to VA. **The risk analysis exercise shall be performed or updated at least on a quarterly basis or as directed by the VA Contracting officer.**
- C. The submittal shall include three copies of a computer-produced risk analysis results, predicting the various meaningful probability curves of achieving the contract schedules. It shall also include a detailed narrative list of all major and minor potential and specific schedule and cost risk areas, and a A/E 's recommendations of mitigating the identified risks which must be addressed by the VA Project and COR teams to maintain the contract schedule.

- - - E N D - - -

SECTION 01 32 16.13

NETWORK ANALYSIS SCHEDULES - MAJOR CONSTRUCTION PROJECT

DESIGN-BID-BUILD

PART 1 - GENERAL:

1.1 DESCRIPTION:

- A. The Contractor shall develop a fully Resource loaded (cost and manpower) Network Analysis System (NAS) plan and computer generated schedule demonstrating fulfillment of the entire contract requirements, shall keep the plan and computer generated schedule up-to-date in accordance with the specification requirements of this section and shall utilize the plan for scheduling, coordinating, mitigating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers) and verification of every Periodic Progress updates and Payment Submittals of the work under this contract. The Contractor's initial NAS Diagram submission will be the basis for their initial project schedule and will be designated as a Day 1 submission. After review and approval by VA, this schedule will be designated as the approved Baseline Schedule.
- B. Conventional Critical Path Method (CPM) Precedence Diagramming Method (PDM) technique shall be utilized to satisfy both time and cost applications. All schedule data and reports required under this specification section shall be based upon total float, not relative or free float schedules. The approved baseline NAS diagram and the schedule becomes the official project schedule of record governing schedule management, oversight and actions on the corresponding contract.

1.2 CONTRACTOR'S REPRESENTATIVE:

- A. The contractor shall designate a representative on the site (Usually the Project Executive or Manager) who will be responsible for the preparation, timeliness, quality and the accuracy of the network diagram, review and report progress of the project with and to the Contracting Officer's representative.

- B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section and such authority shall not be interrupted throughout the duration of the project.

1.3 CONTRACTOR'S CONSULTANT:

- A. To fulfill all the requirements of this specification section, the Contractor shall engage an **independent CPM consultant** who is skilled in the time and cost application of scheduling using (PDM) network techniques for similar sized construction projects. The cost of which is included in the Contractor's bid proposal price. This consultant shall not have any financial ties, business ties, affiliation with or a subsidiary company of the Contractor. The consultant is expected to provide unbiased professional services to the contractor and to VA's representatives in developing and maintaining the project schedule.
- B. Prior to engaging a consultant, and within 10 calendar days after award of the contract, the Contractor shall submit to the Contracting Officer:
1. The name and address of the proposed consultant and Company.
 2. Sufficient information to show that the proposed consultant has the qualifications to meet the requirements specified in this specification section.
 3. A list of at least three similar prior construction projects, along with selected PDM network diagram samples on current projects which the proposed consultant has performed complete project scheduling services. These network diagram and schedule samples must show complete project planning for a project of similar size and scope as covered under this contract.
- C. The Contracting Officer has the right to approve or disapprove employment of the proposed consultant and will notify the Contractor of the VA decision within seven calendar days from receipt of information. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The contractor must have their CPM Consultant approved prior to Notice to Proceed (NTP).

1.4 PRIOR TO BASELINE SCHEDULE ACCEPTANCE:

- A. At the time of the Pre-Construction Conference, prior to the issuance of the project Notice to Proceed, the Contractor and the Contractor's Scheduling Consultant shall arrange a separate meeting with the Contracting Officer and/or his representative to discuss the requirements of this specification in detail. The Contractor and the Contractor's CPM Consultant shall acknowledge, in writing, their understanding and compliance with the requirements of this specification.
- B. With exception of bonds, insurance, and limited mobilization cost associated with preparatory work such as site trailers, staging areas, haul roads etc., the approval of the baseline NAS schedule is a condition precedent to:
 - 1. Processing of contractor's pay request(s) for any construction activities/items of work.
 - 2. Review of any schedule updates.
- C. Government review comments on the contractor's schedule shall not relieve the contractor from compliance with requirements of this specification section and the remaining contract documents.

PART 2 - SCHEDULE CRITERIA / DATA REQUIREMENTS:

2.1 COMPUTER PRODUCED SCHEDULE DEVELOPMENT CRITERIA:

- A. The computer produced schedule shall be prepared and maintained using Primavera P6 software.
- B. Work activity/event relationships shall be restricted to Finish-to-Start (FS) and Start-to-Start (SS) only without lead or lag constraints. Note: Some exception may be allowed for lag in SS relationship but must be approved by the VA's contracting officer on case by case basis prior to inclusion in the schedule.
- C. Subsequent schedule updates work activity/event relationships shall reflect planned sequence of work, with actual status of completed or for in-progress work.
- D. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating

them into the network diagram. The Contracting Officer's separate approval of the network diagram shall not excuse the contractor of this requirement.

- E. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events but must have zero duration. The complete computer schedule shall reflect the Contractor's approach to pursuing the entire project.
- F. Intermediate Phasing milestones contained in the contract documents shall be clearly shown in the schedule.
- G. The Contractor's initial Day 1 submission, prior to VA review and approval, in its original form shall reflect the original contract scope of work.
- H. Early Project Completion or "Short Schedule" - VA will not approve any baseline schedule which shows completion date prior to the contract completion date. Also, there should not be any "filler or "contingency" type of activities to fill the entire contract duration. VA has no obligation to accelerate activities to support a proposed early contract completion. However, if the subsequent updates show that early handover is feasible due to "ahead of schedule" situation, VA may accept the facility earlier at no additional cost to the government.
- I. The Baseline Schedule Critical Path of the project shall be limited to:
 - 1. No more than 20% of the work activities shall be on the critical and near-critical path(s). Critical path is defined as activities with zero (0) day total float. Near-Critical path(s) is defined as activities with one (1) to twenty (20) days of total float.
 - 2. Multiple Critical paths will not be allowed.
- J. The Contractor shall show activities/events for:
 - 1. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
 - 2. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules samples, template, or similar items with time duration of **no less than 20 workdays**.
 - 3. Shutdowns or Interruption of VA Medical Center utilities, delivery of Government furnished equipment (GFE), and rough-in drawings, project phasing and any other specification requirements.

4. VC/VV Equipment - All significant VC (VA furnished and Contractor installed) and VV (VA furnished and VA installed) equipment shall be clearly shown in the schedule. Any smaller VC and VV Equipment shall also be logically grouped together and shown in the schedule.
5. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
6. Commissioning (Cx)Activities - Based upon the project specific Commissioning plan and project specification section 01 91 00, the contractor shall include in the Day 1 NAS Diagram all the systems commissioning activities (see systems covered in Division 7, 8, 21, 22, 23, 26, 28, 31 and others as specified) such as startup, Pre-functional check list, Pre-test, individual component and system level Functional test, Operator's training, O.& M. Manuals etc.(including any deficiency correction and re-testing). The majority of commissioning activities should be completed as part of the normal construction schedule and finalized prior to the construction contract completion date. To this end, it is imperative that the Commissioning Agent and the Contractor collaborate to integrate commissioning activities into the Contractor's overall construction schedule. All commissioning activities shall be cost loaded as required in the later paragraphs. e Commissioning Plan will identify critical commissioning activities and associated construction/start up tasks that must precede these activities to allow for successful execution of the commissioning activities. To coordinate these activities with the construction schedule, a Commissioning Duration Schedule should be provided by the Commissioning Agent to the VA SRE and the Contractor to provide a rational basis for integration of commissioning into the Day 1 NAS diagram and the construction schedule. The Commissioning Duration Schedule should include the following information:
 - a. Description of Commissioning Activity
 - b. Prerequisite Construction Tasks Required to Execute the Cx Activity
 - c. Elapsed Time Duration of Each Activity
 - d. Documentation Associated with Each Task/Document Responsibility

7. Once the duration schedule is delivered to the Contractor, the Contractor will collaborate with the Commissioning Agent to integrate all commissioning activities into the fixed duration construction schedule in accordance with VA NAS requirements for scheduling the project. The Baseline Schedule, as approved by the VA at the beginning, may not have all necessary Cx details, but the contractor is required to subsequently update the commissioning activities as more detailed **Commissioning Duration Schedule** is being developed.
- K. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase. Schedule these activities/events so that only one phase is scheduled for completion within the same 30 consecutive calendar day period (except for those phases immediately preceding the final acceptance). Maintain this scheduling condition throughout the length of the contract unless waived by the Contracting Officer's representative in writing.
1. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
 2. Break up the work into activities/events shall have:
 - a. Duration no longer than 20 work days each, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the Contracting Officer may approve the showing of a longer duration.
 - b. Submittal / Shop Drawings- The duration for VA approval of any required submittal, shop drawing, or other submittals shall not be less than 20 work days. Some long lead items and complex system shop drawings and submittal approval process will require longer than 20 workdays and should be clearly portrayed in the baseline schedule. Refer to drawing CPM-1 for some typical VA approval activities/events which will require minimum duration longer than 20 workdays. The construction time as determined by

- the CPM schedule from early start to late finish for any sub-phase, phase or the entire project shall not exceed the contract time(s) specified or shown.
- c. An activity/event shall only reflect the work of one entity (subcontract or craft).
 - d. The activity/event once began can continue unimpeded until the activity/event is complete.
3. Describe work activities/events clearly, so the work is readily identifiable with clear scope for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable (Refer to item 2.1 B above for some exceptions).
4. Uniquely number each activity/event ID with ALPHA-NUMERIC value in ascending order. The network diagram should be generally numbered in such a way to reflect trade discipline, phase or location of the work.

2.2 WORK ACTIVITY/EVENT COST AND TRADE RESOURCE DATA:

- A. Cost Loading - The Contractor shall cost load all work activities/events except procurement activities. The cost loading shall reflect the appropriate level of effort of the work activities/events. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. In the event of disapproval, the Contractor shall revise and resubmit in accordance with Article, THE INITIAL DAY ONE SCHEDULE SUBMITTAL (Item 3.1B below). Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance

with the provisions in the FAR 52.232 - 5 (PAYMENTS UNDER FIXED-PRICE CONSTRUCTION), Article, and VAAR 852.232 - Article 70 Without NAS-CPM Article 71 Including NAS-CPM for (PAYMENTS UNDER FIXED-PRICE CONSTRUCTION).

- C. The Contractor shall cost load work activities/events for ASBESTOS ABATEMENT. The sum of asbestos abatement work activity/event costs shall equal the value of the asbestos bid item in the Contractors' bid.
- D. The Contractor shall cost load work activities/events for all BID ITEMS. The sum of the cost loading for each bid item work activities/events shall equal the value of the item in the Contractors' bid.
- E. Work activities/events for Contractor bond shall have a trade code and area code of BOND.
- F. General contractor work requirement code - The scope of work activities that will be performed solely by the general contractor must be identified clearly and a unique code assigned to each activity so that it can be sorted and summarized in a report. The purpose is to ascertain that the general contractor is meeting his contractual share of work content (as outlined in the signed contract documents). Care must be taken to estimate individual activity costs realistically, so these are not unreasonably inflated or deflated in the schedule.
- G. Manpower loading - In accordance with Article PERFORMANCE OF WORK BY THE CONTRACTOR in FAR 52.236 - 1 and VAAR 852.236 - 72, the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work. This shall be the basis for the "Resource loading" of the schedule and the contractor shall provide "Manpower loading" reports by trades and the overall Trade manpower requirements, when requested by the contracting officer or his/her representatives.


2.3 NETWORK DIAGRAM (NAS) DATA REQUIREMENTS:

- A. The Day 1 NAS diagram is the logical plan and forms the basis for contractor's baseline schedule. Participation and input of key construction personnel from the General contractor and the major subcontractors is a mandatory requirement in the baseline schedule

development. The Day 1 NAS diagram in its original form shall reflect the original contract scope of work and contain no contract changes or delays which may have been incurred during the final NAS diagram and baseline schedule development period and shall reflect the entire contract duration as defined in the bid documents. Show on the NAS diagram the sequence and interdependence of work activities/events required for complete performance of all items of work. In preparing the NAS diagram, the Contractor shall:

1. Exercise sufficient care to produce a clear, legible and accurate network diagram, in pure logical PDM format, refer to the construction document (CD) drawing, CPM-1 (Sample CPM Network). Computer plotted network diagrams shall legibly display and plot all information required by the VA CPM activity/event legend, otherwise the computer plotted network diagram will not be accepted. If the computer plotted network diagram is not found acceptable by the contracting officer's representative, then the network diagram will need to be created through other means to meet legibility requirements. Provide a key plan on each network diagram sheet showing the project area associated with the work activities/events shown on that sheet. VA will accept electronic version of this legible NAS diagram instead of hard copy, if the contractor so chooses.
2. Show the following on each work activity/event:
 - a. Activity/Event ID number, driven by WBS coding structure.
 - b. Concise description of the work represented by the location and activity/event.
 - c. Activity coding - Provide activity coding (five alpha characters or less) for Trades (GEN, MECH, ELEC, CARP, PLAST, or other acceptable abbreviations), Area, Phasing etc. Provide a dictionary of all coding in the front page of the NAS Diagram.
 - d. Duration (in work days.)
 - e. Cost (in accordance with Article, ACTIVITY/EVENT COST DATA of this section and less than \$9,999,999 per activity).
 - f. Manpower required (average number of workers per day). Load manpower for each and every activity with proper trade codes in the "resource" field of P6 for ease of generating individual

- Trade and overall manpower profile required to plan and complete the project.
- g. No open-ended activities will be accepted, except for Notice to Proceed and the Final Completion activities.
 - h. The SYMBOL LEGEND format shown below and, on the drawing, CPM-1 (Sample CPM Network) is mandatory and shall be followed in preparing final network diagrams.

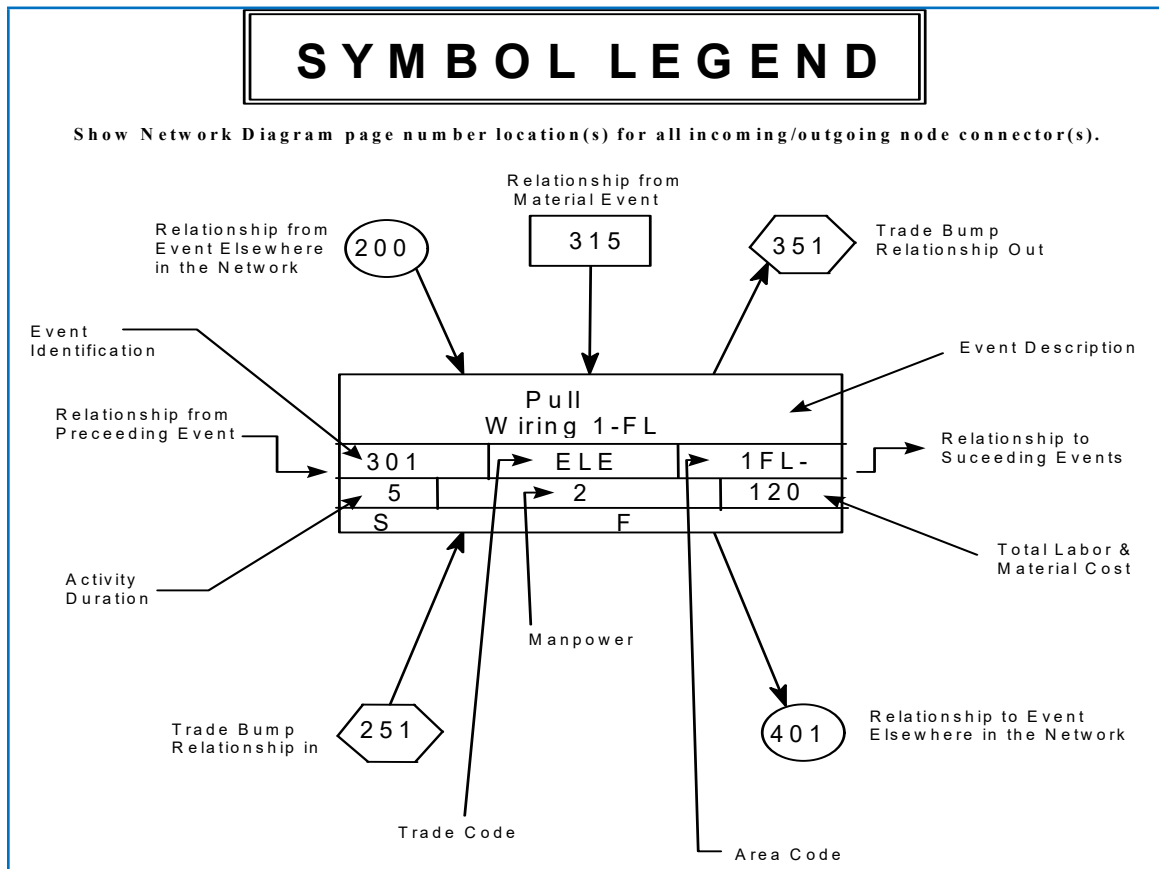

- B. To the extent that the network diagram or any revised network diagram shows anything not jointly agreed upon, it shall not be deemed to have been approved by the Contracting Officer. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the Contracting Officer's approval of the network diagram.

- C. Compact Disk Requirements and CPM Activity/Event Record Specifications:
Submit to the VA (COR and CPM Schedule Analyst) an electronic file(s) containing one file of the data required to produce a Primavera (P6), (PDM) produced schedule, reflecting all the activities/events of the complete project network diagram being submitted.

2.4 CONSTRUCTION SCHEDULE RISK ANALYSIS / MITIGATION PLAN:

- A. Schedule Risk Analysis - The contractor shall conduct the statistical schedule risk analysis based on the above detailed construction activities in the Day 1 approved diagram, identifying major schedule risk areas and recommended risk mitigation plans as outlined below.
- B. The risk analysis shall be conducted by a person or firm skilled in the statistical method of schedule risk analysis based on the (PDM) network techniques for major construction projects, preferably in the major health care related projects. The cost of this service shall be included in the Contractor's proposal.
- C. The Contracting Officer has the right to approve or disapprove the Person or firm designated to perform the risk analysis.

2.5 RISK ANALYSIS FORMAT / DATA REQUIREMENTS:

- A. Conduct Risk Analysis - Based on the approved software / format, the consultant shall perform statistical risk analysis on the detailed approved Day 1 diagram and the baseline schedule. The contractor shall review and utilize any previous Risk analysis performed by the A/E of record based on the "semi-detailed" (yet at an overall level) construction logic and schedule to ensure the continuity of previous schedule risk analysis. The contractor's project manager and Superintendent shall identify the major schedule risk areas and possible risk mitigation strategy/plan and record it in a narrative format, with electronic file submission to the VA as directed by the VA Contracting officer.
- B. The submittal shall include three copies of a computer-produced risk analysis results, predicting the various meaningful probability curves of achieving the contract schedules. It shall also include a detailed narrative list of all major and minor potential and specific schedule and cost risk areas and impact of them on the overall project, and a contractor's recommendations of mitigating the identified risks which

must be addressed by the VA Project and COR teams to maintain the contract schedule.

- C. The contractor shall, as a part of Risk monitoring, prepare a detailed **Project Risk Register (PRR)**, identifying each risk items, risk assessment and its response plan. This PRR, at the discretion of VA SRE and CO, shall be discussed in a monthly risk management meeting for mitigation.

PART 3 - SUBMITTALS, DELIVERABLES, AND UPDATE PROCESS:

3.1 SUBMITTALS:

- A. The independent cpm consultant Submittal: Within 10 calendar days after award of the contract, the Contractor shall submit to the Contracting Officer for review and approval the qualifications of their proposed independent CPM consultant. The submittal information shall be in accordance with PART 1 GENERAL, ARTICLE 1.3 CONTRACTOR'S CONSULTANT of this Specification.
- B. THE INITIAL Day 1 SCHEDULE SUBMITTAL: Within 30 calendar days (45 calendar days on projects over \$50,000,000) after receipt of Notice to Proceed, the Contractor shall submit the initial Day 1 schedule submittal package for the Contracting Officer's review and approval. This Day 1 schedule submittal shall consist of:
1. Two hard copies of the complete Day One network (NAS) diagram on sheets of paper 765 x 1070 mm (30 x 42 inches) activities sorted by physical work area. Submit also an electronic version of the NAS diagram.
 2. Computerized Schedule;
 - a. An electronic file in a compressed Primavera (P6) computerized schedule, (PDM) format.
 - b. Three hard copies of a computer-produced activity/event ID schedule showing all requirements project duration; phase completion dates; and other data, including event manpower and cost. Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, description, duration, predecessor and successor relationships, trade code, area code, budget amount, manpower, early start date, early finish date, late start date, late finish date and total

float. The Contracting Officer's separate approval of the network diagram shall not excuse the contractor of this requirement.

3. Supporting Data include the following data:
 - a. The proposed number of working days per week.
 - b. The holidays to be observed during the life of the contract (by day, month, and year).
 - c. The planned number of shifts per day.
 - d. The number of hours per shift. List the major construction equipment to be used on the site, describing how each piece relates to and will be used in support of the submitted network diagram work activities/events.
 - e. Provide a typed, doubled spaced description, at least one page in length, of the sequencing plan and contractor's approach to constructing the project.
 - f. Failure of the Contractor to include this data will delay the review of the submittal until the Contracting Officer is in receipt of the missing data.

C. VA RESPONSE TO INITIAL SCHEDULE SUBMITTAL - BASELINE SCHEDULE: Within 30 calendar days after receipt of the complete INITIAL Day 1 SCHEDULE SUBMITTAL Package (3.1.B), the Contracting Officer or his representative will do one or both of the following:

1. Notify the Contractor concerning the acceptability of the Day 1 Schedule Submittal Package and any additional actions, opinions, and objections to the package.
2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint review, the Contractor shall revise and shall submit three hard copies of the revised network diagram, three copies of the revised computer-produced activity/event ID schedule and a revised electronic P6 file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.
3. The contractor submitted NAS diagram, the corresponding computer-produced schedule(s) and the submitted supporting data, when approved, shall constitute the official Baseline Schedule until

subsequently revised in accordance with the requirements of this section.

D. COMPUTER PRODUCED SCHEDULES submittals:

1. Within 7 calendar days of periodic (monthly) update meeting, the contractor shall submit to the COR and CPM Schedule Analyst (simultaneously), computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: electronic file copies of up to five different reports (inclusive of all pages), available within the user defined reports of Primavera (P6), to the contracting officer's representatives; a hard copy listing of all project schedule changes, and associated data, made at the update; an electronic file of this data in Primavera (P6) format; and the resulting monthly updated schedule reports in a compressed electronic file in Primavera (P6), (PDM) format. These schedule reports must be submitted along with the modified Look ahead report (with % complete progress) made at the periodic (Monthly) update meeting signed by the contractor and VA); and substantively support the contractor's monthly payment request. The SRE shall identify the five different report formats that the contractor shall provide based upon the monthly schedule updates.
2. The contractor is responsible for the correctness and timeliness of the computer-produced reports. The Contractor is also responsible for the accurate and timely submittal (within 7 calendar days as noted above) of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.

- E. VA RESPONSES TO COMPUTER PRODUCED SCHEDULE submittals: The VA may report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports, indicating approval or disapproval. In case of disapproval, the Contractor will reprocess the computer-produced reports and associated compact disk(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project. In certain large and complex project, as determined by the Contracting Officer, this periodic (monthly) reporting shall be formal submittal and approval process. The next periodic (month) update

shall not proceed without timely submittal and approval of the previous periodic update.

- F. FIRST UPDATE SCHEDULE SUBMITTAL: Within 30 calendar days of VA acceptance of the project baseline schedule, the Contractor shall submit the first update of the schedule. This update shall contain any progress of the work the contractor wishes to receive payment for from contract notice to proceed. Any changes/delays shall be entered at the first update after the final network diagram has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time because of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION. These changes/delays shall be analyzed (entered) at the first update after the final network diagram and baseline schedule have been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time because of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.
- G. Periodic Progress and payment Submittals: The Contractor is entitled to a periodic (not less than monthly) progress payment upon approval of the resource loaded project schedule.
1. The contractor shall submit the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article 3.2, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article FAR 52.232 - 5 (PAYMENTS UNDER FIXED-PRICE CONSTRUCTION), and VAAR 852.232 - Article 70 Without NAS-CPM Article 71 Including NAS-CPMfor (PAYMENTS UNDER FIXED PRICE CONSTRUCTION).
 2. If the Contractor fails or refuses to furnish to the Contracting Officer the information and the associated updated Primavera (P6), (PDM) schedule in electronic format, which, in the sole judgment of the Contracting Officer, is necessary for processing the monthly progress payment, the Contractor shall not be deemed to have provided an estimate and supporting schedule data upon which progress payment may be made.

H. RISK ANALYSIS PROCEDURE SUBMITTAL: Within 45 calendar days (60 calendar days on projects over \$50,000,000) after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review and approval:

1. The qualifications of a consultant or representative who will be conducting the Risk Analysis.
2. The software to be utilized.
3. The methodology of performing the analysis.
4. The format of presenting the data.
5. A sample of the reports to be given to VA.

I. RISK ANALYSIS REPORT SUBMITTAL: Quarterly a risk analysis exercise shall be performed and/or updated and submitted to the VA Contracting Officer. The VA Contracting Officer can request additional risk analysis.

1. The submittal shall include three copies of a computer-produced risk analysis results, predicting the various meaningful probability curves of achieving the contract schedules. It shall also include a detailed narrative list of all major and minor potential and specific schedule and cost risk areas and impact of them on the overall project, and a contractor's recommendations of mitigating the identified risks which must be addressed by the VA Project and COR teams to maintain the contract schedule.
2. The Contractor shall, as a part of Risk Analysis Submittal, prepare a detailed **Project Risk Register (PRR)**, identifying each risk items, risk assessment and its response plan. This PRR, at the discretion of the SRE and the CO, shall be discussed in a monthly risk management meeting for mitigation.

3.2 PAYMENT AND PROGRESS REPORTING - SCHEDULE UPDATES:

A. **Schedule update meeting** - Monthly job site schedule update meeting shall be held on dates mutually agreed to by the Contracting Officer (or Contracting Officer's representative) and the Contractor. Contractor and his CPM consultant will be required to attend all monthly update meetings. Presence of Subcontractors during update meeting is optional unless required by the Contracting Officer (or Contracting Officer's representative). The Contractor shall update the project schedule and all other data required by this section shall be

accurately filled in and completed draft (Pencil copy) prior to the monthly update meeting. The Contractor shall provide this information to the Contracting Officer or the VA representative in completed form **three work days** in advance of the update meeting. The contractor shall use only **approved previous month's schedule** to report progress (% complete) in "pencil copy" and shall not change this in any shape or form. Logic or duration changes for future incomplete activities should be entered later and shown in the resulting reports. Job progress will be reviewed to verify:

1. Actual start and/or finish dates for updated/completed activities/events.
2. Remaining duration, required to complete each activity/event started, or scheduled to start, but not completed.
3. Logic, time and cost data for change orders (CO), and supplemental agreements (SA) that are to be incorporated into the network diagram and computer-produced schedule. Submit "Fragnets" for each CO and SA for VA approval prior to monthly parallel run. Changes in activity/event sequence and duration should be made pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
4. Percentage for completed and partially completed activities/events.
5. Logic and duration revisions required by this section of the specifications, particularly if the Day 1 logic / sequence have changed significantly, which could potentially alter or impact the critical path of the schedule. Highlight and request VA approval prior to making any logic, durations, manpower and cost loading changes.
6. Activity/event duration and percent complete shall be updated independently, meaning that the Remaining Durations (RD) shall be reviewed for all "in-progress" activities and entered manually based on realistic remaining work content, and shall not be left to "auto-calculate" by the software.
7. Out of sequence progress - Activities that have progressed before all preceding logic has been satisfied (Out-of-Sequence progress) are not allowed except on a rare case by case basis, subject to approval by the contracting officer. Propose logic corrections to eliminate out of sequence progress or justify not changing the sequencing for approval prior to submitting updated monthly

- schedule. Correct out of sequence progress that continues for more than two update cycles by logic revision, as approved by the contracting officer. Also, submit complete revised schedule when more than 5% of the remaining activities are out of sequence. Calculate multiple float paths option is not allowed.
8. Logic changes - Specifically identify and discuss all logic changes pertaining to change orders (see section item 3.2.E below), contractor proposed changes in work plan or sequence, correction to schedule logic for out-of-sequence progress etc. that have been made pursuant to contract provisions. VA will only approve logic revisions to keep the schedule valid in terms of its usefulness in calculating a realistic completion date, correcting erroneous logic ties, and accurately sequencing the work.

B. Schedule Narrative - The Contractor, in addition to the 5 schedule reports noted earlier, shall submit a narrative report as a part of his monthly update reporting prepared after the update meeting, in a form agreed upon by the Contractor and the Contracting Officer. The narrative report shall be **prepared by the contractor's authorized representatives (Project manager, Superintendent or other responsible official, and not by the CPM consultant)**; shall include, at a minimum, a description of major construction problem areas; current and anticipated delaying factors and their estimated impact on performance of other activities/events and completion dates; and an explanation of corrective action being taken or proposed. This narrative shall also include:

- 1) Any forward Logic Revisions; 2) any added or deleted activities; 3) Any cost loading or budget changes; 4) any missed major milestones.

This monthly schedule narrative should also briefly discuss the potential schedule risks / mitigation effort, as required by the item 3.1.G above. This report is in addition to the daily reports pursuant to the provisions of Article, DAILY REPORT OF WORKERS AND MATERIALS in the GENERAL CONDITIONS.

C. Cash Flow S-curve or Schedule Variance Control (SVC) Diagram - With each schedule submission, provide an SVC diagram showing **Scheduled and Actual (earned value)** Project cost curve (both incremental and

cumulative) based on both projected early and late activity finish dates. Also, revise the Cash Flow S-curve when the contract is modified, or as directed by the Contracting Officer.

- C. After completion of the joint review and the Contracting Officer's approval of all entries, the contractor will generate an updated computer-produced calendar-dated schedule and submit to the contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified. These reports shall be submitted **within 7 calendar days** after the monthly update meeting to the SRE and the VA CPM Schedule analyst simultaneously via electronic media, as noted earlier.
- D. **Parallel Runs / Time Impact Analysis (TIA)** -After completing the monthly schedule update, the contractor's CPM consultant shall rerun **all current period contract change(s) as a batch against the previous month's approved monthly project schedule with the approved "Fragnet"** (Fragments of network or sub-network) logic and durations. **The Change Order Fragnet should be driven by the pure logical ties; and there should not be any "Plug in" date ahead of the data date or at the time of impact.** The analysis shall only include original workday durations and schedule logic previously agreed upon during the update meeting by the contractor and the SRE for the contract change(s), and preferably shall be submitted as a part of the C.O. proposal and before any physical C.O. work is performed. Fragnet logic shall include only relevant procurement and physical C.O. work activities and **shall not include any RFI (Request for Information) or non-work activities time.** **Note: If timely resolution of the RFI is potentially impacting the contract schedule, in contractor's opinion, the contractor must provide tangible proof with CPM data and immediately submit in writing to the Contracting Officer's review. Only selective RFIs for the CO or SA shall be allowed in the schedule of record only when approved by the contracting officer or his representative.**

When there is a disagreement on Fragnet logic and/or durations, the contractor shall use the Fragnet provided and approved by the SRE. The contractor must also allocate cost and average manpower loading to each

CO or SA Fragnet activities as required by the section 2.3 - Network Diagram Requirements above. **Note: Insertion of any CO or SA activities into the CPM database (as a placeholder for cost only) with faulty logic ties like NTP (predecessor) and Project complete (successor) and zero (0) duration will not be accepted.** The proper "Fragnet" logic and durations must be used as approved by the SRE, tied to the related physical work area of the schedule. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA SRE and the CPM Analyst in accordance to the requirements listed in articles 3.2.D. This electronic submission is separate from the regular monthly project schedule reports requirements and shall be submitted to the SRE **within fourteen (14) calendar days** of completing the regular schedule update meeting. Before inserting the contract changes durations, care must be taken to ensure that only the original durations of the change will be used for the analysis, not the reported durations (as-built) after the progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.

- E. **RFI activities not allowed - RFIs are only contractor inquiries and not legitimate work activities; and VA does not allow indiscriminate inclusion of any RFIs in any project schedule updates.** The contractor must provide, in advance and in writing, to the contracting officer the valid justification for including any RFIs, on an exception basis, in the project schedule updates; and **must obtain VA approval** prior to its inclusion in the schedule of record.
- F. **Retroactive TIA - Retroactive TIA long after (generally over 3 months) the initiation of impact with "as-built" logic / duration will not be accepted as a normal practice.** The contractor is required to perform TIA (as required by Item 3.2.E above) **within a month of VA issued Change or** other directives to proceed with additional work.

- G. Concurrency in Time Extension delays** - Whenever there are several delays (due to change orders impact or other Government or contractor caused delays) occurring at the same time frame (same point of initiation), the contractor is required to perform one single TIA with individual Fragnets for each change inserted in the same base schedule and determine which one is impacting the critical or longest path. Analyze and **assign responsibilities to each individual changes or other delay (Government or contractor caused) with graphics and narratives to show if and how various delay impacts becoming concurrent.** The VA is only responsible for granting the amount of delay caused by them (apportioned delay) in the longest or critical path, discounting effects of any contractor caused delay that has been occurring concurrently in that time frame. The contractor is required to provide justification narrative, and then submit summary results for VA approval and acceptance.
- H. Revised NAS Diagram** - After VA acceptance and approval of the final NAS diagram and the schedule, and after each monthly update, the contractor shall submit to the Contracting Officer electronic copies of a revised complete NAS diagram showing all completed and partially completed activities/ events, contract changes and logic changes made on the intervening updates or at the first update on the final diagram. The Contracting Officer **may elect to have the contractor do this on a less frequent basis**, but it shall be done when the Baseline schedule is revised, or when requested by the Contracting Officer.
- I. Schedule Coordination/ Progress review meeting** - Following approval of the CPM schedule updates, the VA, the General Contractor, its approved CPM Consultant, RE office representatives, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. This schedule coordination meeting shall be chaired by the VA SRE and will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from the previous schedule update. The main emphasis shall be to address work activities to avoid slippages of project schedule and to identify any necessary corrective actions required to maintain project schedule during the reporting period. VA representatives and the Contractor should conclude

the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. **If the project is behind schedule, discussions should concentrate on ways to prevent further slippage as well as ways to improve the project schedule status,** as appropriate. Furthermore, the critical Change Orders that impact the contract schedule, the contractor must include a reasonable **"work-around"** plan or re-planning effort (submit narrative) including revised logic sequence for the downstream base contract work, durations adjustments and crew re-allocation from less critical to the new critical path areas, without adversely impacting the change order cost to the government to minimize/mitigate the impact of the time delay. This should not be implied as a direction to accelerate the schedule, rather a **reasonable mitigation effort within the current work plan.**

J. **Ownership of Project Float** - Project float is the length of time between the contractor's predicted completion milestone and the contract completion date milestone. Project Float available in the schedule, at any time, shall not be considered for the exclusive use of either the VA or the Contractor.

3.3 RESPONSIBILITY FOR COMPLETION / PROJECT DELAY / RECOVERY:

- A. Whenever it becomes apparent from the current monthly progress review meeting or the monthly schedule update that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:
1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
 2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
 3. Reschedule the work in conformance with the specification requirements to recover all of the delay for which the contractor is responsible.

- A. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the Contracting Officer for the proposed schedule changes. If such actions are approved, the contractor shall incorporate this "**Recovery schedule**" with all the CPM revisions into the next update, **at no additional cost to the Government.**

3.4 CHANGES TO NETWORK DIAGRAM AND REVISED SCHEDULE:

- A. Within 30 calendar days after VA acceptance and approval of any updated computer-produced schedule, the contractor shall **submit a revised network diagram and schedule**, the associated compact disk(s), and a list of any activity/event changes including predecessors and successors for any of the following reasons:
1. Delay in completion of any activity/event or group of activities/events; that indicate an extension of the project completion by **20 working days or 10 percent of the remaining project duration**, whichever is less. Such delays which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project is beyond the acceptable limits.
 2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
 3. The schedule **does not represent the actual prosecution and realistic progress of the project, or when more than 5% of the remaining activities are "out of sequence" as noted earlier (Ref. 3.2.A.7).**
 4. When there is, or has been, a substantial revision to the activity/event costs of the network diagram regardless of the cause for these revisions.
- B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Medical Center, contract phase(s) and sub phase(s), utilities furnished by the Government to the

Contractor, or any other previously contracted item, must be furnished in writing to the Contracting Officer for approval.

- B. Contracting Officer's approval for the revised NAS diagram and schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- C. The cost of revisions to the network diagram resulting from contract changes will be included in the proposal for changes in work as specified in Article, FAR 52.243 -4 (CHANGES), and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- D. The cost of revisions to the network diagram and schedule, not resulting from contract changes is the responsibility of the Contractor.

3.5 ADJUSTMENT OF CONTRACT COMPLETION DATE / TIME EXTENSION DUE TO CHANGES TO THE CONTRACT:

- A. **Contract Time Extension due to Changes to Contract** - The contract completion time will be adjusted only for causes specified in this contract. The contractor shall submit Request for a time extension to the contract within reasonable time frame (**within 1 month of the issuance of the Change order or before signing of the bilateral Supplemental Agreement**) and must provide a justification, CPM data and supporting evidence as the Contracting Officer may deem necessary for determination if the Contractor is entitled to a time extension under the provisions of the contract. Submission of proof based on approved Fragnet; i.e. revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced

calendar-dated schedule for the time period in question and all other relevant information.

- B. Actual delays in activities/events which, according to the computer-produced calendar-dated schedule, **do not affect the original or extended contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date.** The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision. The burden of proof to request the time extension is the sole responsibility of the contractor, and the contractor is required to revise the Time analysis or provide further documentation when requested by the Contracting Officer.
- C. The contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under Article, FAR 52.243 -4 (CHANGES). The contractor shall include, as a part of each change order proposal, a sequence of activities showing all CPM logic revisions (Fragnets), duration (in work days) changes, and cost changes, manpower loading for work in question and its relationship to other activities on the approved network diagram (as specified above in item 3.2.E - Parallel Run /Time Impact Analysis).

3.6 ADJUSTMENT OF CONTRACT COMPLETION DATE / TIME EXTENSION DUE TO WEATHER:

Weather Delays - All delays due to Weather shall be analyzed on a month by month basis. The unusual weather events and its "after-effects" must impact the work activities on or near critical path work to qualify for weather delay extension. Any weather-related delays claimed by the contractor must be **"above and beyond" the "normal weather" pattern (10-year average)** and shall be supported by the data shown in the National Oceanic and Atmospheric Administration (NOAA) for the region of the country where the project site is located. The weather delay analysis (along with NOAA weather charts) shall be submitted to the VA within 30

calendar days after the weather event has passed. VA considers Time extension due to the weather is "non-compensable" time only.

3.7 ADJUSTMENT OF CONTRACT COMPLETION DATE / Non-Work activities/events:

- A. All delays due to non-work activities/events such as RFI's, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis and must be supported with a justification, CPM data and supporting evidence as the Contracting Officer may deem necessary for determination as to whether the Contractor is entitled to an extension of time. Note: As noted earlier, RFI activities are not allowed and VA does not allow indiscriminate inclusion of any RFIs in any project schedule updates.
- B. Actual delays in activities/events which, according to the computer produced calendar dated schedule, do not affect the original or extended contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The burden of proof to request the time extension is the sole responsibility of the contractor.
- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under Article, FAR 52.243 -4 (CHANGES). The Contractor shall include, as a part of each change order proposal, a sequence of activities showing all CPM logic revisions (Fragnets), duration (in work days) changes, and cost changes, manpower loading for work in question and its relationship to other activities on the approved network diagram (as specified above in item 3.2.E - Parallel Run /Time Impact Analysis).
- D. The cost of revisions to the network diagram not resulting from VA actions or inactions is the responsibility of the contractor.

- - - E N D - - -

SECTION 01 32 16.15
PROJECT SCHEDULES
(SMALL PROJECTS - DESIGN/BID/BUILD)

PART 1- GENERAL

1.1 DESCRIPTION:

- A. The Contractor shall develop a Critical Path Method (CPM) plan and schedule demonstrating fulfillment of the contract requirements (Project Schedule), and shall keep the Project Schedule up-to-date in accordance with the requirements of this section and shall utilize the plan for scheduling, coordinating and monitoring work under this contract (including all activities of subcontractors, equipment vendors and suppliers). Conventional Critical Path Method (CPM) technique shall be utilized to satisfy both time and cost applications.

1.2 CONTRACTOR'S REPRESENTATIVE:

- A. The Contractor shall designate an authorized representative responsible for the Project Schedule including preparation, review and progress reporting with and to the Contracting Officer's Representative (COTR).
- B. The Contractor's representative shall have direct project control and complete authority to act on behalf of the Contractor in fulfilling the requirements of this specification section.
- C. The Contractor's representative shall have the option of developing the project schedule within their organization or to engage the services of an outside consultant. If an outside scheduling consultant is utilized, Section 1.3 of this specification will apply.

1.3 CONTRACTOR'S CONSULTANT:

- A. The Contractor shall submit a qualification proposal to the COTR, within 10 days of bid acceptance. The qualification proposal shall include:
1. The name and address of the proposed consultant.
 2. Information to show that the proposed consultant has the qualifications to meet the requirements specified in the preceding paragraph.
 3. A representative sample of prior construction projects, which the proposed consultant has performed complete project scheduling services. These representative samples shall be of similar size and scope.

- B. The Contracting Officer has the right to approve or disapprove the proposed consultant, and will notify the Contractor of the VA decision within seven calendar days from receipt of the qualification proposal. In case of disapproval, the Contractor shall resubmit another consultant within 10 calendar days for renewed consideration. The Contractor shall have their scheduling consultant approved prior to submitting any schedule for approval.

1.4 COMPUTER PRODUCED SCHEDULES

- A. The contractor shall provide monthly, to the Department of Veterans Affairs (VA), all computer-produced time/cost schedules and reports generated from monthly project updates. This monthly computer service will include: three copies of up to five different reports (inclusive of all pages) available within the user defined reports of the scheduling software approved by the Contracting Officer; a hard copy listing of all project schedule changes, and associated data, made at the update and an electronic file of this data; and the resulting monthly updated schedule in PDM format. These must be submitted with and substantively support the contractor's monthly payment request and the signed look ahead report. The COTR shall identify the five different report formats that the contractor shall provide.
- B. The contractor shall be responsible for the correctness and timeliness of the computer-produced reports. The Contractor shall also responsible for the accurate and timely submittal of the updated project schedule and all CPM data necessary to produce the computer reports and payment request that is specified.
- C. The VA will report errors in computer-produced reports to the Contractor's representative within ten calendar days from receipt of reports. The Contractor shall reprocess the computer-produced reports and associated diskette(s), when requested by the Contracting Officer's representative, to correct errors which affect the payment and schedule for the project.

1.5 THE COMPLETE PROJECT SCHEDULE SUBMITTAL

- A. Within 45 calendar days after receipt of Notice to Proceed, the Contractor shall submit for the Contracting Officer's review; three blue line copies of the interim schedule on sheets of paper 765 x 1070 mm (30 x 42 inches) and an electronic file in the previously approved CPM schedule program. The submittal shall also include three copies of

a computer-produced activity/event ID schedule showing project duration; phase completion dates; and other data, including event cost. Each activity/event on the computer-produced schedule shall contain as a minimum, but not limited to, activity/event ID, activity/event description, duration, budget amount, early start date, early finish date, late start date, late finish date and total float. Work activity/event relationships shall be restricted to finish-to-start or start-to-start without lead or lag constraints. Activity/event date constraints, not required by the contract, will not be accepted unless submitted to and approved by the Contracting Officer. The contractor shall make a separate written detailed request to the Contracting Officer identifying these date constraints and secure the Contracting Officer's written approval before incorporating them into the network diagram. The Contracting Officer's separate approval of the Project Schedule shall not excuse the contractor of this requirement. Logic events (non-work) will be permitted where necessary to reflect proper logic among work events, but must have zero duration. The complete working schedule shall reflect the Contractor's approach to scheduling the complete project. **The final Project Schedule in its original form shall contain no contract changes or delays which may have been incurred during the final network diagram development period and shall reflect the entire contract duration as defined in the bid documents.** These changes/delays shall be entered at the first update after the final Project Schedule has been approved. The Contractor should provide their requests for time and supporting time extension analysis for contract time as a result of contract changes/delays, after this update, and in accordance with Article, ADJUSTMENT OF CONTRACT COMPLETION.

- B. Within 30 calendar days after receipt of the complete project interim Project Schedule and the complete final Project Schedule, the Contracting Officer or his representative, will do one or both of the following:
1. Notify the Contractor concerning his actions, opinions, and objections.
 2. A meeting with the Contractor at or near the job site for joint review, correction or adjustment of the proposed plan will be scheduled if required. Within 14 calendar days after the joint

review, the Contractor shall revise and shall submit three blue line copies of the revised Project Schedule, three copies of the revised computer-produced activity/event ID schedule and a revised electronic file as specified by the Contracting Officer. The revised submission will be reviewed by the Contracting Officer and, if found to be as previously agreed upon, will be approved.

- C. The approved baseline schedule and the computer-produced schedule(s) generated there from shall constitute the approved baseline schedule until subsequently revised in accordance with the requirements of this section.
- D. The Complete Project Schedule shall contain approximately _____ work activities/events.

1.6 WORK ACTIVITY/EVENT COST DATA

- A. The Contractor shall cost load all work activities/events except procurement activities. The cumulative amount of all cost loaded work activities/events (including alternates) shall equal the total contract price. Prorate overhead, profit and general conditions on all work activities/events for the entire project length. The contractor shall generate from this information cash flow curves indicating graphically the total percentage of work activity/event dollar value scheduled to be in place on early finish, late finish. These cash flow curves will be used by the Contracting Officer to assist him in determining approval or disapproval of the cost loading. Negative work activity/event cost data will not be acceptable, except on VA issued contract changes.
- B. The Contractor shall cost load work activities/events for guarantee period services, test, balance and adjust various systems in accordance with the provisions in Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.232 -Article 70 Without NAS-CPM Article 71 Including NAS-CPMfor (PAYMENTS UNDER FIXED PRICE CONSTRUCTION).
- C. In accordance with FAR 52.236 - 1 (PERFORMANCE OF WORK BY THE CONTRACTOR) and VAAR 852.236 - 72 (PERFORMANCE OF WORK BY THE CONTRACTOR), the Contractor shall submit, simultaneously with the cost per work activity/event of the construction schedule required by this Section, a responsibility code for all activities/events of the project for which the Contractor's forces will perform the work.

D. The Contractor shall cost load work activities/events for all BID ITEMS including ASBESTOS ABATEMENT. The sum of each BID ITEM work shall equal the value of the bid item in the Contractors' bid.

1.7 PROJECT SCHEDULE REQUIREMENTS

- A. Show on the project schedule the sequence of work activities/events required for complete performance of all items of work. The Contractor Shall:
1. Show activities/events as:
 - a. Contractor's time required for submittal of shop drawings, templates, fabrication, delivery and similar pre-construction work.
 - b. Contracting Officer's and Architect-Engineer's review and approval of shop drawings, equipment schedules, samples, template, or similar items.
 - c. Interruption of VA Facilities utilities, delivery of Government furnished equipment, and rough-in drawings, project phasing and any other specification requirements.
 - d. Test, balance and adjust various systems and pieces of equipment, maintenance and operation manuals, instructions and preventive maintenance tasks.
 - e. VA inspection and acceptance activity/event with a minimum duration of five work days at the end of each phase and immediately preceding any VA move activity/event required by the contract phasing for that phase.
 2. Show not only the activities/events for actual construction work for each trade category of the project, but also trade relationships to indicate the movement of trades from one area, floor, or building, to another area, floor, or building, for at least five trades who are performing major work under this contract.
 3. Break up the work into activities/events of a duration no longer than 20 work days each or one reporting period, except as to non-construction activities/events (i.e., procurement of materials, delivery of equipment, concrete and asphalt curing) and any other activities/events for which the COTR may approve the showing of a longer duration. The duration for VA approval of any required submittal, shop drawing, or other submittals will not be less than 20 work days.

4. Describe work activities/events clearly, so the work is readily identifiable for assessment of completion. Activities/events labeled "start," "continue," or "completion," are not specific and will not be allowed. Lead and lag time activities will not be acceptable.
 5. The schedule shall be generally numbered in such a way to reflect either discipline, phase or location of the work.
- B. The Contractor shall submit the following supporting data in addition to the project schedule:
1. The appropriate project calendar including working days and holidays.
 2. The planned number of shifts per day.
 3. The number of hours per shift.
- Failure of the Contractor to include this data shall delay the review of the submittal until the Contracting Officer is in receipt of the missing data.
- C. To the extent that the Project Schedule or any revised Project Schedule shows anything not jointly agreed upon, it shall not be deemed to have been approved by the COTR. Failure to include any element of work required for the performance of this contract shall not excuse the Contractor from completing all work required within any applicable completion date of each phase regardless of the COTR's approval of the Project Schedule.
- D. Compact Disk Requirements and CPM Activity/Event Record Specifications: Submit to the VA an electronic file(s) containing one file of the data required to produce a schedule, reflecting all the activities/events of the complete project schedule being submitted.

1.8 PAYMENT TO THE CONTRACTOR:

- A. Monthly, the contractor shall submit an application and certificate for payment using VA Form 10-6001a or the AIA application and certificate for payment documents G702 & G703 reflecting updated schedule activities and cost data in accordance with the provisions of the following Article, PAYMENT AND PROGRESS REPORTING, as the basis upon which progress payments will be made pursuant to Article, FAR 52.232 - 5 (PAYMENT UNDER FIXED-PRICE CONSTRUCTION CONTRACTS) and VAAR 852.232 - Article 70 Without NAS-CPM Article 71 Including NAS-CPMfor (PAYMENTS UNDER FIXED PRICE CONSTRUCTION). The Contractor shall be entitled to a monthly progress payment upon approval of estimates as determined from

the currently approved updated project schedule. Monthly payment requests shall include: a listing of all agreed upon project schedule changes and associated data; and an electronic file (s) of the resulting monthly updated schedule.

- B. Approval of the Contractor's monthly Application for Payment shall be contingent, among other factors, on the submittal of a satisfactory monthly update of the project schedule.

1.9 PAYMENT AND PROGRESS REPORTING

- A. Monthly schedule update meetings will be held on dates mutually agreed to by the COTR and the Contractor. Contractor and their CPM consultant (if applicable) shall attend all monthly schedule update meetings. The Contractor shall accurately update the Project Schedule and all other data required and provide this information to the COTR three work days in advance of the schedule update meeting. Job progress will be reviewed to verify:
1. Actual start and/or finish dates for updated/completed activities/events.
 2. Remaining duration for each activity/event started, or scheduled to start, but not completed.
 3. Logic, time and cost data for change orders, and supplemental agreements that are to be incorporated into the Project Schedule.
 4. Changes in activity/event sequence and/or duration which have been made, pursuant to the provisions of following Article, ADJUSTMENT OF CONTRACT COMPLETION.
 5. Completion percentage for all completed and partially completed activities/events.
 6. Logic and duration revisions required by this section of the specifications.
 7. Activity/event duration and percent complete shall be updated independently.
- B. After completion of the joint review, the contractor shall generate an updated computer-produced calendar-dated schedule and supply the Contracting Officer's representative with reports in accordance with the Article, COMPUTER PRODUCED SCHEDULES, specified.
- C. After completing the monthly schedule update, the contractor's representative or scheduling consultant shall rerun all current period contract change(s) against the prior approved monthly project schedule.

The analysis shall only include original workday durations and schedule logic agreed upon by the contractor and COR for the contract change(s). When there is a disagreement on logic and/or durations, the Contractor shall use the schedule logic and/or durations provided and approved by the COR. After each rerun update, the resulting electronic project schedule data file shall be appropriately identified and submitted to the VA in accordance to the requirements listed in articles 1.4 and 1.7. This electronic submission is separate from the regular monthly project schedule update requirements and shall be submitted to the COR within fourteen (14) calendar days of completing the regular schedule update. Before inserting the contract changes durations, care must be taken to ensure that only the original durations will be used for the analysis, not the reported durations after progress. In addition, once the final network diagram is approved, the contractor must recreate all manual progress payment updates on this approved network diagram and associated reruns for contract changes in each of these update periods as outlined above for regular update periods. This will require detailed record keeping for each of the manual progress payment updates.

- D. Following approval of the CPM schedule, the VA, the General Contractor, its approved CPM Consultant, RE office representatives, and all subcontractors needed, as determined by the SRE, shall meet to discuss the monthly updated schedule. The main emphasis shall be to address work activities to avoid slippage of project schedule and to identify any necessary actions required to maintain project schedule during the reporting period. The Government representatives and the Contractor should conclude the meeting with a clear understanding of those work and administrative actions necessary to maintain project schedule status during the reporting period. This schedule coordination meeting will occur after each monthly project schedule update meeting utilizing the resulting schedule reports from that schedule update. If the project is behind schedule, discussions should include ways to prevent further slippage as well as ways to improve the project schedule status, when appropriate.

1.10 RESPONSIBILITY FOR COMPLETION

- A. If it becomes apparent from the current revised monthly progress schedule that phasing or contract completion dates will not be met, the Contractor shall execute some or all of the following remedial actions:
1. Increase construction manpower in such quantities and crafts as necessary to eliminate the backlog of work.
 2. Increase the number of working hours per shift, shifts per working day, working days per week, the amount of construction equipment, or any combination of the foregoing to eliminate the backlog of work.
 3. Reschedule the work in conformance with the specification requirements.
- B. Prior to proceeding with any of the above actions, the Contractor shall notify and obtain approval from the COTR for the proposed schedule changes. If such actions are approved, the representative schedule revisions shall be incorporated by the Contractor into the Project Schedule before the next update, at no additional cost to the Government.

1.11 CHANGES TO THE SCHEDULE

- A. Within 30 calendar days after VA acceptance and approval of any updated project schedule, the Contractor shall submit a revised electronic file (s) and a list of any activity/event changes including predecessors and successors for any of the following reasons:
1. Delay in completion of any activity/event or group of activities/events, which may be involved with contract changes, strikes, unusual weather, and other delays will not relieve the Contractor from the requirements specified unless the conditions are shown on the CPM as the direct cause for delaying the project beyond the acceptable limits.
 2. Delays in submittals, or deliveries, or work stoppage are encountered which make rescheduling of the work necessary.
 3. The schedule does not represent the actual prosecution and progress of the project.
 4. When there is, or has been, a substantial revision to the activity/event costs regardless of the cause for these revisions.
- B. CPM revisions made under this paragraph which affect the previously approved computer-produced schedules for Government furnished equipment, vacating of areas by the VA Facility, contract phase(s) and

sub phase(s), utilities furnished by the Government to the Contractor, or any other previously contracted item, shall be furnished in writing to the Contracting Officer for approval.

- C. Contracting Officer's approval for the revised project schedule and all relevant data is contingent upon compliance with all other paragraphs of this section and any other previous agreements by the Contracting Officer or the VA representative.
- D. The cost of revisions to the project schedule resulting from contract changes will be included in the proposal for changes in work as specified in FAR 52.243 - 4 (Changes, and will be based on the complexity of the revision or contract change, man hours expended in analyzing the change, and the total cost of the change.
- E. The cost of revisions to the Project Schedule not resulting from contract changes is the responsibility of the Contractor.

1.12 ADJUSTMENT OF CONTRACT COMPLETION

- A. The contract completion time will be adjusted only for causes specified in this contract. Request for an extension of the contract completion date by the Contractor shall be supported with a justification, CPM data and supporting evidence as the COTR may deem necessary for determination as to whether or not the Contractor is entitled to an extension of time under the provisions of the contract. Submission of proof based on revised activity/event logic, durations (in work days) and costs is obligatory to any approvals. The schedule must clearly display that the Contractor has used, in full, all the float time available for the work involved in this request. The Contracting Officer's determination as to the total number of days of contract extension will be based upon the current computer-produced calendar-dated schedule for the time period in question and all other relevant information.
- B. Actual delays in activities/events which, according to the computer-produced calendar-dated schedule, do not affect the extended and predicted contract completion dates shown by the critical path in the network, will not be the basis for a change to the contract completion date. The Contracting Officer will within a reasonable time after receipt of such justification and supporting evidence, review the facts and advise the Contractor in writing of the Contracting Officer's decision.

- C. The Contractor shall submit each request for a change in the contract completion date to the Contracting Officer in accordance with the provisions specified under FAR 52.243 - 4 (Changes). The Contractor shall include, as a part of each change order proposal, a sketch showing all CPM logic revisions, duration (in work days) changes, and cost changes, for work in question and its relationship to other activities on the approved network diagram.
- D. All delays due to non-work activities/events such as RFI's, WEATHER, STRIKES, and similar non-work activities/events shall be analyzed on a month by month basis.

- - - E N D - - -

SECTION 01 33 23

SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This specification defines the general requirements and procedures for submittals. A submittal is information submitted for VA review to establish compliance with the contract documents.
- B. Detailed submittal requirements are found in the technical sections of the contract specifications. The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective technical specifications at no additional cost to the government.
- C. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.

1.2 DEFINITIONS

- A. Preconstruction Submittals: Submittals which are required prior to issuing contract notice to proceed or starting construction. For example, Certificates of insurance; Surety bonds; Site-specific safety plan; Construction progress schedule; Schedule of values; Submittal register; List of proposed subcontractors.
- B. Shop Drawings: Drawings, diagrams, and schedules specifically prepared to illustrate some portion of the work. Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be integrated and coordinated.
- C. Product Data: Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions, and brochures, which describe and illustrate size, physical appearance, and other characteristics of materials, systems, or equipment for some portion of the work. Samples of warranty language when the contract requires extended product warranties.

- D. Samples: Physical examples of materials, equipment, or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by which the work can be judged. Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project. Field samples and mock-ups constructed to establish standards by which the ensuing work can be judged.
- E. Design Data: Calculations, mix designs, analyses, or other data pertaining to a part of work.
- F. Test Reports: Report which includes findings of a test required to be performed by the Contractor on an actual portion of the work. Report which includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.
- G. Certificates: Document required of Contractor, or of a manufacturer, supplier, installer, or subcontractor through Contractor. The purpose is to document procedures, acceptability of methods, or personnel qualifications for a portion of the work.
- H. Manufacturer's Instructions: Pre-printed material describing installation of a product, system, or material, including special notices and MSDS concerning impedances, hazards, and safety precautions.
- I. Manufacturer's Field Reports: Documentation of the testing and verification actions taken by manufacturer's representative at the job site on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must indicate whether the material, product, or system has passed or failed the test.
- J. Operation and Maintenance Data: Manufacturer data that is required to operate, maintain, troubleshoot, and repair equipment, including manufacturer's help, parts list, and product line documentation. This data shall be incorporated in an operations and maintenance manual.
- K. Closeout Submittals: Documentation necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a phase of construction on a multi-phase contract.

1.3 SUBMITTAL REGISTER

- A. The submittal register will list items of equipment and materials for which submittals are required by the specifications. This list may not be all inclusive and additional submittals may be required by the specifications. The Contractor is not relieved from supplying submittals required by the contract documents but which have been omitted from the submittal register.
- B. The submittal register will serve as a scheduling document for submittals and will be used to control submittal actions throughout the contract period.
- C. The VA will provide the initial submittal register in electronic format. Thereafter, the Contractor shall track all submittals by maintaining a complete list, including completion of all data columns, including dates on which submittals are received and returned by the VA.
- D. The Contractor shall update the submittal register as submittal actions occur and maintain the submittal register at the project site until final acceptance of all work by Contracting Officer.
- E. The Contractor shall submit formal monthly updates to the submittal register in electronic format. Each monthly update shall document actual submission and approval dates for each submittal.

1.4 SUBMITTAL SCHEDULING

- A. Submittals are to be scheduled, submitted, reviewed, and approved prior to the acquisition of the material or equipment.
- B. Coordinate scheduling, sequencing, preparing, and processing of submittals with performance of work so that work will not be delayed by submittal processing. Allow time for potential resubmittal.
- C. No delay costs or time extensions will be allowed for time lost in late submittals or resubmittals.
- D. All submittals are required to be approved prior to the start of the specified work activity.

1.5 SUBMITTAL PREPARATION

- A. Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.

- B. Collect required data for each specific material, product, unit of work, or system into a single submittal. Prominently mark choices, options, and portions applicable to the submittal. Partial submittals will not be accepted for expedition of construction effort. Submittal will be returned without review if incomplete.
- C. If available product data is incomplete, provide Contractor-prepared documentation to supplement product data and satisfy submittal requirements.
- D. All irrelevant or unnecessary data shall be removed from the submittal to facilitate accuracy and timely processing. Submittals that contain the excessive amount of irrelevant or unnecessary data will be returned with review.
- E. Provide a transmittal form for each submittal with the following information:
 - 1. Project title, location and number.
 - 2. Construction contract number.
 - 3. Date of the drawings and revisions.
 - 4. Name, address, and telephone number of subcontractor, supplier, manufacturer, and any other subcontractor associated with the submittal.
 - 5. List paragraph number of the specification section and sheet number of the contract drawings by which the submittal is required.
 - 6. When a resubmission, add alphabetic suffix on submittal description. For example, submittal 18 would become 18A, to indicate resubmission.
 - 7. Product identification and location in project.
- F. The Contractor is responsible for reviewing and certifying that all submittals are in compliance with contract requirements before submitting for VA review. Proposed deviations from the contract requirements are to be clearly identified. All deviations submitted must include a side by side comparison of item being proposed against item specified. Failure to point out deviations will result in the VA requiring removal and replacement of such work at the Contractor's expense.
- G. Stamp, sign, and date each submittal transmittal form indicating action taken.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
05-01-17

H. Stamp used by the Contractor on the submittal transmittal form to certify that the submittal meets contract requirements is to be similar to the following:

CONTRACTOR
(Firm Name)
_____ Approved
_____ Approved with corrections as noted on submittal data and/or attached sheets(s)
SIGNATURE: _____
TITLE: _____
DATE: _____

1.6 SUBMITTAL FORMAT AND TRANSMISSION

- A. Provide submittals in electronic format, with the exception of material samples. Use PDF as the electronic format, unless otherwise specified or directed by the Contracting Officer.
- B. Compile the electronic submittal file as a single, complete document. Name the electronic submittal file specifically according to its contents.
- C. Electronic files must be of sufficient quality that all information is legible. Generate PDF files from original documents so that the text included in the PDF file is both searchable and can be copied. If documents are scanned, Optical Character Resolution (OCR) routines are required.

- D. Provide electronic documents over 5MB through an electronic FTP file sharing system. Confirm that the electronic FTP file sharing system can be accessed from the VA computer network. The Contractor is responsible for setting up, providing, and maintaining the electronic FTP file sharing system for the construction contract period of performance.
- E. Provide hard copies of submittals when requested by the Contracting Officer. Up to 3 additional hard copies of any submittal may be requested at the discretion of the Contracting Officer, at no additional cost to the VA.

1.7 SAMPLES

- A. Submit two sets of physical samples showing range of variation, for each required item.
- B. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified.
- C. When color, texture, or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.
- D. Before submitting samples, the Contractor is to ensure that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.
- E. The VA reserves the right to disapprove any material or equipment which previously has proven unsatisfactory in service.
- F. Physical samples supplied maybe requested back for use in the project after reviewed and approved.

1.8 OPERATION AND MAINTENANCE DATA

- A. Submit data specified for a given item within 30 calendar days after the item is delivered to the contract site.
- B. In the event the Contractor fails to deliver O&M Data within the time limits specified, the Contracting Officer may withhold from progress

payments 50 percent of the price of the item with which such O&M Data are applicable.

1.9 TEST REPORTS

SRE may require specific test after work has been installed or completed which could require contractor to repair test area at no additional cost to contract.

1.10 VA REVIEW OF SUBMITTALS AND RFIS

- A. The VA will review all submittals for compliance with the technical requirements of the contract documents. The Architect-Engineer for this project will assist the VA in reviewing all submittals and determining contractual compliance. Review will be only for conformance with the applicable codes, standards and contract requirements.
- B. Period of review for submittals begins when the VA COR receives submittal from the Contractor.
- C. Period of review for each resubmittal is the same as for initial submittal.
- D. VA review period is 21 working days for submittals. All submittals should be sent through FTP File Sharing system or Procore, to be determined by the VA COR.
- E. VA review period is 21 working days for RFIs.
- F. The VA will return submittals to the Contractor with the following notations:
 1. "Approved": authorizes the Contractor to proceed with the work covered.
 2. "Approved as noted": authorizes the Contractor to proceed with the work covered provided the Contractor incorporates the noted comments and makes the noted corrections.
 3. "Disapproved, revise and resubmit": indicates noncompliance with the contract requirements or that submittal is incomplete. Resubmit with appropriate changes and corrections. No work shall proceed for this item until resubmittal is approved.
 4. "Not reviewed": indicates submittal does not have evidence of being reviewed and approved by Contractor or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals after taking appropriate action.

1.11 APPROVED SUBMITTALS

- A. The VA approval of submittals is not to be construed as a complete check, and indicates only that the general method of construction, materials, detailing, and other information are satisfactory.
- B. VA approval of a submittal does not relieve the Contractor of the responsibility for any error which may exist. The Contractor is responsible for fully complying with all contract requirements and the satisfactory construction of all work, including the need to check, confirm, and coordinate the work of all subcontractors for the project. Non-compliant material incorporated in the work will be removed and replaced at the Contractor's expense.
- C. After submittals have been approved, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.
- D. Retain a copy of all approved submittals at project site, including approved samples.

1.12 WITHHOLDING OF PAYMENT

Payment for materials incorporated in the work will not be made if required approvals have not been obtained.

- - - E N D - - -

SECTION 01 35 26
SAFETY REQUIREMENTS

1.1 APPLICABLE PUBLICATIONS:

A. Latest publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

B. American Society of Safety Engineers (ASSE):

A10.1-2011Pre-Project & Pre-Task Safety and Health
Planning

A10.34-2012Protection of the Public on or Adjacent to
Construction Sites

A10.38-2013Basic Elements of an Employer's Program to
Provide a Safe and Healthful Work Environment
American National Standard Construction and
Demolition Operations

C. American Society for Testing and Materials (ASTM):

E84-2013Surface Burning Characteristics of Building
Materials

D. The Facilities Guidelines Institute (FGI):

FGI Guidelines-2010Guidelines for Design and Construction of
Healthcare Facilities

E. National Fire Protection Association (NFPA):

10-2018Standard for Portable Fire Extinguishers

30-2018Flammable and Combustible Liquids Code

51B-2019Standard for Fire Prevention During Welding,
Cutting and Other Hot Work

70-2020National Electrical Code

70B-2019Recommended Practice for Electrical Equipment
Maintenance

70E-2018Standard for Electrical Safety in the Workplace

99-2018Health Care Facilities Code

241-2019Standard for Safeguarding Construction,
Alteration, and Demolition Operations

F. The Joint Commission (TJC)

TJC ManualComprehensive Accreditation and Certification
Manual

G. U.S. Nuclear Regulatory Commission

10 CFR 20Standards for Protection Against Radiation

H. U.S. Occupational Safety and Health Administration (OSHA):

29 CFR 1910Safety and Health Regulations for General
Industry

29 CFR 1926Safety and Health Regulations for Construction
Industry

I. VHA Directive 2005-007

1.2 DEFINITIONS:

A. Critical Lift. A lift with the hoisted load exceeding 75% of the crane's maximum capacity; lifts made out of the view of the operator (blind picks); lifts involving two or more cranes; personnel being hoisted; and special hazards such as lifts over occupied facilities, loads lifted close to power-lines, and lifts in high winds or where other adverse environmental conditions exist; and any lift which the crane operator believes is critical.

B. OSHA "Competent Person" (CP). One who is capable of identifying existing and predictable hazards in the surroundings and working conditions which are unsanitary, hazardous or dangerous to employees, and who has the authorization to take prompt corrective measures to eliminate them (see 29 CFR 1926.32(f)).

C. "Qualified Person" means one who, by possession of a recognized degree, certificate, or professional standing, or who by extensive knowledge,

training and experience, has successfully demonstrated his ability to solve or resolve problems relating to the subject matter, the work, or the project.

D. High Visibility Accident. Any mishap which may generate publicity or high visibility.

E. Accident/Incident Criticality Categories:

1. No impact - near miss incidents that should be investigated but are not required to be reported to the VA;
2. Minor incident/impact - incidents that require first aid or result in minor equipment damage (less than \$5000). These incidents must be investigated but are not required to be reported to the VA;
3. Moderate incident/impact - Any work-related injury or illness that results in:
 - a. Days away from work (any time lost after day of injury/illness onset);
 - b. Restricted work;
 - c. Transfer to another job;
 - d. Medical treatment beyond first aid;
 - e. Loss of consciousness;
4. A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (5) above or,
5. Any incident that leads to major equipment damage (greater than \$5000).

F. These incidents must be investigated and are required to be reported to the VA;

- 1 Major incident/impact - Any mishap that leads to fatalities, hospitalizations, amputations, and losses of an eye as a result of contractors' activities. Or any incident which leads to major property damage (greater than \$20,000) and/or may generate publicity

or high visibility. These incidents must be investigated and are required to be reported to the VA as soon as practical, but not later than 2 hours after the incident.

- G. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even through provided by a physician or registered personnel.

1.3 REGULATORY REQUIREMENTS:

- A. In addition to the detailed requirements included in the provisions of this contract, comply with 29 CFR 1926, comply with 29 CFR 1910 as incorporated by reference within 29 CFR 1926, comply with ASSE A10.34, and all applicable [federal, state, and local] laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern except with specific approval and acceptance by the Contracting Officer Representative.

1.4 ACCIDENT PREVENTION PLAN (APP):

- A. The APP (aka Construction Safety & Health Plan) shall interface with the Contractor's overall safety and health program. Include any portions of the Contractor's overall safety and health program referenced in the APP in the applicable APP element and ensure it is site-specific. The Government considers the Prime Contractor to be the "controlling authority" for all worksite safety and health of each subcontractor(s). Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out.
- B. The APP shall be prepared as follows:

1. Written in English by a qualified person who is employed by the Prime Contractor articulating the specific work and hazards pertaining to the contract (model language can be found in ASSE A10.33). Specifically articulating the safety requirements found within these VA contract safety specifications.
2. Address both the Prime Contractors and the subcontractors work operations.
3. State measures to be taken to control hazards associated with materials, services, or equipment provided by suppliers.
4. Address all the elements/sub-elements and in order as follows:
 - a. **SIGNATURE SHEET.** Title, signature, and phone number of the following:
 - 1) Plan preparer (Qualified Person such as corporate safety staff person or contracted Certified Safety Professional with construction safety experience);
 - 2) Plan approver (company/corporate officers authorized to obligate the company);
 - 3) Plan concurrence (e.g., Chief of Operations, Corporate Chief of Safety, Corporate Industrial Hygienist, project manager or superintendent, project safety professional). Provide concurrence of other applicable corporate and project personnel (Contractor).
 - b. **BACKGROUND INFORMATION.** List the following:
 - 1) Contractor;
 - 2) Contract number;
 - 3) Project name;
 - 4) Brief project description, description of work to be performed, and location; phases of work anticipated (these will require an AHA).

- c. **STATEMENT OF SAFETY AND HEALTH POLICY.** Provide a copy of current corporate/company Safety and Health Policy Statement, detailing commitment to providing a safe and healthful workplace for all employees. The Contractor's written safety program goals, objectives, and accident experience goals for this contract should be provided.
- d. **RESPONSIBILITIES AND LINES OF AUTHORITIES.** Provide the following:
- 1) A statement of the employer's ultimate responsibility for the implementation of his SOH program;
 - 2) Identification and accountability of personnel responsible for safety at both corporate and project level. Contracts specifically requiring safety or industrial hygiene personnel shall include a copy of their resumes.
 - 3) The names of Competent and/or Qualified Person(s) and proof of competency/qualification to meet specific OSHA Competent/Qualified Person(s) requirements must be attached.;
 - 4) Requirements that no work shall be performed unless a designated competent person is present on the job site;
 - 5) Requirements for pre-task Activity Hazard Analysis (AHAs);
 - 6) Lines of authority;
 - 7) Policies and procedures regarding noncompliance with safety requirements (to include disciplinary actions for violation of safety requirements) should be identified;
- e. **SUBCONTRACTORS AND SUPPLIERS.** If applicable, provide procedures for coordinating SOH activities with other employers on the job site:
- 1) Identification of subcontractors and suppliers (if known);
 - 2) Safety responsibilities of subcontractors and suppliers.
- f. **TRAINING.**

- 1) Site-specific SOH orientation training at the time of initial hire or assignment to the project for every employee before working on the project site is required.
- 2) Mandatory training and certifications that are applicable to this project (e.g., explosive actuated tools, crane operator, rigger, crane signal person, fall protection, electrical lockout/NFPA 70E, machine/equipment lockout, confined space, etc...) and any requirements for periodic retraining/recertification are required.
- 3) Procedures for ongoing safety and health training for supervisors and employees shall be established to address changes in site hazards/conditions.
- 4) OSHA 10-hour training is required for all workers on site and the OSHA 30-hour training is required for Trade Competent Persons (CPs)

g. SAFETY AND HEALTH INSPECTIONS.

- 1) Specific assignment of responsibilities for a minimum daily job site safety and health inspection during periods of work activity: Who will conduct (e.g., "Site Safety and Health CP"), proof of inspector's training/qualifications, when inspections will be conducted, procedures for documentation, deficiency tracking system, and follow-up procedures.
- 2) Any external inspections/certifications that may be required (e.g., contracted CSP or CSHT)

h. ACCIDENT/INCIDENT INVESTIGATION & REPORTING. The Contractor shall conduct mishap investigations of all Moderate and Major as well as all High Visibility Incidents. The APP shall include accident/incident investigation procedure and identify person(s) responsible to provide the following to the Contracting Officer Representative:

- 1) Exposure data (man-hours worked);
- 2) Accident investigation reports;

3) Project site injury and illness logs.

i. PLANS (PROGRAMS, PROCEDURES) REQUIRED. Based on a risk assessment of contracted activities and on mandatory OSHA compliance programs, the Contractor shall address all applicable occupational, patient, and public safety risks in site-specific compliance and accident prevention plans. These Plans shall include but are not be limited to procedures for addressing the risks associates with the following:

- 1) Emergency response;
- 2) Contingency for severe weather;
- 3) Fire Prevention;
- 4) Medical Support;
- 5) Posting of emergency telephone numbers;
- 6) Prevention of alcohol and drug abuse;
- 7) Site sanitation(housekeeping, drinking water, toilets);
- 8) Night operations and lighting;
- 9) Hazard communication program;
- 10) Welding/Cutting "Hot" work;
- 11) Electrical Safe Work Practices (Electrical LOTO/NFPA 70E);
- 12) General Electrical Safety;
- 13) Hazardous energy control (Machine LOTO);
- 14) Site-Specific Fall Protection & Prevention;
- 15) Excavation/trenching;
- 16) Asbestos abatement;
- 17) Lead abatement;
- 18) Crane Critical lift;
- 19) Respiratory protection;

- 20) Health hazard control program;
- 21) Radiation Safety Program;
- 22) Abrasive blasting;
- 23) Heat/Cold Stress Monitoring;
- 24) Crystalline Silica Monitoring (Assessment);
- 25) Demolition plan (to include engineering survey);
- 26) Formwork and shoring erection and removal;
- 27) Public (Mandatory compliance with ANSI/ASSE A10.34-2012).

- C. Submit the APP to the Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance. Work cannot proceed without an accepted APP.
- D. Once accepted by the Contracting Officer Representative, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP will be cause for stopping of work, at the discretion of the Contracting Officer in accordance with FAR Clause 52.236-13, *Accident Prevention*, until the matter has been rectified.
- E. Once work begins, changes to the accepted APP shall be made with the knowledge and concurrence of the COR project superintendent, project overall designated OSHA Competent Person, and facility Safety Manager Contracting Officer Representative . Should any severe hazard exposure, i.e. imminent danger, become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of discovery. Eliminate/remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public and the environment.

1.5 ACTIVITY HAZARD ANALYSES (AHAS) :

- A. AHAs are also known as Job Hazard Analyses, Job Safety Analyses, and Activity Safety Analyses. Before beginning each work activity involving a type of work presenting hazards not experienced in previous project operations or where a new work crew or sub-contractor is to perform the work, the Contractor(s) performing that work activity shall prepare an AHA (Example electronic AHA forms can be found on the US Army Corps of Engineers web site)
- B. AHAs shall define the activities being performed and identify the work sequences, the specific anticipated hazards, site conditions, equipment, materials, and the control measures to be implemented to eliminate or reduce each hazard to an acceptable level of risk.
- C. Work shall not begin until the AHA for the work activity has been accepted by the Contracting Officer Representative and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
 1. The names of the Competent/Qualified Person(s) required for a particular activity (for example, excavations, scaffolding, fall protection, other activities as specified by OSHA and/or other State and Local agencies) shall be identified and included in the AHA. Certification of their competency/qualification shall be submitted to the Government Designated Authority (GDA) for acceptance prior to the start of that work activity.
 2. The AHA shall be reviewed and modified as necessary to address changing site conditions, operations, or change of competent/qualified person(s).
 - a. If more than one Competent/Qualified Person is used on the AHA activity, a list of names shall be submitted as an attachment to the AHA. Those listed must be Competent/Qualified for the type of work involved in the AHA and familiar with current site safety issues.
 - b. If a new Competent/Qualified Person (not on the original list) is added, the list shall be updated (an administrative action not

requiring an updated AHA). The new person shall acknowledge in writing that he or she has reviewed the AHA and is familiar with current site safety issues.

3. Submit AHAs to the Contracting Officer Representative or Government Designated Authority for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES for review at least 15 calendar days prior to the start of each phase. Subsequent AHAs as shall be formatted as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.
4. The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.
5. Develop the activity hazard analyses using the project schedule as the basis for the activities performed. All activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier, or subcontractor and provided to the prime contractor for review and approval and then submitted to the Contracting Officer Representative .

1.6 PRECONSTRUCTION CONFERENCE:

- A. Contractor representatives who have a responsibility or significant role in implementation of the accident prevention program, as required by 29 CFR 1926.20(b)(1), on the project shall attend the preconstruction conference to gain a mutual understanding of its implementation. This includes the project superintendent, subcontractor superintendents, and any other assigned safety and health professionals.

- B. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.
- C. Deficiencies in the submitted APP will be brought to the attention of the Contractor within 14 days of submittal, and the Contractor shall revise the plan to correct deficiencies and re-submit it for acceptance. Do not begin work until there is an accepted APP.

1.7 "SITE SAFETY AND HEALTH OFFICER" (SSHO) AND "COMPETENT PERSON" (CP):

- A. The Prime Contractor shall designate a minimum of one SSHO at each project site that will be identified as the SSHO to administer the Contractor's safety program and government-accepted Accident Prevention Plan. Each subcontractor shall designate a minimum of one CP in compliance with 29 CFR 1926.20 (b) (2) that will be identified as a CP to administer their individual safety programs.
- B. Further, all specialized Competent Persons for the work crews will be supplied by the respective contractor as required by 29 CFR 1926 (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- C. These Competent Persons can have collateral duties as the subcontractor's superintendent and/or work crew lead persons as well as fill more than one specialized CP role (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations). However, the SSHO has be a separate qualified individual from the Prime Contractor's Superintendent and/or Quality Control Manager with duties only as the SSHO
- D. The SSHO or an equally-qualified Designated Representative/alternate will maintain a presence on the site during construction operations in

accordance with FAR Clause 52.236-6: *Superintendence by the Contractor*. CPs will maintain presence during their construction activities in accordance with above mentioned clause. A listing of the designated SSHO and all known CPs shall be submitted prior to the start of work as part of the APP with the training documentation and/or AHA as listed in Section 1.8 below.

- E. The repeated presence of uncontrolled hazards during a contractor's work operations will result in the designated CP as being deemed incompetent and result in the required removal of the employee in accordance with FAR Clause 52.236-5: Material and Workmanship, Paragraph (c).

1.8 TRAINING:

- A. The designated Prime Contractor SSHO must meet the requirements of all applicable OSHA standards and be capable (through training, experience, and qualifications) of ensuring that the requirements of 29 CFR 1926.16 and other appropriate Federal, State and local requirements are met for the project. As a minimum the SSHO must have completed the OSHA 30-hour Construction Safety class and have five (5) years of construction industry safety experience or three (3) years if he/she possesses a Certified Safety Professional (CSP) or certified Construction Safety and Health Technician (CSHT) certification or have a safety and health degree from an accredited university or college.
- B. All designated CPs shall have completed the OSHA 30-hour Construction Safety course within the past 5 years.
- C. In addition to the OSHA 30 Hour Construction Safety Course, all CPs with high hazard work operations such as operations involving asbestos, electrical, cranes, demolition, work at heights/fall protection, fire safety/life safety, ladder, rigging, scaffolds, and trenches/excavations shall have a specialized formal course in the hazard recognition & control associated with those high hazard work operations. Documented "repeat" deficiencies in the execution of safety requirements will require retaking the requisite formal course.

- D. All other construction workers shall have the OSHA 10-hour Construction Safety Outreach course and any necessary safety training to be able to identify hazards within their work environment.
- E. Submit training records associated with the above training requirements to the Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 15 calendar days prior to the date of the preconstruction conference for acceptance.
- F. Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the SSHO or his/her designated representative. As a minimum, this briefing shall include information on the site-specific hazards, construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, emergency procedures, accident reporting etc... Documentation shall be provided to the COR that individuals have undergone contractor's safety briefing.
- G. Ongoing safety training will be accomplished in the form of weekly documented safety meeting.

1.9 INSPECTIONS:

- A. The SSHO shall conduct frequent and regular safety inspections (daily) of the site and each of the subcontractors CPs shall conduct frequent and regular safety inspections (daily) of the their work operations as required by 29 CFR 1926.20(b)(2). Each week, the SSHO shall conduct a formal documented inspection of the entire construction areas with the subcontractors' "Trade Safety and Health CPs" present in their work areas. Coordinate with, and report findings and corrective actions weekly to Contracting Officer Representative .
- B. A Certified Safety Professional (CSP) with specialized knowledge in construction safety or a certified Construction Safety and Health Technician (CSHT) shall randomly conduct a monthly site safety inspection. The CSP or CSHT can be a corporate safety professional or

independently contracted. The CSP or CSHT will provide their certificate number on the required report for verification as necessary.

1. Results of the inspection will be documented with tracking of the identified hazards to abatement.
2. The Contracting Officer Representative will be notified immediately prior to start of the inspection and invited to accompany the inspection.
3. Identified hazard and controls will be discussed to come to a mutual understanding to ensure abatement and prevent future reoccurrence.
4. A report of the inspection findings with status of abatement will be provided to the Contracting Officer Representative within one week of the onsite inspection.

1.10 ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS:

- A. The prime contractor shall establish and maintain an accident reporting, recordkeeping, and analysis system to track and analyze all injuries and illnesses, high visibility incidents, and accidental property damage (both government and contractor) that occur on site. Notify the Contracting Officer Representative as soon as practical, but no more than four hours after any accident meeting the definition of a Moderate or Major incidents, High Visibility Incidents, , or any weight handling and hoisting equipment accident. Within notification include contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage, if any; extent of injury, if known, and brief description of accident (to include type of construction equipment used, PPE used, etc.). Preserve the conditions and evidence on the accident site until the Contracting Officer Representative determine whether a government investigation will be conducted.
- B. Conduct an accident investigation for all Minor, Moderate and Major incidents as defined in paragraph DEFINITIONS, and property damage accidents resulting in at least \$20,000 in damages, to establish the root cause(s) of the accident. Complete the VA Form 2162 (or

equivalent) , and provide the report to the Contracting Officer Representative within 5 calendar days of the accident. The Contracting Officer Representative will provide copies of any required or special forms.

- C. A summation of all man-hours worked by the contractor and associated sub-contractors for each month will be reported to the Contracting Officer Representative monthly.
- D. A summation of all Minor, Moderate, and Major incidents experienced on site by the contractor and associated sub-contractors for each month will be provided to the Contracting Officer Representative monthly. The contractor and associated sub-contractors' OSHA 300 logs will be made available to the Contracting Officer Representative as requested.

1.11 PERSONAL PROTECTIVE EQUIPMENT (PPE) :

- A. PPE is governed in all areas by the nature of the work the employee is performing. For example, specific PPE required for performing work on electrical equipment is identified in NFPA 70E, Standard for Electrical Safety in the Workplace.
- B. Mandatory PPE includes:
 - 1. Hard Hats - unless written authorization is given by the Contracting Officer Representative in circumstances of work operations that have limited potential for falling object hazards such as during finishing work or minor remodeling. With authorization to relax the requirement of hard hats, if a worker becomes exposed to an overhead falling object hazard, then hard hats would be required in accordance with the OSHA regulations.
 - 2. Safety glasses - unless written authorization is given by the Contracting Officer Representative in circumstances of no eye hazards, appropriate safety glasses meeting the ANSI Z.87.1 standard must be worn by each person on site.
 - 3. Appropriate Safety Shoes - based on the hazards present, safety shoes meeting the requirements of ASTM F2413-11 shall be worn by each person on site unless written authorization is given by the

Contracting Officer Representative in circumstances of no foot hazards.

4. Hearing protection - Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks.

1.12 INFECTION CONTROL

- A. Infection Control is critical in all medical center facilities. Interior construction activities causing disturbance of existing dust, or creating new dust, must be conducted within ventilation-controlled areas that minimize the flow of airborne particles into patient areas. Exterior construction activities causing disturbance of soil or creates dust in some other manner must be controlled.

- B. An AHA associated with infection control will be performed by VA personnel in accordance with FGI Guidelines (i.e. Infection Control Risk Assessment (ICRA)). The ICRA procedure found on the American Society for Healthcare Engineering (ASHE) website will be utilized. Risk classifications of Class II or lower will require approval by the Contracting Officer Representative before beginning any construction work. Risk classifications of Class III or higher will require a permit before beginning any construction work. Infection Control permits will be issued by the COR. The Infection Control Permits will be posted outside the appropriate construction area. More than one permit may be issued for a construction project if the work is located in separate areas requiring separate classes. The primary project scope area for this project is: **Class [_____]**, however, work outside the primary project scope area may vary. The required infection control precautions with each class are as follows:

1. Class I requirements:

- a. During Construction Work:
 - 1) Notify the Contracting Officer Representative
 - 2) Execute work by methods to minimize raising dust from construction operations.
 - 3) Ceiling tiles: Immediately replace a ceiling tiles displaced for visual inspection.
 - b. Upon Completion:
 - 1) Clean work area upon completion of task
 - 2) Notify the Contracting Officer Representative
2. Class II requirements:
- a. During Construction Work:
 - 1) Notify the Contracting Officer Representative
 - 2) Provide active means to prevent airborne dust from dispersing into atmosphere such as wet methods or tool mounted dust collectors where possible.
 - 3) Water mist work surfaces to control dust while cutting.
 - 4) Seal unused doors with duct tape.
 - 5) Block off and seal air vents.
 - 6) Remove or isolate HVAC system in areas where work is being performed.
 - b. Upon Completion:
 - 1) Wipe work surfaces with cleaner/disinfectant.
 - 2) Contain construction waste before transport in tightly covered containers.
 - 3) Wet mop and/or vacuum with HEPA filtered vacuum before leaving work area.
 - 4) Upon completion, restore HVAC system where work was performed

5) Notify the Contracting Officer Representative

3. Class III requirements:

a. During Construction Work:

- 1) Obtain permit from the Contracting Officer Representative
- 2) Remove or Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non-work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.
- 5) Contain construction waste before transport in tightly covered containers.
- 6) Cover transport receptacles or carts. Tape covering unless solid lid.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the Contracting Officer Representative and thoroughly cleaned by the VA Environmental Services Department.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Vacuum work area with HEPA filtered vacuums.

- 4) Wet mop area with cleaner/disinfectant.
- 5) Upon completion, restore HVAC system where work was performed.
- 6) Return permit to the Contracting Officer Representative

4. Class IV requirements:

a. During Construction Work:

- 1) Obtain permit from the Resident Engineer Project Manager and Facility Safety Manager Officer or Contracting Officer Representative or Government Designated Authority
- 2) Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.
- 5) Seal holes, pipes, conduits, and punctures.
- 6) Construct anteroom and require all personnel to pass through this room so they can be vacuumed using a HEPA vacuum cleaner before leaving work site or they can wear cloth or paper coveralls that are removed each time they leave work site.
- 7) All personnel entering work site are required to wear shoe covers. Shoe covers must be changed each time the worker exits the work area.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the Contracting Officer Representative with thorough cleaning by the VA Environmental Services Dept.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Contain construction waste before transport in tightly covered containers.
- 4) Cover transport receptacles or carts. Tape covering unless solid lid.
- 5) Vacuum work area with HEPA filtered vacuums.
- 6) Wet mop area with cleaner/disinfectant.
- 7) Upon completion, restore HVAC system where work was performed.
- 8) Return permit to the Contracting Officer Representative

C. Barriers shall be erected as required based upon classification (Class III & IV requires barriers) and shall be constructed as follows:

1. Class III and IV - closed door with masking tape applied over the frame and door is acceptable for projects that can be contained in a single room.
2. Construction, demolition or reconstruction not capable of containment within a single room must have the following barriers erected and made presentable on hospital occupied side:
 - a. Class III & IV (where dust control is the only hazard, and an agreement is reached with the Resident Engineer and Medical Center) - Airtight plastic barrier that extends from the floor to ceiling. Seams must be sealed with duct tape to prevent dust and debris from escaping
 - b. Class III & IV - Drywall barrier erected with joints covered or sealed to prevent dust and debris from escaping.

- c. Class III & IV - Seal all penetrations in existing barrier airtight
- d. Class III & IV - Barriers at penetration of ceiling envelopes, chases and ceiling spaces to stop movement air and debris
- e. Class IV only - Anteroom or double entrance openings that allow workers to remove protective clothing or vacuum off existing clothing
- f. Class III & IV - At elevators shafts or stairways within the field of construction, overlapping flap minimum of two feet wide of polyethylene enclosures for personnel access.

D. Products and Materials:

1. Sheet Plastic: Fire retardant polystyrene, 6-mil thickness meeting local fire codes
2. Barrier Doors: Self Closing One-hour solid core wood in steel frame, painted
3. Dust proof one-hour drywall
4. High Efficiency Particulate Air-Equipped filtration machine rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. HEPA filters should have ASHRAE 85 or other prefilter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Maintenance of equipment and replacement of the HEPA filters and other filters will be in accordance with manufacturer's instructions.
5. Exhaust Hoses: Heavy duty, flexible steel reinforced; Ventilation Blower Hose
6. Adhesive Walk-off Mats: Provide minimum size mats of 24 inches x 36 inches
7. Disinfectant: Hospital-approved disinfectant or equivalent product
8. Portable Ceiling Access Module

- E. Before any construction on site begins, all contractor personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- F. A dust control program will be establish and maintained as part of the contractor's infection preventive measures in accordance with the FGI Guidelines for Design and Construction of Healthcare Facilities. Prior to start of work, prepare a plan detailing project-specific dust protection measures with associated product data, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- G. Medical center Infection Control personnel will monitor for airborne disease (e.g. aspergillosis) during construction. A baseline of conditions will be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality with safe thresholds established.
- H. In general, the following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. HEPA filtration is required where the exhaust dust may reenter the medical center.
 2. Exhaust hoses shall be exhausted so that dust is not reintroduced to the medical center.
 3. Adhesive Walk-off/Carpet Walk-off Mats shall be used at all interior transitions from the construction area to occupied medical center area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.
 4. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently.

Remove debris as it is created. Transport these outside the construction area in containers with tightly fitting lids.

5. The contractor shall not haul debris through patient-care areas without prior approval of the Resident Engineer and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
6. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
7. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

I. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

J. Exterior Construction

1. Contractor shall verify that dust will not be introduced into the medical center through intake vents, or building openings. HEPA filtration on intake vents is required where dust may be introduced.

2. Dust created from disturbance of soil such as from vehicle movement will be wetted with use of a water truck as necessary
3. All cutting, drilling, grinding, sanding, or disturbance of materials shall be accomplished with tools equipped with either local exhaust ventilation (i.e. vacuum systems) or wet suppression controls.

1.13 TUBERCULOSIS SCREENING

- A. Contractor shall provide written certification that all contract employees assigned to the work site have had a pre-placement tuberculin screening within 90 days prior to assignment to the worksite and been found have negative TB screening reactions. Contractors shall be required to show documentation of negative TB screening reactions for any additional workers who are added after the 90-day requirement before they will be allowed to work on the work site. NOTE: This can be the Center for Disease Control (CDC) and Prevention and two-step skin testing or a Food and Drug Administration (FDA)-approved blood test.
 1. Contract employees manifesting positive screening reactions to the tuberculin shall be examined according to current CDC guidelines prior to working on VHA property.
 2. Subsequently, if the employee is found without evidence of active (infectious) pulmonary TB, a statement documenting examination by a physician shall be on file with the employer (construction contractor), noting that the employee with a positive tuberculin screening test is without evidence of active (infectious) pulmonary TB.
 3. If the employee is found with evidence of active (infectious) pulmonary TB, the employee shall require treatment with a subsequent statement to the fact on file with the employer before being allowed to return to work on VHA property.

1.14 FIRE SAFETY

- A. Fire Safety Plan: Establish and maintain a site-specific fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to Contracting Officer Representative for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. This plan may be an element of the Accident Prevention Plan.
- B. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- C. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- D. Temporary Construction Partitions:
 - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas the areas that are described in phasing requirements and adjoining areas. Construct partitions of gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on both sides of fire retardant treated wood or metal steel studs. Extend the partitions through suspended ceilings to floor slab deck or roof. Seal joints and penetrations. At door openings, install Class C, $\frac{3}{4}$ hour fire/smoke rated doors with self-closing devices.
 - 2. Install one-hour temporary construction partitions as shown on drawings to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.

3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- E. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with Contracting Officer Representative .
- G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to Contracting Officer Representative .
- H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
- J. Standpipes: Install and extend standpipes up with each floor in accordance with 29 CFR 1926 and NFPA 241. Do not charge wet standpipes subject to freezing until weather protected.
- K. Sprinklers: Install, test and activate new automatic sprinklers prior to removing existing sprinklers.
- L. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with Contracting Officer Representative . All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed

shall be recorded by the medical center and copies provided to the Resident Engineer.

- M. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with Contracting Officer Representative .

- N. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with Resident Engineer Facility Safety Office . Obtain permits from COR at least 48 hours in advance . Designate contractor's responsible project-site fire prevention program manager to permit hot work.

- O. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to Contracting Officer Representative .

- P. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction. In separate and detached buildings under construction, smoking is prohibited except in designated smoking rest areas.

- Q. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily.

- R. If required, submit documentation to the COR that personnel have been trained in the fire safety aspects of working in areas with impaired structural or compartmentalization features.

1.15 ELECTRICAL

- A. All electrical work shall comply with NFPA 70 (NEC), NFPA 70B, NFPA 70E, 29 CFR Part 1910 Subpart J - General Environmental Controls, 29 CFR Part 1910 Subpart S - Electrical, and 29 CFR 1926 Subpart K in addition to other references required by contract.

- B. All qualified persons performing electrical work under this contract shall be licensed journeyman or master electricians. All apprentice electricians performing under this contract shall be deemed unqualified

persons unless they are working under the immediate supervision of a licensed electrician or master electrician.

C. All electrical work will be accomplished de-energized and in the Electrically Safe Work Condition (refer to NFPA 70E for Work Involving Electrical Hazards, including Exemptions to Work Permit). Any Contractor, subcontractor or temporary worker who fails to fully comply with this requirement is subject to immediate termination in accordance with FAR clause 52.236-5(c). Only in rare circumstance where achieving an electrically safe work condition prior to beginning work would increase or cause additional hazards, or is infeasible due to equipment design or operational limitations is energized work permitted. The Contracting Officer Representative with approval of the Medical Center Director will make the determination if the circumstances would meet the exception outlined above. An AHA and permit specific to energized work activities will be developed, reviewed, and accepted by the VA prior to the start of that activity.

1. Development of a Hazardous Electrical Energy Control Procedure is required prior to de-energization. A single Simple Lockout/Tagout Procedure for multiple work operations can only be used for work involving qualified person(s) de-energizing one set of conductors or circuit part source. Task specific Complex Lockout/Tagout Procedures are required at all other times.
2. Verification of the absence of voltage after de-energization and lockout/tagout is considered "energized electrical work" (live work) under NFPA 70E, and shall only be performed by qualified persons wearing appropriate shock protective (voltage rated) gloves and arc rate personal protective clothing and equipment, using Underwriters Laboratories (UL) tested and appropriately rated contact electrical testing instruments or equipment appropriate for the environment in which they will be used.
3. Personal Protective Equipment (PPE) and electrical testing instruments will be readily available for inspection by the The Contracting Officer Representative .

- D. Before beginning any electrical work, an Activity Hazard Analysis (AHA) will be conducted to include Shock Hazard and Arc Flash Hazard analyses (NFPA Tables can be used only as a last alternative and it is strongly suggested a full Arc Flash Hazard Analyses be conducted). Work shall not begin until the AHA for the work activity and permit for energized work has been reviewed and accepted by the Contracting Officer Representative and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
- E. Ground-fault circuit interrupters. GFCI protection shall be provided where an employee is operating or using cord- and plug-connected tools related to construction activity supplied by 125-volt, 15-, 20-, or 30-ampere circuits. Where employees operate or use equipment supplied by greater than 125-volt, 15-, 20-, or 30- ampere circuits, GFCI protection or an assured equipment grounding conductor program shall be implemented in accordance with NFPA 70E - 2015, Chapter 1, Article 110.4(C) (2)..

1.16 FALL PROTECTION

- A. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) for ALL WORK, unless specified differently or the OSHA 29 CFR 1926 requirements are more stringent, to include steel erection activities, systems-engineered activities (prefabricated) metal buildings, residential (wood) construction and scaffolding work.
1. The use of a Safety Monitoring System (SMS) as a fall protection method is prohibited.
 2. The use of Controlled Access Zone (CAZ) as a fall protection method is prohibited.
 3. A Warning Line System (WLS) may ONLY be used on floors or flat or low-sloped roofs (between 0 - 18.4 degrees or 4:12 slope) and shall be erected around all sides of the work area (See 29 CFR 1926.502(f) for construction of WLS requirements). Working within the WLS does not require FP. No worker shall be allowed in the area between the roof or floor edge and the WLS without FP. FP is required when working outside the WLS.

4. Fall protection while using a ladder will be governed by the OSHA requirements.

1.17 SCAFFOLDS AND OTHER WORK PLATFORMS

- A. All scaffolds and other work platforms construction activities shall comply with 29 CFR 1926 Subpart L.
- B. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) as stated in Section 1.16.
- C. The following hierarchy and prohibitions shall be followed in selecting appropriate work platforms.
 1. Scaffolds, platforms, or temporary floors shall be provided for all work except that can be performed safely from the ground or similar footing.
 2. Ladders less than 20 feet may be used as work platforms only when use of small hand tools or handling of light material is involved.
 3. Ladder jacks, lean-to, and prop-scaffolds are prohibited.
 4. Emergency descent devices shall not be used as working platforms.
- D. Contractors shall use a scaffold tagging system in which all scaffolds are tagged by the Competent Person. Tags shall be color-coded: green indicates the scaffold has been inspected and is safe to use; red indicates the scaffold is unsafe to use. Tags shall be readily visible, made of materials that will withstand the environment in which they are used, be legible and shall include:
 1. The Competent Person's name and signature;
 2. Dates of initial and last inspections.
- E. Mast Climbing work platforms: When access ladders, including masts designed as ladders, exceed 20 ft (6 m) in height, positive fall protection shall be used.

1.18 EXCAVATION AND TRENCHES

- A. All excavation and trenching work shall comply with 29 CFR 1926 Subpart P. Excavations less than 5 feet in depth require evaluation by the contractor's "Competent Person" (CP) for determination of the necessity

of an excavation protective system where kneeing, laying in, or stooping within the excavation is required.

B. All excavations and trenches 24 inches in depth or greater shall require a written trenching and excavation permit (NOTE - some States and other local jurisdictions require separate state/jurisdiction-issued excavation permits). The permit shall have two sections, one section will be completed prior to digging or drilling and the other will be completed prior to personnel entering the excavations greater than 5 feet in depth. Each section of the permit shall be provided to the COR prior to proceeding with digging or drilling and prior to proceeding with entering the excavation. After completion of the work and prior to opening a new section of an excavation, the permit shall be closed out and provided to the COR . The permit shall be maintained onsite and the first section of the permit shall include the following:

1. Estimated start time & stop time.
2. Specific location and nature of the work.
2. Indication of the contractor's "Competent Person" (CP) in excavation safety with qualifications and signature. Formal course in excavation safety is required by the contractor's CP.
3. Indication of whether soil or concrete removal to an offsite location is necessary.
4. Indication of whether soil samples are required to determined soil contamination.
5. Indication of coordination with local authority (i.e. "One Call") or contractor's effort to determine utility location with search and survey equipment.
6. Indication of review of site drawings for proximity of utilities to digging/drilling.

C. The second section of the permit for excavations greater than five feet in depth shall include the following:

1. Determination of OSHA classification of soil. Soil samples will be from freshly dug soil with samples taken from different soil type

- layers as necessary and placed at a safe distance from the excavation by the excavating equipment. A pocket penetrometer will be utilized in determination of the unconfined compression strength of the soil for comparison against OSHA table (Less than 0.5 Tons/FT² - Type C, 0.5 Tons/FT² to 1.5 Tons/FT² - Type B, greater than 1.5 Tons/FT² - Type A without condition to reduce to Type B).
2. Indication of selected protective system (sloping/benching, shoring, shielding). When soil classification is identified as "Type A" or "Solid Rock", only shoring or shielding or Professional Engineer designed systems can be used for protection. A Sloping/Benching system may only be used when classifying the soil as Type B or Type C. Refer to Appendix B of 29 CFR 1926, Subpart P for further information on protective systems designs.
 3. Indication of the spoil pile being stored at least 2 feet from the edge of the excavation and safe access being provided within 25 feet of the workers.
 4. Indication of assessment for a potential toxic, explosive, or oxygen deficient atmosphere where oxygen deficiency (atmospheres containing less than 19.5 percent oxygen) or a hazardous atmosphere exists or could reasonably be expected to exist. Internal combustion engine equipment is not allowed in an excavation without providing force air ventilation to lower the concentration to below OSHA PELs, providing sufficient oxygen levels, and atmospheric testing as necessary to ensure safe levels are maintained.
- D As required by OSHA 29 CFR 1926.651(b)(1), the estimated location of utility installations, such as sewer, telephone, fuel, electric, water lines, or any other underground installations that reasonably may be expected to be encountered during excavation work, shall be determined prior to opening an excavation.
1. The planned dig site will be outlined/marked in white prior to locating the utilities.
 2. Used of the American Public Works Association Uniform Color Code is required for the marking of the proposed excavation and located utilities.

3. 811 will be called two business days before digging on all local or State lands and public Right-of Ways.
 4. Digging will not commence until all known utilities are marked.
 5. Utility markings will be maintained
- E. Excavations will be hand dug or excavated by other similar safe and acceptable means as excavation operations approach within 3 to 5 feet of identified underground utilities. Exploratory bar or other detection equipment will be utilized as necessary to further identify the location of underground utilities.
- F. Excavations greater than 20 feet in depth require a Professional Engineer designed excavation protective system.

1.19 CRANES

- A. All crane work shall comply with 29 CFR 1926 Subpart CC.
- B. Prior to operating a crane, the operator must be licensed, qualified or certified to operate the crane. Thus, all the provisions contained with Subpart CC are effective and there is no "Phase In" date.
- C. A detailed lift plan for all lifts shall be submitted to the COR 14 days prior to the scheduled lift complete with route for truck carrying load, crane load analysis, siting of crane and path of swing and all other elements of a critical lift plan where the lift meets the definition of a critical lift. Critical lifts require a more comprehensive lift plan to minimize the potential of crane failure and/or catastrophic loss. The plan must be reviewed and accepted by the General Contractor before being submitted to the VA for review. The lift will not be allowed to proceed without prior acceptance of this document.
- D. Crane operators shall not carry loads
 1. over the general public or VAMC personnel
 2. over any occupied building unless
 - a. the top two floors are vacated

- b. or overhead protection with a design live load of 300 psf is provided

1.20 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)

- A. All installation, maintenance, and servicing of equipment or machinery shall comply with 29 CFR 1910.147 except for specifically referenced operations in 29 CFR 1926 such as concrete & masonry equipment [1926.702(j)], heavy machinery & equipment [1926.600(a)(3)(i)], and process safety management of highly hazardous chemicals (1926.64). Control of hazardous electrical energy during the installation, maintenance, or servicing of electrical equipment shall comply with Section 1.15 to include NFPA 70E and other VA specific requirements discussed in the section.

1.21 CONFINED SPACE ENTRY

- A. All confined space entry shall comply with 29 CFR 1926, Subpart AA except for specifically referenced operations in 29 CFR 1926 such as excavations/trenches [1926.651(g)].
- B. A site-specific Confined Space Entry Plan (including permitting process) shall be developed and submitted to the COR.

1.22 WELDING AND CUTTING

As specified in section 1.14, Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR at least 24 hours in advance . Designate contractor's responsible project-site fire prevention program manager to permit hot work.

1.23 LADDERS

- A. All Ladder use shall comply with 29 CFR 1926 Subpart X.
- B. All portable ladders shall be of sufficient length and shall be placed so that workers will not stretch or assume a hazardous position.
- C. Manufacturer safety labels shall be in place on ladders
- D. Step Ladders shall not be used in the closed position
- E. Top steps or cap of step ladders shall not be used as a step

- F. Portable ladders, used as temporary access, shall extend at least 3 ft (0.9 m) above the upper landing surface.
1. When a 3 ft (0.9-m) extension is not possible, a grasping device (such as a grab rail) shall be provided to assist workers in mounting and dismounting the ladder.
 2. In no case shall the length of the ladder be such that ladder deflection under a load would, by itself, cause the ladder to slip from its support.
- G. Ladders shall be inspected for visible defects on a daily basis and after any occurrence that could affect their safe use. Broken or damaged ladders shall be immediately tagged "DO NOT USE," or with similar wording, and withdrawn from service until restored to a condition meeting their original design.

1.24 FLOOR & WALL OPENINGS

- A. All floor and wall openings shall comply with 29 CFR 1926 Subpart M.
- B. Floor and roof holes/openings are any that measure over 2 in (51 mm) in any direction of a walking/working surface which persons may trip or fall into or where objects may fall to the level below. Skylights located in floors or roofs are considered floor or roof hole/openings.
- C. All floor, roof openings or hole into which a person can accidentally walk or fall through shall be guarded either by a railing system with toeboards along all exposed sides or a load-bearing cover. When the cover is not in place, the opening or hole shall be protected by a removable guardrail system or shall be attended when the guarding system has been removed, or other fall protection system.
1. Covers shall be capable of supporting, without failure, at least twice the weight of the worker, equipment and material combined.
 2. Covers shall be secured when installed, clearly marked with the word "HOLE", "COVER" or "Danger, Roof Opening-Do Not Remove" or color-coded or equivalent methods (e.g., red or orange "X"). Workers must be made aware of the meaning for color coding and equivalent methods.

3. Roofing material, such as roofing membrane, insulation or felts, covering or partly covering openings or holes, shall be immediately cut out. No hole or opening shall be left unattended unless covered.
4. Non-load-bearing skylights shall be guarded by a load-bearing skylight screen, cover, or railing system along all exposed sides.
5. Workers are prohibited from standing/walking on skylights.

- - - E N D - - -

**SECTION 01 42 19
REFERENCE STANDARDS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS
Office of Construction & Facilities Management
Facilities Quality Service (00CFM1A)
425 Eye Street N.W, (sixth floor)
Washington, DC 20001
Telephone Numbers: (202) 632-5249 or (202) 632-5178
Between 9:00 AM - 3:00 PM

1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

- AA Aluminum Association Inc.
<http://www.aluminum.org>
- AABC Associated Air Balance Council
<http://www.aabchq.com>
- AAMA American Architectural Manufacturer's Association
<http://www.aamanet.org>
- AASHTO American Association of State Highway and Transportation
Officials
<http://www.aashto.org>
- AATCC American Association of Textile Chemists and Colorists
<http://www.aatcc.org>
- ACGIH American Conference of Governmental Industrial Hygienists
<http://www.acgih.org>
- ACI American Concrete Institute
<http://www.aci-int.net>
- ACPA American Concrete Pipe Association
<http://www.concrete-pipe.org>
- ACPPA American Concrete Pressure Pipe Association
<http://www.acppa.org>
- ADC Air Diffusion Council
<http://flexibleduct.org>
- AGA American Gas Association
<http://www.aga.org>
- AGC Associated General Contractors of America
<http://www.agc.org>

AGMA	American Gear Manufacturers Association, Inc. http://www.agma.org
AH	American Hort https://www.americanhort.org
AHAM	Association of Home Appliance Manufacturers http://www.aham.org
AIA	American Institute of Architects http://www.aia.org
AISC	American Institute of Steel Construction http://www.aisc.org
AISI	American Iron and Steel Institute http://www.steel.org
AITC	American Institute of Timber Construction https://aitc-glulam.org
AMCA	Air Movement and Control Association, Inc. http://www.amca.org
ANSI	American National Standards Institute, Inc. http://www.ansi.org
APA	The Engineered Wood Association http://www.apawood.org
ARI	Air-Conditioning and Refrigeration Institute http://www.ari.org
ARPM	Association for Rubber Product Manufacturers https://arpm.com
ASABE	American Society of Agricultural and Biological Engineers https://www.asabe.org
ASCE	American Society of Civil Engineers http://www.asce.org

ASHRAE	American Society of Heating, Refrigerating, and Air-Conditioning Engineers http://www.ashrae.org
ASME	American Society of Mechanical Engineers http://www.asme.org
ASSE	American Society of Sanitary Engineering International http://www.asse-plumbing.org
ASTM	American Society for Testing and Materials International http://www.astm.org
AWI	Architectural Woodwork Institute https://www.awinet.org
AWS	American Welding Society https://www.aws.org
AWWA	American Water Works Association https://www.awwa.org
BHMA	Builders Hardware Manufacturers Association https://www.buildershardware.com
BIA	The Brick Industry Association http://www.gobrick.com
CAGI	Compressed Air and Gas Institute https://www.cagi.org
CGA	Compressed Gas Association, Inc. https://www.cganet.com
CI	The Chlorine Institute, Inc. https://www.chlorineinstitute.org
CISCA	Ceilings and Interior Systems Construction Association https://www.cisca.org
CISPI	Cast Iron Soil Pipe Institute https://www.cispi.org

CLFMI	Chain Link Fence Manufacturers Institute https://www.chainlinkinfo.org
CPA	Composite Panel Association https://www.compositepanel.org
CPMB	Concrete Plant Manufacturers Bureau https://www.cpmc.org
CRA	California Redwood Association http://www.calredwood.org
CRSI	Concrete Reinforcing Steel Institute https://www.crsi.org
CTI	Cooling Technology Institute https://www.cti.org
DHA	Decorative Hardwoods Association https://www.decorativehardwood.org
DHI	Door and Hardware Institute https://www.dhi.org
EGSA	Electrical Generating Systems Association http://www.egsa.org
EEI	Edison Electric Institute https://www.eei.org
EPA	United States Environmental Protection Agency https://www.epa.gov
ETL	ETL Testing Services http://www.intertek.com
FAA	Federal Aviation Administration https://www.faa.gov
FCC	Federal Communications Commission https://www.fcc.gov

FPS	Forest Products Society http://www.forestprod.org
GANNA	Glass Association of North America http://www.glasswebsite.com
FM	Factory Mutual Global Insurance https://www.fmglobal.com
GA	Gypsum Association https://gypsum.org
GSA	General Services Administration https://www.gsa.gov
HI	Hydraulic Institute http://www.pumps.org
ICC	International Code Council https://shop.iccsafe.org
ICEA	Insulated Cable Engineers Association https://www.icea.net
ICAC	Institute of Clean Air Companies http://www.icac.com
IEEE	Institute of Electrical and Electronics Engineers https://www.ieee.org/
IGMA	Insulating Glass Manufacturers Alliance https://www.igmaonline.org
IMSA	International Municipal Signal Association http://www.imsasafety.org
MBMA	Metal Building Manufacturers Association https://www.mbma.com
MSS	Manufacturers Standardization Society of the Valve and Fittings Industry http://msshq.org

NAAMM National Association of Architectural Metal Manufacturers
<https://www.naamm.org>

PHCC Plumbing-Heating-Cooling Contractors Association
<https://www.phccweb.org>

NBS National Bureau of Standards
See - NIST

NBBI The National Board of Boiler and Pressure Vessel Inspectors
<https://www.nationalboard.org>

NEC National Electric Code
See - NFPA National Fire Protection Association

NEMA National Electrical Manufacturers Association
<https://www.nema.org>

NFPA National Fire Protection Association
<https://www.nfpa.org>

NHLA National Hardwood Lumber Association
<https://www.nhla.com>

NIH National Institute of Health
<https://www.nih.gov>

NIST National Institute of Standards and Technology
<https://www.nist.gov>

NELMA Northeastern Lumber Manufacturers Association, Inc.
<http://www.nelma.org>

NPA National Particleboard Association
(See CPA, Composite Panel Association)

NSF National Sanitation Foundation
<http://www.nsf.org>

OSHA Occupational Safety and Health Administration
Department of Labor
<https://www.osha.gov>

PCA	Portland Cement Association https://www.cement.org
PCI	Precast Prestressed Concrete Institute https://www.pci.org
PPI	Plastics Pipe Institute https://www.plasticpipe.org
PEI	Porcelain Enamel Institute http://www.porcelainenamel.com
PTI	Post-Tensioning Institute http://www.post-tensioning.org
RFCI	Resilient Floor Covering Institute https://www.rfci.com
RIS	Redwood Inspection Service (See Western Wood Products Association) https://www.wwpa.org
SCMA	Southern Cypress Manufacturers Association http://www.cypressinfo.org
SDI	Steel Door Institute http://www.steeldoor.org
SJI	Steel Joist Institute https://www.steeljoist.org
SMACNA	Sheet Metal & Air-Conditioning Contractors' National Association https://www.smacna.org
SSPC	The Society for Protective Coatings https://www.sspc.org
STI	Steel Tank Institute https://www.steeltank.com
SWI	Steel Window Institute https://www.steelwindows.com

TCNA Tile Council of North America

<https://www.tcnatile.com>

TEMA Tubular Exchanger Manufacturers Association

<http://www.tema.org>

TPI Truss Plate Institute

<https://www.tpinst.org>

UBC The Uniform Building Code
(See ICC)

UL Underwriters' Laboratories Incorporated

<https://www.ul.com>

ULC Underwriters' Laboratories of Canada

<https://www.ulc.ca>

WCLB West Coast Lumber Inspection Bureau

<http://www.wclib.org>

WDMA Window and Door Manufacturers Association

<https://www.wdma.com>

WRCLA Western Red Cedar Lumber Association

<https://www.realcedar.com>

WWPA Western Wood Products Association

<http://www.wwpa.org>

- - - E N D - - -

SECTION 01 45 00
QUALITY CONTROL

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies requirements for Contractor Quality Control (CQC) for Design-Bid-Build (DBB) construction projects. This section can be used for both project types.

1.2 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.
- B. ASTM International (ASTM)
 - 1. D3740 - (2012a) Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction
 - 2. E329 - (2014a) Standard Specification for Agencies Engaged in the Testing and/or Inspection of Materials Used in Construction

1.3 SUBMITTALS

Government approval is required for all submittals. CQC inspection reports shall be submitted under this Specification section and follow the Applicable CQC Control Phase (Preparatory, Initial, or Follow-Up): Applicable Specification section naming convention.

- 1. Preconstruction Submittals
 - a. Interim CQC Plan
 - b. CQC Plan
 - c. Additional Requirements for Design Quality Control (DQC) Plan
- 2. Design Data
 - a. Discipline-Specific Checklists
 - b. Design Quality Control
- 3. Test Reports
 - a. Verification Statement

PART 2 PRODUCTS - NOT USED

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

Establish and maintain an effective quality control (QC) system. that complies with the FAR Clause 52.246.12 titled "Inspection of Construction". QC consists of plans, procedures, and organization necessary to produce an end product which complies with the Contract requirements. The QC system covers all design and construction operations, both onsite and offsite, and be keyed to the proposed design and construction sequence. The project superintendent will be held responsible for the quality of work and is subject to removal by the Contracting Office or Authorized designee for non-compliance with the quality requirements specified in the Contract. In this context the highest level manager responsible for the overall construction activities at the site, including quality and production is the project superintendent. The project superintendent maintains a physical presence at the site at all times and is responsible for all construction and related activities at the site, except as otherwise acceptable to the Contracting Officer.

3.2 CQC PLAN:

- A. Submit the CQC Plan no later than CO or Designee to determine during Constructability review -30 days after receipt of Notice to Proceed (NTP) proposed to implement the requirements of the FAR Clause 52.246.12 titled "Inspection of Construction". The Government will consider an Interim CQC Plan for the first to match timeline established immediately above days of operation, which must be accepted within 10 business days of NTP. Design and/or construction will be permitted to begin only after acceptance of the CQC Plan or acceptance of an Interim plan applicable to the particular feature of work to be started. Work outside of the accepted Interim CQC Plan will not be permitted to begin until acceptance of a CQC Plan or another Interim CQC Plan containing the additional work scope is accepted.
- B. Content of the CQC Plan: Include, as a minimum, the following to cover all design and construction operations, both onsite and offsite, including work by subcontractors, designers of record consultants,

architects/engineers (A/E), fabricators, suppliers, and purchasing agents:

1. A description of the QC organization, including a chart showing lines of authority and acknowledgement that the CQC staff will implement the three phase control system for all aspects of the work specified. Include a CQC System Manager that reports to the project superintendent.
2. The name, qualifications (in resume format) duties, responsibilities, and authorities of each person assigned a CQC function.
3. A copy of the letter to the CQC System Manager signed by an authorized official of the firm which describes the responsibilities and delegates sufficient authorities to adequately perform the functions of the CQC System Manager, including authority to stop work which is not in compliance with the Contract. Letters of direction to all other various quality control representatives outlining duties, authorities, and responsibilities will to the Contracting Officer or Authorized designee. be issued by the CQC System Manager. Furnish copies of these letters
4. Procedures for scheduling, reviewing, certifying, and managing submittals including those of subcontractors, designers of record, consultants, A/E's offsite fabricators, suppliers and purchasing agents. These procedures must be in accordance with Section 01 33 23 Shop Drawings, Product Data, and Samples.
5. Control, verification, and acceptance of testing procedures for each specific test to include the test name, specification paragraph requiring test, feature of work to be tested, test frequency, and person responsible for each test. (Laboratory facilities approved by the Contracting Officer or Authorized designee are required to be used)
6. Procedures for tracking Preparatory, Initial, and Follow-Up control phases and control, verification, and acceptance tests including documentation.
7. Procedures for tracking design and construction deficiencies from identification through acceptable corrective action. Establish verification procedures that identified deficiencies have been corrected.

8. Reporting procedures, including proposed reporting formats.
 9. A list of the definable features of work. A definable feature of work is a task which is separate and distinct from other tasks has separate control requirements, and is identified by different trades or disciplines, or it is work by the same trade in a different environment. Although each section of specifications can generally be considered as a definable feature of work, there are frequently more than one definable feature under a particular section. This list will be agreed upon during the Coordination meeting.
 10. Coordinate schedule work with Special Inspections required by Section 01 45 35 Special Inspections, the Statement of Special Inspections and Schedule of Special Inspections. Where the applicable Code issue by the International Code Council (ICC) calls for inspections by the Building Official, the Contractor must include the inspections in the CQC Plan and must perform the inspections required by the applicable ICC. The Contractor must perform these inspections using independent qualified inspectors. Include the Special Inspection Plan requirements in the CQC Plan.
- C. Additional Requirements for Design Quality Control (DQC) Plan: The following additional requirements apply to the DQC Plan for DB projects only and not DBB projects:
1. Submit and maintain a DQC Plan as an effective QC program which assures that all services required by this contract are performed and provided in a manner that meets professional architectural and engineering quality standards. As a minimum, all documents must be technically reviewed by competent, independent reviewers identified in the DQC Plan. The same element that produced the product may not perform the independent technical review (ITR). Correct errors and deficiencies in the design documents prior to submitting them to the Government.
 2. Include the design schedule in the master project schedule, showing the sequence of events involved in carrying out the project design tasks within the specific Contract period. This should be at a detailed level of scheduling sufficient to identify all major design tasks, including those that control the flow of work. Include review and correction periods associated with each item. This should be a forward planning as well as a project monitoring tool. The schedule

reflects calendar days and not dates for each activity. If the schedule is changed, submit a revised schedule reflecting the change within 7 calendar days. Include in the DQC Plan the discipline-specific checklists to be used during the design and quality control of each submittal. Submit at each design phase as part of the project documentation these completed discipline-specific checklists.

3. Implement the DQC Plan by a DQC Manager who has the responsibility of being cognizant of and assuring that all documents on the project have been coordinated. This individual must be a person who has verifiable engineering or architectural design experience and is a Professional Engineer or Registered Architect within the state of Construction location. Notify the Contracting Officer or Authorized designee, in writing, of the name of the individual, and the name of an alternate person assigned to the position.

D. Acceptance of Plan: Acceptance of the Contractor's plan is required prior to the start of design and construction. Acceptance is conditional and will be predicated on satisfactory performance during the design and construction. The Government reserves the right to require the Contractor to make changes in the CQC Plan and operations including removal of personnel as necessary, to obtain the quality specified.

E. Notification of Changes: After acceptance of the CQC Plan, notify the Contracting Officer or Authorized designee in writing of any proposed change. Proposed changes are subject to acceptance by the Government prior to implementation by the Contractor.

3.3 COORDINATION MEETING:

After the Preconstruction Conference Post-award Conference before start of design or construction, and prior to acceptance by the Government of the CQC Plan, meet with the Contracting Officer or Authorized designee to discuss the Contractor's quality control system. Submit the CQC Plan a minimum of 5 business days prior to the Coordination Meeting.

During the meeting, a mutual understanding of the system details must be developed, including the forms for recording the CC operations, design activities (if applicable), control activities, testing,

administration of the system for both onsite and offsite work, and the interrelationship of Contractor's Management and control with the Government's Quality Assurance. Minutes of the meeting will be prepared by the Government, signed by both the Contractor and Contracting Officer or Authorized designee and will become a part of the contract file. There can be occasions when subsequent conferences will be called by either party to reconfirm mutual understandings or address deficiencies in the CQC system or procedures which can require corrective action by the Contractor.

3.4 QUALITY CONTROL ORGANIZATION:

- A. Personnel Requirements: The requirements for the CQC organization are a Safety and Health Manager, CQC System Manager, a Design Quality Manager (if applicable), and sufficient number of additional qualified personnel to ensure safety and Contract compliance. The Safety and Health Manager shall satisfy the requirements of Specification 01 35 26 Safety Requirements and reports directly to a senior project (or corporate) official independent from the CQC System Manager. The Safety and Health Manager will also serve as a member of the CQC Staff. Personnel identified in the technical provisions as requiring specialized skills to assure the required work is being performed properly will also be included as part of the CQC organization. The Contractor's CQC staff maintains a presence at the site at all times during progress of the work and have complete authority and responsibility to take any action necessary to ensure Contract compliance. The CQC staff will be subject to acceptance by the Contracting Officer or Authorized designee. Provide adequate office space, filing systems, and other resources as necessary to maintain an effective and fully functional CQC organization. Promptly complete and furnish all letters, material submittals, shop drawings submittals, schedules and all other project documentation to the CQC organization. The CQC organization is responsible to maintain these documents and records at the site at all times, except as otherwise acceptable to the Government.
- B. CQC System Manager: Identify as CQC System Manager an individual within the onsite work organization that is responsible for overall management of CQC and has the authority to act in all CQC matters for the

Contractor. The CQC system Manager is required to be a graduate engineer, graduate architect, or a graduate of construction management, with a minimum of PM or SRE to determine qualifications based on project complexity at construction review years construction experience on construction similar to the scope of this Contract. construction person with a minimum of PM or SRE to determine qualifications based on project complexity at construction review years in related work. This CQC System manager is on the site at all times during construction and is employed by the General Contractor. The CQC System Manger is assigned as CQC System Manager but has duties as project superintendent in addition to quality control. Identify in the plan an alternate to serve in the event of the CDQC System Manager's absence. The requirements for the alternate are the same as the CQC System Manager.

- C. CQC Personnel: In addition to CQC personnel specified elsewhere in the contract, provide as part of the CQC organization specialized personnel to assist in the CQC System Manager for the following areas, as applicable: electrical, mechanical, civil, structural, environmental, architectural, materials technician submittals clerk, Commissioning Agent/LEED specialist, and low voltage systems. These individuals or specified technical companies are directly employed by the General Contractor and cannot be employed by a supplier or subcontractor on this project are employees of the prime or subcontractor ; be responsible to the CQC System Manager; be physically present at the construction site during work on the specialized personnel's areas of responsibility; have the necessary education or experience in accordance with the Experience Matrix listed herein. These individuals have no other duties other than quality control. can perform other duties but need to be allowed sufficient time to perform the specialized personnel's assigned quality controls duties as described in the CQC Plan. A single person can cover more than one area provided that the single person is qualified to perform QC activities in each designated and that workload allows.

EXPERIENCE MATRIX

Area	Qualifications
Civil	Graduate Civil Engineer or Construction Manager with 2 years experience in the type of work being performed on this project or technician with 5 years related experience.
Mechanical	Graduate Mechanical Engineer with 2 years experience or construction professional with 5 years of experience supervising mechanical features of work in the field with a construction company.
Electrical	Graduate Electrical Engineer with 2 years related experience or construction professional with 5 years of experience supervising electrical features of work in the field with a construction company.
Structural	Graduate Civil Engineer (with Structural Track or Focus), Structural Engineer, or Construction Manager with 2 years experience or construction professional with 5 years experience supervising structural features of work in the field with a construction company.
Architectural	Graduate Architect with 2 years experience or construction professional with 5 years of related experience.
Environmental	Graduate Environmental Engineer with 3 years experience.
Submittals	Submittal Clerk with 1 year experience.
Concrete, Pavement, and Soils	Materials Technician with 2 years experience for the appropriate area.
Testing, Adjusting, and Balancing (TAB)	Specialist must be a member of AABC or an experienced technician of the firm certified by the NEBB.
Design Quality Control Manager	Registered Architect or Professional Engineer

D. Additional Requirements: In addition to the above experience and education requirements, the CQC System Manager and Alternate CQC System Manager are required to have completed the Construction Quality Management (CQM) for Construction course. If the CQC System Manager does not have a current specification, obtain the CQM for Contractors course identification within 90 days of award. This course is

periodically offered by the Naval Facilities Engineering Command and the Army Corps of Engineers. Contact the Contracting Officer or Authorized designee for information on the next scheduled class.

- E. Organizational Changes: Maintain the CQC staff at full strength at all times. When it is necessary to make changes to the CQC staff, revise the CQC Plan to reflect the changes and submit the changes to the Contracting Officer or Authorized designee for acceptance.

3.5 SUBMITTALS AND DELIVERABLES: Submittals have to comply with the requirements in Section 01 33 23 Shop Drawings, Product Data, and Samples. The CQC organization is responsible for certifying that all submittals and deliverables are in compliance with the contract requirements. When Section 01 91 00 General Commissioning Requirements is included in the contract, the submittals required by the section have to be coordinated with the Section 01 33 23 Shop Drawings, Product Data, and Samples to ensure adequate time is allowed for each type of submittal required.

3.6 CONTROL:

- A. CQC is the means by which the Contractor ensures that the construction, to include that of subcontractors and suppliers, complies with the requirements of the contract. At least three phases of control are required to be conducted by the CQC System Manager for each definable feature of the construction work as follows:

1. Preparatory Phase: This phase is performed prior to beginning work on each definable feature of work after all required plans/documents/materials are approved/accepted, and after copies are at the work site. This phase includes:
 - a. A review of each paragraph of applicable specifications, references codes, and standards. Make available during the preparatory inspection a copy of those sections of referenced codes and standards applicable to that portion of the work to be accomplished in the field. Maintain and make available in the field for use by Government personnel until final acceptance of the work.
 - b. Review of the Contract drawings.
 - c. Check to assure that all materials and equipment have been tested, submitted, and approved.

- d. Review of provisions that have been made to provide required control inspection and testing.
 - e. Review Special Inspections required by Section 01 45 35 Special Inspections, that Statement of Special Inspections and the Schedule of Specials Inspections.
 - f. Examination of the work area to assure that all required preliminary work has been completed and is in compliance with the Contract.
 - g. Examination of required materials, equipment, and sample work to assure that they are on hand conform to approved shop drawings or submitted data, and are properly stored.
 - h. Review of the appropriate Activity Hazard Analysis (AHA) to assure safety requirements are met.
 - i. Discussion of procedures for controlling quality of the work including repetitive deficiencies. Document construction tolerances and workmanship standards - contract defined or industry standard if not contract defined - for that feature of work.
 - j. Check to ensure that the portion of the plan for the work to be performed has been accepted by the Contracting Officer.
 - k. Discussion of the initial control phase.
 - l. The Government needs to be notified at least 48 hours or 2 business days in advance of beginning the Preparatory control phase. Include a meeting conducted by the CQC System Manager and attended by the superintendent, other CQC personnel (as applicable), and the foreman responsible for the definable feature. Document the results of the Preparatory phase actions by separate minutes prepared by the CQC System Manager and attach to the daily CQC report. Instruct applicable workers as to the acceptable level of workmanship required in order to meet contract specifications.
- B. Initial Phase: This phase is accomplished at the beginning of a definable feature of work. Accomplish the following:
1. Check work to ensure that it is in full compliance with contract requirements. Review minutes of the Preparatory meeting.

2. Verify adequacy of controls to ensure full contract compliance.
Verify the required control inspection and testing is in compliance with the contract.
 3. Establish level of workmanship and verify that it meets minimum acceptable workmanship standards. Compare with required sample panels as appropriate.
 4. Resolve all differences.
 5. Check safety to include compliance with an upgrading of the safety plan and activity hazard analysis. Review the activity analysis with each worker.
 6. The Government needs to be notified at least 48 hours or 2 business days in advance of beginning the initial phase for definable features of work. Prepare separate minutes of this phase by the CQC System Manager and attach to the daily CQC report. Indicate the exact location of initial phase for definable feature of work for future reference and comparison with Follow-Up phases.
 7. The initial phase for each definable feature of work is repeated for each new crew to work onsite, or any time acceptable specified quality standards are not being met.
 8. Coordinate scheduled work with Special Inspections required by Section 01 45 35 Special Inspections, the Statement of Special Inspections, and the Schedule of Special Inspections.
- C. Follow-Up Phase: Perform daily checks to assure control activities, including control testing, are providing continued compliance with contract requirements until the completion of the particular feature of work. Record the checks in the CQC documentation. Conduct final Follow-Up checks and correct all deficiencies prior to the start of additional features of work which may be affected by the deficient work. Do not build upon nor conceal non-conforming work. Coordinate scheduled work with Special Inspections required by Section 01 45 35 Special Inspections, the Statement of Special Inspections, and the Schedule of Special Inspections
- D. Additional Preparatory and Initial Phases on the same definable features of work if: the quality ongoing work is unacceptable; if there are changes in the applicable CQC staff, onsite production supervision or work crew; if work on a definable feature is resumed after a substantial period of inactivity, or if other problems develop.

3.7 TESTS

- A. Testing Procedure: Perform specified or required tests to verify that control measures are adequate to provide a product which conforms to contract requirements. Upon request, furnish to the Government duplicate samples of test specimens for possible testing by the Government. Testing includes operation and acceptance test when specified. Procure the services of a Department of Veteran Affairs approved testing laboratory or establish an approved testing laboratory at the project site. Perform the following activities and record and provide the following data:
1. Verify that testing procedures comply with contract requirements.
 2. Verify that facilities and testing equipment are available and comply with testing standards.
 3. Check test instrument calibration data against certified standards.
 4. Verify that recording forms and test identification control number system, including all of the test documentation requirements, have been prepared.
 5. Record results of all tests taken, both passing and failing on the CQC report for the date taken. Specification paragraph reference, location where tests were taken, and the unique sequential control number identifying the test. If approved by the Contracting Officer or Authorized designee, actual test reports are submitted later with a reference to the test number and date taken. Provide an information copy of tests performed by an offsite or commercial test facility directly to the Contracting Officer or Authorized designee. Failure to submit timely test reports as stated results in nonpayment for related work performed and disapproval of the test facility for this Contract.
- B. Testing Laboratories: All testing laboratories must be validated through the procedures contained in Specification section 01 45 29 Testing Laboratory Services.
1. Capability Check: The Government reserves the right to check laboratory equipment in the proposed laboratory for compliance with the standards set forth in the contract specifications and to check the laboratory technician's testing procedures and techniques. Laboratories utilized for testing soils, concrete, asphalt and steel is required to meet criteria detailed in ASTM D3740 and ASTM E329.

2. Capability Recheck: If the selected laboratory fails the capability check, the Contractor will be assessed a charge equal to value of recheck to reimburse the Government for each succeeding recheck of the laboratory or the checking of a subsequently selected laboratory. Such costs will be deducted from the Contract amount due the Contractor.

C. Onsite Laboratory: The Government reserves the right to utilize the Contractor's control testing laboratory and equipment to make assurance tests, and to check the Contractor's testing procedures, techniques, and test results at no additional cost to the Government.

3.8 COMPLETION INSPECTION

A. Punch-Out Inspection: Conduct an inspection of the work by the CQC system Manager near the end of the work, or any increment of the work established by the specifications. Prepare and include in the CQC documentation a punch list of items which do not conform to the approved drawings and specifications. Include within the list of deficiencies the estimated date by which the deficiencies will be corrected. Make a second inspection the CQC System Manager or staff to ascertain that all deficiencies have been corrected. Once this is accomplished, notify the Government that the facility is ready for the Government Pre-Final Inspection.

B. Pre-Final Inspection: The Government will perform the Pre-Final Inspection to verify that the facility is complete and ready to be occupied. A Government Pre-Final Punch List may be developed as a result of this inspection. Ensure that all items on this list have been corrected before notifying the Government, so that a Final Acceptance Inspection with the customer can be scheduled. Correct any items noted on the Pre-Final Inspection in a timely manner. These inspections and any deficiency corrections required by this paragraph need to be accomplished within the time slated for completion of the entire work or any particular increment of the work if the project is divided into increments by separate construction completion dates.

C. Final Acceptance Inspection: The Contractor's QC Inspection personnel, plus the superintendent or other primary management person, and the Contracting Officer's Authorized designee is required to be in attendance at the Final Acceptance Inspection. Additional Government

personnel can also be in attendance. The Final Acceptance Inspection will be formally scheduled by the Contracting Officer's or Authorized designee based upon results of the Pre-Final Inspection. Notify the Contracting Officer through the Resident Engineer office at least 14 days prior to the Final Acceptance Inspection and include the Contractor's assurance that all specific items previously identified to the Contractor as being unacceptable, along with all remaining work performed under the contract, will be complete and acceptable by the date schedule for the Final Acceptance Inspection. Failure of the Contractor to have all contract work acceptably complete for this inspection will be cause for the Contracting Officer to bill the Contractor for the Government's additional inspection cost in accordance with FAR Clause 52.246-12 titled "Inspection of Construction".

3.9 DOCUMENTATION

- A. Quality Control Activities: Maintain current records providing factual evidence that required QC activities and tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:
1. The name and area of responsibility of the Contractor/Subcontractor
 2. Operating plant/equipment with hours worked, idle, or down for repair.
 3. Work performed each day, giving location, description, and by whom. When Network Analysis (NAS) is used, identify each phase of work performed each day by NAS activity number.
 4. Test and control activities performed with results and references to specification/drawing requirements. Identify the Control Phase (Preparatory, Initial, and/or Follow-Up). List deficiencies noted, along with corrective action.
 5. Quantity of materials received at the site with statement as to acceptability, storage, and reference to specification/drawing requirements.
 6. Submittals and deliverables reviewed, with Contract reference, by whom, and action taken.
 7. Offsite surveillance activities, including actions taken.

8. Job safety evaluations stating what was checked, results, and instructions or corrective actions.
 9. Instructions given/received and conflicts in plans and specifications.
 10. Provide documentation of design quality control activities. For independent design reviews, provide, as a minimum, identification of the Independent Technical Reviewer (ITR) team, the ITR review comments, responses, and the record of resolution of the comments.
- B. Verification Statement: Indicate a description of trades working on the project; the number of personnel working; weather conditions encountered; and any delays encountered. Cover both conforming and deficient features and include a statement that equipment and materials incorporated in the work and workmanship comply with the Contract. Furnish the original and one copy of these records in report form to the Government daily with 1 week after the date covered by the report, except that reports need not be submitted for days on which no work is performed. As a minimum, prepare and submit on report for every 7 days of no work and on the last day of a no work period. All calendar days need to be accounted for throughout the life of the contract. The first report following a day of no work will be for that day only. Reports need to be signed and dated by the CQC System Manager. Include copies of test reports and copies of reports prepared by all subordinate QC personnel within the CQC System Manager Report.

3.10 SAMPLE FORMS

Templates of various quality control reports can be found on the Whole Building Design Guide website at

https://www.wbdg.org/FFC/NAVGRAPH/quality_control_reports.pdf

- 3.11 **NOTIFICATION OF NONCOMPLIANCE:** The Contracting Officer or Authorized designee will notify the Contractor of any detected noncompliance with the foregoing requirements. The Contractor should take immediate corrective action after receipt of such notice. Such notice, when delivered to the Contractor at the work site will be deemed sufficient for the purpose of notification. If the Contractor fails or refuses to comply promptly, the Contracting Officer can issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders will be made

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
05-01-20

the subject of claim for extension of time or for excess costs or
damages by the Contractor.

--- End of Section ---

SECTION 01 45 29
TESTING LABORATORY SERVICES

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies materials testing activities and inspection services required during project construction to be provided by a Testing Laboratory retained by the Contractor.

1.2 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.
- B. American Association of State Highway and Transportation Officials (AASHTO):
 - T27-11Standard Method of Test for Sieve Analysis of Fine and Coarse Aggregates
 - T96-02 (R2006)Standard Method of Test for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
 - T99-10Standard Method of Test for Moisture-Density Relations of Soils Using a 2.5 Kg (5.5 lb.) Rammer and a 305 mm (12 in.) Drop
 - T104-99 (R2007)Standard Method of Test for Soundness of Aggregate by Use of Sodium Sulfate or Magnesium Sulfate
 - T180-10Standard Method of Test for Moisture-Density Relations of Soils using a 4.54 kg (10 lb.) Rammer and a 457 mm (18 in.) Drop
 - T191-02 (R2006)Standard Method of Test for Density of Soil In-Place by the Sand-Cone Method
 - T310-13Standard Method of Test for In-place Density and Moisture Content of Soil and Soil-aggregate by Nuclear Methods (Shallow Depth)
- C. American Concrete Institute (ACI):
 - 506.4R-94 (R2004)Guide for the Evaluation of Shotcrete

D. American Society for Testing and Materials (ASTM):

- A370-12Standard Test Methods and Definitions for
Mechanical Testing of Steel Products
- A416/A416M-10Standard Specification for Steel Strand,
Uncoated Seven-Wire for Prestressed Concrete
- C31/C31M-10Standard Practice for Making and Curing
Concrete Test Specimens in the Field
- C33/C33M-11aStandard Specification for Concrete Aggregates
- C39/C39M-12Standard Test Method for Compressive Strength
of Cylindrical Concrete Specimens
- C109/C109M-11bStandard Test Method for Compressive Strength
of Hydraulic Cement Mortars
- C136-06Standard Test Method for Sieve Analysis of Fine
and Coarse Aggregates
- C138/C138M-10bStandard Test Method for Density (Unit Weight),
Yield, and Air Content (Gravimetric) of
Concrete
- C140-12Standard Test Methods for Sampling and Testing
Concrete Masonry Units and Related Units
- C143/C143M-10aStandard Test Method for Slump of Hydraulic
Cement Concrete
- C172/C172M-10Standard Practice for Sampling Freshly Mixed
Concrete
- C173/C173M-10bStandard Test Method for Air Content of freshly
Mixed Concrete by the Volumetric Method
- C330/C330M-09Standard Specification for Lightweight
Aggregates for Structural Concrete
- C567/C567M-11Standard Test Method for Density Structural
Lightweight Concrete
- C780-11Standard Test Method for Pre-construction and
Construction Evaluation of Mortars for Plain
and Reinforced Unit Masonry
- C1019-11Standard Test Method for Sampling and Testing
Grout
- C1064/C1064M-11Standard Test Method for Temperature of Freshly
Mixed Portland Cement Concrete

- C1077-11cStandard Practice for Agencies Testing Concrete
and Concrete Aggregates for Use in Construction
and Criteria for Testing Agency Evaluation
- C1314-11aStandard Test Method for Compressive Strength
of Masonry Prisms
- D422-63(2007)Standard Test Method for Particle-Size Analysis
of Soils
- D698-07e1Standard Test Methods for Laboratory Compaction
Characteristics of Soil Using Standard Effort
- D1140-00(2006)Standard Test Methods for Amount of Material in
Soils Finer than No. 200 Sieve
- D1143/D1143M-07e1Standard Test Methods for Deep Foundations
Under Static Axial Compressive Load
- D1188-07e1Standard Test Method for Bulk Specific Gravity
and Density of Compacted Bituminous Mixtures
Using Coated Samples
- D1556-07Standard Test Method for Density and Unit
Weight of Soil in Place by the Sand-Cone Method
- D1557-09Standard Test Methods for Laboratory Compaction
Characteristics of Soil Using Modified Effort
(56,000ft lbf/ft³ (2,700 KNm/m³))
- D2166-06Standard Test Method for Unconfined Compressive
Strength of Cohesive Soil
- D2167-08)Standard Test Method for Density and Unit
Weight of Soil in Place by the Rubber Balloon
Method
- D2216-10Standard Test Methods for Laboratory
Determination of Water (Moisture) Content of
Soil and Rock by Mass
- D2974-07aStandard Test Methods for Moisture, Ash, and
Organic Matter of Peat and Other Organic Soils
- D3666-11Standard Specification for Minimum Requirements
for Agencies Testing and Inspecting Road and
Paving Materials
- D3740-11Standard Practice for Minimum Requirements for
Agencies Engaged in Testing and/or Inspection

- of Soil and Rock as used in Engineering Design
and Construction
- D6938-10Standard Test Method for In-Place Density and
Water Content of Soil and Soil-Aggregate by
Nuclear Methods (Shallow Depth)
- E94-04 (2010)Standard Guide for Radiographic Examination
- E164-08Standard Practice for Contact Ultrasonic
Testing of Weldments
- E329-11cStandard Specification for Agencies Engaged in
Construction Inspection, Testing, or Special
Inspection
- E543-09Standard Specification for Agencies Performing
Non-Destructive Testing
- E605-93 (R2011)Standard Test Methods for Thickness and Density
of Sprayed Fire Resistive Material (SFRM)
Applied to Structural Members
- E709-08Standard Guide for Magnetic Particle
Examination
- E1155-96 (R2008)Determining FF Floor Flatness and FL Floor
Levelness Numbers
- F3125/F3125M-15Standard Specification for High Strength
Structural Bolts, Steel and Alloy Steel, Heat
Treated, 120 ksi (830 MPa) and 150 ksi (1040
MPa) Minimum Tensile Strength, Inch and Metric
Dimensions
- E. American Welding Society (AWS):
- D1.D1.1M-10Structural Welding Code-Steel

1.3 REQUIREMENTS:

- A. Accreditation Requirements: Construction materials testing laboratories must be accredited by a laboratory accreditation authority and will be required to submit a copy of the Certificate of Accreditation and Scope of Accreditation. The laboratory's scope of accreditation must include the appropriate ASTM standards (i.e.; E329, C1077, D3666, D3740, A880, E543) listed in the technical sections of the specifications. Laboratories engaged in Hazardous Materials Testing shall meet the requirements of OSHA and EPA. The policy applies to the specific

laboratory performing the actual testing, not just the "Corporate Office."

- B. Inspection and Testing: Testing laboratory shall inspect materials and workmanship and perform tests described herein and additional tests requested by Resident Engineer. When it appears materials furnished, or work performed by Contractor fail to meet construction contract requirements, Testing Laboratory shall direct attention of Resident Engineer to such failure.
- C. Written Reports: Testing laboratory shall submit test reports to Resident Engineer, Contractor, unless other arrangements are agreed to in writing by the COR. Submit reports of tests that fail to meet construction contract requirements on colored paper.
- D. Verbal Reports: Give verbal notification to COR immediately of any irregularity.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 EARTHWORK:

- A. General: The Testing Laboratory shall provide qualified personnel, materials, equipment, and transportation as required to perform the services identified/required herein, within the agreed to schedule and/or time frame. The work to be performed shall be as identified herein and shall include but not be limited to the following:
 - 1. Observe fill and subgrades during proof-rolling to evaluate suitability of surface material to receive fill or base course. Provide recommendations to the COR regarding suitability or unsuitability of areas where proof-rolling was observed. Where unsuitable results are observed, witness excavation of unsuitable material and recommend to COR extent of removal and replacement of unsuitable materials and observe proof-rolling of replaced areas until satisfactory results are obtained.
 - 2. Provide part time observation of fill placement and compaction and field density testing in building areas and provide full time part time observation of fill placement and compaction and field density testing in pavement areas to verify that earthwork compaction obtained is in accordance with contract documents.

3. Provide supervised geotechnical technician to inspect excavation, subsurface preparation, and backfill for structural fill.

B. Testing Compaction:

1. Determine maximum density and optimum moisture content for each type of fill, backfill and subgrade material used, in compliance with AASHTO T99/T180 Method A ASTM D698 D1557 Method A ASTM D698 and/or ASTM D1557.
2. Make field density tests in accordance with the primary testing method following ASTM D6938 AASHTO T310 wherever possible. Field density tests utilizing ASTM D1556 AASHTO T191 , or ASTM D2167 shall be utilized on a case by case basis only if there are problems with the validity of the results from the primary method due to specific site field conditions. Should the testing laboratory propose these alternative methods, they should provide satisfactory explanation to the COR before the tests are conducted.
 - a. Building Slab Subgrade: At least one test of subgrade for every 185 m² (2000 square feet) of building slab, but in no case fewer than three tests. In each compacted fill layer, perform one test for every 185 m² (2000 square feet) of overlaying building slab, but in no case fewer than three tests.
 - b. Foundation Wall Backfill: One test per 30 m (100 feet) of each layer of compacted fill but in no case fewer than two tests.
 - c. Pavement Subgrade: One test for each 335 m² (400 square yards), but in no case fewer than two tests.
 - d. Curb, Gutter, and Sidewalk: One test for each 90 m (300 feet), but in no case fewer than two tests.
 - e. Trenches: One test at maximum 30 m (100 foot) intervals per 1200 mm (4 foot) of vertical lift and at changes in required density, but in no case fewer than two tests.
 - f. Footing Subgrade: At least one test for each layer of soil on which footings will be placed. Subsequent verification and approval of each footing subgrade may be based on a visual comparison of each subgrade with related tested subgrade when acceptable to COR. In each compacted fill layer below wall footings, perform one field density test for every 30 m (100 feet) of wall. Verify subgrade is level, all loose or disturbed

soils have been removed, and correlate actual soil conditions observed with those indicated by test borings.

- C. Fill and Backfill Material Gradation: One test per Lift cubicmeters yards stockpiled or in-place source material. Gradation of fill and backfill material shall be determined in accordance with ASTM C136 ASTM D422 ASTM D1140.
- D. Testing for Footing Bearing Capacity: Evaluate if suitable bearing capacity material is encountered in footing subgrade.
- E. Testing Materials: Test suitability of on-site and off-site borrow as directed by COR.

3.2 FOUNDATION PILES:

- A. Witness load test procedure for conformance with ASTM D1143 and interpret test data to verify geotechnical recommendations for pile capacity. Submit load test report in accordance with ASTM D1143.
- B. Review Contractor's equipment, methods, and procedures prior to starting any work on site. Provide continuous inspection of pile installation. Maintain a record of all pertinent phases of operation for submittal to COR.
- C. Auger-Placed Piles: Take and test samples of grout in accordance with ASTM C109 for conformance with specified strength requirements. Not less than six cubes shall be made for each day of casting. Test three cubes at 7 days and three at 28 days.
- D. Cast-in-Place Concrete Piles: Test concrete including materials for concrete as required in Article CONCRETE of this section, except make two test cylinders for each day's production of each strength of concrete produced.
- E. Prestressed Concrete Piles:
 - 1. Inspection at Plant: Inspect forms, placement of reinforcing steel and strands, placement and finishing of concrete, and tensioning of strands.
 - 2. Concrete Testing: Test concrete including materials for concrete as required in Article, CONCRETE of this section, except make two test cylinders for each day's production of each strength of concrete produced.
 - 3. Test strand for conformance with ASTM A416/A416M and furnish report to COR.

4. Inspect piles to insure specification requirements for curing and finishes have been met.

3.3 LANDSCAPING:

- A. Test topsoil for organic materials, pH, phosphate, potash content, and gradation of particles.
 1. Test for organic material by using ASTM D2974.
 2. Determine percent of silt, sand, clay, and foreign materials such as rock, roots, and vegetation.
- B. Submit laboratory test report of topsoil to COR.

3.4 ASPHALT CONCRETE PAVING:

- A. Aggregate Base Course:
 1. Determine maximum density and optimum moisture content for aggregate base material in accordance with AASHTO T180, Method D ASTM D1557, Method D
 2. Make a minimum of three field density tests on each day's final compaction on each aggregate course in accordance with AASHTO T191 ASTM D1556 .
 3. Sample and test aggregate as necessary to insure compliance with specification requirements for gradation, wear, and soundness as specified in the applicable state highway standards and specifications.
- B. Asphalt Concrete:
 1. Aggregate: Sample and test aggregates in stock pile and hot-bins as necessary to insure compliance with specification requirements for gradation (AASHTO T27), wear (AASHTO T96), and soundness (AASHTO T104).
 2. Temperature: Check temperature of each load of asphalt concrete at mixing plant and at site of paving operation.
 3. Density: Make a minimum of two field density tests in accordance with ASTM D1188 of asphalt base and surface course for each day's paving operation.

3.5 SITE WORK CONCRETE:

Test site work concrete including materials for concrete as required in Article CONCRETE of this section.

3.6 CONCRETE:

A. Batch Plant Inspection and Materials Testing:

1. Perform continuous batch plant inspection until concrete quality is established to satisfaction of Resident Engineer with concurrence of Contracting Officer and perform periodic inspections thereafter as determined by Resident Engineer.
2. Periodically inspect and test batch proportioning equipment for accuracy and report deficiencies to COR.
3. Sample and test mix ingredients as necessary to insure compliance with specifications.
4. Sample and test aggregates daily and as necessary for moisture content. Test the dry rodded weight of the coarse aggregate whenever a sieve analysis is made, and when it appears there has been a change in the aggregate.
5. Certify, in duplicate, ingredients and proportions and amounts of ingredients in concrete conform to approved trial mixes. When concrete is batched or mixed off immediate building site, certify (by signing, initialing or stamping thereon) on delivery slips (duplicate) that ingredients in truck-load mixes conform to proportions of aggregate weight, cement factor, and water-cement ratio of approved trial mixes.

B. Field Inspection and Materials Testing:

1. Provide a technician at site of placement at all times to perform concrete sampling and testing.
2. Review the delivery tickets of the ready-mix concrete trucks arriving on-site. Notify the Contractor if the concrete cannot be placed within the specified time limits or if the type of concrete delivered is incorrect. Reject any loads that do not comply with the Specification requirements. Rejected loads are to be removed from the site at the Contractor's expense. Any rejected concrete that is placed will be subject to removal.
3. Take concrete samples at point of placement in accordance with ASTM C172. Mold and cure compression test cylinders in accordance with ASTM C31. Make at least three cylinders for each 40 m³ (50 cubic yards) or less of each concrete type, and at least three cylinders for any one day's pour for each concrete type. After good concrete

- quality control has been established and maintained as determined by COR make three cylinders for each 80 m³ (100 cubic yards) or less of each concrete type, and at least three cylinders from any one day's pour for each concrete type. Label each cylinder with an identification number. COR may require additional cylinders to be molded and cured under job conditions.
4. Perform slump tests in accordance with ASTM C143. Test the first truck each day, and every time test cylinders are made. Test pumped concrete at the hopper and at the discharge end of the hose at the beginning of each day's pumping operations to determine change in slump.
 5. Determine the air content of concrete per ASTM C173. For concrete required to be air-entrained, test the first truck and every 20 m³ (25 cubic yards) thereafter each day. For concrete not required to be air-entrained, test every 80 m³ (100 cubic yards) at random. For pumped concrete, initially test concrete at both the hopper and the discharge end of the hose to determine change in air content.
 6. If slump or air content fall outside specified limits, make another test immediately from another portion of same batch.
 7. Perform unit weight tests in compliance with ASTM C138 for normal weight concrete and ASTM C567 for lightweight concrete. Test the first truck and each time cylinders are made.
 8. Notify laboratory technician at batch plant of mix irregularities and request materials and proportioning check.
 9. Verify that specified mixing has been accomplished.
 10. Environmental Conditions: Determine the temperature per ASTM C1064 for each truckload of concrete during hot weather and cold weather concreting operations:
 - a. When ambient air temperature falls below 4.4 degrees C (40 degrees F), record maximum and minimum air temperatures in each 24 hour period; record air temperature inside protective enclosure; record minimum temperature of surface of hardened concrete.
 - b. When ambient air temperature rises above 29.4 degrees C (85 degrees F), record maximum and minimum air temperature in each 24 hour period; record minimum relative humidity; record maximum

wind velocity; record maximum temperature of surface of hardened concrete.

11. Inspect the reinforcing steel placement, including bar size, bar spacing, top and bottom concrete cover, proper tie into the chairs, and grade of steel prior to concrete placement. Submit detailed report of observations.
 12. Observe conveying, placement, and consolidation of concrete for conformance to specifications.
 13. Observe condition of formed surfaces upon removal of formwork prior to repair of surface defects and observe repair of surface defects.
 14. Observe curing procedures for conformance with specifications, record dates of concrete placement, start of preliminary curing, start of final curing, end of curing period.
 15. Observe preparations for placement of concrete:
 - a. Inspect handling, conveying, and placing equipment, inspect vibrating and compaction equipment.
 - b. Inspect preparation of construction, expansion, and isolation joints.
 16. Observe preparations for protection from hot weather, cold weather, sun, and rain, and preparations for curing.
 17. Observe concrete mixing:
 - a. Monitor and record amount of water added at project site.
 - b. Observe minimum and maximum mixing times.
 18. Measure concrete flatwork for levelness and flatness as follows:
 - a. Perform Floor Tolerance Measurements F_F and F_L in accordance with ASTM E1155. Calculate the actual overall F- numbers using the inferior/superior area method.
 - b. Perform all floor tolerance measurements within 48 hours after slab installation and prior to removal of shoring and formwork.
 - c. Provide the Contractor and the Resident Engineer with the results of all profile tests, including a running tabulation of the overall F_F and F_L values for all slabs installed to date, within 72 hours after each slab installation.
 19. Other inspections:
 - a. Grouting under base plates.
 - b. Grouting anchor bolts and reinforcing steel in hardened concrete.
- C. Laboratory Tests of Field Samples:

1. Test compression test cylinders for strength in accordance with ASTM C39. For each test series, test one cylinder at 7 days and one cylinder at 28 days. Use remaining cylinder as a spare tested as directed by COR. Compile laboratory test reports as follows:
Compressive strength test shall be result of one cylinder, except when one cylinder shows evidence of improper sampling, molding or testing, in which case it shall be discarded and strength of spare cylinder shall be used.
2. Make weight tests of hardened lightweight structural concrete in accordance with ASTM C567.
3. Furnish certified compression test reports (duplicate) to Resident Engineer. In test report, indicate the following information:
 - a. Cylinder identification number and date cast.
 - b. Specific location at which test samples were taken.
 - c. Type of concrete, slump, and percent air.
 - d. Compressive strength of concrete in MPa (psi).
 - e. Weather conditions during placing.
 - f. Temperature of concrete in each test cylinder when test cylinder was molded.
 - g. Maximum and minimum ambient temperature during placing.
 - h. Ambient temperature when concrete sample in test cylinder was taken.
 - i. Date delivered to laboratory and date tested.

3.7 REINFORCEMENT:

- A. Review mill test reports furnished by Contractor.
- A. Perform sampling at fabricating plant. Take two samples from each 23 t (25 tons) or fraction thereof of each size of reinforcing steel No. 10 thru No. 57 (No. 3 thru No. 18).
- B. Make one tensile and one bend test in accordance with ASTM A370 from each pair of samples obtained.
- C. Written report shall include, in addition to test results, heat number, manufacturer, type and grade of steel, and bar size.
- D. Perform tension tests of mechanical and welded splices in accordance with ASTM A370.

3.8 MASONRY:

- A. Mortar Tests:

1. Laboratory compressive strength test:
 - a. Comply with ASTM C780.
 - b. Obtain samples during or immediately after discharge from batch mixer.
 - c. Furnish molds with 50 mm (2 inch), 3 compartment gang cube.
 - d. Test one sample at 7 days and 2 samples at 28 days.
 2. Two tests during first week of operation; one test per week after initial test until masonry completion.
- B. Grout Tests:
1. Laboratory compressive strength test:
 - a. Comply with ASTM C1019.
 - b. Test one sample at 7 days and 2 samples at 28 days.
 - c. Perform test for each 230 m² (2500 square feet) of masonry.
- C. Masonry Unit Tests:
1. Laboratory Compressive Strength Test:
 - a. Comply with ASTM C140.
 - b. Test 3 samples for each 460 m² (5000 square feet) of wall area.
- D. Prism Tests: For each type of wall construction indicated, test masonry prisms per ASTM C1314 for each 460 m² (5000 square feet) of wall area. Prepare one set of prisms for testing at 7 days and one set for testing at 28 days.

3.9 STRUCTURAL STEEL:

- A. General: Provide shop and field inspection and testing services to certify structural steel work is done in accordance with contract documents. Welding shall conform to AWS D1.1 Structural Welding Code.
- B. Prefabrication Inspection:
1. Review design and shop detail drawings for size, length, type and location of all welds to be made.
 2. Approve welding procedure qualifications either by pre-qualification or by witnessing qualifications tests.
 3. Approve welder qualifications by certification or retesting.
 4. Approve procedure for control of distortion and shrinkage stresses.
 5. Approve procedures for welding in accordance with applicable sections of AWS D1.1.
- C. Fabrication and Erection:
1. Weld Inspection:

- a. Inspect welding equipment for capacity, maintenance and working condition.
 - b. Verify specified electrodes and handling and storage of electrodes in accordance with AWS D1.1.
 - c. Inspect preparation and assembly of materials to be welded for conformance with AWS D1.1.
 - d. Inspect preheating and interpass temperatures for conformance with AWS D1.1.
 - e. Measure 25 percent of fillet welds.
 - f. Welding Magnetic Particle Testing: Test in accordance with ASTM E709 for a minimum of:
 - 1) 20 percent of all shear plate fillet welds at random, final pass only.
 - 2) 20 percent of all continuity plate and bracing gusset plate fillet welds, at random, final pass only.
 - 3) 100 percent of tension member fillet welds (i.e., hanger connection plates and other similar connections) for root and final passes.
 - 4) 20 percent of length of built-up column member partial penetration and fillet welds at random for root and final passes.
 - 5) 100 percent of length of built-up girder member partial penetration and fillet welds for root and final passes.
 - g. Welding Ultrasonic Testing: Test in accordance with ASTM E164 and AWS D1.1 for 100 percent of all full penetration welds, braced and moment frame column splices, and a minimum of 20 percent of all other partial penetration column splices, at random.
 - h. Welding Radiographic Testing: Test in accordance with ASTM E94, and AWS D1.1 for 5 percent of all full penetration welds at random.
 - i. Verify that correction of rejected welds are made in accordance with AWS D1.1.
 - j. Testing and inspection do not relieve the Contractor of the responsibility for providing materials and fabrication procedures in compliance with the specified requirements.
2. Bolt Inspection:

- a. Inspect high-strength bolted connections in accordance AISC Specifications for Structural Joints Using ASTM F3125 Bolts.
 - b. Slip-Critical Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in each connection in accordance with AISC Specifications for Structural Joints Using ASTM F3125 Bolts. Inspect all bolts in connection when one or more are rejected.
 - c. Fully Pre-tensioned Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in 25 percent of connections in accordance with AISC Specification for Structural Joints Using ASTM F3125 Bolts. Inspect all bolts in connection when one or more are rejected.
 - d. Bolts installed by turn-of-nut tightening may be inspected with calibrated wrench when visual inspection was not performed during tightening.
 - e. Snug Tight Connections: Inspect 10 percent of connections verifying that plies of connected elements have been brought into snug contact.
 - f. Inspect field erected assemblies; verify locations of structural steel for plumbness, level, and alignment.
- D. Submit inspection reports, record of welders and their certification, and identification, and instances of noncompliance toCOR.

3.10 STEEL DECKING:

- A. Provide field inspection of welds of metal deck to the supporting steel, and testing services to insure steel decking has been installed in accordance with contract documents and manufacturer's requirements.
- B. Qualification of Field Welding: Qualify welding processes and welding operators in accordance with "Welder Qualification" procedures of AWS D1.1. Refer to the "Plug Weld Qualification Procedure" in Part 3 "Field Quality Control."
- C. Submit inspection reports, certification, and instances of noncompliance to Resident Engineer.

3.11 SHEAR CONNECTOR STUDS:

- A. Provide field inspection and testing services required by AWS D.1 to insure shear connector studs have been installed in accordance with contract documents.

- B. Tests: Test 20 percent of headed studs for fastening strength in accordance with AWS D1.1.
- C. Submit inspection reports, certification, and instances of noncompliance to COR.

3.18 TYPE OF TEST:

Approximate Number of Tests Required

A. Earthwork:

Laboratory Compaction Test, Soils:

(AASHTO T180) (AASHTO T99) (ASTM D1557) (ASTM D698) _____

Field Density, Soils (AASHTO T191, T205, or T310) _____

Penetration Test, Soils _____

B. Aggregate Base:

Laboratory Compaction, (AASHTO T180) (ASTM D1557) _____

Field Density, (AASHTO T191) (ASTM D1556) _____

Aggregate, Base Course Gradation (AASHTO T27) _____

Wear (AASHTO T96) _____

Soundness (AASHTO T104) _____

C. Concrete:

Making and Curing Concrete Test Cylinders (ASTM C31) _____

Compressive Strength, Test Cylinders (ASTM C39) _____

Concrete Slump Test (ASTM C143) _____

Concrete Air Content Test (ASTM C173) _____

Unit Weight, Lightweight Concrete (ASTM C567) _____

Aggregate, Normal Weight: Gradation (ASTM C33) _____

Deleterious Substances (ASTM C33) _____

Soundness (ASTM C33) _____

Abrasion (ASTM C33) _____

Aggregate, Lightweight Gradation (ASTM C330) _____

Deleterious Substances (ASTM C330) _____

Unit Weight (ASTM C330) _____

Flatness and Levelness Readings (ASTM E1155) (number of days) _____

D. Reinforcing Steel:

Tensile Test (ASTM A370) _____
Bend Test (ASTM A370) _____
Mechanical Splice (ASTM A370) _____
Welded Splice Test (ASTM A370) _____

E. Masonry:

Making and Curing Test Cubes (ASTM C109) _____
Compressive Strength, Test Cubes (ASTM C109) _____
Sampling and Testing Mortar, Comp. Strength (ASTM C780) _____
Sampling and Testing Grout, Comp. Strength (ASTM C1019) _____
Masonry Unit, Compressive Strength (ASTM C140) _____
Prism Tests (ASTM C1314) _____

F. Structural Steel:

Ultrasonic Testing of Welds (ASTM E164) _____
Magnetic Particle Testing of Welds (ASTM E709) _____
Radiographic Testing of Welds (ASTM E94) _____

G. Inspection:

Technical Personnel (Man-days) _____

H. Technical Personnel: (Minimum _____ months)

1. Technicians to perform tests and inspection listed above. Laboratory will be equipped with concrete cylinder storage facilities, compression machine, cube molds, proctor molds, balances, scales, moisture ovens, slump cones, air meter, and all necessary equipment for compaction control.

- - - E N D - - -

**SECTION 01 45 35
SPECIAL INSPECTIONS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This guide specification will be applicable to both new buildings and existing building rehabilitations/renovations. In addition to the Special Inspection and testing specified requirements, a registered design professional must perform structural observations during construction. All observed deficiencies will be immediately reported to the Contracting Officer. The registered design professional performing these observations will be a representative of the Designer of Record (DOR) for the building being constructed.
- B. Structural observations are required for the following project conditions per IBC Chapter 17:
1. Seismic Design Category D, E or F; and assigned to Risk Cat III, IV or V.
 2. Seismic Design Category D, E or F; and with a height greater than 22860 mm 75 ft.
 3. Seismic Design Category E, assigned to Risk Category I or II and the building is greater than two stories above grade plane.
 4. Nominal design wind speed in excess of 49 m/sec 110 mph; and assigned to Risk Cat III, IV or V.
 5. Nominal design wind speed in excess of 49 m/sec 110 mph; and with a height greater than 23 m 75 ft.

1.2 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.
- B. American Society of Civil Engineers (ASCE)
1. ASCE 7 - (2010; Errata 2011; Supp 2 2013) Minimum Design Loads for Buildings and Other Structures
- C. International Code Council (ICC)
2. ICC IBC - (2015) International Building Code

1.3 **GENERAL REQUIREMENTS**

- A. Perform Special Inspections in accordance with the Statement of Special Inspections, Schedule of Special Inspections and Chapter 17 of ICC IBC. The Statement of Special Inspections and Schedule of Special Inspections are included as an attachment to this specification. Special Inspections are to be performed by an independent third party and are intended to ensure that the work of the prime contractor is in accordance with the Contract Documents and applicable building codes. Special inspections do not take the place of the three phases of control inspections performed by the Contractor's QC Manager or any testing and inspections required by other sections of the specifications.
- B. Structural observations will be performed by the Government. The contractor must provide notification to the Contracting Officer 14 days prior to the following points of construction that structural observations need to occur:
 - 1. The Government shall perform structural observations during construction on the following dates TBD
 - 2. The Government shall perform structural observations during construction on the following dates TBD

1.4 **DEFINITIONS**

- A. Continuous Special Inspections - The constant monitoring of specific tasks by a special inspector. These inspections must be carried out continuously over the duration of the particular tasks.
- B. Periodic Special Inspections - Special Inspections by the special inspector who is intermittently present where the work to be inspected has been or is being performed. Specific time interval on a specific Special Inspection should be indicated on the Schedule of Special Inspections.
- C. Perform - Perform these Special Inspections tasks for each welded joint or member.
- D. Observe - Observe these Special Inspections items on a random daily basis. Operations need not be delayed pending these inspections.
- E. Special Inspector (SI) - A qualified person retained by the contractor and approved by the Contracting Officer as having the competence necessary to inspect a particular type of construction requiring

Special Inspections. The SI must be an independent third party hired directly by the Prime Contractor.

- F. Associate Special Inspector (ASI) - A qualified person who assists the SI in performing Special Inspections but must perform inspection under the direct supervision of the SI and cannot perform inspections without the SI on site.
- G. Third Party - A third party inspector must not be company employee of the Contractor or any Sub-Contractor performing the work to be inspected.
- H. Special Inspector of Record (SIOR) - SIOR must be an independent third party hired directly by the Prime Contractor and is required for the following project conditions:
 - 1. Seismic Design Category D, E, or F; and assigned to Risk Category III, IV, or V.
 - 2. Seismic Design Category D, E, or F; and with a height greater than 22860mm 75 ft.
 - 3. Seismic Design Category E, assigned to Risk Category I or II and the building is greater than two (2) stories above grade plane.
 - 4. Nominal design wind speed in excess of 49 m/sec 100 mph; and assigned to Risk Category III, IV, or V.
 - 5. Nominal design wind speed in excess of 49 mm/sec 100mph; and with a height greater than 23m 75ft.
 - 6. In addition to these conditions, the DOR is encouraged to consider using an SIOR on large magnitude or critical projects where this additional level of quality control is affordable.
- I. Contracting Officer - The Government official having overall authority for administrative contracting actions. Certain contracting actions may be delegated to the Contracting Officer's Representative (COR).
- J. Contractor's Quality Control (QC) Manager - An individual retained by the prime contractor and qualified in accordance with the Section 01 45 00.00 10 QUALITY CONTROL having the overall responsibility for the contractor's QC organization.
- K. Designer of Record (DOR) - A registered design professional is contracted by the Government as an A/E responsible for the overall design and review of submittal documents prepared by others. The DOR is registered or licensed to practice their respective design profession as defined by the statutory requirements of the professional

registration laws in state in which the design professional works. The DOR is also referred to as the Engineer of Record (EOR) in design code documents.

- L. Statement of Special Inspections (SSI) - A document developed by the DOR identifying the material, systems, components and work required to have Special Inspections and covering the following:
1. List of the Architectural Designated Seismic Systems - these components are in or attached to a Risk Category IV or V structure and are needed for continued operation of the facility or their failure could impair the continued operation of the facility.
 2. List of the Mechanical Designated Seismic Systems
 - a. For Seismic Design Category C or Risk V, list the following:
 - 1) Heating, ventilation, and air-conditioning (HVAC) ductwork containing hazardous materials and anchorage of such ductwork
 - 2) Piping systems and mechanical units containing flammable, combustible, or highly toxic materials.
 - b. For Seismic Design Category D, E, or F or Risk Category V list mechanical system that meet one of the following:
 - 1) Life safety component required to function after an earthquake
 - 2) Component that contains hazardous content,
 - 3) All components in an essential facility needed for continued operation after an earthquake.
 3. List of the Electrical Designated Systems
 - a. For Seismic Design Category C or Risk V, list the anchorage of electrical equipment used for emergency or standby power systems.
 - b. For Seismic Design Category D, E or F list electrical system that meet one of the following:
 - 1) Life safety component required to function after an earthquake
 - 2) Component that contains hazardous content,
 - 3) All components in an essential facility needed for continued operation after an earthquake.
 4. List of elements that are part of the progressive collapse resistance system.
 - a. Provide a description of the following as they apply:

- 1) Elements of the tie force system consisting of internal longitudinal and transverse, vertical, and peripheral ties.
- 2) Elements of the alternate path system.
- 3) Elements having enhanced local resistance. The Statement of Special Inspections and the Schedule of Special Inspections will be included as an attachment to this specification
 - a) Schedule of Special Inspections - A schedule which lists each of the required Special Inspections, the extent to which each Special Inspections is to be performed, and the required frequency for each in accordance with ICC IBC Chapter 17. Template found here:



SECTION 01 45 35 SECTION 01 45 35
Schedule of SI Templk Statement of SI Temp

- b) Designated Seismic System - Those nonstructural components that require design in accordance with ASCE 7 Chapter 13 and for which the component importance factor, I_p , is greater than 1.0. This designation applies to systems that are required to be operational following the Design Earthquake for RC I - IV structures and following the MCER for RC V structures. All systems in RC V facilities designated as MC-1 in accordance with UFC 3-310-04 are considered part of the Designated Seismic Systems. Designated Seismic Systems will be identified by Owner and will have an Importance Factor $I_p = 1.5$
 - b. Submittals: Government approval is required for all submittals. CQC Special Inspection reports shall be submitted under this Specification section and follow the [Special Inspection]: [Applicable Specification section or description] naming convention. Submit the following:
 - 1) SD-01 Preconstruction Submittals;
 - 2) SIOR Letter of Acceptance;
 - 3) Special Inspections Project Manual;

- 4) Special Inspections Agency's Written Practices
 - 5) NDT Procedures and Equipment' Calibration Records;
 - 6) SD-06 Test Reports;
 - 7) Special Inspections
 - 8) Daily Reports;
 - 9) Special Inspections; Biweekly Reports;
 - 10) SD-07 Certificates;
 - 11) Fabrication Plant
 - 12) Steel Truss Plant;
 - 13) AC472 Accreditation;
 - 14) Certificate of Compliance;
 - 15) Special Inspector of Record Qualifications;
 - 16) Special Inspector Qualifications;
 - 17) Qualification Records for NDT technicians;
 - 18) SD-11 Closeout Submittals;
 - 19) Interim Final Report of Special Inspections;
 - 20) Comprehensive Final Report of Special Inspections;
- c. Special Inspector Qualifications: Submit qualifications for each SI, ASI, and the SIOR from the following certifying associations: Associated Air Balance Council (AABC); American Concrete Institute (ACI); Association of the Wall and Ceiling Industry (AWCI); American Welding Society (AWS); Factory Mutual (FM); International Code Council (ICC); Nondestructive Testing (NDT); National Institute for Certification in Engineering Technologies (NICET); Precast/Prestressed Concrete Institute (PCI); Post-Tensioning Institute (PTI); Underwriters Laboratories (UL). Qualifications should be in accordance with the following minimums ; PM or SRE can restrict qualifications to the higher standards shown if multiple options are shown for a role based on complexity of project .

QUALIFICATIONS

Area	Special Inspector	Associated Special Inspector	SIOR
Steel Construction and High Strength Bolting	ICC Structural Steel and Bolting Special Inspector certificate with on year of related experience, or Registered Professional Engineer with related experience.	Engineer-In-Training with one year of related experience.	
Welding Structural Steel (For highly complex steel use only AWS Certified Welding Inspectors)	ICC Welding Special Inspector certificate with one year of related experience or AWS Certified Welding Inspector	AWS Certified Associate Welding Inspector	
Nondestructive Testing of Welds	NDT Level II Certificate	NDT Level II Certificate plus one year of related experience	
Cold Formed Steel Framing	ICC Structural Steel and Bolting Special Inspector certificate with on year of related experience, or ICC Commercial Building Inspector with one year of experience; or Registered Professional Engineer with related experience.	Engineer-In-Training with one year of related experience.	
Concrete Construction	ICC Reinforced Concrete Special Inspector Certificate with one year of related experience, or ACI Concrete Construction Special Inspector, or NICET Concrete Technician Level III Certificate in Construction Materials Testing,	ACI Concrete Construction Special Inspector in Training, or Engineer-In-Training with one year of related experience	

Area	Special Inspector	Associated Special Inspector	SIOR
	or, Registered Professional Engineer with related experience		
Masonry Construction	ICC Structural Masonry Special Inspector Certificate with one year of related experience, or Registered Professional Engineer with related experience	Engineer-In-Training with one year of related experience	
Verification of Site Soil Condition, Fill Placement, and Load-Bearing Requirements	ICC Soils Special Inspector Certificate with one year of related experience, or NICET Soils Technician Level II Certificate in Construction Material Testing, or NICET Geotechnical Engineering Technician Level II Construction or Generalist Certificate, or Geologist-In-Training with one year of related experience, or Registered Professional Engineer with related experience	NICET Soils Technician Level I Certificate in Construction Material Testing with one year of related experience, or NICET Geotechnical Engineering Technician Level I Construction, or Generalist Certificate with one year of related experience, or Engineer-In-Training with one year of related experience	
Deep Foundations	NICET Soils Technician Level II Certificate in Construction Material Testing, or NICET Geotechnical	NICET Soils Technician Level I Certificate in Construction Material Testing with one year of related	

Area	Special Inspector	Associated Special Inspector	SIOR
	Engineering Technician Level II Construction or Generalist Certificate, or Geologist-In-Training with one year of related experience, or Registered Professional Engineer with related experience	experience, or NICET Geotechnical Engineering Technician Level I Construction or Generalist Certificate with one year of related experience, or Engineer-In-Training with one year of related experience	
Sprayed Fire Resistant Manual	ICC Spray-applied Fireproofing Special Inspector Certificate, or ICC Fire Inspector I Certificate with one year of related experience, or Registered Professional Engineer with related experience	Engineer-In-Training with one year of related experience	
Fire-Resistant Penetrations and Joints	Passed the UL Firestop Exam with one year of related experience, or Passed the FM Firestop Exam with one year of related experience, or Registered Professional Engineer with related experience	Engineer-In-Training with one year of related experience.	
Smoke Control	AABC Technician Certification with one year of related experience, or Registered Professional Engineer with related experience	Engineer-In-Training with one year of related experience.	

Area	Special Inspector	Associated Special Inspector	SIOR
SIOR			Registered Professional Engineer

PART 2 - PRODUCTS

2.1 FABRICATORS SPECIAL INSPECTION

- A. Special Inspections of fabricator's work performed in the fabricator's shop is required to be inspected in accordance with the Statement of Special Inspections and the Schedule of Special Inspections unless the fabricator is certified by the approved agency to perform such work without Special Inspections. Submit the applicable certification(s) from the following list to the Contracting Officer for information to allow work performed in the fabricator's shop to not be subjected to Special Inspections.
- B. The following certifications meet the requirements for fabricator approval in accordance with paragraph 1704.2.5.2 of IBC:
 - 1. American Institute of Steel Construction (AISC) Certified Fabrication Plant, Category STD.
 - 2. Truss Plate Institute (TPI) steel truss plate quality assurance program certification.
 - 3. Truss Plate Institute (TPI) wood truss plate quality assurance program certification.
 - 4. International Accreditation Service, AC472 Accreditation Steel Joist Institute Membership
 - 5. Precast Concrete Institute (PCI) Certified Plant, Group C
- C. At the completion of fabrication, submit a certificate of compliance, to be included with the comprehensive final report of Special **Inspections, stating that the materials supplied and work performed by the fabricator are in accordance the construction documents.**

PART 3 - EXECUTION

3.1 RESPONSIBILITIES MATRIX

Inspector	Responsibility	Condition
SIOR	a. Supervise all Special Inspectors required by the contract documents and the IBC. b. Submit a SIOR Letter of Acceptance to the Contracting Officer attesting to acceptance of the duties of SIOR, signed and sealed by the SIOR. c. Verify the qualifications of all of the Special Inspectors. d. Verify the qualifications of fabricators.	Applicable when SIOR is required
	e. Submit Special Inspections agency's written practices for the monitoring and control of the agency's operations to include the following: <ol style="list-style-type: none"> 1. The agency's procedures for the selection and administration of inspection personnel, describing the training, experience and examination requirements for qualifications and certification of inspection personnel. 2. The agency's inspection procedures, including general inspection, material controls, and visual welding inspection. f. Submit qualification records for nondestructive testing (NDT) technicians designated for the project. Submit NDT procedures and equipment calibration records for NDT to be performed and equipment to be used for the project.	Applicable when SIOR is required and when the structural design is required to follow AISC341 for seismic design of steel structures
	g. Prepare a Special Inspections Project Manual, which will cover the following: <ol style="list-style-type: none"> 1. Roles and responsibilities of the following individuals during Special Inspections: SIOR, SI, General Contractor, Subcontractors, QC Manager, and DOR. 2. Organizational chart and/or communication plan, indicating lines of communication 3. Contractor's internal plan for scheduling inspections. Address items such as timeliness of inspection requests, who to contact for inspection requests, and availability of alternate inspectors. Contractor's internal plan for scheduling inspections. Address items such as timeliness of inspection requests, who to contact for inspection 	Applicable when SIOR is required

Inspector	Responsibility	Condition
	<p>requests, and availability of alternate inspectors.</p> <ol style="list-style-type: none"> 4. Indicate the government reporting procedures. 5. Propose forms or templates to be used by SI and SIOR to document inspections. 6. Indicate procedures for tracking nonconforming work and verification that corrective work is complete. 7. Indicate how the SIOR and/or SI will participate in weekly QC meetings. 8. Indicate how Special Inspections of shop fabricated items will be handled when the fabricator's shop is not certified per paragraph FABRICATOR SPECIAL INSPECTIONS. 9. Include a section in the manual that covers each specific item requiring Special Inspections that is indicated on the Schedule of Special Inspections. Provide names and qualifications of each special inspector who will be performing the Special Inspections for each specific item. Provide detail on how the Special Inspections are to be carried out for each item so that the expectations are clear for the General Contractor and the Subcontractor performing the work. Make a copy of the Special Inspections Project Manual available on the job site during construction. Submit a copy of the Special Inspections Project Manual for approval. h. Attend coordination and mutual understanding meeting where the information in the Special Inspections Project Manual will be reviewed to verify that all parties have a clear understanding of the Special Inspections provisions and the individual duties and responsibilities of each party. i. Maintain a 3- ring binder for the Special Inspector's daily and biweekly reports and the Special Inspections Project Manual. This file must be located in a conspicuous place in the project trailer/office to allow review by the Contracting Officer and the DOR. j. Submit a copy of the Special Inspector's daily reports to the QC Manager. k. Discrepancies that are observed during Special Inspections must be reported to the QC Manager for correction. If discrepancies are not corrected before the special inspector leaves 	

Inspector	Responsibility	Condition
	<p>the site the observed discrepancies must be documented in the daily report.</p> <ol style="list-style-type: none"> 1. Submit a biweekly Special Inspections report until all work requiring Special Inspections is complete. A report is required for each biweekly period in which Special Inspections activity occurs, and must include the following: <ol style="list-style-type: none"> 1. A brief summary of the work performed during the reporting time frame. 2. Changes and/or discrepancies with the drawings, specifications, and mechanical or electrical component certification if they require seismic systems, that were observed during the reporting period. 3. Discrepancies which were resolved or corrected. 4. A list of nonconforming items requiring resolution. 5. All applicable test results including nondestructive testing reports. m. For large, complex projects, at the completion of each Definable Feature of Work (DFOW) requiring Special Inspections, submit an interim final report of Special Inspections that documents the Special Inspections completed for that DFOW and corrections of all discrepancies noted in the daily reports. The interim final report of Special Inspections must be signed, dated and bear the seal of the SIOR.]. 	
QC Manager	<ol style="list-style-type: none"> a. If there is no SIOR, QC Manager must Supervise all Special Inspectors required by the contract documents and the IBC; Verify the qualifications of all of the Special Inspectors; Verify the qualifications of fabricators; Maintain a 3-ring binder for the Special Inspector's daily and biweekly reports. This file must be located in a conspicuous place in the project trailer/office to allow review by the Contracting Officer and the DOR. 	Applicable when SIOR is not required
	<ol style="list-style-type: none"> b. Maintain a rework items list that includes discrepancies noted on the Special Inspectors daily report. 	n/a

Inspector	Responsibility	Condition
Special Inspectors	a. Inspect all elements of the project for which the special inspector is qualified to inspect and are identified in the Schedule of Special Inspections. b. Attend preparatory phase meetings related to the Definable Feature of Work (DFOW) for which the special inspector is qualified to inspect.	
	c. Submit Special Inspections agency's written practices for the monitoring and control of the agency's operations to include the following: 1. The agency's procedures for the selection and administration of inspection personnel, describing the training, experience and examination requirements for qualifications and certification of inspection personnel. 2. The agency's inspection procedures, including general inspection, material controls, and visual welding inspection. d. Submit qualification records for nondestructive testing (NDT) technicians designated for the project. e. Submit NDT procedures and equipment calibration records for NDT to be performed and equipment to be used for the project.	Applicable when SIOR is NOT required and when the structural design is required to follow AISC 341 for seismic design of steel structures
	f. Submit a copy of the daily reports to the QC Manager. g. Discrepancies that are observed during Special Inspections must be reported to the QC Manager for correction. If discrepancies are not corrected before the special inspector leaves the site the observed discrepancies must be documented in the daily report. h. Submit a biweekly Special Inspection Report until all inspections are complete. A report is required for each biweekly period in which Special Inspections activity occurs, and must include the following: 1. A brief summary of the work performed during the reporting time frame 2. Changes and/or discrepancies with the drawings, specifications, and mechanical or electrical component certification if they require seismic systems that were observed during the reporting period. 3. Discrepancies which were resolved or corrected.	Applicable when SIOR is not required

Inspector	Responsibility	Condition
	4. A list of nonconforming items requiring resolution. 5. All applicable test result including nondestructive testing reports. i. For large, complex projects, at the completion of each Definable Feature of Work (DFOW) requiring Special Inspections, submit an interim final report of Special Inspections that documents the Special Inspections completed for that DFW and corrections of all discrepancies noted in the daily reports. The interim final report of Special Inspections must be signed, dated and bear the seal of the SIOR.]. j. At the completion of the project submit a comprehensive final report of Special Inspections that documents the Special Inspections completed for the project and corrections of all discrepancies noted in the daily reports. The comprehensive final report of Special Inspections must be signed, dated and indicate the certification of the special inspector qualifying them to conduct the inspection.	
	k. Submit daily reports to the SIOR	Applicable when SIOR is required

3.2 DEFECTIVE WORK

Check work as it progresses, but failure to detect any defective work or materials must in no way prevent later rejection if defective work or materials are discovered, nor obligate the Government to accept such work.

-- End of Section -

SCHEDULE OF SPECIAL INSPECTIONS

Reference 01 45 35 for all requirements not noted as part of this schedule.

INSPECTION DEFINITIONS:

- PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and noted verification.
- OBSERVE:** Observe these items randomly during the course of each work day to insure that applicable requirements are being met. Operations need not be delayed pending these inspections at contractor's risk.
- DOCUMENT:** Document, with a report, that the work has been performed in accordance with the contract documents. This is in addition to any other reports required in the Special Inspections guide specification.
- CONTINUOUS:** Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

A. STRUCTURAL - STEEL – WELDING SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

STEEL INSPECTION PRIOR TO WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE		
IBC 1705.2.1, AISC 360-16: Table C-N5.4-1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Verify that the welding procedures specification (WPS) is available	PERFORM	
2. Verify manufacturer certifications for welding consumables are available	PERFORM	
3. Verify material identification	PERFORM	Type and grade.
4. Welder Identification System	PERFORM	The fabricator or erector, as applicable, shall maintain a system by which a welder who has welded a joint or member can be identified. Stamps, if used, shall be the low-stress type.
5. Fit-up of groove welds (including joint geometry)	OBSERVE	<ul style="list-style-type: none"> ✓ Joint preparation ✓ Dimensions (alignment, root opening, root face, bevel) ✓ Cleanliness (condition of steel surfaces) ✓ Tacking (tack weld quality and location) ✓ Backing type and fit (if applicable)
6. Configuration and finish of access holes	OBSERVE	
7. Fit-up of fillet welds	OBSERVE	<ul style="list-style-type: none"> ✓ Dimensions (alignment, gaps at root) ✓ Cleanliness (condition of steel surfaces) ✓ Tacking (tack weld quality and location)
STEEL INSPECTION <u>DURING</u> WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE		
IBC 1705.2.1, AISC 360-16: Table C-N5.4-2		
TASK	INSPECTION TYPE	DESCRIPTION
8. Use of qualified welders	PERFORM	Welding by welders, welding operators, and tack welders who are qualified in conformance with requirements.
9. Control and handling of welding consumables	OBSERVE	<ul style="list-style-type: none"> ✓ Packaging ✓ Electrode atmospheric exposure control
10. No welding over cracked tack welds	OBSERVE	
11. Environmental conditions	OBSERVE	<ul style="list-style-type: none"> ✓ Wind speed within limits ✓ Precipitation and temperature
12. Welding Procedures Specification followed	OBSERVE	<ul style="list-style-type: none"> ✓ Settings on welding equipment ✓ Travel speed ✓ Selected welding materials ✓ Shielding gas type/flow rate ✓ Preheat applied ✓ Interpass temperature maintained (min./max.) ✓ Proper position (F, V, H, OH) ✓ Intermix of filler metals avoided
13. Welding techniques	OBSERVE	<ul style="list-style-type: none"> ✓ Interpass and final cleaning ✓ Each pass within profile limitations ✓ Each pass meets quality requirements

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.

OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

A. STRUCTURAL - STEEL – WELDING SECTION (CONTINUED)

STEEL INSPECTION AFTER WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 2015 1705.2.1, AISC 360-16: Table C-N5.4-3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
14. Welds cleaned	OBSERVE	
15. Size, length, and location of all welds	PERFORM	Size, length, and location of all welds conform to the requirements of the detail drawings.
16. Welds meet visual acceptance criteria	PERFORM AND DOCUMENT	<ul style="list-style-type: none"> ✓ Crack prohibition ✓ Weld/base-metal fusion ✓ Crater cross section ✓ Weld profiles ✓ Weld size ✓ Undercut ✓ Porosity
17. Arc strikes	PERFORM	
18. k-area	PERFORM	When welding of doubler plates, continuity plates or stiffeners has been performed in the k-area, visually inspect the web k-area for cracks.
19. Backing removed, weld tabs removed and finished, and fillet welds added where required	PERFORM	
20. Repair activities	PERFORM AND DOCUMENT	
21. Document acceptance or rejection of welded joint or member	PERFORM	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

B. STRUCTURAL - STEEL – BOLTING SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

STEEL INSPECTION TASKS PRIOR TO BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-16: Table C-N5.6-1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Manufacture’s certifications available for fastener materials	PERFORM	
2. Fasteners marked in accordance with ASTM requirements	OBSERVE	
3. Proper fasteners selected for joint detail (grade, type, bolt length if threads are to be excluded from shear plane)	OBSERVE	
4. Proper bolting procedure selected for joint detail	OBSERVE	
5. Connecting elements, including appropriate faying surface condition and hole preparation, if specified, meet applicable requirements	OBSERVE	
6. Proper storage provided for bolts, nuts, washers, and other fastener components	OBSERVE	
STEEL INSPECTION TASKS DURING BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-16: Table C-N5.6-2		
TASK	INSPECTION TYPE ¹	DESCRIPTION
7. Fastener assemblies of suitable condition, placed in all holes and washers (if required) are positioned as required	OBSERVE	
8. Joint brought to the snug-tight condition prior to pretensioning operation	OBSERVE	
9. Fastener component not turned by the wrench prevented from rotating	OBSERVE	
10. Bolts are pretensioned in accordance with RCSC Specification, progressing systematically from the most rigid point toward the free edges	OBSERVE	
STEEL INSPECTION TASKS AFTER BOLTING – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-16: Table C-N5.6-3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Document acceptance or rejection of all bolted connections	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

C. STRUCTURAL - STEEL - NON DESTRUCTIVE TESTING SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

NONDESTRUCTIVE TESTING OF WELDED JOINTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-16: Section N5.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Use of qualified nondestructive testing personnel	PERFORM	Visual weld inspection and nondestructive testing (NDT) shall be conducted by personnel qualified in accordance with AWS D1.8 clause 7.2
2. CJP groove welds	OBSERVE	Dye penetrant testing (DT) and ultrasonic testing (UT) shall be performed on 20% of CJP groove welds for materials greater than 5/16" (8mm) thick. Testing rate must be increased to 100% if greater than 5% of welds tested have unacceptable defects.
3. Welded joints subject to fatigue	OBSERVE	Dye penetrant testing (DT) and Ultrasonic testing (UT) shall be performed on 100% of welded joints identified on contract drawings as being subject to fatigue.
4. Weld tab removal sites	OBSERVE	At the end of welds where weld tabs have been removed, magnetic particle testing shall be performed on the same beam-to-column joints receiving UT

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

D. STRUCTURAL - STEEL – AISC 341 REQUIREMENTS (SEISMIC PROVISIONS) SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

NONDESTRUCTIVE TESTING OF WELDED JOINTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 341-16: Section J6.2		
TASK	INSPECTION TYPE ¹	DESCRIPTION
5. CJP groove welds	OBSERVE	Dye penetrant testing (DT) and ultrasonic testing (UT) shall be performed on 100% of CJP groove welds for materials greater than 5/16" thick (8mm).
6. Beam cope and access hole.	OBSERVE	At welded splices and connections, thermally cut surfaces of beam copes and access holes shall be tested using magnetic particle testing (MT) or dye penetrant testing (DT), when the flange thickness exceeds 1 1/2 in. for rolled shapes, or when the web thickness exceeds 1 1/2 in. for built-up shapes.
7. K-area NDT (AISC 341)	PERFORM	Where welding of doubler plates, continuity plates or stiffeners has been performed in the k-area, the web shall be tested for cracks using magnetic particle testing (MT). The MT inspection area shall include the k-area base metal within 3-inches of the weld. The MT shall be performed no sooner than 48 hours following completion of the welding.
8. Placement of reinforcing or contouring fillet welds	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

E. STRUCTURAL - STEEL - COMPOSITE CONSTRUCTION ¹

THIS SECTION APPLICABLE IF BOX IS CHECKED:

COMPOSITE CONSTRUCTION PRIOR TO PLACING CONCRETE – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 360-16: Table N6.1, AISC 341-16: Table J9-1		
TASK	INSPECTION TYPE ²	DESCRIPTION
1. Placement and installation of steel headed stud anchors	PERFORM	
2. Material identification of reinforcing steel (Type/Grade)	OBSERVE	
3. Determination of carbon equivalent for reinforcing steel other than ASTM A706	OBSERVE	
4. Proper reinforcing steel size, spacing, clearances, support, and orientation	OBSERVE	
5. Reinforcing steel has been tied and supported as required	OBSERVE	

END SECTION

F. STRUCTURAL - STEEL - OTHER INSPECTIONS

THIS SECTION APPLICABLE IF BOX IS CHECKED:

OTHER STEEL INSPECTIONS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.1, AISC 341-16: Tables J8-1 & J10-1		
TASK	INSPECTION TYPE ²	DESCRIPTION
1. Anchor rods and other embedments supporting structural steel	PERFORM	Verify the diameter, grade, type, and length of the anchor rod or embedded item, and the extent or depth of embedment prior to placement of concrete.
2. Fabricated steel or erected steel frame	OBSERVE	Verify compliance with the details shown on the construction documents, such as braces, stiffeners, member locations and proper application of joint details at each connection.
3. Reduced beam sections (RBS) where/if occurs	DOCUMENT	✓ Contour and finish ✓ Dimensional tolerances
4. Protected zones	DOCUMENT	No holes or unapproved attachments made by fabricator or erector
5. H-piles where/if occurs	DOCUMENT	No holes or unapproved attachments made by the responsible contractor

END SECTION

¹ See Concrete Construction Section for all concrete related inspection of composite steel construction.

² **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

G. STRUCTURAL - COLD-FORMED METAL DECK - PLACEMENT SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>PRIOR TO</u> DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.1		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Verify compliance of materials (deck and all deck accessories) with construction documents, including profiles, material properties, and base metal thickness	PERFORM	
2. Document acceptance or rejection of deck and deck accessories	DOCUMENT	
METAL DECK INSPECTION <u>DURING</u> DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.2		
TASK	INSPECTION TYPE ¹	DESCRIPTION
3. Verify compliance of deck and all deck accessories installation with construction documents	PERFORM	
4. Verify deck materials are represented by the mill certifications that comply with the construction documents	PERFORM	
5. Document acceptance or rejection of installation of deck and deck accessories	DOCUMENT	
METAL DECK INSPECTION <u>AFTER</u> DECK PLACEMENT – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
6. Welding procedure specification (WPS) available	PERFORM	
7. Manufactures certifications for welding consumables available	OBSERVE	
8. Material identification (type/grade)	OBSERVE	
9. Check welding equipment	OBSERVE	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

H. STRUCTURAL - COLD-FORMED METAL DECK – WELDING SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>DURING</u> WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.4		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Use of qualified welders	OBSERVE	
2. Control and handling of welding consumables	OBSERVE	
3. Environmental conditions (wind speed, moisture, temperature)	OBSERVE	
4. WPS followed	OBSERVE	
METAL DECK INSPECTION <u>AFTER</u> WELDING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
5. Verify size and location of welds, including support, sidelap, and perimeter welds.	PERFORM	
6. Welds meet visual acceptance criteria	PERFORM	
7. Verify repair activities	PERFORM	
8. Document acceptance or rejection of welds	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

I. STRUCTURAL - COLD-FORMED METAL DECK – FASTENING SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

METAL DECK INSPECTION <u>BEFORE</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.6		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Manufacturer installation instructions available for mechanical fasteners	OBSERVE	
2. Proper tools available for fastener installation	OBSERVE	
METAL DECK INSPECTION <u>DURING</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.7		
TASK	INSPECTION TYPE ¹	DESCRIPTION
3. Fasteners are positioned as required	OBSERVE	
4. Fasteners are installed in accordance with manufacturer's instructions	OBSERVE	
METAL DECK INSPECTION <u>AFTER</u> MECHANICAL FASTENING – VERIFY THE FOLLOWING ARE IN COMPLIANCE SDI QA/QC-2017, Appendix 1, Table 1.8		
TASK	INSPECTION TYPE ¹	DESCRIPTION
5. Check spacing, type, and installation of support fasteners	PERFORM	
6. Check spacing, type, and installation of sidelap fasteners	PERFORM	
7. Check spacing, type, and installation of perimeter fasteners	PERFORM	
8. Verify repair activities	PERFORM	
9. Document acceptance or rejection of mechanical fasteners	DOCUMENT	

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.
OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.

J. STRUCTURAL - LIGHT GAUGE STEEL FRAMING AND/OR LIGHT GAUGE TRUSSES SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

LIGHT GAUGE STEEL CONSTRUCTION AND CONNECTIONS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.2.2, 1705.11.2, 1705.11.3, UFC 4 023 03		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Trusses spanning 60-feet or greater where/if applies	PERFORM	Verify that temporary and permanent truss restraint/bracing is installed in accordance with approved truss submittal package.
2. Welded connections (seismic and/or wind resisting system)	OBSERVE	Visually inspect all welds composing part of the main wind or seismic force resisting system, including shearwalls, braces, collectors (drag struts), and hold-downs.
3. Connections (seismic and/or wind resisting system)	OBSERVE	Visually inspect all screw attachment, bolting, anchoring and other fastening of components within the main wind or seismic force resisting system, including roof deck, roof framing, exterior wall covering, wall to roof/floor connections, braces, collectors (drag struts) and hold-downs.
4. Cold-formed steel (progressive collapse resisting system where/if applies)	OBSERVE	Verify proper welding operations, screw attachment, bolting, anchoring and other fastening of components within the progressive collapse resisting system, including horizontal tie force elements, vertical tie force elements and bridging elements (UFC 4 023 03).

END SECTION

K. STRUCTURAL - OPEN-WEB STEEL JOISTS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

OPEN-WEB STEEL JOISTS AND JOIST GIRDERS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.2.3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Installation of open-web steel joists and joist girders	OBSERVE	<ul style="list-style-type: none"> ✓ End connections – welded or bolted ✓ Bridging – horizontal and diagonal

END SECTION

¹ **PERFORM:** Perform these tasks for each weld, fastener or bolted connection, and required verification.

OBSERVE: Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

L. STRUCTURAL - CONCRETE CONSTRUCTION SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

CONCRETE CONSTRUCTION, INCLUDING COMPOSITE DECK – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.3 (ACI 318 REFERENCES NOTED IN IBC TABLE)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Inspect reinforcement, including prestressing tendons, and verify placement.	OBSERVE	Verify prior to placing concrete that reinforcing is of specified type, grade and size; that it is free of oil, dirt and unacceptable rust; that it is located and spaced properly; that hooks, bends, ties, stirrups and supplemental reinforcement are placed correctly; that lap lengths, stagger and offsets are provided; and that all mechanical connections are installed per the manufacturer’s instructions and/or evaluation report.
2. Reinforcing bar welding	OBSERVE	✓ Verify weldability of reinforcing bars other than ASTM A 706 ✓ Inspect single-pass fillet welds, maximum 5/16” in accordance with AWS D1.4
3. All other welding	CONTINUOUS	Visually inspect all welds in accordance with AWS D1.4
4. Cast in place anchors and post installed drilled anchors (downward inclined)	OBSERVE	Verify prior to placing concrete that cast in place anchors and post installed drilled anchors have proper embedment, spacing and edge distance.
5. Post-installed adhesive anchors in horizontal or upward inclined orientations	CONTINUOUS AND DOCUMENT	✓ Inspect as required per approved ICC-ES report ✓ Verify that installer is certified for installation of horizontal and overhead installation applications ✓ Inspect proof loading as required by the contract documents
6. Verify use of required mix design	OBSERVE	Verify that all mixes used comply with the approved construction documents
7. Prior to concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete	CONTINUOUS	At the time fresh concrete is sampled to fabricate specimens for strength test verify these tests are performed by qualified technicians.
8. Inspect concrete and/or shotcrete placement for proper application techniques	CONTINUOUS	Verify proper application techniques are used during concrete conveyance and depositing avoids segregation or contamination. Verify that concrete is properly consolidated.
9. Verify maintenance of specified curing temperature and technique	OBSERVE	Inspect curing, cold weather protection, and hot weather protection procedures.
10. Pre-stressed concrete	CONTINUOUS	Verify application of prestressing forces and grouting of bonded prestressing tendons.

CONTINUED ON FOLLOWING PAGE

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.
CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

K. STRUCTURAL - CONCRETE CONSTRUCTION (CONTINUED)

CONCRETE CONSTRUCTION, INCLUDING COMPOSITE DECK – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.3 (ACI 318 REFERENCES NOTED IN IBC TABLE)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Inspect erection of precast concrete members	OBSERVE	
12. Verify in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms from beams and structural slabs.	OBSERVE	
13. Inspect formwork for shape, location and dimensions of the concrete member being formed.	OBSERVE	

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.
DOCUMENT: Document in a report that the work has been performed as required. This is in addition to all other required reports.
CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

M. STRUCTURAL - MASONRY CONSTRUCTION SECTION (ALL RISK CATEGORIES)

THIS SECTION APPLICABLE IF BOX IS CHECKED:

MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>AT START OF CONSTRUCTION</u> IBC 1705.4 (TMS 402-16 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Compliance with approved submittals prior to start	OBSERVE	
2. Proportions of site-mixed mortar.	OBSERVE	
3. Grade and type of reinforcement, anchor bolts, and prestressing tendons and anchorages	OBSERVE	
4. Prestressing technique	OBSERVE	
5. Properties of thin bed mortar for AAC masonry	OBSERVE	
MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>PRIOR TO GROUTING</u> IBC 1705.4 (TMS 402-16 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
6. Grout space	OBSERVE CONTINUOUS	[NOTE: DOR must either delete 'OBSERVE' for Risk Category IV/V, or delete 'CONTINUOUS' for Risk Categories I/II/ III]
7. Proportions of site-prepared grout and prestressing grout for bonded tendons	OBSERVE	
8. Proportions of site-mixed grout and prestressing grout for bonded tendons	OBSERVE	
9. Placement of masonry units and mortar joints	OBSERVE	
10. Welding of reinforcement	CONTINUOUS	
MASONRY CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE <u>DURING CONSTRUCTION</u> IBC 1705.4 (TMS 402-16 TABLE 3.1.2 & 3.1.3)		
TASK	INSPECTION TYPE ¹	DESCRIPTION
11. Size and location of structural elements is in compliance	OBSERVE	
12. Preparation, construction, and protection of masonry during cold weather (temperature below 40°F (4.4°C) or hot weather (temp above 90°F (32.2°C))	OBSERVE	
13. Application and measurement of prestressing force	CONTINUOUS	
14. Placement of grout and prestressing grout for bonded tendons	CONTINUOUS	
15. Placement of AAC masonry units and construction of thin bed mortar joints	CONTINUOUS	Continuous for first 5000 square feet only (465 square meters).
16. Observe preparation of grout specimens, mortar specimens, and/or prisms	OBSERVE	
17. Type, size and placement of reinforcement, connectors, anchor bolts and prestressing tendons and anchorages, including details of anchorage of masonry to structural members, frames, or other construction	OBSERVE CONTINUOUS	[NOTE: DOR must either delete 'OBSERVE' for Risk Category IV/V, or delete 'CONTINUOUS' for Risk Categories I/II/III]

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

N. STRUCTURAL - WOOD CONSTRUCTION – SPECIALTY ITEMS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

WOOD CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. High-load diaphragms where applicable	OBSERVE	Verify thickness and grade of sheathing, size of framing members at panel edges, nail diameters and length, and the number of fastener lines and that fastener spacing is per approved contract documents.
2. Metal-plate connected wood trusses spanning 60 feet or greater	OBSERVE	Verify that the temporary installation restraint/bracing and the permanent individual truss member restraint/bracing are installed in accordance with the approved truss submittal package

END SECTION

O. STRUCTURAL - WOOD CONSTRUCTION - SEISMIC & WIND SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

WOOD CONSTRUCTION SEISMIC AND WIND – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
[NOTE: DOR may uncheck this section where sheathing nailing/fasteners (both shearwall and roof) are consistently greater than 4" on center, or if the design wind speed is less than 110 mph (49 meters/sec) AND the seismic design category is A or B]		
1. Nailing, bolting, anchoring and other fastening of elements of the main wind/seismic force-resisting system	OBSERVE	Includes connectors for: shearwall sheathing, roof/floor sheathing, drag struts/collectors, braces, hold downs, roof and floor framing connections to exterior walls.

END SECTION

P. STRUCTURAL – ISOLATION AND ENERGY DISSIPATION SYSTEMS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

ISOLATION AND ENERGY DISSIPATION SYSTEMS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC TABLE 1705.2.3		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Fabrication and installation	OBSERVE	Verify that fabrication and installation of isolator units and energy dissipation devices conform to manufacturer’s recommendations and approved construction documents

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

Q. GEOTECHNICAL - SOILS INSPECTION SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

SOILS INSPECTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.6		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Materials below shallow foundations are adequate to achieve the design bearing capacity.	OBSERVE	
2. Excavations are extended to proper depth and have reached proper material	OBSERVE	
3. Verify use of proper materials, densities and lift thicknesses during placement and compaction of compacted fill	CONTINUOUS	
4. Prior to placement of compacted fill, inspect subgrade and verify that site has been prepared properly.	OBSERVE	During fill placement, the special inspector shall verify that proper materials and procedures are used in accordance with the provisions of the approved geotechnical report

END SECTION

R. GEOTECHNICAL - DRIVEN DEEP FOUNDATION ELEMENTS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

DEEP DRIVEN FOUNDATION CONSTRUCTION – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.5		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Verify element materials, sizes and lengths comply with requirements	CONTINUOUS	
2. Inspect driving operations and maintain complete and accurate records for each element	CONTINUOUS	
3. Verify placement locations and plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and document any damage to foundation element	CONTINUOUS	

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

CONTINUOUS: Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

S. GEOTECHNICAL - HELICAL PILE FOUNDATIONS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

HELICAL PILE FOUNDATIONS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.9		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Record installation equipment used, pile dimensions, tip elevations, final depth, final installation torque and other pertinent installation data. The approved geotechnical report and the contract documents shall be used to determine compliance	CONTINUOUS	

END SECTION

T. GEOTECHNICAL - CAST IN PLACE DEEP FOUNDATION ELEMENTS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

CAST IN PLACE DEEP FOUNDATION ELEMENTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.8		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Inspect drilling operations and maintain complete and accurate records for each element.	CONTINUOUS	
2. Verify placement locations and plumbness, confirm element diameters, bell diameters (if applicable), lengths, embedment into bedrock (if applicable and adequate end-bearing strata capacity. Record concrete or grout volumes	CONTINUOUS	

END SECTION

¹ **CONTINUOUS:** Constant monitoring of identified tasks by a special inspector over the duration of performance of said tasks.

U. FIRE PROTECTION - SPRAYED FIRE-RESISTANT MATERIALS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

SPRAYED FIRE RESISTANT MATERIALS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.14		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Surface condition	OBSERVE	Prior to application confirm that surface has been prepared per the approved fire-resistance design and manufacturer’s instructions.
2. Application	OBSERVE	Prior to application confirm that the substrate meets the minimum ambient temperature per the approved fire-resistance design and manufacturer’s instructions.
3. Material thickness	OBSERVE	Verify that the thickness of the SFRM to structural elements is not less than the thickness require by the fire-resistant design in more that 10 percent of the measurement, but in no case less than minimum allowable thickness required by 1705.14.
4. Material density	OBSERVE	Verify that the thickness of the SFRM to structural elements is not less than the thickness require by the fire-resistant design in more than 10 percent of the measurement, but in no case less than minimum allowable thickness required by IBC 1705.14.5
5. Bond strength	OBSERVE	Verify cohesive/adhesive bond strength of the cured SFRM applied to the structural element is not less than 150psf and according to IBC 1705.14.6

END SECTION

V. FIRE PROTECTION - MASTIC AND INTUMESCENT COATINGS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

MASTIC AND INTUMESCENT FIRE-RESISTANT COATINGS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.15		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Surface preparation	OBSERVE	Inspections shall be performed in accordance with AWCI 12-B and the contract documents

END SECTION

W. FIRE PROTECTION – FIRE RESISTANT PENETRATIONS AND JOINTS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

FIRE RESISTANT PENETRATIONS AND JOINTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.17		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Inspections of penetration firestop systems conducted in accordance with ASTM E 2174.	OBSERVE	
2. Inspections of fire-resistant joint systems conducted in accordance with ASTM E 2393	OBSERVE	

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

END SECTION

FIRE PROTECTION – SMOKE CONTROL SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

SMOKE CONTROL – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.17		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Verify device locations and perform leakage testing	OBSERVE	Perform during erection of ductwork and prior to concealment
2. Pressure difference testing, flow measurements and detection and control verification	OBSERVE	Perform prior to occupancy and after sufficient completion

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor's risk.

X. ARCHITECTURAL - EXTERIOR INSULATION AND FINISH SYSTEMS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

EXTERIOR INSULATION AND FINISH SYSTEMS (EIFS) – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.16		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Water resistive barrier coating applied over a sheathing substrate.	OBSERVE	Verify that water resistive barrier coating complies with ASTM E 2570.

END SECTION

Y. ARCHITECTURAL – ARCHITECTURAL COMPONENTS

THIS SECTION APPLICABLE IF BOX IS CHECKED:

ARCHITECTURAL COMPONENTS – VERIFY THE FOLLOWING ARE IN COMPLIANCE IBC 1705.12.5, 1705.12.7		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Erection and fastening of exterior cladding and interior and exterior veneer.	OBSERVE	Verify appropriate materials, fasteners and attachment at commencement of work and at completion. Inspector Note: Inspection not required if height is less than 30 feet or weight is less than 5psf
2. Interior and exterior non-load bearing walls	OBSERVE	Verify appropriate materials, fasteners and attachment at commencement of work and at completion. Inspector Note: Inspection not required if height is less than 30 feet. Also, Interior non-load bearing walls need not be inspected if weighing less than 15psf
3. Access floors	OBSERVE	Verify that anchorage complies with approved construction documents. Inspection of post-installed anchors shall comply with approved ICC-ES report
4. Storage racks	OBSERVE	Verify that anchorage complies with approved construction documents. Inspection of post-installed anchors shall comply with approved ICC-ES report. Inspector Note: Not required for racks less than 8 feet in height

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

Z. PLUMBING/MECHANICAL/ELECTRICAL DESIGNATED SEISMIC SYSTEMS SECTION

THIS SECTION APPLICABLE IF BOX IS CHECKED:

PLUMBING, MECHANICAL AND ELECTRICAL - DESIGNATED SEISMIC SYSTEMS IBC 1705.12.4		
TASK	INSPECTION TYPE ¹	DESCRIPTION
1. Designated Seismic Systems equipment verification	OBSERVE	<ul style="list-style-type: none"> ✓ Verify model number and serial number are in conformance with project specific seismic qualification (PSSQ) ✓ Verify Tag ID is correct and installed per specifications
2. Designated Seismic Systems equipment Mounting	OBSERVE	<ul style="list-style-type: none"> ✓ Verify that Anchor Base Bolting is installed per PSSQ ✓ Verify that Equipment Bracing is Installed per PSSQ ✓ Verify that Bracing Attachments are installed per PSSQ
3. Designated Seismic Systems utility Conduit/Piping	OBSERVE	<ul style="list-style-type: none"> ✓ Verify that Conduit/Piping is connected to the equipment per PSSQ (flex or rigid) ✓ Verify that Conduit/Piping is seismically supported independently of equipment and in accordance with PSSQ support requirements
4. Designated Seismic Systems clearance	OBSERVE	<ul style="list-style-type: none"> ✓ Adjacent Equipment – Verify that there is adequate gap to eliminate possibility of pounding ✓ Conduit/Piping - Verify that there is adequate gap to eliminate possibility of pounding

END SECTION

¹ **OBSERVE:** Observe these items on a random sampling basis daily to insure that applicable requirements are met. Operations need not be delayed pending these inspections at contractor’s risk.

Project: Construct New Entryway Building 17
 Location: Lebanon, Pennsylvania
 Project #: 595-668
 Date: 11/24/2021

STATEMENT OF SPECIAL INSPECTIONS

Project Seismic Design Category: A

Project Risk Category: II

Project Design Wind Speed (mph): 113

Number of Stories: 1

Structure Height Above Grade (ft): 35

Hazardous Occupancy or attached to such? No Group H Occupancies

Special Inspector of Record (SIOR)

A Special Inspector of Record (SIOR) IS NOT required (per UFGS 01 45 35, Section 1.3.8)

Lateral Force Resisting System (LFRS)

2021 IBC 1704.3.2 and 1704.3.3

Following is a listing of critical main wind/seismic force resisting systems for this structure. Carefully inspect these elements as part of the roles and responsibilities of the Special Inspector (reference the Schedule of Special Inspections for inspection checklists).

Vertical LFRS Elements	Notes
Ordinary Steel Moment resisting Frames (SMRF)	Both orthogonal Directions, See plan for call out
Horizontal LFRS Elements	Notes
Metal Roof Deck & Related Fastening System	See Roof Plan

Project: Construct New Entryway Building 17
 Location: Lebanon, Pennsylvania
 Project #: 595-668
 Date: 11/24/2021

Designated Seismic Systems (DSS)

(2021 IBC 1705.13.3) (ASCE 7-16, 13.2.2, C13.2.2) (UFC 3-301-1, 2-5.3)

DESIGNATED SEISMIC SYSTEMS DO NOT APPLY TO THIS PROJECT, due to the Seismic Design Category being less than C.

ELECTRICAL Designated Seismic Systems (DSS) Requiring a Certificate of Compliance	
N/A	
N/A	
N/A	
N/A	
N/A	

If additional space is required, append an additional sheet listing the remaining DSS

MECHANICAL/PLUMBING Designated Seismic Systems (DSS) Requiring a Certificate of Compliance	
N/A	
N/A	
N/A	
N/A	
N/A	
N/A	

If additional space is required, append an additional sheet listing the remaining DSS

OTHER Designated Seismic Systems (DSS) Requiring a Certificate of Compliance	
N/A	
N/A	
N/A	
N/A	
N/A	
N/A	

Final Walk Down Inspection and Report

(UFC 3 301 01 SECTION 2-5.4)

Final Walk Down Inspection of non-structural Designated Seismic Systems does not apply to this project (no Designated Seismic Systems)

3. Document that all Designated Seismic Systems are installed according to construction/manufacturer document requirements, and that Compliance Certificates have been collected (UFC 03 301 01, 3-6.2, 13.2.2.2).

SECTION 01 57 19
TEMPORARY ENVIRONMENTAL CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the control of environmental pollution and damage that the Contractor must consider for air, water, and land resources. It includes management of visual aesthetics, noise, solid waste, radiant energy, and radioactive materials, as well as other pollutants and resources encountered or generated by the Contractor. The Contractor is obligated to consider specified control measures with the costs included within the various contract items of work.
- B. Environmental pollution and damage is defined as the presence of chemical, physical, or biological elements or agents which:
1. Adversely effect human health or welfare,
 2. Unfavorably alter ecological balances of importance to human life,
 3. Effect other species of importance to humankind, or;
 4. Degrade the utility of the environment for aesthetic, cultural, and historical purposes.
- C. Definitions of Pollutants:
1. Chemical Waste: Petroleum products, bituminous materials, salts, acids, alkalis, herbicides, pesticides, organic chemicals, and inorganic wastes.
 2. Debris: Combustible and noncombustible wastes, such as leaves, tree trimmings, ashes, and waste materials resulting from construction or maintenance and repair work.
 3. Sediment: Soil and other debris that has been eroded and transported by runoff water.
 4. Solid Waste: Rubbish, debris, garbage, and other discarded solid materials resulting from industrial, commercial, and agricultural operations and from community activities.
 5. Surface Discharge: The term "Surface Discharge" implies that the water is discharged with possible sheeting action and subsequent soil erosion may occur. Waters that are surface discharged may terminate in drainage ditches, storm sewers, creeks, and/or "water of the United States" and would require a permit to discharge water from the governing agency.

6. Rubbish: Combustible and noncombustible wastes such as paper, boxes, glass and crockery, metal and lumber scrap, tin cans, and bones.
7. Sanitary Wastes:
 - a. Sewage: Domestic sanitary sewage and human and animal waste.
 - b. Garbage: Refuse and scraps resulting from preparation, cooking, dispensing, and consumption of food.

1.2 QUALITY CONTROL

- A. Establish and maintain quality control for the environmental protection of all items set forth herein.
- B. Record on daily reports any problems in complying with laws, regulations, and ordinances. Note any corrective action taken.

1.3 REFERENCES

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.
- B. U.S. National Archives and Records Administration (NARA):
33 CFR 328.....Definitions

1.4 SUBMITTALS

- A. In accordance with Section, 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 1. Environmental Protection Plan: After the contract is awarded and prior to the commencement of the work, the Contractor shall meet with the COR to discuss the proposed Environmental Protection Plan and to develop mutual understanding relative to details of environmental protection. Not more than 20 days after the meeting, the Contractor shall prepare and submit to the and the Contracting Officer for approval, a written and/or graphic Environmental Protection Plan including, but not limited to, the following:
 - a. Name(s) of person(s) within the Contractor's organization who is (are) responsible for ensuring adherence to the Environmental Protection Plan.
 - b. Name(s) and qualifications of person(s) responsible for manifesting hazardous waste to be removed from the site.
 - c. Name(s) and qualifications of person(s) responsible for training the Contractor's environmental protection personnel.
 - d. Description of the Contractor's environmental protection personnel training program.

- e. A list of Federal, State, and local laws, regulations, and permits concerning environmental protection, pollution control, noise control and abatement that are applicable to the Contractor's proposed operations and the requirements imposed by those laws, regulations, and permits.
 - f. Methods for protection of features to be preserved within authorized work areas including trees, shrubs, vines, grasses, ground cover, landscape features, air and water quality, fish and wildlife, soil, historical, and archeological and cultural resources.
 - g. Procedures to provide the environmental protection that comply with the applicable laws and regulations. Describe the procedures to correct pollution of the environment due to accident, natural causes, or failure to follow the procedures as described in the Environmental Protection Plan.
 - h. Permits, licenses, and the location of the solid waste disposal area.
 - i. Drawings showing locations of any proposed temporary excavations or embankments for haul roads, stream crossings, material storage areas, structures, sanitary facilities, and stockpiles of excess or spoil materials. Include as part of an Erosion Control Plan approved by the District Office of the U.S. Soil Conservation Service and the Department of Veterans Affairs.
 - j. Environmental Monitoring Plans for the job site including land, water, air, and noise.
 - k. Work Area Plan showing the proposed activity in each portion of the area and identifying the areas of limited use or nonuse. Plan should include measures for marking the limits of use areas. This plan may be incorporated within the Erosion Control Plan.
- B. Approval of the Contractor's Environmental Protection Plan will not relieve the Contractor of responsibility for adequate and continued control of pollutants and other environmental protection measures.

1.5 PROTECTION OF ENVIRONMENTAL RESOURCES

- A. Protect environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire period of this contract. Confine activities to areas defined by the specifications and drawings.

- B. Protection of Land Resources: Prior to construction, identify all land resources to be preserved within the work area. Do not remove, cut, deface, injure, or destroy land resources including trees, shrubs, vines, grasses, top soil, and land forms without permission from the COR. Do not fasten or attach ropes, cables, or guys to trees for anchorage unless specifically authorized, or where special emergency use is permitted.
1. Work Area Limits: Prior to any construction, mark the areas that require work to be performed under this contract. Mark or fence isolated areas within the general work area that are to be saved and protected. Protect monuments, works of art, and markers before construction operations begin. Convey to all personnel the purpose of marking and protecting all necessary objects.
 2. Protection of Landscape: Protect trees, shrubs, vines, grasses, land forms, and other landscape features shown on the drawings to be preserved by marking, fencing, or using any other approved techniques.
 - a. Box and protect from damage existing trees and shrubs to remain on the construction site.
 - b. Immediately repair all damage to existing trees and shrubs by trimming, cleaning, and painting with antiseptic tree paint.
 - c. Do not store building materials or perform construction activities closer to existing trees or shrubs than the farthest extension of their limbs.
 3. Reduction of Exposure of Unprotected Erodible Soils: Plan and conduct earthwork to minimize the duration of exposure of unprotected soils. Clear areas in reasonably sized increments only as needed to use. Form earthwork to final grade as shown. Immediately protect side slopes and back slopes upon completion of rough grading.
 4. Temporary Protection of Disturbed Areas: Construct diversion ditches, benches, and berms to retard and divert runoff from the construction site to protected drainage areas approved under paragraph 208 of the Clean Water Act.
 - a. Sediment Basins: Trap sediment from construction areas in temporary or permanent sediment basins that accommodate the

- runoff of a local _____ (design year) storm. After each storm, pump the basins dry and remove the accumulated sediment. Control overflow/drainage with paved weirs or by vertical overflow pipes, draining from the surface.
- b. Reuse or conserve the collected topsoil sediment as directed by the COR. Topsoil use and requirements are specified in Section 31 20 00, EARTH MOVING.
 - c. Institute effluent quality monitoring programs as required by Federal, State, and local environmental agencies.
5. Erosion and Sedimentation Control Devices: The erosion and sediment controls selected and maintained by the Contractor shall be such that water quality standards are not violated as a result of the Contractor's activities. Construct or install all temporary and permanent erosion and sedimentation control features shown on the Environmental Protection Plan. Maintain temporary erosion and sediment control measures such as berms, dikes, drains, sedimentation basins, grassing, and mulching, until permanent drainage and erosion control facilities are completed and operative.
 6. Manage borrow areas on and off Government property to minimize erosion and to prevent sediment from entering nearby water courses or lakes.
 7. Manage and control spoil areas on and off Government property to limit spoil to areas shown on the Environmental Protection Plan and prevent erosion of soil or sediment from entering nearby water courses or lakes.
 8. Protect adjacent areas from despoilment by temporary excavations and embankments.
 9. Handle and dispose of solid wastes in such a manner that will prevent contamination of the environment. Place solid wastes (excluding clearing debris) in containers that are emptied on a regular schedule. Transport all solid waste off Government property and dispose of waste in compliance with Federal, State, and local requirements.
 10. Store chemical waste away from the work areas in corrosion resistant containers and dispose of waste in accordance with Federal, State, and local regulations.

11. Handle discarded materials other than those included in the solid waste category as directed by the COR.
- C. Protection of Water Resources: Keep construction activities under surveillance, management, and control to avoid pollution of surface and ground waters and sewer systems. Implement management techniques to control water pollution by the listed construction activities that are included in this contract.
1. Washing and Curing Water: Do not allow wastewater directly derived from construction activities to enter water areas. Collect and place wastewater in retention ponds allowing the suspended material to settle, the pollutants to separate, or the water to evaporate.
 2. Control movement of materials and equipment at stream crossings during construction to prevent violation of water pollution control standards of the Federal, State, or local government.
 3. Monitor water areas affected by construction.
- D. Protection of Fish and Wildlife Resources: Keep construction activities under surveillance, management, and control to minimize interference with, disturbance of, or damage to fish and wildlife. Prior to beginning construction operations, list species that require specific attention along with measures for their protection.
- E. Protection of Air Resources: Keep construction activities under surveillance, management, and control to minimize pollution of air resources. Burning is not permitted on the job site. Keep activities, equipment, processes, and work operated or performed, in strict accordance with the State of insert Name of State and title of State Air Pollution Statute, Rule, or Regulation and Federal emission and performance laws and standards. Maintain ambient air quality standards set by the Environmental Protection Agency, for those construction operations and activities specified.
1. Particulates: Control dust particles, aerosols, and gaseous by-products from all construction activities, processing, and preparation of materials (such as from asphaltic batch plants) at all times, including weekends, holidays, and hours when work is not in progress.
 2. Particulates Control: Maintain all excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and all other work areas within or outside the

project boundaries free from particulates which would cause a hazard or a nuisance. Sprinklering, chemical treatment of an approved type, light bituminous treatment, baghouse, scrubbers, electrostatic precipitators, or other methods are permitted to control particulates in the work area.

3. Hydrocarbons and Carbon Monoxide: Control monoxide emissions from equipment to Federal and State allowable limits.
 4. Odors: Control odors of construction activities and prevent obnoxious odors from occurring.
- F. Reduction of Noise: Minimize noise using every action possible. Perform noise-producing work in less sensitive hours of the day or week as directed by the COR. Maintain noise-produced work at or below the decibel levels and within the time periods specified.
1. Perform construction activities involving repetitive, high-level impact noise only between 8:00 ___a.m. and 6:00___p.m unless otherwise permitted by local ordinance or the COR. Repetitive impact noise on the property shall not exceed the following dB limitations:

Time Duration of Impact Noise	Sound Level in dB
More than 12 minutes in any hour	70
Less than 30 seconds of any hour	85
Less than three minutes of any hour	80
Less than 12 minutes of any hour	75

2. Provide sound-deadening devices on equipment and take noise abatement measures that are necessary to comply with the requirements of this contract, consisting of, but not limited to, the following:
 - a. Maintain maximum permissible construction equipment noise levels at 15 m (50 feet) (dBA):

EARTHMOVING		MATERIALS HANDLING	
FRONT LOADERS	75	CONCRETE MIXERS	75
BACKHOES	75	CONCRETE PUMPS	75
DOZERS	75	CRANES	75
TRACTORS	75		
SCAPERS	80		

GRADERS	75	JACK HAMMERS	75
TRUCKS	75	ROCK DRILLS	80
PAVERS, STATIONARY	80	PNEUMATIC TOOLS	80
PUMPS	75		--
GENERATORS	75	SAWS	75
COMPRESSORS	75	VIBRATORS	75

- b. Use shields or other physical barriers to restrict noise transmission.
 - c. Provide soundproof housings or enclosures for noise-producing machinery.
 - d. Use efficient silencers on equipment air intakes.
 - e. Use efficient intake and exhaust mufflers on internal combustion engines that are maintained so equipment performs below noise levels specified.
 - f. Line hoppers and storage bins with sound deadening material.
 - g. Conduct truck loading, unloading, and hauling operations so that noise is kept to a minimum.
3. Measure sound level for noise exposure due to the construction at least once every five successive working days while work is being performed above 55 dB(A) noise level. Measure noise exposure at the property line or 15 m (50 feet) from the noise source, whichever is greater. Measure the sound levels on the A weighing network of a General Purpose sound level meter at slow response. To minimize the effect of reflective sound waves at buildings, take measurements at 900 to 1800 mm (three to six feet) in front of any building face. Submit the recorded information to the COR noting any problems and the alternatives for mitigating actions.
- G. Restoration of Damaged Property: If any direct or indirect damage is done to public or private property resulting from any act, omission, neglect, or misconduct, the Contractor shall restore the damaged property to a condition equal to that existing before the damage at no additional cost to the Government. Repair, rebuild, or restore property as directed or make good such damage in an acceptable manner.
- H. Final Clean-up: On completion of project and after removal of all debris, rubbish, and temporary construction, Contractor shall leave the

construction area in a clean condition satisfactory to the COR.
Cleaning shall include off the station disposal of all items and
materials not required to be salvaged, as well as all debris and rubbish
resulting from demolition and new work operations.

- - - E N D - - -

SECTION 01 58 16
TEMPORARY INTERIOR SIGNAGE

PART 1 GENERAL

DESCRIPTION

This section specifies temporary interior signs.

PART 2 PRODUCTS

2.1 TEMPORARY SIGNS

- A. Fabricate from 50 Kg (110 pound) mat finish white paper.
- B. Cut to 100 mm (4-inch) wide by 300 mm (12 inch) long size tag.
- C. Punch 3 mm (1/8-inch) diameter hole centered on 100 mm (4-inch) dimension of tag. Edge of Hole spaced approximately 13 mm (1/2-inch) from one end on tag.
- D. Reinforce hole on both sides with gummed cloth washer or other suitable material capable of preventing tie pulling through paper edge.
- E. Ties: Steel wire 0.3 mm (0.0120-inch) thick, attach to tag with twist tie, leaving 150 mm (6-inch) long free ends.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install temporary signs attached to room door frame or room door knob, lever, or pull for doors on corridor openings.
- B. Mark on signs with felt tip marker having approximately 3 mm (1/8-inch) wide stroke for clearly legible numbers or letters.
- C. Identify room with numbers as designated on floor plans.

3.2 LOCATION

- A. Install on doors that have room, corridor, and space numbers shown.
- B. Doors that do not require signs are as follows:
 - 1. Corridor barrier doors (cross-corridor) in corridor with same number.
 - 2. Folding doors or partitions.
 - 3. Toilet or bathroom doors within and between rooms.
 - 4. Communicating doors in partitions between rooms with corridor entrance doors.
 - 5. Closet doors within rooms.
- C. Replace missing, damaged, or illegible signs.

- - - E N D - - -

SECTION 01 74 19
CONSTRUCTION WASTE MANAGEMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
 - 1. Waste Management Plan development and implementation.
 - 2. Techniques to minimize waste generation.
 - 3. Sorting and separating of waste materials.
 - 4. Salvage of existing materials and items for reuse or resale.
 - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
 - 1. Soil.
 - 2. Inerts (eg, concrete, masonry and asphalt).
 - 3. Clean dimensional wood and palette wood.
 - 4. Green waste (biodegradable landscaping materials).
 - 5. Engineered wood products (plywood, particle board and I-joists, etc).
 - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
 - 7. Cardboard, paper and packaging.
 - 8. Bitumen roofing materials.
 - 9. Plastics (eg, ABS, PVC).
 - 10. Carpet and/or pad.
 - 11. Gypsum board.
 - 12. Insulation.
 - 13. Paint.
 - 14. Fluorescent lamps.

1.2 RELATED WORK

- A. Section 02 41 00, DEMOLITION.

B. Section 01 00 00, GENERAL REQUIREMENTS.

C. Lead Paint: Section 02 83 33.13, LEAD BASED PAINT REMOVAL AND DISPOSAL.

1.3 QUALITY ASSURANCE

A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:

1. Excess or unusable construction materials.
2. Packaging used for construction products.
3. Poor planning and/or layout.
4. Construction error.
5. Over ordering.
6. Weather damage.
7. Contamination.
8. Mishandling.
9. Breakage.

B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.

C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.

D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.

E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.

F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to

be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.

- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

1.4 TERMINOLOGY

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.

- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.
- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
 - 1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
 - 2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:

- B. Prepare and submit to the Resident Engineer a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
1. Procedures to be used for debris management.
 2. Techniques to be used to minimize waste generation.
 3. Analysis of the estimated job site waste to be generated:
 - a. List of each material and quantity to be salvaged, reused, recycled.
 - b. List of each material and quantity proposed to be taken to a landfill.
 4. Detailed description of the Means/Methods to be used for material handling.
 - a. On site: Material separation, storage, protection where applicable.
 - b. Off site: Transportation means and destination. Include list of materials.
 - 1) Description of materials to be site-separated and self-hauled to designated facilities.
 - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
 - c. The names and locations of mixed debris reuse and recycling facilities or sites.
 - d. The names and locations of trash disposal landfill facilities or sites.
 - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

1.6 APPLICABLE PUBLICATIONS

- A Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.

B. U.S. Green Building Council (USGBC):

LEED Green Building Rating System for New Construction

1.7 RECORDS

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration. Records shall be kept in accordance with the LEED Reference Guide and LEED Template.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

PART 3 - EXECUTION

3.1 COLLECTION

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

3.2 DISPOSAL

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

3.3 REPORT

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.

- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -

SECTION 01 81 13
SUSTAINABLE CONSTRUCTION REQUIREMENTS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section describes general requirements and procedures to comply with federal mandates and U.S. Department of Veterans Affairs (VA) policies for sustainable construction.
- B. The Design Professional has selected materials and utilized integrated design processes that achieve the Government's objectives. Contractor is responsible to maintain and support these objectives in developing means and methods for performing work and in proposing product substitutions or changes to specified processes. Obtain approval from Contracting Officer for all changes and substitutions to materials or processes. Proposed changes must meet, or exceed, materials or processes specified.

1.2 RELATED WORK

- A. Section 01 57 19 TEMPORARY ENVIRONMENTAL CONTROLS.
- B. Section 01 74 19 CONSTRUCTION WASTE MANAGEMENT.
- C. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

1.3 DEFINITIONS

- A. Recycled Content: Recycled content of materials is defined according to Federal Trade Commission Guides for the Use of Environmental Marketing Claims (16 CFR Part 260). Recycled content value of a material assembly is determined by weight. Recycled fraction of assembly is multiplied by cost of assembly to determine recycled content value.
 - 1. "Post-Consumer" material is defined as waste material generated by households or by commercial, industrial, and institutional facilities in their role as end users of the product, which can no longer be used for its intended purpose.
 - 2. "Pre-Consumer" material is defined as material diverted from waste stream during the manufacturing process. Excluded is reutilization of materials such as rework, regrind, or scrap generated in a process and capable of being reclaimed within the same process that generated it.
- B. Biobased Products: Biobased products are derived from plants and other renewable agricultural, marine, and forestry materials and provide an

alternative to conventional petroleum derived products. Biobased products include diverse categories such as lubricants, cleaning products, inks, fertilizers, and bioplastics.

- C. Low Pollutant-Emitting Materials: Materials and products which are minimally odorous, irritating, or harmful to comfort and well-being of installers and occupants.
- D. Volatile Organic Compounds (VOC): Chemicals that are emitted as gases from certain solids or liquids. VOCs include a variety of chemicals, some of which may have short- and long-term adverse health effects.

1.4 REFERENCE STANDARDS

- A. Carpet and Rug Institute Green Label Plus program.
- B. U.S. Department of Agriculture BioPreferred program (USDA BioPreferred).
- C. U.S. Environmental Protection Agency Comprehensive Procurement Guidelines (CPG).
- D. U.S. Environmental Protection Agency WaterSense Program (WaterSense).
- E. U.S. Environmental Protection Agency ENERGY STAR Program (ENERGY STAR).
- F. U. S. Department of Energy Federal Energy Management Program (FEMP).
- G. Green Electronic Council EPEAT Program (EPEAT).

1.5 SUBMITTALS

- A. All submittals to be provided by contractor to COR.
- B. Sustainability Action Plan:
 - 1. Submit documentation as required by this section; provide additional copies of typical submittals required under technical sections when sustainable construction requires copies of record submittals.
 - 2. Within 30 days after Preconstruction Meeting provide a narrative plan for complying with requirements stipulated within this section.
 - 3. Sustainability Action Plan must:
 - a. Make reference to sustainable construction submittals defined by this section.
 - b. Address all items listed under PERFORMANCE CRITERIA.
 - c. Indicate individual(s) responsible for implementing the plan.
- C. Low Pollutant-Emitting Materials Tracking Spreadsheet: Within 30 days after Preconstruction Meeting provide a preliminary Low Pollutant-Emitting Materials Tracking Spreadsheet. The Low Pollutant-Emitting Materials Tracking Spreadsheet must be an electronic file and include

all materials on Project in categories described under Low Pollutant-Emitting Materials in 01 81 13.

D. Construction Indoor Air Quality (IAQ) Management Plan:

1. Not more than 30 days after Preconstruction Meeting provide a Construction IAQ Management Plan as an electronic file including descriptions of the following:
 - a. Instruction procedures for meeting or exceeding minimum requirements of ANSI/SMACNA 008-2008, Chapter 3, including procedures for HVAC Protection, Source Control, Pathway Interruption, Housekeeping, and Scheduling.
 - b. Instruction procedures for protecting absorptive materials stored on-site or installed from moisture damage.
 - c. Schedule of submission of photographs of on-site construction IAQ management measures such as protection of ducts and on-site stored oil installed absorptive materials.
 - d. Instruction procedures if air handlers must be used during construction, including a description of filtration media to be used at each return air grille.
 - e. Instruction procedure for replacing all air-filtration media immediately prior to occupancy after completion of construction, including a description of filtration media to be used at each air handling or air supply unit.
 - f. Instruction procedures and schedule for implementing building flush-out.

E. Product Submittals:

1. Recycled Content: Submit product data from manufacturer indicating percentages by weight of post-consumer and pre-consumer recycled content for products having recycled content (excluding MEP systems equipment and components).
2. Biobased Content: Submit product data for products to be installed or used which are included in any of the USDA BioPreferred program's product categories. Data to include percentage of biobased content and source of biobased material.
3. Low Pollutant-Emitting Materials: Submit product data confirming compliance with relevant requirements for all materials on Project in categories described under Low Pollutant-Emitting Materials in 01 81 13.

4. For applicable products and equipment, submit product documentation confirming ENERGY STAR label, FEMP certification, WaterSense, and/or EPEAT certification.
- F. Sustainable Construction Progress Reports: Concurrent with each Application for Payment, submit a Sustainable Construction Progress Report to confirm adherence with Sustainability Action Plan.
1. Include narratives of revised strategies for bringing work progress into compliance with plan and product submittal data.
 2. Include updated and current Low Pollutant-Emitting Materials Tracking Spreadsheet.
 3. Include construction waste tracking, in tons or cubic yards, including waste description, whether diverted or landfilled, hauler, and percent diverted for comingled quantities; and excluding land-clearing debris and soil. Provide haul receipts and documentation of diverted percentages for comingled wastes.
- G. Closeout Submittals: Within 14 days after Substantial Completion provide the following:
1. Final version of Low Pollutant-Emitting Materials Tracking Spreadsheet.
 2. Manufacturer's cut sheets and product data highlighting the Minimum Efficiency Reporting Value (MERV) for filtration media installed at return air grilles during construction if permanently installed air handling units are used during construction.
 3. Manufacturer's cut sheets and product data highlighting the Minimum Efficiency Reporting Value (MERV) for final filtration media in air handling units.
 4. Minimum 18 construction photographs including six photographs taken on three different occasions during construction of ANSI/SMACNA 008-2008, Chapter 3 approaches employed, along with a brief description of each approach, documenting implementation of IAQ management measures, such as protection of ducts and on-site stored or installed absorptive materials.
 5. Flush-out Documentation:
 - a. Product data for filtration media used during flush-out.
 - b. Product data for filtration media installed immediately prior to occupancy.

- c. Signed statement describing building air flush-out procedures including dates when flush-out was begun and completed and statement that filtration media was replaced after flush-out.

1.6 QUALITY ASSURANCE

- A. Preconstruction Meeting: After award of Contract and prior to commencement of Work, schedule and conduct meeting with COR and Architect to discuss the Project Sustainable Action Plan content as it applies to submittals, project delivery, required Construction Indoor Air Quality (IAQ) Management Plan, and other Sustainable Construction Requirements. The purpose of this meeting is to develop a mutual understanding of the Sustainable Construction Requirements and coordination of contractor's management of these requirements with the Contracting Officer and the Construction Quality Manager.
- B. Construction Job Conferences: Status of compliance with Sustainable Construction Requirements of these specifications will be an agenda item at regular job meetings conducted during the course of work at the site.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.
- B. Green Seal Standard GS-11, Paints, 1st Edition, May 20, 1993.
- C. Green Seal Standard GC-03, Anti-Corrosive Paints, 2nd Edition, January 7, 1997.
- D. Green Seal Standard GC-36, Commercial Adhesives, October 19, 2000.
- E. South Coast Air Quality Management District (SCAQMD) Rule 1113, Architectural Coatings, rules in effect on January 1, 2004.
- F. South Coast Air Quality Management District (SCAQMD) Rule 1168, July 1, 2005 and rule amendment date of January 7, 2005.
- G. Sheet Metal and Air Conditioning National Contractors' Association (SMACNA) IAQ Guidelines for Occupied Buildings under Construction, 2nd Edition (ANSI/SMACNA 008-2008), Chapter 3.
- H. California Department of Public Health Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor

Sources Using Environmental Chambers, Version 1.1, Emission Testing method for California Specification 01350 (CDPH Standard Method V1.1-2010).

- I. Federal Trade Commission Guides for the Use of Environmental Marketing Claims (16 CFR Part 260).
- J. ASHRAE Standard 52.2-2007.

PART 2 - PRODUCTS

2.1 PERFORMANCE CRITERIA

- A. Construction waste diversion from landfill disposal must comprise at least 50 percent of total construction waste, excluding land clearing debris and soil. Alternative daily cover (ADC) does not qualify as material diverted from disposal.
- B. Low Pollutant-Emitting Materials:
 - 1. Adhesives, sealants and sealant primers applied on site within the weatherproofing membrane must comply with VOC limits of SCAQMD Rule 1168:
 - a. Flooring Adhesives and Sealants:
 - 1) Indoor carpet adhesives: 50 g/L.
 - 2) Wood Flooring Adhesive: 100 g/L.
 - 3) Rubber Floor Adhesives: 60 g/L.
 - 4) Subfloor Adhesives: 50 g/L.
 - 5) Ceramic Tile Adhesives and Grout: 65 g/L.
 - 6) Cove Base Adhesives: 50 g/L.
 - 7) Multipurpose Construction Adhesives: 70 g/L.
 - 8) Porous Material (Except Wood) Substrate: 50 g/L.
 - 9) Wood Substrate: 30 g/L.
 - 10) Architectural Non-Porous Sealant Primer: 250 g/L.
 - 11) Architectural Porous Sealant Primer: 775 g/L.
 - 12) Other Sealant Primer: 750 g/L.
 - 13) Sheet-Applied Rubber Lining Operations: 850 g/L.
 - 14) Top and Trim Adhesive: 250 g/L.
 - 15) Architectural Sealant: 250 g/L.
 - 16) Other Sealant: 420 g/L.
 - b. Non-Flooring Adhesives and Sealants:
 - 1) Drywall and Panel Adhesives: 50 g/L.
 - 2) Multipurpose Construction Adhesives: 70 g/L.

- 3) Structural Glazing Adhesives: 100 g/L.
 - 4) Metal-to-Metal Substrate Adhesives: 30 g/L.
 - 5) Plastic Foam Substrate Adhesive: 50 g/L.
 - 6) Porous Material (Except Wood) Substrate Adhesive: 50 g/L.
 - 7) Wood Substrate Adhesive: 30 g/L.
 - 8) Fiberglass Substrate Adhesive: 80 g/L.
 - 9) Architectural Non-Porous Sealant Primer: 250 g/L.
 - 10) Architectural Porous Sealant Primer: 775 g/L.
 - 11) Other Sealant Primer: 750 g/L.
 - 12) PVC Welding Adhesives: 510 g/L.
 - 13) CPVC Welding Adhesives: 490 g/L.
 - 14) ABS Welding Adhesives: 325 g/L.
 - 15) Plastic Cement Welding Adhesives: 250 g/L.
 - 16) Adhesive Primer for Plastic: 550 g/L.
 - 17) Contact Adhesive: 80 g/L.
 - 18) Special Purpose Contact Adhesive: 250 g/L.
 - 19) Top and Trim Adhesive: 250 g/L.
 - 20) Architectural Sealants: 250 g/L.
 - 21) Other Sealants: 420 g/L.
2. Aerosol adhesives applied on site within the weatherproofing membrane must comply with the following Green Seal GS-36.
- a. Aerosol Adhesive, General-Purpose Mist Spray: 65 percent VOCs by weight.
 - b. Aerosol Adhesive, General-Purpose Web Spray: 55 percent VOCs by weight.
 - c. Special-Purpose Aerosol Adhesive (All Types): 70 percent VOCs by weight.
3. Paints and coatings applied on site within the weatherproofing membrane must comply with the following criteria:
- a. VOC content limits for paints and coatings established in Green Seal Standard GS-11.
 - b. VOC content limit for anti-corrosive and anti-rust paints applied to interior ferrous metal substrates of 250 g/L established in Green Seal GC-03.
 - c. Clear wood finishes, floor coatings, stains, primers, sealers, and shellacs applied to interior elements must not exceed VOC content limits established in SCAQMD Rule 1113.

- d. Comply with the following VOC content limits:
 - 1) Anti-Corrosive/Antirust Paints: 250 g/L.
 - 2) Floor Coating: 100 g/L.
 - 3) Interior Flat Paint, Coating or Primer: 50 g/L.
 - 4) Interior Non-Flat Paint, Coating or Primer: 150 g/L.
 - 5) Sealers and Undercoaters: 200 g/L.
 - 6) Stain: 250 g/L.
 - 7) Concrete Curing Compounds: 350 g/L.
 - 8) Waterproofing Sealers: 250 g/L.
 - 9) Wood Preservatives: 350 g/L.
 - 10) Low-Solids Coatings: 120 g/L.
 4. Carpet installed in building interior must comply with one of the following:
 - a. Meet testing and product requirements of the Carpet and Rug Institute Green Label Plus program.
 - b. Maximum VOC concentrations specified in CDPH Standard Method V1.1-2010, using office scenario at the 14 day time point.
 5. Each non-carpet flooring element installed in building interior which is not inherently non-emitting (stone, ceramic, powder-coated metals, plated or anodized metal, glass, concrete, clay brick, and unfinished or untreated solid wood flooring) must comply with one of the following:
 - a. Meet requirements of the FloorScore standard as shown with testing by an independent third-party.
 - b. Maximum VOC concentrations specified in CDPH Standard Method V1.1-2010, using office scenario at 14 day time point.
 6. Composite wood and agrifiber products used within the weatherproofing membrane must contain no added urea-formaldehyde resins.
 7. Laminating adhesives used to fabricate on-site and shop-applied composite wood and agrifiber assemblies must not contain added urea-formaldehyde.
- C. Recycled Content:
1. Any products being installed or used that are listed on EPA Comprehensive Procurement Guidelines designated product list must meet or exceed the EPA's recycled content recommendations. The EPA Comprehensive Procurement Guidelines categories include:

- a. Building insulation.
 - b. Cement and concrete.
 - c. Consolidated and reprocessed latex paint.
 - d. Floor tiles.
 - e. Flowable fill.
 - f. Laminated paperboard.
 - g. Nonpressure pipe.
 - h. Roofing materials.
 - i. Shower and restroom dividers/partitions.
 - j. Structural fiberboard.
 - k. Nylon carpet and nylon carpet backing.
 - l. Compost and fertilizer made from recovered organic materials.
 - m. Hydraulic mulch.
 - n. Lawn and garden edging.
 - o. Plastic lumber landscaping timbers and posts.
 - p. Plastic fencing.
- D. Biobased Content:
1. Materials and equipment being installed or used that are listed on the USDA BioPreferred program product category list must meet or exceed USDA's minimum biobased content threshold. Refer to individual specification sections for detailed requirements applicable to that section.
 - a. USDA BioPreferred program categories include:
 - 1) Adhesive and Mastic Removers.
 - 2) Carpets.
 - 3) Cleaners.
 - 4) Composite Panels.
 - 5) Corrosion Preventatives.
 - 6) Erosion Control Materials.
 - 7) Dust Suppressants.
 - 8) Fertilizers.
 - 9) Floor Cleaners and Protectors.
 - 10) Floor Coverings (Non-Carpet).
 - 11) Glass Cleaners.
 - 12) Hydraulic Fluids.
 - 13) Industrial Cleaners.
 - 14) Interior Paints and Coatings.

- 15) Mulch and Compost Materials.
- 16) Multipurpose Cleaners.
- 17) Multipurpose Lubricants.
- 18) Packaging Films.
- 19) Paint Removers.
- 20) Plastic Insulating Foam.
- 21) Pneumatic Equipment Lubricants.
- 22) Roof Coatings.
- 23) Wastewater Systems Coatings.
- 24) Water Tank Coatings.
- 25) Wood and Concrete Sealers.

E. Materials, products, and equipment being installed which fall into a category covered by the WaterSense program must be WaterSense-labeled or meet or exceed WaterSense program performance requirements, unless disallowed for infection control reasons.

1. WaterSense categories include:

- a. Bathroom Faucets
- b. Commercial Toilets
- c. Pre-Rinse Spray Valves
- d. Residential Toilets
- e. Showerheads
- f. Spray Sprinkler Bodies
- g. Urinals

F. Materials, products, and equipment being installed which fall into any of the following product categories must be Energy Star-labeled.

1. Applicable Energy Star product categories as of 09/14/2017 include:

a. Appliances:

- 1) Air Purifiers and Cleaners.
- 2) Clothes Washers (Commercial & Residential).
- 3) Dehumidifiers.

b. Electronics and Information Technology:

- 1) Audio/Video Equipment.
- 2) Computers.
- 3) Data Center Storage.
- 4) Digital Media Player.
- 5) Enterprise Servers.
- 6) Imaging Equipment.

- 7) Monitors.
 - 8) Professional Displays.
 - 9) Set-Top and Cable Boxes.
 - 10) Telephones.
 - 11) Televisions.
 - 12) Uninterruptible Power Supplies.
 - 13) Voice over Internet Protocol (VoIP) Phones.
- c. Food Service Equipment (Commercial):
- 1) Dishwashers.
 - 2) Fryers.
 - 3) Griddles.
 - 4) Hot Food Holding Cabinets.
 - 5) Ice Makers.
 - 6) Ovens.
 - 7) Refrigerators and Freezers.
 - 8) Steam Cookers.
 - 9) Vending Machines.
- d. Heating and Cooling Equipment:
- 1) Air-Source Heat Pumps (Residential).
 - 2) Boilers.
 - 3) Ceiling Fans (Residential).
 - 4) Central Air Conditioners (Residential).
 - 5) Ductless Heating and Cooling (Residential).
 - 6) Furnaces (Residential).
 - 7) Water Heaters.
 - 8) Geothermal Heat Pumps (Residential).
 - 9) Light Commercial Heating and Cooling Equipment.
 - 10) Room Air Conditioners (Residential).
 - 11) Ventilation Fans (Residential).
- e. Other:
- 1) Decorative Light Strings.
 - 2) Electric Vehicle Supply Equipment.
 - 3) Laboratory-Grade Refrigerators and Freezers.
 - 4) Light Bulbs.
 - 5) Light Fixtures.
 - 6) Pool Pumps.
 - 7) Roof Products.

- 8) Water Coolers.
 - 9) Windows, Doors, and Skylights.
- G. Materials, products, and equipment being installed which fall into any of the following categories must be FEMP-designated. FEMP-designated product categories as of 09/14/2017 include:
1. Boilers (Commercial).
 2. Dishwashers (Commercial).
 3. Electric Chillers, Air-Cooled (Commercial).
 4. Electric Chillers, Water-Cooled (Commercial).
 5. Exterior Lighting.
 6. Fluorescent Ballasts.
 7. Fluorescent Lamps, General Service.
 8. Ice Machines, Water-Cooled.
 9. Industrial Lighting (High/Low Bay).
 10. Light Emitting Diode (LED) Luminaires.
- H. Electronic products and equipment being installed which fall into any of the following categories shall be EPEAT registered. Electronic products and equipment covered by EPEAT program as of 09/14/2017 include:
1. Computers.
 2. Displays.
 3. Imaging Equipment.
 4. Televisions.

PART 3 - EXECUTION

3.1 FIELD QUALITY CONTROL

- A. Construction Indoor Air Quality Management:
1. During construction, meet or exceed recommended control measures of ANSI/SMACNA 008-2008, Chapter 3.
 2. Protect stored on-site and installed absorptive materials from moisture damage.
 3. If permanently installed air handlers are used during construction, filtration media with a minimum efficiency reporting value (MERV) of 8 must be used at each return air grille, as determined by ASHRAE Standard 52.2-1999 (with errata but without addenda). Replace all filtration media immediately prior to occupancy.
 4. Perform building flush-out as follows:

- a. After construction ends, prior to occupancy and with interior finishes installed, perform a building flush-out by supplying a total volume of 14000 cu. ft. of outdoor air per sq. ft. of floor area while maintaining an internal temperature of at least 60 degrees Fahrenheit and a relative humidity no higher than 60 percent. OR
 - b. If occupancy is desired prior to flush-out completion, the space may be occupied following delivery of a minimum of 3500 cu. ft. of outdoor air per sq. ft. of floor area to the space. Once a space is occupied, it must be ventilated at a minimum rate of 0.30 cfm per sq. ft. of outside air or design minimum outside air rate determined until a total of 14000 cu. ft./sq. ft. of outside air has been delivered to the space. During each day of flush-out period, ventilation must begin a minimum of three hours prior to occupancy and continue during occupancy.
5. Provide construction dust control to comply with SCAQMD Rule 403.

-----END-----

SECTION 01 91 00

GENERAL COMMISSIONING REQUIREMENTS

PART 1 - GENERAL

1.1 COMMISSIONING DESCRIPTION

- A. This Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS shall form the basis of the construction phase commissioning process and procedures. The Commissioning Agent shall add, modify, and refine the commissioning procedures, as approved by the Department of Veterans Affairs (VA), to suit field conditions and actual manufacturer's equipment, incorporate test data and procedure results, and provide detailed scheduling for all commissioning tasks.
- B. Various sections of the project specifications require equipment startup, testing, and adjusting services. Requirements for startup, testing, and adjusting services specified in the Division 21, Division 22, Division 23, Division 26, Division 27, and Division 28, series sections of these specifications are intended to be provided in coordination with the commissioning services and are not intended to duplicate services. The Contractor shall coordinate the work required by individual specification sections with the commissioning services requirements specified herein.
- C. Where individual testing, adjusting, or related services are required in the project specifications and not specifically required by this commissioning requirements specification, the specified services shall be provided and copies of documentation, as required by those specifications shall be submitted to the VA and the Commissioning Agent to be indexed for future reference.
- D. Where training or educational services for VA are required and specified in other sections of the specifications, including but not limited to Division 7, Division 8, Division 21, Division 22, Division 23, Division 26, Division 27, Division 28, and Division 31 series sections of the specification, these services are intended to be provided in addition to the training and educational services specified herein.
- E. Commissioning is a systematic process of verifying that the building systems perform interactively according to the construction documents and the VA's operational needs. The commissioning process shall

encompass and coordinate the system documentation, equipment startup, control system calibration, testing and balancing, performance testing and training. Commissioning during the construction and post-occupancy phases is intended to achieve the following specific objectives according to the contract documents:

1. Verify that the applicable equipment and systems are installed in accordance with the contact documents and according to the manufacturer's recommendations.
 2. Verify and document proper integrated performance of equipment and systems.
 3. Verify that Operations & Maintenance documentation is complete.
 4. Verify that all components requiring servicing can be accessed, serviced and removed without disturbing nearby components including ducts, piping, cabling or wiring.
 5. Verify that the VA's operating personnel are adequately trained to enable them to operate, monitor, adjust, maintain, and repair building systems in an effective and energy-efficient manner.
 6. Document the successful achievement of the commissioning objectives listed above.
- F. The commissioning process does not take away from or reduce the responsibility of the Contractor to provide a finished and fully functioning product.

1.2 CONTRACTUAL RELATIONSHIPS

- A. For this construction project, the Department of Veterans Affairs contracts with a Contractor to provide construction services. The contracts are administered by the VA Contracting Officer and the COR as the designated representative of the Contracting Officer. On this project, the authority to modify the contract in any way is strictly limited to the authority of the Contracting Officer.
- B. In this project, only two contract parties are recognized and communications on contractual issues are strictly limited to VA COR and the Contractor. It is the practice of the VA to require that communications between other parties to the contracts (Subcontractors and Vendors) be conducted through the COR and Contractor. It is also the practice of the VA that communications between other parties of the project (Commissioning Agent and Architect/Engineer) be conducted through the COR.

- C. Whole Building Commissioning is a process that relies upon frequent and direct communications, as well as collaboration between all parties to the construction process. By its nature, a high level of communication and cooperation between the Commissioning Agent and all other parties (Architects, Engineers, Subcontractors, Vendors, third party testing agencies, etc.) is essential to the success of the Commissioning effort.
- D. With these fundamental practices in mind, the commissioning process described herein has been developed to recognize that, in the execution of the Commissioning Process, the Commissioning Agent must develop effective methods to communicate with every member of the construction team involved in delivering commissioned systems while simultaneously respecting the exclusive contract authority of the Contracting Officer and COR. Thus, the procedures outlined in this specification must be executed within the following limitations:
1. No communications (verbal or written) from the Commissioning Agent shall be deemed to constitute direction that modifies the terms of any contract between the Department of Veterans Affairs and the Contractor.
 2. Commissioning Issues identified by the Commissioning Agent will be delivered to the COR and copied to the designated Commissioning Representatives for the Contractor and subcontractors on the Commissioning Team for information only in order to expedite the communication process. These issues must be understood as the professional opinion of the Commissioning Agent and as suggestions for resolution.
 3. In the event that any Commissioning Issues and suggested resolutions are deemed by the COR to require either an official interpretation of the construction documents or require a modification of the contract documents, the Contracting Officer or COR will issue an official directive to this effect.
 4. All parties to the Commissioning Process shall be individually responsible for alerting the COR of any issues that they deem to constitute a potential contract change prior to acting on these issues.
 5. Authority for resolution or modification of design and construction issues rests solely with the Contracting Officer or COR, with

appropriate technical guidance from the Architect/Engineer and/or Commissioning Agent.

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 32.16.15 PROJECT SCHEDULES (SMALL PROJECTS - DESIGN/BID/BUILD)
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- D. Section 01 81 13 SUSTAINABLE CONSTRUCTION REQUIREMENTS
- E. Section 21 08 00 COMMISSIONING OF FIRE PROTECTION SYSTEMS.
- F. Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.
- G. Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.
- H. Section 26 08 00 COMMISSIONING OF ELECTRICAL SYSTEMS.
- I. Section 27 08 00 COMMISSIONING OF COMMUNICATIONS SYSTEMS.
- J. Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

1.4 SUMMARY

- A. This Section includes general requirements that apply to implementation of commissioning without regard to systems, subsystems, and equipment being commissioned.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.

1.5 ACRONYMS

List of Acronyms	
Acronym	Meaning
A/E	Architect / Engineer Design Team
AHJ	Authority Having Jurisdiction
ASHRAE	Association Society for Heating Air Condition and Refrigeration Engineers
BOD	Basis of Design
BSC	Building Systems Commissioning
CCTV	Closed Circuit Television
CD	Construction Documents
CMMS	Computerized Maintenance Management System
CO	Contracting Officer (VA)
COR	Contracting Officer's Representative (see also VA-RE)
COBie	Construction Operations Building Information Exchange

List of Acronyms	
Acronym	Meaning
CPC	Construction Phase Commissioning
Cx	Commissioning
CxA	Commissioning Agent
CxM	Commissioning Manager
CxR	Commissioning Representative
DPC	Design Phase Commissioning
FPT	Functional Performance Test
GBI-GG	Green Building Initiative - Green Globes
HVAC	Heating, Ventilation, and Air Conditioning
LEED	Leadership in Energy and Environmental Design
NC	Department of Veterans Affairs National Cemetery
NCA	Department of Veterans Affairs National Cemetery Administration
NEBB	National Environmental Balancing Bureau
O&M	Operations & Maintenance
OPR	Owner's Project Requirements
PFC	Pre-Functional Checklist
PFT	Pre-Functional Test
SD	Schematic Design
SO	Site Observation
TAB	Test Adjust and Balance
VA	Department of Veterans Affairs
VAMC	VA Medical Center
VA CFM	VA Office of Construction and Facilities Management
VACO	VA Central Office
VA PM	VA Project Manager
VA-RE	VA COR
USGBC	United States Green Building Council

1.6 DEFINITIONS

Acceptance Phase Commissioning: Commissioning tasks executed after most construction has been completed, most Site Observations and Static Tests have been completed and Pre-Functional Testing has been completed and accepted. The main commissioning activities performed during this

phase are verification that the installed systems are functional by conducting Systems Functional Performance tests and Owner Training.

Accuracy: The capability of an instrument to indicate the true value of a measured quantity.

Back Check: A back check is a verification that an agreed upon solution to a design comment has been adequately addressed in a subsequent design review

Basis of Design (BOD): The Engineer's Basis of Design is comprised of two components: the Design Criteria and the Design Narrative, these documents record the concepts, calculations, decisions, and product selections used to meet the Owner's Project Requirements (OPR) and to satisfy applicable regulatory requirements, standards, and guidelines.

Benchmarks: Benchmarks are the comparison of a building's energy usage to other similar buildings and to the building itself.. For example, ENERGY STAR Portfolio Manager is a frequently used and nationally recognized building energy benchmarking tool.

Building Information Modeling (BIM): Building Information Modeling is a parametric database which allows a building to be designed and constructed virtually in 3D, and provides reports both in 2D views and as schedules. This electronic information can be extracted and reused for pre-populating facility management CMMS systems. Building Systems Commissioning (BSC): NEBB acronym used to designate its commissioning program.

Calibrate: The act of comparing an instrument of unknown accuracy with a standard of known accuracy to detect, correlate, report, or eliminate by adjustment any variation in the accuracy of the tested instrument.

CCTV: Closed circuit Television. Normally used for security surveillance and alarm detections as part of a special electrical security system.

COBie: Construction Operations Building Information Exchange (COBie) is an electronic industry data format used to transfer information developed during design, construction, and commissioning into the Computer Maintenance Management Systems (CMMS) used to operate facilities. See the Whole Building Design Guide website for further information (<http://www.wbdg.org/resources/cobie.php>)

Commissionability: Defines a design component or construction process that has the necessary elements that will allow a system or component to be effectively measured, tested, operated and commissioned

Commissioning Agent (CxA): The qualified Commissioning Professional who administers the Cx process by managing the Cx team and overseeing the Commissioning Process. Where CxA is used in this specification it means the Commissioning Agent, members of his staff or appointed members of the commissioning team. Note that LEED uses the term Commissioning Authority in lieu of Commissioning Agent.

Commissioning Checklists: Lists of data or inspections to be verified to ensure proper system or component installation, operation, and function. Verification checklists are developed and used during all phases of the commissioning process to verify that the Owner's Project Requirements (OPR) is being achieved.

Commissioning Design Review: The commissioning design review is a collaborative review of the design professionals design documents for items pertaining to the following: owner's project requirements; basis of design; operability and maintainability (O&M) including documentation; functionality; training; energy efficiency, control systems' sequence of operations including building automation system features; commissioning specifications and the ability to functionally test the systems.

Commissioning Issue: A condition identified by the Commissioning Agent or other member of the Commissioning Team that adversely affects the commissionability, operability, maintainability, or functionality of a system, equipment, or component. A condition that is in conflict with the Contract Documents and/or performance requirements of the installed systems and components. (See also - Commissioning Observation).

Commissioning Manager (CxM): A qualified individual appointed by the Contractor to manage the commissioning process on behalf of the Contractor.

Commissioning Observation: An issue identified by the Commissioning Agent or other member of the Commissioning Team that does not conform to the project OPR, contract documents or standard industry best practices. (See also Commissioning Issue)

Commissioning Plan: A document that outlines the commissioning process, commissioning scope and defines responsibilities, processes, schedules, and the documentation requirements of the Commissioning Process.

Commissioning Process: A quality focused process for enhancing the delivery of a project. The process focuses upon verifying and documenting that the facility and all of its systems, components, and assemblies are planned, designed, installed, tested, can be operated, and maintained to meet the Owner's Project Requirements.

Commissioning Report: The final commissioning document which presents the commissioning process results for the project. Cx reports include an executive summary, the commissioning plan, issue log, correspondence, and all appropriate check sheets and test forms.

Commissioning Representative (CxR): An individual appointed by a sub-contractor to manage the commissioning process on behalf of the sub-contractor.

Commissioning Specifications: The contract documents that detail the objective, scope and implementation of the commissioning process as developed in the Commissioning Plan.

Commissioning Team: Individual team members whose coordinated actions are responsible for implementing the Commissioning Process.

Construction Phase Commissioning: All commissioning efforts executed during the construction process after the design phase and prior to the Acceptance Phase Commissioning.

Contract Documents (CD): Contract documents include design and construction contracts, price agreements and procedure agreements. Contract Documents also include all final and complete drawings, specifications and all applicable contract modifications or supplements.

Construction Phase Commissioning (CPC): All commissioning efforts executed during the construction process after the design phase and prior to the Acceptance Phase Commissioning.

Coordination Drawings: Drawings showing the work of all trades that are used to illustrate that equipment can be installed in the space allocated without compromising equipment function or access for maintenance and replacement. These drawings graphically illustrate and dimension manufacturers' recommended maintenance clearances. On mechanical projects, coordination drawings include structural steel,

ductwork, major piping and electrical conduit and show the elevations and locations of the above components.

Data Logging: The monitoring and recording of temperature, flow, current, status, pressure, etc. of equipment using stand-alone data recorders.

Deferred System Test: Tests that cannot be completed at the end of the acceptance phase due to ambient conditions, schedule issues or other conditions preventing testing during the normal acceptance testing period.

Deficiency: See "Commissioning Issue".

Design Criteria: A listing of the VA Design Criteria outlining the project design requirements, including its source. These are used during the design process to show the design elements meet the OPR.

Design Intent: The overall term that includes the OPR and the BOD. It is a detailed explanation of the ideas, concepts, and criteria that are defined by the owner to be important. The design intent documents are utilized to provide a written record of these ideas, concepts and criteria.

Design Narrative: A written description of the proposed design solutions that satisfy the requirements of the OPR.

Design Phase Commissioning (DPC): All commissioning tasks executed during the design phase of the project.

Environmental Systems: Systems that use a combination of mechanical equipment, airflow, water flow and electrical energy to provide heating, ventilating, air conditioning, humidification, and dehumidification for the purpose of human comfort or process control of temperature and humidity.

Executive Summary: A section of the Commissioning report that reviews the general outcome of the project. It also includes any unresolved issues, recommendations for the resolution of unresolved issues and all deferred testing requirements.

Functionality: This defines a design component or construction process which will allow a system or component to operate or be constructed in a manner that will produce the required outcome of the OPR.

Functional Test Procedure (FTP): A written protocol that defines methods, steps, personnel, and acceptance criteria for tests conducted

on components, equipment, assemblies, systems, and interfaces among systems.

Industry Accepted Best Practice: A design component or construction process that has achieved industry consensus for quality performance and functionality. Refer to the current edition of the NEBB Design Phase Commissioning Handbook for examples.

Installation Verification: Observations or inspections that confirm the system or component has been installed in accordance with the contract documents and to industry accepted best practices.

Integrated System Testing: Integrated Systems Testing procedures entail testing of multiple integrated systems performance to verify proper functional interface between systems. Typical Integrated Systems Testing includes verifying that building systems respond properly to loss of utility, transfer to emergency power sources, re-transfer from emergency power source to normal utility source; interface between HVAC controls and Fire Alarm systems for equipment shutdown, interface between Fire Alarm system and elevator control systems for elevator recall and shutdown; interface between Fire Alarm System and Security Access Control Systems to control access to spaces during fire alarm conditions; and other similar tests as determined for each specific project.

Issues Log: A formal and ongoing record of problems or concerns - and their resolution - that have been raised by members of the Commissioning Team during the course of the Commissioning Process.

Lessons Learned Workshop: A workshop conducted to discuss and document project successes and identify opportunities for improvements for future projects.

Maintainability: A design component or construction process that will allow a system or component to be effectively maintained. This includes adequate room for access to adjust and repair the equipment.

Maintainability also includes components that have readily obtainable repair parts or service.

Manual Test: Testing using hand-held instruments, immediate control system readouts or direct observation to verify performance (contrasted to analyzing monitored data taken over time to make the 'observation').

Owner's Project Requirements (OPR): A written document that details the project requirements and the expectations of how the building and its

systems will be used and operated. These include project goals, measurable performance criteria, cost considerations, benchmarks, success criteria, and supporting information.

Peer Review: A formal in-depth review separate from the commissioning review processes. The level of effort and intensity is much greater than a typical commissioning facilitation or extended commissioning review. The VA usually hires an independent third-party (called the IDIQ A/E) to conduct peer reviews.

Precision: The ability of an instrument to produce repeatable readings of the same quantity under the same conditions. The precision of an instrument refers to its ability to produce a tightly grouped set of values around the mean value of the measured quantity.

Pre-Design Phase Commissioning: Commissioning tasks performed prior to the commencement of design activities that includes project programming and the development of the commissioning process for the project

Pre-Functional Checklist (PFC): A form used by the contractor to verify that appropriate components are onsite, correctly installed, set up, calibrated, functional and ready for functional testing.

Pre-Functional Test (PFT): An inspection or test that is done before functional testing. PFT's include installation verification and system and component start up tests.

Procedure or Protocol: A defined approach that outlines the execution of a sequence of work or operations. Procedures are used to produce repeatable and defined results.

Range: The upper and lower limits of an instrument's ability to measure the value of a quantity for which the instrument is calibrated.

Resolution: This word has two meanings in the Cx Process. The first refers to the smallest change in a measured variable that an instrument can detect. The second refers to the implementation of actions that correct a tested or observed deficiency.

Site Observation Visit: On-site inspections and observations made by the Commissioning Agent for the purpose of verifying component, equipment, and system installation, to observe contractor testing, equipment start-up procedures, or other purposes.

Site Observation Reports (SO): Reports of site inspections and observations made by the Commissioning Agent. Observation reports are

intended to provide early indication of an installation issue which will need correction or analysis.

Special System Inspections: Inspections required by a local code authority prior to occupancy and are not normally a part of the commissioning process.

Static Tests: Tests or inspections that validate a specified static condition such as pressure testing. Static tests may be specification or code initiated.

Start Up Tests: Tests that validate the component or system is ready for automatic operation in accordance with the manufactures requirements.

Systems Manual: A system-focused composite document that includes all information required for the owners operators to operate the systems.

Test Procedure: A written protocol that defines methods, personnel, and expectations for tests conducted on components, equipment, assemblies, systems, and interfaces among systems.

Testing: The use of specialized and calibrated instruments to measure parameters such as: temperature, pressure, vapor flow, air flow, fluid flow, rotational speed, electrical characteristics, velocity, and other data in order to determine performance, operation, or function.

Testing, Adjusting, and Balancing (TAB): A systematic process or service applied to heating, ventilating and air-conditioning (HVAC) systems and other environmental systems to achieve and document air and hydronic flow rates. The standards and procedures for providing these services are referred to as "Testing, Adjusting, and Balancing" and are described in the Procedural Standards for the Testing, Adjusting and Balancing of Environmental Systems, published by NEBB or AABC.

Thermal Scans: Thermographic pictures taken with an Infrared Thermographic Camera. Thermographic pictures show the relative temperatures of objects and surfaces and are used to identify leaks, thermal bridging, thermal intrusion, electrical overload conditions, moisture containment, and insulation failure.

Training Plan: A written document that details, in outline form the expectations of the operator training. Training agendas should include instruction on how to obtain service, operate, startup, shutdown and maintain all systems and components of the project.

Trending: Monitoring over a period of time with the building automation system.

Unresolved Commissioning Issue: Any Commissioning Issue that, at the time that the Final Report or the Amended Final Report is issued that has not been either resolved by the construction team or accepted by the VA. Validation: The process by which work is verified as complete and operating correctly:

1. First party validation occurs when a firm or individual verifying the task is the same firm or individual performing the task.
2. Second party validation occurs when the firm or individual verifying the task is under the control of the firm performing the task or has other possibilities of financial conflicts of interest in the resolution (Architects, Designers, General Contractors and Third Tier Subcontractors or Vendors).
3. Third party validation occurs when the firm verifying the task is not associated with or under control of the firm performing or designing the task.

Verification: The process by which specific documents, components, equipment, assemblies, systems, and interfaces among systems are confirmed to comply with the criteria described in the Owner's Project Requirements.

Warranty Phase Commissioning: Commissioning efforts executed after a project has been completed and accepted by the Owner. Warranty Phase Commissioning includes follow-up on verification of system performance, measurement and verification tasks and assistance in identifying warranty issues and enforcing warranty provisions of the construction contract.

Warranty Visit: A commissioning meeting and site review where all outstanding warranty issues and deferred testing is reviewed and discussed.

Whole Building Commissioning: Commissioning of building systems such as Building Envelope, HVAC, Electrical, Special Electrical (Fire Alarm, Security & Communications), Plumbing and Fire Protection as described in this specification.

1.7 SYSTEMS TO BE COMMISSIONED

- A. Commissioning of a system or systems specified for this project is part of the construction process. Documentation and testing of these

Systems To Be Commissioned	
System	Description
Domestic Hot Water Systems	Point-of-use water heaters*
HVAC	
Noise and Vibration Control	Noise and vibration levels for critical equipment such as Air Handlers, Chillers, Cooling Towers, Boilers, Generators, etc. will be commissioned as part of the system commissioning
Direct Digital Control System**	Operator Interface Computer, Operator Work Station (including graphics, point mapping, trends, alarms), Network Communications Modules and Wiring, Integration Panels. [DDC Control panels will be commissioned with the systems controlled by the panel]
HVAC Air Handling Systems**	Packaged rooftop AHU, DDC control panels
HVAC Ventilation/Exhaust Systems	General exhaust, DDC control panels

Systems To Be Commissioned	
System	Description
Convection Heating Units	Electric wall heaters, manufacturer controls
HVAC Terminal Unit Systems**	VAV Terminal Units, DDC control panels
Humidity Control Systems	Humidifiers, DDC control panels
Electrical	
Grounding & Bonding Systems	Witness 3rd party testing, review reports
Electrical System Protective Device Study	Review reports, verify field settings consistent with Study
Low-Voltage Distribution System	Normal power distribution system, Life-safety power distribution system, equipment power distribution system, distribution panels, panelboards, verify breaker testing results
Lighting & Lighting Control** Systems	Emergency lighting, occupancy sensors, lighting control systems, exterior lighting and controls
Communications	
Grounding & Bonding System	Witness 3rd party testing, review reports
Structured Cabling System	Witness 3rd party testing, review reports

Systems To Be Commissioned	
System	Description
Duress Alarm Systems	Witness 3rd party testing, review reports
Electronic Safety and Security	
Grounding & Bonding	Witness 3rd party testing, review reports
Physical Access Control Systems	Witness 3rd party testing, review reports
Access Control Systems	Witness 3rd party testing, review reports
Security Access Detection Systems	Witness 3rd party testing, review reports
Video Surveillance System	Witness 3rd party testing, review reports
Fire Detection and Alarm System	100% device acceptance testing, battery draw-down test, verify system monitoring, verify interface with other systems.
Renewable Energy Sources	
Site Utilities	
Storm Drainage Utilities	Site Storm Water Distribution
Integrated Systems Tests	

Systems To Be Commissioned	
System	Description
Fire Alarm Response	Integrated System Response to Fire Alarm Condition and Return to Normal
Table Notes	
** Denotes systems that LEED requires to be commissioned to comply with the LEED Fundamental Commissioning pre-requisite.	

1.8 COMMISSIONING TEAM

- A. The commissioning team shall consist of, but not be limited to, representatives of Contractor, including Project Superintendent and subcontractors, installers, schedulers, suppliers, and specialists deemed appropriate by the Department of Veterans Affairs (VA) and Commissioning Agent.
- B. Members Appointed by Contractor:
1. Contractor' Commissioning Manager: The designated person, company, or entity that plans, schedules and coordinates the commissioning activities for the construction team.
 2. Contractor's Commissioning Representative(s): Individual(s), each having authority to act on behalf of the entity he or she represents, explicitly organized to implement the commissioning process through coordinated actions.
- C. Members Appointed by VA:
1. Commissioning Agent: The designated person, company, or entity that plans, schedules, and coordinates the commissioning team to implement the commissioning process. The VA will engage the CxA under a separate contract.
 2. User: Representatives of the facility user and operation and maintenance personnel.
 3. A/E: Representative of the Architect and engineering design professionals.

1.9 VA'S COMMISSIONING RESPONSIBILITIES

- A. Appoint an individual, company or firm to act as the Commissioning Agent.

- B. Assign operation and maintenance personnel and schedule them to participate in commissioning team activities including, but not limited to, the following:
 - 1. Coordination meetings.
 - 2. Training in operation and maintenance of systems, subsystems, and equipment.
 - 3. Testing meetings.
 - 4. Witness and assist in Systems Functional Performance Testing.
 - 5. Demonstration of operation of systems, subsystems, and equipment.
- C. Provide the Construction Documents, prepared by Architect and approved by VA, to the Commissioning Agent and for use in managing the commissioning process, developing the commissioning plan, systems manuals, and reviewing the operation and maintenance training plan.

1.10 CONTRACTOR'S COMMISSIONING RESPONSIBILITIES

- A. The Contractor shall assign a Commissioning Manager to manage commissioning activities of the Contractor, and subcontractors.
- B. The Contractor shall ensure that the commissioning responsibilities outlined in these specifications are included in all subcontracts and that subcontractors comply with the requirements of these specifications.
- C. The Contractor shall ensure that each installing subcontractor shall assign representatives with expertise and authority to act on behalf of the subcontractor and schedule them to participate in and perform commissioning team activities including, but not limited to, the following:
 - 1. Participate in commissioning coordination meetings.
 - 2. Conduct operation and maintenance training sessions in accordance with approved training plans.
 - 3. Verify that Work is complete and systems are operational according to the Contract Documents, including calibration of instrumentation and controls.
 - 4. Evaluate commissioning issues and commissioning observations identified in the Commissioning Issues Log, field reports, test reports or other commissioning documents. In collaboration with entity responsible for system and equipment installation, recommend corrective action.
 - 5. Review and comment on commissioning documentation.

6. Participate in meetings to coordinate Systems Functional Performance Testing.
7. Provide schedule for operation and maintenance data submittals, equipment startup, and testing to Commissioning Agent for incorporation into the commissioning plan.
8. Provide information to the Commissioning Agent for developing commissioning plan.
9. Participate in training sessions for VA's operation and maintenance personnel.
10. Provide technicians who are familiar with the construction and operation of installed systems and who shall develop specific test procedures to conduct Systems Functional Performance Testing of installed systems.

1.11 COMMISSIONING AGENT'S RESPONSIBILITIES

- A. Organize and lead the commissioning team.
- B. Prepare the commissioning plan. See Paragraph 1.11-A of this specification Section for further information.
- C. Review and comment on selected submittals from the Contractor for general conformance with the Construction Documents. Review and comment on the ability to test and operate the system and/or equipment, including providing gages, controls and other components required to operate, maintain, and test the system. Review and comment on performance expectations of systems and equipment and interfaces between systems relating to the Construction Documents.
- D. At the beginning of the construction phase, conduct an initial construction phase coordination meeting for the purpose of reviewing the commissioning activities and establishing tentative schedules for operation and maintenance submittals; operation and maintenance training sessions; TAB Work; Pre-Functional Checklists, Systems Functional Performance Testing; and project completion.
- E. Convene commissioning team meetings for the purpose of coordination, communication, and conflict resolution; discuss status of the commissioning processes. Responsibilities include arranging for facilities, preparing agenda and attendance lists, and notifying participants. The Commissioning Agent shall prepare and distribute minutes to commissioning team members and attendees within five workdays of the commissioning meeting.

- F. Observe construction and report progress, observations and issues.
Observe systems and equipment installation for adequate accessibility for maintenance and component replacement or repair, and for general conformance with the Construction Documents.
- G. Prepare Project specific Pre-Functional Checklists and Systems Functional Performance Test procedures.
- H. Coordinate Systems Functional Performance Testing schedule with the Contractor.
- I. Witness selected systems startups.
- J. Verify selected Pre-Functional Checklists completed and submitted by the Contractor.
- K. Witness and document Systems Functional Performance Testing.
- L. Compile test data, inspection reports, and certificates and include them in the systems manual and commissioning report.

- M. Review and comment on operation and maintenance (O&M) documentation and systems manual outline for compliance with the Contract Documents.
Operation and maintenance documentation requirements are specified in Paragraph 1.25, Section 01 00 00 GENERAL REQUIREMENTS.

- N. Review operation and maintenance training program developed by the Contractor. Verify training plans provide qualified instructors to conduct operation and maintenance training.
- O. Prepare commissioning Field Observation Reports.
- P. Prepare the Final Commissioning Report.
- Q. Return to the site at 10 months into the 12 month warranty period and review with facility staff the current building operation and the condition of outstanding issues related to the original and seasonal Systems Functional Performance Testing. Also interview facility staff and identify problems or concerns they have operating the building as originally intended. Make suggestions for improvements and for recording these changes in the O&M manuals. Identify areas that may come under warranty or under the original construction contract. Assist facility staff in developing reports, documents and requests for services to remedy outstanding problems.
- R. Assemble the final commissioning documentation, including the Final Commissioning Report and Addendum to the Final Commissioning Report.

1.12 COMMISSIONING DOCUMENTATION

- A. Commissioning Plan: A document, prepared by Commissioning Agent, that outlines the schedule, allocation of resources, and documentation requirements of the commissioning process, and shall include, but is not limited, to the following:
1. Plan for delivery and review of submittals, systems manuals, and other documents and reports. Identification of the relationship of these documents to other functions and a detailed description of submittals that are required to support the commissioning processes. Submittal dates shall include the latest date approved submittals must be received without adversely affecting commissioning plan.
 2. Description of the organization, layout, and content of commissioning documentation (including systems manual) and a detailed description of documents to be provided along with identification of responsible parties.
 3. Identification of systems and equipment to be commissioned.
 4. Schedule of Commissioning Coordination meetings.
 5. Identification of items that must be completed before the next operation can proceed.
 6. Description of responsibilities of commissioning team members.
 7. Description of observations to be made.
 8. Description of requirements for operation and maintenance training.
 9. Schedule for commissioning activities with dates coordinated with overall construction schedule.
 10. Process and schedule for documenting changes on a continuous basis to appear in Project Record Documents.
 11. Process and schedule for completing prestart and startup checklists for systems, subsystems, and equipment to be verified and tested.
 12. Preliminary Systems Functional Performance Test procedures.
- B. Systems Functional Performance Test Procedures: The Commissioning Agent will develop Systems Functional Performance Test Procedures for each system to be commissioned, including subsystems, or equipment and interfaces or interlocks with other systems. Systems Functional Performance Test Procedures will include a separate entry, with space for comments, for each item to be tested. Preliminary Systems Functional Performance Test Procedures will be provided to the VA, Architect/Engineer, and Contractor for review and comment. The Systems

Performance Test Procedure will include test procedures for each mode of operation and provide space to indicate whether the mode under test responded as required. Each System Functional Performance Test procedure, regardless of system, subsystem, or equipment being tested, shall include, but not be limited to, the following:

1. Name and identification code of tested system.
 2. Test number.
 3. Time and date of test.
 4. Indication of whether the record is for a first test or retest following correction of a problem or issue.
 5. Dated signatures of the person performing test and of the witness, if applicable.
 6. Individuals present for test.
 7. Observations and Issues.
 8. Issue number, if any, generated as the result of test.
- C. Pre-Functional Checklists: The Commissioning Agent will prepare Pre-Functional Checklists. Pre-Functional Checklists shall be completed and signed by the Contractor, verifying that systems, subsystems, equipment, and associated controls are ready for testing. The Commissioning Agent will spot check Pre-Functional Checklists to verify accuracy and readiness for testing. Inaccurate or incomplete Pre-Functional Checklists shall be returned to the Contractor for correction and resubmission.
- D. Test and Inspection Reports: The Commissioning Agent will record test data, observations, and measurements on Systems Functional Performance Test Procedure. The report will also include recommendation for system acceptance or non-acceptance. Photographs, forms, and other means appropriate for the application shall be included with data. Commissioning Agent Will compile test and inspection reports and test and inspection certificates and include them in systems manual and commissioning report.
- E. Corrective Action Documents: The Commissioning Agent will document corrective action taken for systems and equipment that fail tests. The documentation will include any required modifications to systems and equipment and/or revisions to test procedures, if any. The Commissioning Agent will witness and document any retesting of systems

and/or equipment requiring corrective action and document retest results.

F. Commissioning Issues Log: The Commissioning Agent will prepare and maintain Commissioning Issues Log that describes Commissioning Issues and Commissioning Observations that are identified during the Commissioning process. These observations and issues include, but are not limited to, those that are at variance with the Contract Documents. The Commissioning Issues Log will identify and track issues as they are encountered, the party responsible for resolution, progress toward resolution, and document how the issue was resolved. The Master Commissioning Issues Log will also track the status of unresolved issues.

1. Creating an Commissioning Issues Log Entry:

- a. Identify the issue with unique numeric or alphanumeric identifier by which the issue may be tracked.
- b. Assign a descriptive title for the issue.
- c. Identify date and time of the issue.
- d. Identify test number of test being performed at the time of the observation, if applicable, for cross reference.
- e. Identify system, subsystem, and equipment to which the issue applies.
- f. Identify location of system, subsystem, and equipment.
- g. Include information that may be helpful in diagnosing or evaluating the issue.
- h. Note recommended corrective action.
- i. Identify commissioning team member responsible for corrective action.
- j. Identify expected date of correction.
- k. Identify person that identified the issue.

2. Documenting Issue Resolution:

- a. Log date correction is completed or the issue is resolved.
- b. Describe corrective action or resolution taken. Include description of diagnostic steps taken to determine root cause of the issue, if any.
- c. Identify changes to the Contract Documents that may require action.

- d. State that correction was completed and system, subsystem, and equipment are ready for retest, if applicable.
 - e. Identify person(s) who corrected or resolved the issue.
 - f. Identify person(s) verifying the issue resolution.
- G. Final Commissioning Report: The Commissioning Agent will document results of the commissioning process, including unresolved issues, and performance of systems, subsystems, and equipment. The Commissioning Report will indicate whether systems, subsystems, and equipment have been properly installed and are performing according to the Contract Documents. This report will be used by the Department of Veterans Affairs when determining that systems will be accepted. This report will be used to evaluate systems, subsystems, and equipment and will serve as a future reference document during VA occupancy and operation. It shall describe components and performance that exceed requirements of the Contract Documents and those that do not meet requirements of the Contract Documents. The commissioning report will include, but is not limited to, the following:
1. Lists and explanations of substitutions; compromises; variances with the Contract Documents; record of conditions; and, if appropriate, recommendations for resolution. Design Narrative documentation maintained by the Commissioning Agent.
 2. Commissioning plan.
 3. Pre-Functional Checklists completed by the Contractor, with annotation of the Commissioning Agent review and spot check.
 4. Systems Functional Performance Test Procedures, with annotation of test results and test completion.
 5. Commissioning Issues Log.
 6. Listing of deferred and off season test(s) not performed, including the schedule for their completion.
- H. Addendum to Final Commissioning Report: The Commissioning Agent will prepare an Addendum to the Final Commissioning Report near the end of the Warranty Period. The Addendum will indicate whether systems, subsystems, and equipment are complete and continue to perform according to the Contract Documents. The Addendum to the Final Commissioning Report shall include, but is not limited to, the following:
1. Documentation of deferred and off season test(s) results.

2. Completed Systems Functional Performance Test Procedures for off season test(s).
 3. Documentation that unresolved system performance issues have been resolved.
 4. Updated Commissioning Issues Log, including status of unresolved issues.
 5. Identification of potential Warranty Claims to be corrected by the Contractor.
- I. Systems Manual: The Commissioning Agent will gather required information and compile the Systems Manual. The Systems Manual will include, but is not limited to, the following:
1. Design Narrative, including system narratives, schematics, single-line diagrams, flow diagrams, equipment schedules, and changes made throughout the Project.
 2. Reference to Final Commissioning Plan.
 3. Reference to Final Commissioning Report.
 4. Approved Operation and Maintenance Data as submitted by the Contractor.

1.13 SUBMITTALS

- A. Preliminary Commissioning Plan Submittal: The Commissioning Agent has prepared a Preliminary Commissioning Plan based on the final Construction Documents. The Preliminary Commissioning Plan is included as an Appendix to this specification section. The Preliminary Commissioning Plan is provided for information only. It contains preliminary information about the following commissioning activities:
1. The Commissioning Team: A list of commissioning team members by organization.
 2. Systems to be commissioned. A detailed list of systems to be commissioned for the project. This list also provides preliminary information on systems/equipment submittals to be reviewed by the Commissioning Agent; preliminary information on Pre-Functional Checklists that are to be completed; preliminary information on Systems Performance Testing, including information on testing sample size (where authorized by the VA).
 3. Commissioning Team Roles and Responsibilities: Preliminary roles and responsibilities for each Commissioning Team member.

4. Commissioning Documents: A preliminary list of commissioning-related documents, include identification of the parties responsible for preparation, review, approval, and action on each document.
 5. Commissioning Activities Schedule: Identification of Commissioning Activities, including Systems Functional Testing, the expected duration and predecessors for the activity.
 6. Pre-Functional Checklists: Preliminary Pre-Functional Checklists for equipment, components, subsystems, and systems to be commissioned. These Preliminary Pre-Functional Checklists provide guidance on the level of detailed information the Contractor shall include on the final submission.
 7. Systems Functional Performance Test Procedures: Preliminary step-by-step System Functional Performance Test Procedures to be used during Systems Functional Performance Testing. These Preliminary Systems Functional Performance procedures provide information on the level of testing rigor, and the level of Contractor support required during performance of system's testing.
- B. Final Commissioning Plan Submittal: Based on the Final Construction Documents and the Contractor's project team, the Commissioning Agent will prepare the Final Commissioning Plan as described in this section. The Commissioning Agent will submit three hard copies and three sets of electronic files of Final Commissioning Plan. The Contractor shall review the Commissioning Plan and provide any comments to the VA. The Commissioning Agent will incorporate review comments into the Final Commissioning Plan as directed by the VA.
- C. Systems Functional Performance Test Procedure: The Commissioning Agent will submit preliminary Systems Functional Performance Test Procedures to the Contractor, and the VA for review and comment. The Contractor shall return review comments to the VA and the Commissioning Agent. The VA will also return review comments to the Commissioning Agent. The Commissioning Agent will incorporate review comments into the Final Systems Functional Test Procedures to be used in Systems Functional Performance Testing.
- D. Pre-Functional Checklists: The Commissioning Agent will submit Pre-Functional Checklists to be completed by the Contractor.

- E. Test and Inspection Reports: The Commissioning Agent will submit test and inspection reports to the VA with copies to the Contractor and the Architect/Engineer.
- F. Corrective Action Documents: The Commissioning Agent will submit corrective action documents to the VA COR with copies to the Contractor and Architect.
- G. Preliminary Commissioning Report Submittal: The Commissioning Agent will submit three electronic copies of the preliminary commissioning report. One electronic copy, with review comments, will be returned to the Commissioning Agent for preparation of the final submittal.
- H. Final Commissioning Report Submittal: The Commissioning Agent will submit four sets of electronically formatted information of the final commissioning report to the VA. The final submittal will incorporate comments as directed by the VA.
- I. Data for Commissioning:
 - 1. The Commissioning Agent will request in writing from the Contractor specific information needed about each piece of commissioned equipment or system to fulfill requirements of the Commissioning Plan.
 - 2. The Commissioning Agent may request further documentation as is necessary for the commissioning process or to support other VA data collection requirements, including Construction Operations Building Information Exchange (COBIE), Building Information Modeling (BIM), etc.

1.14 COMMISSIONING PROCESS

- A. The Commissioning Agent will be responsible for the overall management of the commissioning process as well as coordinating scheduling of commissioning tasks with the VA and the Contractor. As directed by the VA, the Contractor shall incorporate Commissioning tasks, including, but not limited to, Systems Functional Performance Testing (including predecessors) with the Master Construction Schedule.
- B. Within XX days of contract award, the Contractor shall designate a specific individual as the Commissioning Manager (CxM) to manage and lead the commissioning effort on behalf of the Contractor. The Commissioning Manager shall be the single point of contact and

communications for all commissioning related services by the Contractor.

- C. Within XX days of contract award, the Contractor shall ensure that each subcontractor designates specific individuals as Commissioning Representatives (CXR) to be responsible for commissioning related tasks. The Contractor shall ensure the designated Commissioning Representatives participate in the commissioning process as team members providing commissioning testing services, equipment operation, adjustments, and corrections if necessary. The Contractor shall ensure that all Commissioning Representatives shall have sufficient authority to direct their respective staff to provide the services required, and to speak on behalf of their organizations in all commissioning related contractual matters.

1.15 QUALITY ASSURANCE

- A. Instructor Qualifications: Factory authorized service representatives shall be experienced in training, operation, and maintenance procedures for installed systems, subsystems, and equipment.
- B. Test Equipment Calibration: The Contractor shall comply with test equipment manufacturer's calibration procedures and intervals. Recalibrate test instruments immediately whenever instruments have been repaired following damage or dropping. Affix calibration tags to test instruments. Instruments shall have been calibrated within six months prior to use.

1.16 COORDINATION

- A. Management: The Commissioning Agent will coordinate the commissioning activities with the VA and Contractor. The Commissioning Agent will submit commissioning documents and information to the VA. All commissioning team members shall work together to fulfill their contracted responsibilities and meet the objectives of the contract documents.
- B. Scheduling: The Contractor shall work with the Commissioning Agent and the VA to incorporate the commissioning activities into the construction schedule. The Commissioning Agent will provide sufficient information (including, but not limited to, tasks, durations and predecessors) on commissioning activities to allow the Contractor and the VA to schedule commissioning activities. All parties shall address scheduling issues and make necessary notifications in a timely manner

in order to expedite the project and the commissioning process. The Contractor shall update the Master Construction as directed by the VA.

- C. Initial Schedule of Commissioning Events: The Commissioning Agent will provide the initial schedule of primary commissioning events in the Commissioning Plan and at the commissioning coordination meetings. The Commissioning Plan will provide a format for this schedule. As construction progresses, more detailed schedules will be developed by the Contractor with information from the Commissioning Agent.
- D. Commissioning Coordinating Meetings: The Commissioning Agent will conduct periodic Commissioning Coordination Meetings of the commissioning team to review status of commissioning activities, to discuss scheduling conflicts, and to discuss upcoming commissioning process activities.
- E. Pretesting Meetings: The Commissioning Agent will conduct pretest meetings of the commissioning team to review startup reports, Pre-Functional Checklist results, Systems Functional Performance Testing procedures, testing personnel and instrumentation requirements.
- F. Systems Functional Performance Testing Coordination: The Contractor shall coordinate testing activities to accommodate required quality assurance and control services with a minimum of delay and to avoid necessity of removing and replacing construction to accommodate testing and inspecting. The Contractor shall coordinate the schedule times for tests, inspections, obtaining samples, and similar activities.

PART 2 - PRODUCTS

2.1 TEST EQUIPMENT

- A. The Contractor shall provide all standard and specialized testing equipment required to perform Systems Functional Performance Testing. Test equipment required for Systems Functional Performance Testing will be identified in the detailed System Functional Performance Test Procedure prepared by the Commissioning Agent.
- B. Data logging equipment and software required to test equipment shall be provided by the Contractor.
- C. All testing equipment shall be of sufficient quality and accuracy to test and/or measure system performance with the tolerances specified in the Specifications. If not otherwise noted, the following minimum requirements apply: Temperature sensors and digital thermometers shall have a certified calibration within the past year to an accuracy of 0.5

°C (1.0 °F) and a resolution of + or - 0.1 °C (0.2 °F). Pressure sensors shall have an accuracy of + or - 2.0% of the value range being measured (not full range of meter) and have been calibrated within the last year. All equipment shall be calibrated according to the manufacturer's recommended intervals and following any repairs to the equipment. Calibration tags shall be affixed or certificates readily available.

PART 3 - EXECUTION

3.1 COMMISSIONING PROCESS ROLES AND RESPONSIBILITIES

A. The following table outlines the roles and responsibilities for the Commissioning Team members during the Construction Phase:

Construction Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional	
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes	
Commissioning Roles & Responsibilities								
Meetings	Construction Commissioning Kick Off meeting	L	A	P	P	O		
	Commissioning Meetings	L	A	P	P	O		
	Project Progress Meetings	P	A	P	L	O		
	Controls Meeting	L	A	P	P	O		
Coordination	Coordinate with [OGC's, AHJ, Vendors, etc.] to ensure that Cx interacts properly with other systems as needed to support the OPR and BOD.	L	A	P	P	N/A		
Cx Plan & Spec	Final Commissioning Plan	L	A	R	R	O		
Schedules	Duration Schedule for Commissioning Activities	L	A	R	R	N/A		

Construction Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional	
Commissioning Roles & Responsibilities								
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes	
OPR and BOD	Maintain OPR on behalf of Owner	L	A	R	R	O		
	Maintain BOD/DID on behalf of Owner	L	A	R	R	O		
Document Reviews	TAB Plan Review	L	A	R	R	O		
	Submittal and Shop Drawing Review	R	A	R	L	O		
	Review Contractor Equipment Startup Checklists	L	A	R	R	N/A		
	Review Change Orders, ASI, and RFI	L	A	R	R	N/A		
Site Observations	Witness Factory Testing	P	A	P	L	O		
	Construction Observation Site Visits	L	A	R	R	O		
Functional Test Protocols	Final Pre-Functional Checklists	L	A	R	R	O		
	Final Functional Performance Test Protocols	L	A	R	R	O		
Technical Activities	Issues Resolution Meetings	P	A	P	L	O		

Construction Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes
Commissioning Roles & Responsibilities							
Reports and Logs	Status Reports	L	A	R	R	O	
	Maintain Commissioning Issues Log	L	A	R	R	O	

B. The following table outlines the roles and responsibilities for the Commissioning Team members during the Acceptance Phase:

Acceptance Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes
Commissioning Roles & Responsibilities							
Meetings	Commissioning Meetings	L	A	P	P	O	
	Project Progress Meetings	P	A	P	L	O	
	Pre-Test Coordination Meeting	L	A	P	P	O	
	Lessons Learned and Commissioning Report Review Meeting	L	A	P	P	O	

Acceptance Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional
Commissioning Roles & Responsibilities							
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes
Coordination	Coordinate with [OGC's, AHJ, Vendors, etc.] to ensure that Cx interacts properly with other systems as needed to support OPR and BOD	L	P	P	P	O	
Cx Plan & Spec	Maintain/Update Commissioning Plan	L	A	R	R	O	
Schedules	Prepare Functional Test Schedule	L	A	R	R	O	
OPR and BOD	Maintain OPR on behalf of Owner	L	A	R	R	O	
	Maintain BOD/DID on behalf of Owner	L	A	R	R	O	
Document Reviews	Review Completed Pre-Functional Checklists	L	A	R	R	O	
	Pre-Functional Checklist Verification	L	A	R	R	O	
	Review Operations & Maintenance Manuals	L	A	R	R	R	
	Training Plan Review	L	A	R	R	R	
	Warranty Review	L	A	R	R	O	
	Review TAB Report	L	A	R	R	O	
Site Observations	Construction Observation Site Visits	L	A	R	R	O	
	Witness Selected Equipment Startup	L	A	R	R	O	

Acceptance Phase		CxA = Commissioning Agent RE = COR A/E = Design Arch/Engineer PC = Prime Contractor O&M = Gov't Facility O&M					L = Lead P = Participate A = Approve R = Review O = Optional
Commissioning Roles & Responsibilities							
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes
Functional Test Protocols	TAB Verification	L	A	R	R	O	
	Systems Functional Performance Testing	L	A	P	P	P	
	Retesting	L	A	P	P	P	
Technical Activities	Issues Resolution Meetings	P	A	P	L	O	
	Systems Training	L	S	R	P	P	
Reports and Logs	Status Reports	L	A	R	R	O	
	Maintain Commissioning Issues Log	L	A	R	R	O	
	Final Commissioning Report	L	A	R	R	R	
	Prepare Systems Manuals	L	A	R	R	R	

C. The following table outlines the roles and responsibilities for the Commissioning Team members during the Warranty Phase:

Warranty Phase		CxA = Commissioning Agent					L = Lead
Commissioning Roles & Responsibilities		RE = COR					P = Participate
		A/E = Design Arch/Engineer					A = Approve
		PC = Prime Contractor					R = Review
		O&M = Gov't Facility O&M					O = Optional
Category	Task Description	CxA	RE	A/E	PC	O&M	Notes
Meetings	Post-Occupancy User Review Meeting	L	A	O	P	P	
Site Observations	Periodic Site Visits	L	A	O	O	P	
Functional Test Protocols	Deferred and/or seasonal Testing	L	A	O	P	P	
Technical Activities	Issues Resolution Meetings	L	S	O	O	P	
	Post-Occupancy Warranty Checkup and review of Significant Outstanding Issues	L	A		R	P	
Reports and Logs	Final Commissioning Report Amendment	L	A		R	R	
	Status Reports	L	A		R	R	

3.2 STARTUP, INITIAL CHECKOUT, AND PRE-FUNCTIONAL CHECKLISTS

A. The following procedures shall apply to all equipment and systems to be commissioned, according to Part 1, Systems to Be Commissioned.

1. Pre-Functional Checklists are important to ensure that the equipment and systems are hooked up and operational. These ensure that Systems Functional Performance Testing may proceed without unnecessary delays. Each system to be commissioned shall have a full Pre-Functional Checklist completed by the Contractor prior to Systems Functional Performance Testing. No sampling strategies are used.
 - a. The Pre-Functional Checklist will identify the trades responsible for completing the checklist. The Contractor shall ensure the appropriate trades complete the checklists.
 - b. The Commissioning Agent will review completed Pre-Functional Checklists and field-verify the accuracy of the completed checklist using sampling techniques.
2. Startup and Initial Checkout Plan: The Contractor shall develop detailed startup plans for all equipment. The primary role of the Contractor in this process is to ensure that there is written documentation that each of the manufacturer recommended procedures have been completed. Parties responsible for startup shall be identified in the Startup Plan and in the checklist forms.
 - a. The Contractor shall develop the full startup plan by combining (or adding to) the checklists with the manufacturer's detailed startup and checkout procedures from the O&M manual data and the field checkout sheets normally used by the Contractor. The plan shall include checklists and procedures with specific boxes or lines for recording and documenting the checking and inspections of each procedure and a summary statement with a signature block at the end of the plan.
 - b. The full startup plan shall at a minimum consist of the following items:
 - 1) The Pre-Functional Checklists.
 - 2) The manufacturer's standard written startup procedures copied from the installation manuals with check boxes by each procedure and a signature block added by hand at the end.
 - 3) The manufacturer's normally used field checkout sheets.

- c. The Commissioning Agent will submit the full startup plan to the VA and Contractor for review. Final approval will be by the VA.
 - d. The Contractor shall review and evaluate the procedures and the format for documenting them, noting any procedures that need to be revised or added.
3. Sensor and Actuator Calibration
- a. All field installed temperature, relative humidity, CO2 and pressure sensors and gages, and all actuators (dampers and valves) on all equipment shall be calibrated using the methods described in Division 21, Division 22, Division 23, Division 26, Division 27, and Division 28 specifications.
 - b. All procedures used shall be fully documented on the Pre-Functional Checklists or other suitable forms, clearly referencing the procedures followed and written documentation of initial, intermediate and final results.
4. Execution of Equipment Startup
- a. Four insert number weeks prior to equipment startup, the Contractor shall schedule startup and checkout with the VA and Commissioning Agent. The performance of the startup and checkout shall be directed and executed by the Contractor.
 - b. The Commissioning Agent will observe the startup procedures for selected pieces of primary equipment.
 - c. The Contractor shall execute startup and provide the VA and Commissioning Agent with a signed and dated copy of the completed startup checklists, and contractor tests.
 - d. Only individuals that have direct knowledge and witnessed that a line item task on the Startup Checklist was actually performed shall initial or check that item off. It is not acceptable for witnessing supervisors to fill out these forms.

3.3 DEFICIENCIES, NONCONFORMANCE, AND APPROVAL IN CHECKLISTS AND STARTUP

- A. The Contractor shall clearly list any outstanding items of the initial startup and Pre-Functional Checklist procedures that were not completed successfully, at the bottom of the procedures form or on an attached sheet. The procedures form and any outstanding deficiencies shall be provided to the VA and the Commissioning Agent within two days of completion.

- B. The Commissioning Agent will review the report and submit comments to the VA. The Commissioning Agent will work with the Contractor to correct and verify deficiencies or uncompleted items. The Commissioning Agent will involve the VA and others as necessary. The Contractor shall correct all areas that are noncompliant or incomplete in the checklists in a timely manner, and shall notify the VA and Commissioning Agent as soon as outstanding items have been corrected. The Contractor shall submit an updated startup report and a Statement of Correction on the original noncompliance report. When satisfactorily completed, the Commissioning Agent will recommend approval of the checklists and startup of each system to the VA.
- C. The Contractor shall be responsible for resolution of deficiencies as directed the VA.

3.4 PHASED COMMISSIONING

- A. The project may require startup and initial checkout to be executed in phases. This phasing shall be planned and scheduled in a coordination meeting of the VA, Commissioning Agent, and the Contractor. Results will be added to the master construction schedule and the commissioning schedule.

3.5 DDC SYSTEM TRENDING FOR COMMISSIONING

- A. Trending is a method of testing as a standalone method or to augment manual testing. The Contractor shall trend any and all points of the system or systems at intervals specified below.
- B. Alarms are a means to notify the system operator that abnormal conditions are present in the system. Alarms shall be structured into three tiers - Critical, Priority, and Maintenance.
1. Critical alarms are intended to be alarms that require the immediate attention of and action by the Operator. These alarms shall be displayed on the Operator Workstation in a popup style window that is graphically linked to the associated unit's graphical display. The popup style window shall be displayed on top of any active window within the screen, including non DDC system software.
 2. Priority level alarms are to be printed to a printer which is connected to the Operator's Work Station located within the engineer's office. Additionally Priority level alarms shall be able to be monitored and viewed through an active alarm application.

Priority level alarms are alarms which shall require reaction from the operator or maintenance personnel within a normal work shift, and not immediate action.

3. Maintenance alarms are intended to be minor issues which would require examination by maintenance personnel within the following shift. These alarms shall be generated in a scheduled report automatically by the DDC system at the start of each shift. The generated maintenance report will be printed to a printer located within the engineer's office.
- C. The Contractor shall provide a wireless internet network in the building for use during controls programming, checkout, and commissioning. This network will allow project team members to more effectively program, view, manipulate and test control devices while being in the same room as the controlled device.
- D. The Contractor shall provide graphical trending through the DDC control system of systems being commissioned. Trending requirements are indicated below and included with the Systems Functional Performance Test Procedures. Trending shall occur before, during and after Systems Functional Performance Testing. The Contractor shall be responsible for producing graphical representations of the trended DDC points that show each system operating properly during steady state conditions as well as during the System Functional Testing. These graphical reports shall be submitted to the COR and Commissioning Agent for review and analysis before, during dynamic operation, and after Systems Functional Performance Testing. The Contractor shall provide, but not limited to, the following trend requirements and trend submissions:
1. Pre-testing, Testing, and Post-testing - Trend reports of trend logs and graphical trend plots are required as defined by the Commissioning Agent. The trend log points, sampling rate, graphical plot configuration, and duration will be dictated by the Commissioning Agent. At any time during the Commissioning Process the Commissioning Agent may recommend changes to aspects of trending as deemed necessary for proper system analysis. The Contractor shall implement any changes as directed by the COR. Any pre-test trend analysis comments generated by the Commissioning Team should be addressed and resolved by the Contractor, as directed by the COR, prior to the execution of Systems Functional Performance Testing.

2. Dynamic plotting - The Contractor shall also provide dynamic plotting during Systems Functional Performance testing at frequent intervals for points determined by the Systems Functional Performance Test Procedure. The graphical plots will be formatted and plotted at durations listed in the Systems Functional Performance Test Procedure.
3. Graphical plotting - The graphical plots shall be provided with a dual y-axis allowing 15 or more trend points (series) plotted simultaneously on the graph with each series in distinct color. The plots will further require title, axis naming, legend etc. all described by the Systems Functional Performance Test Procedure. If this cannot be sufficiently accomplished directly in the Direct Digital Control System then it is the responsibility of the Contractor to plot these trend logs in Microsoft Excel.
4. The following tables indicate the points to be trended and alarmed by system. The Operational Trend Duration column indicates the trend duration for normal operations. The Testing Trend Duration column indicates the trend duration prior to Systems Functional Performance Testing and again after Systems Functional Performance Testing. The Type column indicates point type: AI = Analog Input, AO = Analog Output, DI = Digital Input, DO = Digital Output, Calc = Calculated Point. In the Trend Interval Column, COV = Change of Value. The Alarm Type indicates the alarm priority; C = Critical, P = Priority, and M = Maintenance. The Alarm Range column indicates when the point is considered in the alarm state. The Alarm Delay column indicates the length of time the point must remain in an alarm state before the alarm is recorded in the DDC. The intent is to allow minor, short-duration events to be corrected by the DDC system prior to recording an alarm.

Rooftop Unit Trending and Alarms							
Point	Type	Trend Interval	Operational Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
OA Temperature	AI	15 min	24 hours	3 days	N/A		
RA Temperature	AI	15 min	24 hours	3 days	N/A		

Rooftop Unit Trending and Alarms							
Point	Type	Trend Interval	Operational Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
RA Humidity	AI	15 min	24 hours	3 days	P	RH<20%, RH>60%	10 min
Mixed Air Temp	AI	15 min	24 hours	3 days	P	MA>90°, MA<45°F	10 min
SA Temp	AI	15 min	24 hours	3 days	C	±5°F from SP	10 min
Supply Fan Speed	AI	15 min	24 hours	3 days	N/A		
Pre Filter Status	AI	15 min	24 hours	3 days	M	SP>0.25 in wg	5 min
SA Flow	AI	15 min	24 hours	3 days	N/A		
OA Flow	AI	15 min	24 hours	3 days	N/A		
RA Flow	AI	15 min	24 hours	3 days	N/A		
Duct Pressure	AI	15 min	24 hours	3 days	C	±25% from SP	6 min
CO2 Level	AI	15 min	24 hours	3 days	P	CO2>1000 ppm	10 min
Building Static Pressure	AI	15 min	24 hours	3 days	N/A		
OA Damper Position	AI	15 min	24 hours	3 days	N/A		
EA Damper Position	AI	15 min	24 hours	3 days	N/A		
MA Damper Position	AI	15 min	24 hours	3 days	N/A		
OA Damper	AO	15 min	24 hours	3 days	N/A		
EA Damper	AO	15 min	24 hours	3 days	N/A		
MA Damper	AO	15 min	24 hours	3 days	N/A		
Heating Coil Output	AO	15 min	24 hours	3 days	N/A		
Supply Fan Speed	AO	15 min	24 hours	3 days	N/A		
Exhaust Fan Speed	AO	15 min	24 hours	3 days	N/A		
Supply Fan Status	DI	COV	24 hours	3 days	C	Status <> Command	10 min
High Static Status	DI	COV	24 hours	3 days	P	True	1 min
RA Fire Alarm Status	DI	COV	24 hours	3 days	C	True	5 min
SA Smoke Detector Status	DI	COV	24 hours	3 days	C	True	1 min

Rooftop Unit Trending and Alarms							
Point	Type	Trend Interval	Operationa l Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Freeze Stat Level 1	DI	COV	24 hours	3 days	C	True	10 min
Emergency AHU Shutdown	DI	COV	24 hours	3 days	P	True	1 min
Exhaust Fan Status	DI	COV	24 hours	3 days	C	Status <> Command	10 min
High Static Alarm	DI	COV	24 hours	3 days	C	True	10 min
CO2 Alarm	DI	COV	24 hours	3 days	P	True	10 min
EA Damper Alarm	DI	COV	24 hours	3 days	P	True	10 min
Compressor Alarm	DI	COV	24 hours	3 days	P	True	10 min
EF VFD Alarm	DI	COV	24 hours	3 days	P	True	10 min
EF Damper Position	DI	COV	24 hours	3 days	N/A		
Supply Fan S/S	DO	COV	24 hours	3 days	N/A		
Exhaust Fan S/S	DO	COV	24 hours	3 days	N/A		
EF Damper	DO	COV	24 hours	3 days	N/A		
Cooling Stage 1	DO	COV	24 hours	3 days	N/A		
Cooling Stage 2	DO	COV	24 hours	3 days	N/A		
Cooling Stage 3	DO	COV	24 hours	3 days	N/A		
Heating Enable	DO	COV	24 hours	3 days	N/A		
Emergency Epidemic Mode	DO	COV	24 hours	3 days	N/A		

Terminal Unit (VAV) Trending and Alarms							
Point	Type	Trend Interval	Operationa l Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Space Temperature	AI	15 min	12 hours	3 days	P	±5°F from SP	10 min
SA Temperature	AI	15 min	12 hours	3 days	P	±5°F from SP	10 min

Terminal Unit (VAV) Trending and Alarms							
Point	Type	Trend Interval	Operationa l Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Air Flow	AI	15 min	12 hours	3 days	N/A		
Damper Position Feedback	AI	15 min	12 hours	3 days	N/A		
Damper Position	AO	15 min	12 hours	3 days	N/A		
Heating coil SCR Control	AO	15 min	12 hours	3 days	N/A		
Heating Coil Enable	DO	COV	24 hours	3 days	N/A		

Steam Humidifier Trending and Alarms							
Point	Type	Trend Interval	Operationa l Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
RA Humidity	AI	15 min	12 hours	3 days	P	RH<20%, RH>60%	10 min
SA Humidity	AI	15 min	12 hours	3 days	N/A	RH>90%	10 min
V-1 Position Feedback	AI	15 min	12 hours	3 days	N/A		
Jacket Temp	AI	15 min	12 hours	3 days	N/A		
V-1 Position	AO	15 min	12 hours	3 days	N/A		
Airflow Switch	DI	COV	24 hours	3 days	N/A		
V-2 Position Feedback	DI	COV	24 hours	3 days	N/A		
High Humidity Limit Switch	DI	COV	24 hours	3 days	N/A		
V-2 Position	DO	COV	24 hours	3 days	N/A		

EF-1 Trending and Alarms							
Point	Type	Trend Interval	Operationa l Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Space Temperature	AI	15 min	12 hours	3 days	P	±5°F from SP	10 min
Fan Status	DI	COV	24 hours	3 days	P	N/A	5 min
Fan Speed	AO	15 min	12 hours	3 days	N/A		
Fan Start/Stop	DO	COV	24 hours	3 days	N/A		

EF-2 Trending and Alarms							
Point	Type	Trend Interval	Operational Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Fan Status	DI	COV	24 hours	3 days	P	N/A	5 min
Fan Speed	AO	15 min	12 hours	3 days	N/A		
Fan Start/Stop	DO	COV	24 hours	3 days	N/A		

Domestic Hot Water Trending and Alarms							
Point	Type	Trend Interval	Operational Trend Duration	Testing Trend Duration	Alarm Type	Alarm Range	Alarm Delay
Domestic HW Setpoint WH-1	AI	15 Minute	12 Hours	3 days	N/A		
Domestic HW Setpoint WH-2	AI	15 Minute	12 Hours	3 days	N/A		
Domestic HW Temperature	AI	15 Minute	12 Hours	3 days	C	> 135 °F	10 Min
Domestic HW Temperature	AI	15 Minute	12 Hours	3 days	P	±5°F from SP	10 Min
Dom. Circ. Pump #1 Status	DI	COV	12 Hours	3 days	M	Status <> Command	30 min
Dom. Circ. Pump #2 Status	DI	COV	12 Hours	3 days	M	Status <> Command	30 min
Dom. Circ. Pump #1 Start/Stop	DO	COV	12 Hours	3 days	N/A		
Dom. Circ. Pump #2 Start/Stop	DO	COV	12 Hours	3 days	N/A		
Domestic HW Start/Stop	DO	COV	12 Hours	3 days	N/A		

E. The Contractor shall provide the following information prior to Systems Functional Performance Testing. Any documentation that is modified after submission shall be recorded and resubmitted to the COR and Commissioning Agent.

1. Point-to-Point checkout documentation;

2. Sensor field calibration documentation including system name, sensor/point name, measured value, DDC value, and Correction Factor.
3. A sensor calibration table listing the referencing the location of procedures to following in the O&M manuals, and the frequency at which calibration should be performed for all sensors, separated by system, subsystem, and type. The calibration requirements shall be submitted both in the O&M manuals and separately in a standalone document containing all sensors for inclusion in the commissioning documentation. The following table is a sample that can be used as a template for submission.

SYSTEM		
Sensor	Calibration Frequency	O&M Calibration Procedure Reference
Discharge air temperature	Once a year	Volume I Section D.3.aa
Discharge static pressure	Every 6 months	Volume II Section A.1.c

4. Loop tuning documentation and constants for each loop of the building systems. The documentation shall be submitted in outline or table separated by system, control type (e.g. heating valve temperature control); proportional, integral and derivative constants, interval (and bias if used) for each loop. The following table is a sample that can be used as a template for submission.

EQUIPMENT NAME				
Control Reference	Proportional Constant	Integral Constant	Derivative Constant	Interval

3.6 SYSTEMS FUNCTIONAL PERFORMANCE TESTING

- A. This paragraph applies to Systems Functional Performance Testing of systems for all referenced specification Divisions.
- B. Objectives and Scope: The objective of Systems Functional Performance Testing is to demonstrate that each system is operating according to

the Contract Documents. Systems Functional Performance Testing facilitates bringing the systems from a state of substantial completion to full dynamic operation. Additionally, during the testing process, areas of noncompliant performance are identified and corrected, thereby improving the operation and functioning of the systems. In general, each system shall be operated through all modes of operation (seasonal, occupied, unoccupied, warm-up, cool-down, part- and full-load, fire alarm and emergency power) where there is a specified system response. The Contractor shall verify each sequence in the sequences of operation. Proper responses to such modes and conditions as power failure, freeze condition, low oil pressure, no flow, equipment failure, etc. shall also be tested.

- C. Development of Systems Functional Performance Test Procedures: Before Systems Functional Performance Test procedures are written, the Contractor shall submit all requested documentation and a current list of change orders affecting equipment or systems, including an updated points list, program code, control sequences and parameters. Using the testing parameters and requirements found in the Contract Documents and approved submittals and shop drawings, the Commissioning Agent will develop specific Systems Functional Test Procedures to verify and document proper operation of each piece of equipment and system to be commissioned. The Contractor shall assist the Commissioning Agent in developing the Systems Functional Performance Test procedures as requested by the Commissioning Agent i.e. by answering questions about equipment, operation, sequences, etc. Prior to execution, the Commissioning Agent will provide a copy of the Systems Functional Performance Test procedures to the VA, the Architect/Engineer, and the Contractor, who shall review the tests for feasibility, safety, equipment and warranty protection.
- D. Purpose of Test Procedures: The purpose of each specific Systems Functional Performance Test is to verify and document compliance with the stated criteria of acceptance given on the test form. Representative test formats and examples are found in the Commissioning Plan for this project. (The Commissioning Plan is issued as a separate document and is available for review.) The test procedure forms developed by the Commissioning Agent will include, but not be limited to, the following information:

1. System and equipment or component name(s)
 2. Equipment location and ID number
 3. Unique test ID number, and reference to unique Pre-Functional Checklists and startup documentation, and ID numbers for the piece of equipment
 4. Date
 5. Project name
 6. Participating parties
 7. A copy of the specification section describing the test requirements
 8. A copy of the specific sequence of operations or other specified parameters being verified
 9. Formulas used in any calculations
 10. Required pretest field measurements
 11. Instructions for setting up the test.
 12. Special cautions, alarm limits, etc.
 13. Specific step-by-step procedures to execute the test, in a clear, sequential and repeatable format
 14. Acceptance criteria of proper performance with a Yes / No check box to allow for clearly marking whether or not proper performance of each part of the test was achieved.
 15. A section for comments.
 16. Signatures and date block for the Commissioning Agent. A place for the Contractor to initial to signify attendance at the test.
- E. Test Methods: Systems Functional Performance Testing shall be achieved by manual testing (i.e. persons manipulate the equipment and observe performance) and/or by monitoring the performance and analyzing the results using the control system's trend log capabilities or by standalone data loggers. The Contractor and Commissioning Agent shall determine which method is most appropriate for tests that do not have a method specified.
1. Simulated Conditions: Simulating conditions (not by an overwritten value) shall be allowed, although timing the testing to experience actual conditions is encouraged wherever practical.
 2. Overwritten Values: Overwriting sensor values to simulate a condition, such as overwriting the outside air temperature reading in a control system to be something other than it really is, shall be allowed, but shall be used with caution and avoided when

- possible. Such testing methods often can only test a part of a system, as the interactions and responses of other systems will be erroneous or not applicable. Simulating a condition is preferable. e.g., for the above case, by heating the outside air sensor with a hair blower rather than overwriting the value or by altering the appropriate setpoint to see the desired response. Before simulating conditions or overwriting values, sensors, transducers and devices shall have been calibrated.
3. Simulated Signals: Using a signal generator which creates a simulated signal to test and calibrate transducers and DDC constants is generally recommended over using the sensor to act as the signal generator via simulated conditions or overwritten values.
 4. Altering Setpoints: Rather than overwriting sensor values, and when simulating conditions is difficult, altering setpoints to test a sequence is acceptable. For example, to see the Air Conditioning compressor lockout initiate at an outside air temperature below 12 C (54 F), when the outside air temperature is above 12 C (54 F), temporarily change the lockout setpoint to be 2 C (4 F) above the current outside air temperature.
 5. Indirect Indicators: Relying on indirect indicators for responses or performance shall be allowed only after visually and directly verifying and documenting, over the range of the tested parameters, that the indirect readings through the control system represent actual conditions and responses. Much of this verification shall be completed during systems startup and initial checkout.
- F. Setup: Each function and test shall be performed under conditions that simulate actual conditions as closely as is practically possible. The Contractor shall provide all necessary materials, system modifications, etc. to produce the necessary flows, pressures, temperatures, etc. necessary to execute the test according to the specified conditions. At completion of the test, the Contractor shall return all affected building equipment and systems, due to these temporary modifications, to their pretest condition.
- G. Sampling: No sampling is allowed in completing Pre-Functional Checklists. Sampling is allowed for Systems Functional Performance Test Procedures execution. The Commissioning Agent will determine the sampling rate. If at any point, frequent failures are occurring and

testing is becoming more troubleshooting than verification, the Commissioning Agent may stop the testing and require the Contractor to perform and document a checkout of the remaining units, prior to continuing with Systems Functional Performance Testing of the remaining units.

- H. Cost of Retesting: The cost associated with expanded sample System Functional Performance Tests shall be solely the responsibility of the Contractor. Any required retesting by the Contractor shall not be considered a justified reason for a claim of delay or for a time extension by the Contractor.
- I. Coordination and Scheduling: The Contractor shall provide a minimum of 7 days' notice to the Commissioning Agent and the VA regarding the completion schedule for the Pre-Functional Checklists and startup of all equipment and systems. The Commissioning Agent will schedule Systems Functional Performance Tests with the Contractor and VA. The Commissioning Agent will witness and document the Systems Functional Performance Testing of systems. The Contractor shall execute the tests in accordance with the Systems Functional Performance Test Procedure.
- J. Testing Prerequisites: In general, Systems Functional Performance Testing will be conducted only after Pre-Functional Checklists have been satisfactorily completed. The control system shall be sufficiently tested and approved by the Commissioning Agent and the VA before it is used to verify performance of other components or systems. The air balancing and water balancing shall be completed before Systems Functional Performance Testing of air-related or water-related equipment or systems are scheduled. Systems Functional Performance Testing will proceed from components to subsystems to systems. When the proper performance of all interacting individual systems has been achieved, the interface or coordinated responses between systems will be checked.
- K. Problem Solving: The Commissioning Agent will recommend solutions to problems found, however the burden of responsibility to solve, correct and retest problems is with the Contractor.

3.7 DOCUMENTATION, NONCONFORMANCE AND APPROVAL OF TESTS

- A. Documentation: The Commissioning Agent will witness, and document the results of all Systems Functional Performance Tests using the specific

procedural forms developed by the Commissioning Agent for that purpose. Prior to testing, the Commissioning Agent will provide these forms to the VA and the Contractor for review and approval. The Contractor shall include the filled out forms with the O&M manual data.

- B. Nonconformance: The Commissioning Agent will record the results of the Systems Functional Performance Tests on the procedure or test form. All items of nonconformance issues will be noted and reported to the VA on Commissioning Field Reports and/or the Commissioning Master Issues Log.
1. Corrections of minor items of noncompliance identified may be made during the tests. In such cases, the item of noncompliance and resolution shall be documented on the Systems Functional Test Procedure.
 2. Every effort shall be made to expedite the systems functional Performance Testing process and minimize unnecessary delays, while not compromising the integrity of the procedures. However, the Commissioning Agent shall not be pressured into overlooking noncompliant work or loosening acceptance criteria to satisfy scheduling or cost issues, unless there is an overriding reason to do so by direction from the VA.
 3. As the Systems Functional Performance Tests progresses and an item of noncompliance is identified, the Commissioning Agent shall discuss the issue with the Contractor and the VA.
 4. When there is no dispute on an item of noncompliance, and the Contractor accepts responsibility to correct it:
 - a. The Commissioning Agent will document the item of noncompliance and the Contractor's response and/or intentions. The Systems Functional Performance Test then continues or proceeds to another test or sequence. After the day's work is complete, the Commissioning Agent will submit a Commissioning Field Report to the VA. The Commissioning Agent will also note items of noncompliance and the Contractor's response in the Master Commissioning Issues Log. The Contractor shall correct the item of noncompliance and report completion to the VA and the Commissioning Agent.
 - b. The need for retesting will be determined by the Commissioning Agent. If retesting is required, the Commissioning Agent and the

Contractor shall reschedule the test and the test shall be repeated.

5. If there is a dispute about item of noncompliance, regarding whether it is an item of noncompliance, or who is responsible:
 - a. The item of noncompliance shall be documented on the test form with the Contractor's response. The item of noncompliance with the Contractor's response shall also be reported on a Commissioning Field Report and on the Master Commissioning Issues Log.
 - b. Resolutions shall be made at the lowest management level possible. Other parties are brought into the discussions as needed. Final interpretive and acceptance authority is with the Department of Veterans Affairs.
 - c. The Commissioning Agent will document the resolution process.
 - d. Once the interpretation and resolution have been decided, the Contractor shall correct the item of noncompliance, report it to the Commissioning Agent. The requirement for retesting will be determined by the Commissioning Agent. If retesting is required, the Commissioning Agent and the Contractor shall reschedule the test. Retesting shall be repeated until satisfactory performance is achieved.

C. Cost of Retesting: The cost to retest a System Functional Performance Test shall be solely the responsibility of the Contractor. Any required retesting by the Contractor shall not be considered a justified reason for a claim of delay or for a time extension by the Contractor.

D. Failure Due to Manufacturer Defect: If 10%, or three, whichever is greater, of identical pieces (size alone does not constitute a difference) of equipment fail to perform in compliance with the Contract Documents (mechanically or substantively) due to manufacturing defect, not allowing it to meet its submitted performance specifications, all identical units may be considered unacceptable by

the VA. In such case, the Contractor shall provide the VA with the following:

1. Within one week of notification from the VA, the Contractor shall examine all other identical units making a record of the findings. The findings shall be provided to the VA within two weeks of the original notice.
 2. Within two weeks of the original notification, the Contractor shall provide a signed and dated, written explanation of the problem, cause of failures, etc. and all proposed solutions which shall include full equipment submittals. The proposed solutions shall not significantly exceed the specification requirements of the original installation.
 3. The VA shall determine whether a replacement of all identical units or a repair is acceptable.
 4. Two examples of the proposed solution shall be installed by the Contractor and the VA shall be allowed to test the installations for up to one week, upon which the VA will decide whether to accept the solution.
 5. Upon acceptance, the Contractor shall replace or repair all identical items, at their expense and extend the warranty accordingly, if the original equipment warranty had begun. The replacement/repair work shall proceed with reasonable speed beginning within one week from when parts can be obtained.
- E. Approval: The Commissioning Agent will note each satisfactorily demonstrated function on the test form. Formal approval of the Systems Functional Performance Test shall be made later after review by the Commissioning Agent and by the VA. The Commissioning Agent will evaluate each test and report to the VA using a standard form. The VA will give final approval on each test using the same form, and provide signed copies to the Commissioning Agent and the Contractor.

3.8 DEFERRED TESTING

- A. Unforeseen Deferred Systems Functional Performance Tests: If any Systems Functional Performance Test cannot be completed due to the building structure, required occupancy condition or other conditions, execution of the Systems Functional Performance Testing may be delayed upon approval of the VA. These Systems Functional Performance Tests shall be conducted in the same manner as the seasonal tests as soon as

possible. Services of the Contractor to conduct these unforeseen Deferred Systems Functional Performance Tests shall be negotiated between the VA and the Contractor.

- B. Deferred Seasonal Testing: Deferred Seasonal Systems Functional Performance Tests are those that must be deferred until weather conditions are closer to the systems design parameters. The Commissioning Agent will review systems parameters and recommend which Systems Functional Performance Tests should be deferred until weather conditions more closely match systems parameters. The Contractor shall review and comment on the proposed schedule for Deferred Seasonal Testing. The VA will review and approve the schedule for Deferred Seasonal Testing. Deferred Seasonal Systems Functional Performances Tests shall be witnessed and documented by the Commissioning Agent. Deferred Seasonal Systems Functional Performance Tests shall be executed by the Contractor in accordance with these specifications.

3.9 OPERATION AND MAINTENANCE TRAINING REQUIREMENTS

- A. Training Preparation Conference: Before operation and maintenance training, the Commissioning Agent will convene a training preparation conference to include VA's COR, VA's Operations and Maintenance personnel, and the Contractor. The purpose of this conference will be to discuss and plan for Training and Demonstration of VA Operations and Maintenance personnel.
- B. The Contractor shall provide training and demonstration as required by other Division 21, Division 22, Division 23, Division 26, Division 27, Division 28, and Division 31 sections. The Training and Demonstration shall include, but is not limited to, the following:
1. Review the Contract Documents.
 2. Review installed systems, subsystems, and equipment.
 3. Review instructor qualifications.
 4. Review instructional methods and procedures.
 5. Review training module outlines and contents.
 6. Review course materials (including operation and maintenance manuals).
 7. Review and discuss locations and other facilities required for instruction.

8. Review and finalize training schedule and verify availability of educational materials, instructors, audiovisual equipment, and facilities needed to avoid delays.
 9. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.
- C. Training Module Submittals: The Contractor shall submit the following information to the VA and the Commissioning Agent:
1. Instruction Program: Submit two copies of outline of instructional program for demonstration and training, including a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module. At completion of training, submit two complete training manuals for VA's use.
 2. Qualification Data: Submit qualifications for facilitator and/or instructor.
 3. Attendance Record: For each training module, submit list of participants and length of instruction time.
 4. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.
 5. Demonstration and Training Recording:
 - a. General: Engage a qualified commercial photographer to record demonstration and training. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice. At beginning of each training module, record each chart containing learning objective and lesson outline.
 - b. Video Format: Provide high quality color DVD color on standard size DVD disks.
 - c. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to show area of demonstration and training. Display continuous running time.
 - d. Narration: Describe scenes on video recording by audio narration by microphone while demonstration and training is recorded. Include description of items being viewed. Describe vantage point, indicating location, direction (by compass point), and elevation or story of construction.

- e. Submit two copies within seven days of end of each training module.
 6. Transcript: Prepared on 8-1/2-by-11-inch paper, punched and bound in heavy-duty, 3-ring, vinyl-covered binders. Mark appropriate identification on front and spine of each binder. Include a cover sheet with same label information as the corresponding videotape. Include name of Project and date of videotape on each page.
- D. Quality Assurance:
1. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
 2. Instructor Qualifications: A factory authorized service representative, complying with requirements in Division 01 Section "Quality Requirements," experienced in operation and maintenance procedures and training.
 3. Photographer Qualifications: A professional photographer who is experienced photographing construction projects.
- E. Training Coordination:
1. Coordinate instruction schedule with VA's operations. Adjust schedule as required to minimize disrupting VA's operations.
 2. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
 3. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by the VA.
- F. Instruction Program:
1. Program Structure: Develop an instruction program that includes individual training modules for each system and equipment not part of a system, as required by individual Specification Sections, and as follows:
 - a. Fire protection systems, including fire alarm, fire pumps, and fire suppression systems.
 - b. Intrusion detection systems.

- c. Conveying systems, including elevators, wheelchair lifts, escalators, and automated materials handling systems.
 - d. Medical equipment, including medical gas equipment and piping.
 - e. Laboratory equipment, including laboratory air and vacuum equipment and piping.
 - f. Heat generation, including boilers, feedwater equipment, pumps, steam distribution piping, condensate return systems, heating hot water heat exchangers, and heating hot water distribution piping.
 - g. Refrigeration systems, including chillers, cooling towers, condensers, pumps, and distribution piping.
 - h. HVAC systems, including air handling equipment, air distribution systems, and terminal equipment and devices.
 - i. HVAC instrumentation and controls.
 - j. Electrical service and distribution, including switchgear, transformers, switchboards, panelboards, uninterruptible power supplies, and motor controls.
 - k. Packaged engine generators, including synchronizing switchgear/switchboards, and transfer switches.
 - l. Lighting equipment and controls.
 - m. Communication systems, including intercommunication, surveillance, nurse call systems, public address, mass evacuation, voice and data, and entertainment television equipment.
 - n. Site utilities including lift stations, condensate pumping and return systems, and storm water pumping systems.
- G. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participants are expected to master. For each module, include instruction for the following:
- 1. Basis of System Design, Operational Requirements, and Criteria:
Include the following:
 - a. System, subsystem, and equipment descriptions.
 - b. Performance and design criteria if Contractor is delegated design responsibility.
 - c. Operating standards.
 - d. Regulatory requirements.
 - e. Equipment function.

- f. Operating characteristics.
 - g. Limiting conditions.
 - H, Performance curves.
2. Documentation: Review the following items in detail:
- a. Emergency manuals.
 - b. Operations manuals.
 - c. Maintenance manuals.
 - d. Project Record Documents.
 - e. Identification systems.
 - f. Warranties and bonds.
 - g. Maintenance service agreements and similar continuing commitments.
3. Emergencies: Include the following, as applicable:
- a. Instructions on meaning of warnings, trouble indications, and error messages.
 - b. Instructions on stopping.
 - c. Shutdown instructions for each type of emergency.
 - d. Operating instructions for conditions outside of normal operating limits.
 - e. Sequences for electric or electronic systems.
 - f. Special operating instructions and procedures.
4. Operations: Include the following, as applicable:
- a. Startup procedures.
 - b. Equipment or system break-in procedures.
 - c. Routine and normal operating instructions.
 - d. Regulation and control procedures.
 - e. Control sequences.
 - f. Safety procedures.
 - g. Instructions on stopping.
 - h. Normal shutdown instructions.
 - i. Operating procedures for emergencies.
 - j. Operating procedures for system, subsystem, or equipment failure.
 - k. Seasonal and weekend operating instructions.
 - l. Required sequences for electric or electronic systems.
 - m. Special operating instructions and procedures.
5. Adjustments: Include the following:
- a. Alignments.

- b. Checking adjustments.
- c. Noise and vibration adjustments.
- d. Economy and efficiency adjustments.
- 6. Troubleshooting: Include the following:
 - a. Diagnostic instructions.
 - b. Test and inspection procedures.
- 7. Maintenance: Include the following:
 - a. Inspection procedures.
 - b. Types of cleaning agents to be used and methods of cleaning.
 - c. List of cleaning agents and methods of cleaning detrimental to product.
 - d. Procedures for routine cleaning
 - e. Procedures for preventive maintenance.
 - f. Procedures for routine maintenance.
 - g. Instruction on use of special tools.
- 8. Repairs: Include the following:
 - a. Diagnosis instructions.
 - b. Repair instructions.
 - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
 - d. Instructions for identifying parts and components.
 - e. Review of spare parts needed for operation and maintenance.
- H. Training Execution:
 - 1. Preparation: Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a combined training manual. Set up instructional equipment at instruction location.
 - 2. Instruction:
 - a. Facilitator: Engage a qualified facilitator to prepare instruction program and training modules, to coordinate instructors, and to coordinate between Contractor and Department of Veterans Affairs for number of participants, instruction times, and location.
 - b. Instructor: Engage qualified instructors to instruct VA's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.

- 1) The Commissioning Agent will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
 - 2) The VA will furnish an instructor to describe VA's operational philosophy.
 - 3) The VA will furnish the Contractor with names and positions of participants.
3. Scheduling: Provide instruction at mutually agreed times. For equipment that requires seasonal operation, provide similar instruction at start of each season. Schedule training with the VA and the Commissioning Agent with at least seven days' advance notice.
 4. Evaluation: At conclusion of each training module, assess and document each participant's mastery of module by use of an oral, or a written, performance-based test.
 5. Cleanup: Collect used and leftover educational materials and remove from Project site. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.
- I. Demonstration and Training Recording:
1. General: Engage a qualified commercial photographer to record demonstration and training. Record each training module separately. Include classroom instructions and demonstrations, board diagrams, and other visual aids, but not student practice. At beginning of each training module, record each chart containing learning objective and lesson outline.
 2. Video Format: Provide high quality color DVD color on standard size DVD disks.
 3. Recording: Mount camera on tripod before starting recording, unless otherwise necessary to show area of demonstration and training. Display continuous running time.
 4. Narration: Describe scenes on videotape by audio narration by microphone while demonstration and training is recorded. Include description of items being viewed. Describe vantage point, indicating location, direction (by compass point), and elevation or story of construction.

----- END -----

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
10-01-15

SECTION 02 41 00
DEMOLITION

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies demolition and removal of buildings, portions of buildings, utilities, other structures and debris from trash dumps shown.

1.2 RELATED WORK:

- A. Demolition and removal of roads, walks, curbs, and on-grade slabs outside buildings to be demolished: Section 31 20 00, EARTH MOVING Section 31 20 11.
- B. Safety Requirements: Section 01 35 26 Safety Requirements Article, ACCIDENT PREVENTION PLAN (APP).
- C. Disconnecting utility services prior to demolition: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- E. Environmental Protection: Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- F. Construction Waste Management: Section 01 74 19 CONSTRUCTION WASTE MANAGEMENT.
- G. Infectious Control: Section 01 35 26, SAFETY REQUIREMENTS.

1.3 PROTECTION:

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of GENERAL CONDITIONS Article, ACCIDENT PREVENTION.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations. Comply with requirements of Section 01 00 00, GENERAL REQUIREMENTS,

Article PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT,
UTILITIES AND IMPROVEMENTS.

- C. Maintain fences, barricades, lights, and other similar items around exposed excavations until such excavations have been completely filled.
- D. Provide enclosed dust chutes with control gates from each floor to carry debris to truck beds and govern flow of material into truck. Provide overhead bridges of tight board or prefabricated metal construction at dust chutes to protect persons and property from falling debris.
- E. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.
- F. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
 - 1. No wall or part of wall shall be permitted to fall outwardly from structures.
 - 2. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers.
 - 3. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.
- G. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center ; any damaged items shall be repaired or replaced as approved by the Resident Engineer. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting,

removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have COR approval.

- H. The work shall comply with the requirements of Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS.
- I. The work shall comply with the requirements of Section 01 00 00, GENERAL REQUIREMENTS and Section 01 35 26, SAFETY REQUIREMENTS.

1.4 UTILITY SERVICES:

- A. Demolish and remove outside utility service lines shown to be removed.
- B. Remove abandoned outside utility lines that would interfere with installation of new utility lines and new construction.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 DEMOLITION:

- A. Completely demolish and remove buildings and structures, including all appurtenances related or connected thereto, as noted below:
 - 1. As required for installation of new utility service lines.
 - 2. To full depth within an area defined by hypothetical lines located 1500 mm (5 feet) outside building lines of new structures.
- B. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the Resident Engineer. Break up concrete slabs below grade that do not require removal from present location into pieces not exceeding 600 mm (24 inches) square to permit drainage. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- C. In removing buildings and structures of more than two stories, demolish work story by story starting at highest level and progressing down to third floor level. Demolition of first and second stories may proceed simultaneously.
- D. Remove and legally dispose of all materials, other than earth to remain as part of project work, from any trash dumps shown. Materials removed shall become property of contractor and shall be disposed of in

compliance with applicable federal, state or local permits, rules and/or regulations be hauled to VA specified disposal site . All materials in the indicated trash dump areas, including above surrounding grade and extending to a depth of 1500mm (5feet) below surrounding grade, shall be included as part of the lump sum compensation for the work of this section. Materials that are located beneath the surface of the surrounding ground more than 1500 mm (5 feet), or materials that are discovered to be hazardous, shall be handled as unforeseen. The removal of hazardous material shall be referred to Hazardous Materials specifications.

- E. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the COR. When Utility lines are encountered that are not indicated on the drawings, the COR shall be notified prior to further work in that area.

3.2 CLEAN-UP:

On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to COR. Clean-up shall include off the Medical Center disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

SECTION 03 30 00
CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies cast-in-place structural concrete and materials and mixes for other concrete.

1.2 RELATED WORK

- A. Section 01 45 29, TESTING LABORATORY SERVICES: Materials testing and inspection during construction.
- B. Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS
- C. Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS: Concrete roads, walks, and similar exterior site work.

1.3 TESTING AGENCY FOR CONCRETE MIX DESIGN

- A. Testing agency for the trial concrete mix design retained and reimbursed by the Contractor and approved by COR. For all other testing, refer to Section 01 45 29 Testing Laboratory Services.
- B. Testing agency maintaining active participation in Program of Cement and Concrete Reference Laboratory (CCRL) of National Institute of Standards and Technology.
- C. Testing agency shall furnish equipment and qualified technicians to establish proportions of ingredients for concrete mixes.

1.4 TOLERANCES

- A. Formwork: ACI 117, except the elevation tolerance of formed surfaces before removal of shores is +0 mm (+0 inch) and -20 mm (-3/4 inch).
- B. Reinforcement Fabricating and Placing: ACI 117, except that fabrication tolerance for bar sizes Nos. 10, 13, and 16 (Nos. 3, 4, and 5) (Tolerance Symbol 1 in Fig. 2.1(a), ACI, 117) used as column ties or stirrups is +0 mm (+0 inch) and -13 mm (-1/2 inch) where gross bar length is less than 3600 mm (12 feet), or +0 mm (+0 inch) and -20 mm (-3/4 inch) where gross bar length is 3600 mm (12 feet) or more.
- C. Cross-Sectional Dimension: ACI 117, except tolerance for thickness of slabs 12 inches or less is +20 mm (+3/4 inch) and - 6 mm (-1/4 inch). Tolerance of thickness of beams more than 300 mm (12 inch) but less than 900 mm (3 feet) is +20 mm (+3/4 inch) and -10 mm (-3/8 inch).
- D. Slab Finishes: ACI 117, Section 4.5.6, F-number method in accordance with ASTM E1155, except as follows:

1. Test entire slab surface, including those areas within 600 mm (2 feet) of construction joints and vertical elements that project through slab surface.
2. Maximum elevation change which may occur within 600 mm (2 feet) of any column or wall element is 6 mm (0.25 inches).
3. Allow sample measurement lines that are perpendicular to construction joints to extend past joint into previous placement no further than 1500 mm (5 feet).

1.5 REGULATORY REQUIREMENTS

- A. ACI SP-66 - ACI Detailing Manual.
- B. ACI 318 - Building Code Requirements for Reinforced Concrete.
- C. ACI 301 - Standard Specifications for Structural Concrete.

1.6 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES. All items indicated below are required submittals requiring Contracting Officer's Representative (COR) review and approval.
- B. Shop Drawings: Reinforcing steel: Complete shop drawings
- C. Mill Test Reports:
 1. Reinforcing Steel.
 2. Cement.
- D. Manufacturer's Certificates:
 1. Abrasive aggregate.
 2. Air-entraining admixture.
 3. Chemical admixtures, including chloride ion content.
 4. Waterproof paper for curing concrete.
 5. Liquid membrane-forming compounds for curing concrete.
 6. Non-shrinking grout.
 7. Liquid hardener.
 8. Waterstops.
 9. Expansion joint filler.
 10. Adhesive binder.
- E. Testing Agency for Concrete Mix Design: Approval request including qualifications of principals and technicians and evidence of active participation in program of Cement and Concrete Reference Laboratory (CCRL) of National Institute of Standards and Technology.

- F. Test Report for Concrete Mix Designs: Trial mixes including water-cement -fly ash ratio curves, concrete mix ingredients, and admixtures.
- G. Shoring and Reshoring Sequence: Submit for approval a shoring and reshoring sequence for flat slab/flat plate portions, prepared by a registered Professional Engineer. As a minimum, include timing of form stripping, reshoring, number of floors to be re-shored and timing of re-shore removal to serve as an initial outline of procedures subject to modification as construction progresses. Submit revisions to sequence, whether initiated by COR (see FORMWORK) or Contractor.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Conform to ACI 304. Store aggregate separately for each kind or grade, to prevent segregation of sizes and avoid inclusion of dirt and other materials.
- B. Deliver cement in original sealed containers bearing name of brand and manufacturer, and marked with net weight of contents. Store in suitable watertight building in which floor is raised at least 300 mm (1 foot) above ground. Store bulk cement and fly ash in separate suitable bins.
- C. Deliver other packaged materials for use in concrete in original sealed containers, plainly marked with manufacturer's name and brand, and protect from damage until used.

1.8 PRE-CONCRETE CONFERENCE

- A. General: At least 15 days prior to submittal of design mixes, conduct a meeting to review proposed methods of concrete construction to achieve the required results.
- B. Agenda: Includes but is not limited to:
 - 1. Submittals.
 - 2. Coordination of work.
 - 3. Availability of material.
 - 4. Concrete mix design including admixtures.
 - 5. Methods of placing, finishing, and curing.
 - 6. Finish criteria required to obtain required flatness and levelness.
 - 7. Timing of floor finish measurements.
 - 8. Material inspection and testing.
- C. Attendees: Include but not limited to representatives of Contractor; subcontractors involved in supplying, conveying, placing, finishing, and curing concrete; lightweight aggregate manufacturer; admixture

manufacturers; COR; Consulting Engineer; Department of Veterans Affairs retained testing laboratories for concrete testing and finish (F-number) verification.

- D. Minutes of the meeting: Contractor shall take minutes and type and distribute the minutes to attendees within five days of the meeting.

1.9 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

- B. American Concrete Institute (ACI):

- 117-10Specifications for Tolerances for Concrete Construction and Materials and Commentary
- 211.1-91 (R2009)Standard Practice for Selecting Proportions for Normal, Heavyweight, and Mass Concrete
- 214R-11 (R2019)Guide to Evaluation of Strength Test Results of Concrete
- 301-16Specifications for Structural Concrete
- 304R-00 (R2009)Guide for Measuring, Mixing, Transporting, and Placing Concrete
- 305.1-14Specification for Hot Weather Concreting
- 306.1-90 (R2002)Standard Specification for Cold Weather Concreting
- 308.1-11Specification for Curing Concrete
- 309R-05Guide for Consolidation of Concrete
- 318/318-19Building Code Requirements for Structural Concrete and Commentary
- 347R-14Guide to Formwork for Concrete
- SP-66-04ACI Detailing Manual

- C. American National Standards Institute and American Hardboard Association (ANSI/AHA):

- A135.4-2012Basic Hardboard

- D. ASTM International (ASTM):

- A615/A615M-20Standard Specification for Deformed and Plain Carbon Steel Bars for Concrete Reinforcement
- A653/A653M-20Standard Specification for Steel Sheet, Zinc Coated (Galvanized) or Zinc Iron Alloy Coated (Galvannealed) by the Hot Dip Process

- A1064/A1064M-18aStandard Specification for Carbon-Steel Wire
and Welded Wire Reinforcement, Plain and
Deformed, for Concrete
- C31/C31M-19aStandard Practice for Making and Curing
Concrete Test Specimens in the field
- C33/C33M-18Standard Specification for Concrete Aggregates
- C39/C39M-20Standard Test Method for Compressive Strength
of Cylindrical Concrete Specimens
- C94/C94M-19aStandard Specification for Ready Mixed Concrete
- C143/C143M-20Standard Test Method for Slump of Hydraulic
Cement Concrete
- C150C150M-20Standard Specification for Portland Cement
- C171-16Standard Specification for Sheet Materials for
Curing Concrete
- C172C172M-17Standard Practice for Sampling Freshly Mixed
Concrete
- C173/C173M-16...Standard Test Method for Air Content of Freshly
Mixed Concrete by the Volumetric Method
- C192/C192M-19Standard Practice for Making and Curing
Concrete Test Specimens in the Laboratory
- C231/C231M-17aStandard Test Method for Air Content of Freshly
Mixed Concrete by the Pressure Method
- C260/C260M-10a(2016) ...Standard Specification for Air Entraining
Admixtures for Concrete
- C309-19Standard Specification for Liquid Membrane
Forming Compounds for Curing Concrete
- C494/C494M-19Standard Specification for Chemical Admixtures
for Concrete
- C618-19Standard Specification for Coal Fly Ash and Raw
or Calcined Natural Pozzolan for Use in
Concrete
- C666/C666M-15Standard Test Method for Resistance of Concrete
to Rapid Freezing and Thawing
- C881/C881M-20Standard Specification for Epoxy Resin Base
Bonding Systems for Concrete
- C1107/1107M-20Standard Specification for Packaged Dry,
Hydraulic-Cement Grout (Non-shrink)

- C1315-19Standard Specification for Liquid Membrane
Forming Compounds Having Special Properties for
Curing and Sealing Concrete
- D6/D6M-95(2018)Standard Test Method for Loss on Heating of Oil
and Asphaltic Compounds
- D297-15(2019)Standard Test Methods for Rubber Products
Chemical Analysis
- D412-16Standard Test Methods for Vulcanized Rubber and
Thermoplastic Elastomers - Tension
- D1751-18Standard Specification for Preformed Expansion
Joint Filler for Concrete Paving and Structural
Construction (Non-extruding and Resilient
Bituminous Types)
- D4263-83(2018)Standard Test Method for Indicating Moisture in
Concrete by the Plastic Sheet Method.
- E1155-20Standard Test Method for Determining F_F Floor
Flatness and F_L Floor Levelness Numbers
- F1249-20Standard Test Method for Water Vapor
Transmission Rate Through Plastic Film and
Sheeting Using a Modulated Infrared Sensor
- F1869-16aStandard Test Method for Measuring Moisture
Vapor Emission Rate of Concrete Subfloor Using
Anhydrous Calcium Chloride.
- E. American Welding Society (AWS):
- D1.4/D1.4M-18Structural Welding Code - Steel Reinforcing
Bars
- F. Concrete Reinforcing Steel Institute (CRSI):
- Handbook 2008
- G. National Cooperative Highway Research Program (NCHRP):
- Report OnConcrete Sealers for the Protection of Bridge
Structures
- H. U. S. Department of Commerce Product Standard (PS):
- PS 1-07Structural Plywood
- PS 20-20American Softwood Lumber Standard
- I. U. S. Army Corps of Engineers Handbook for Concrete and Cement:
- CRD C513Rubber Waterstops

CRD C572Polyvinyl Chloride Waterstops

PART 2 - PRODUCTS

2.1 FORMS

- A. Wood: PS 20 free from loose knots and suitable to facilitate finishing concrete surface specified; tongue and grooved.
- B. Plywood: PS-1 Exterior Grade B-B (concrete-form) 16 mm (5/8 inch), or 20 mm (3/4 inch) thick for unlined contact form. B-B High Density Concrete Form Overlay optional.
- C. Metal for Concrete Rib-Type Construction: Steel (removal type) of suitable weight and form to provide required rigidity.
- D. Permanent Steel Form for Concrete Slabs: Corrugated, ASTM A653, Grade E, and Galvanized, ASTM A653, G90. Provide venting where insulating concrete fill is used.
- E. Form Lining:
 - 1. 1. Hardboard: ANSI/AHA A135.4, Class 2 with one (S1S) smooth side)
 - 2. 2. Plywood: Grade B-B Exterior (concrete-form) not less than 6 mm (1/4 inch) thick.
 - 3. 3. Plastic, fiberglass, or elastomeric capable of reproducing the desired pattern or texture.
- F. Concrete products shall comply with following standards for biobased materials:

Material Type	Percent by Weight
Concrete Penetrating Liquid	79 percent biobased material
Concrete form Release Agent	87 percent biobased material
Concrete Sealer	11 percent biobased material

The minimum-content standards are based on the weight (not the volume) of the material.

- G. Form Ties: Develop a minimum working strength of 13.35 kN (3000 pounds) when fully assembled. Ties shall be adjustable in length to permit tightening of forms and not have any lugs, cones, washers to act as spreader within form, nor leave a hole larger than 20 mm (3/4 inch) diameter, or a depression in exposed concrete surface, or leave metal closer than 40 mm (1 1/2 inches) to concrete surface. Wire ties not permitted. Cutting ties back from concrete face not permitted.

2.2 MATERIALS

- A. Portland Cement: ASTM C150 Type I or II.

- B. Fly Ash: ASTM C618, Class C or F including supplementary optional requirements relating to reactive aggregates and alkalies, and loss on ignition (LOI) not to exceed 5 percent. Do not exceed more than 25 percent total cementitious content by weight.
- C. Coarse Aggregate: ASTM C33.
1. Size 67 or Size 467 may be used for footings and walls over 300 mm (12 inches) thick.
 2. Coarse aggregate for interior slabs on ground shall conform to the following:
 - a. Dense or well graded aggregate.
 - 1) Percent retained on each sieve below the top size and above the No. 100 sieve:
 - a) 8 to 18 percent for 1-1/2 inches (38 mm) top size.
 - b) 8 to 22 percent for 3/4 or 1 inch (19 or 25 mm) top size.
 - 2) The above requirements may be deviated from based on locally available material.
 - a) One or two non-adjacent sieves sizes may fall outside of the limits set above.
 - b) Percent retained on two adjacent sieves sizes shall not be less than 5 percent of the above required.
 - c) Percent retained on three adjacent sieve sizes shall not be less than 8 percent of the above required.
 - d) When the percent retained on each of two adjacent sieve sizes is less than 8 percent the total percent retained on either of these sieves and the adjacent outside sieve should be at least 13 percent (for example, if both the No. 4 and No. 8 (4.75 and 2.36 mm) sieves have 6 percent retained on each item then: 1. the total retained on the 3/8 inch and No. 4 (9.5 and 4.75 mm) sieves should be at least 13 percent, and 2. the total retained on the No. 8 and No. 16 (2.36 and 1.18 mm) sieves should be at least 13 percent.
 3. Maximum size of coarse aggregates not more than one-fifth of narrowest dimension between sides of forms, one-third of depth of slabs, nor three-fourth of minimum clear spacing between reinforcing bars.

- D. Fine Aggregate: ASTM C33. Fine aggregate for applied concrete floor topping shall pass a 4.75 mm (No. 4) sieve, 10 percent maximum shall pass a 150 μ m (No. 100) sieve.
- E. Mixing Water: Fresh, clean, and potable.
- F. Admixtures:
1. Water Reducing Admixture: ASTM C494, Type A and not contain more chloride ions than are present in municipal drinking water.
 2. Water Reducing, Retarding Admixture: ASTM C494, Type D and not contain more chloride ions than are present in municipal drinking water.
 3. High-Range Water-Reducing Admixture (Superplasticizer): ASTM C494, Type F or G, and not contain more chloride ions than are present in municipal drinking water. Use of superplasticizer requires COR approval.
 4. Non-Corrosive, Non-Chloride Accelerator: ASTM C494, Type C or E, and not contain more chloride ions than are present in municipal drinking water. Admixture manufacturer must have long-term non-corrosive test data from an independent testing laboratory of at least one year duration using an acceptable accelerated corrosion test method such as that using electrical potential measures.
 5. Air Entraining Admixture: ASTM C260.
 6. Calcium Nitrite corrosion inhibitor: ASTM C494 Type C.
 7. Prohibited Admixtures: Calcium chloride, thiocyanate or admixtures containing more than 0.05 percent chloride ions are not permitted.
 8. Certification: Written conformance to the requirements above and the chloride ion content of the admixture prior to mix design review.
- G. Vapor Barrier: ASTM F1249, 0.25 mm (10 mil) WVT 0.012 foot/hr.
- H. Reinforcing Steel: ASTM A615, deformed, grade as shown.
- I. Welded Wire Fabric: ASTM A185.
- J. Cold Drawn Steel Wire: ASTM A1064.
- K. Supports, Spacers, and Chairs: Types which will hold reinforcement in position shown in accordance with requirements of ACI 318 except as specified.
- L. Expansion Joint Filler: ASTM D1751.
- M. Sheet Materials for Curing Concrete: ASTM C171.
- N. Liquid Membrane-forming Compounds for Curing Concrete: ASTM C309, Type I, with fugitive dye, and shall meet the requirements of ASTM

C1315. Compound shall be compatible with scheduled surface treatment, such as paint and resilient tile, and shall not discolor concrete surface.

O. Abrasive Aggregate: Aluminum oxide grains or emery grits.

P. Moisture Vapor Emissions & Alkalinity Control Sealer: 100 percent active colorless aqueous silicate solution concrete surface.

1. ASTM C1315 Type 1 Class A, and ASTM C309 Type 1 Class A, penetrating product to have no less than 34 percent solid content, leaving no sheen, volatile organic compound (VOC) content rating as required to suite regulatory requirements. The product shall have at least a five (5) year documented history in controlling moisture vapor emission from damaging floor covering, compatible with all finish materials.

2. MVE 15-Year Warranty:

a. When a floor covering is installed on a below grade, on grade, or above grade concrete slab treated with Moisture Vapor Emissions & Alkalinity Control Sealer according to manufacturer's instruction, sealer manufacturer shall warrant the floor covering system against failure due to moisture vapor migration or moisture-born contaminates for a period of fifteen (15) years from the date of original installation. The warranty shall cover all labor and materials needed to replace all floor covering that fails due to moisture vapor emission & moisture born contaminates.

Q. Penetrating Sealer: For use on parking garage ramps and decks. High penetration silane sealer providing minimum 95 percent screening per National Cooperative Highway Research Program (NCHRP) No. 244 standards for chloride ion penetration resistance. Requires moist (non-membrane) curing of slab.

R. Non-Shrink Grout:

1. ASTM C1107, pre-mixed, produce a compressive strength of at least 18 MPa (2610 psi) at three days and 35 MPa (5000 psi) at 28 days.

Furnish test data from an independent laboratory indicating that the grout when placed at a fluid consistency shall achieve 95 percent bearing under a 1200 mm x 1200 mm (4 foot by 4 foot) base plate.

2. Where high fluidity or increased placing time is required, furnish test data from an independent laboratory indicating that the grout

- when placed at a fluid consistency shall achieve 95 percent under an 450 mm x 900 mm (18 inch by 36 inch) base plate.
- S. Adhesive Binder: ASTM C881.
- T. Waterstops:
1. Polyvinyl Chloride Waterstop: CRD C572.
 2. Rubber Waterstops: CRD C513.
 3. Bentonite Waterstop: Flexible strip of bentonite 25 mm x 20 mm (1 inch by 3/4 inch), weighing 8.7 kg/m (5.85 pounds per foot) composed of Butyl Rubber Hydrocarbon (ASTM D297), Bentonite (SS-S-210-A) and Volatile Matter (ASTM D6).
 4. Non-Metallic Hydrophilic: Swellable strip type compound of polymer modified chloroprene rubber that swells upon contact with water shall conform to ASTM D412 as follows: Tensile strength 420 psi minimum; ultimate elongation 600 percent minimum. Hardness shall be 50 minimum on the type A durometer and the volumetric expansion ratio in in 70 deg water shall be 3 to 1 minimum.
- U. Porous Backfill: Crushed stone or gravel graded from 25 mm to 20 mm (1 inch to 3/4 inch).
- V. Fibers:
1. Synthetic Fibers: Monofilament or fibrillated polypropylene fibers for secondary reinforcing of concrete members. Use appropriate length and 0.9 kg/m³ (1.5 lb. per cubic yard). Product shall have a UL rating.
- W. Epoxy Joint Filler: Two component, 100 percent solids compound, with a minimum shore D hardness of 50.
- X. Bonding Admixture: Non-rewettable, polymer modified, bonding compound.
- Y. Architectural Concrete: For areas designated as architectural concrete on the Contract Documents, use colored cements and specially selected aggregates as necessary to produce a concrete of a color and finish which exactly matches the designated sample panel.

2.3 CONCRETE MIXES

- A. Mix Designs: Proportioned in accordance with Section 5.3, "Proportioning on the Basis of Field Experience and/or Trial Mixtures" of ACI 318.
1. If trial mixes are used, make a set of at least 6 cylinders in accordance with ASTM C192 for test purposes from each trial mix; test three for compressive strength at 7 days and three at 28 days.

2. Submit a report of results of each test series, include a detailed listing of the proportions of trial mix or mixes, including cement, fly ash, admixtures, weight of fine and coarse aggregate per m³ (cubic yard) measured dry rodded and damp loose, specific gravity, fineness modulus, percentage of moisture, air content, water-cement -fly ash ratio, and consistency of each cylinder in terms of slump.
 3. Prepare a curve showing relationship between water-cement -fly ash ratio at 7-day and 28-day compressive strengths. Plot each curve using at least three specimens.
 4. If the field experience method is used, submit complete standard deviation analysis.
- B. Fly Ash Testing: Submit certificate verifying conformance with ASTM 618 initially with mix design and for each truck load of fly ash delivered from source. Submit test results performed within 6 months of submittal date. Notify the COR immediately when change in source is anticipated.
1. Testing Laboratory used for fly ash certification/testing shall participate in the Cement and Concrete Reference Laboratory (CCRL) program. Submit most recent CCRL inspection report.
- C. After approval of mixes no substitution in material or change in proportions of approval mixes may be made without additional tests and approval of the COR or as specified. Making and testing of preliminary test cylinders may be carried on pending approval of cement and fly ash, providing Contractor and manufacturer certify that ingredients used in making test cylinders are the same. The COR may allow Contractor to proceed with depositing concrete for certain portions of work, pending final approval of cement and fly ash and approval of design mix.
- D. Cement Factor: Maintain minimum cement factors in Table I regardless of compressive strength developed above minimums. Use Fly Ash as an admixture with maximum of 25 percent replacement by weight in all structural work. Fly ash shall not be used in high-early mix design.

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE

Concrete Strength		Non-Air-Entrained	Air-Entrained	
Min. 28 Day Comp. Str. MPa (psi)	Min. Cement kg/m ³ (lbs/c. yd)	Max. Water Cement Ratio	Min. Cement kg/m ³ (lbs/c. yd)	Max. Water Cement Ratio

35 (5000)1,3	375 (630)	0.45	385 (650)	0.40
30 (4000)1,3	325 (550)	0.55	340 (570)	0.50
25 (3000)1,3	280 (470)	0.65	290 (490)	0.55
25 (3000)1,2	300 (500)	See 4 below	310 (520)	See 4 below

1. If trial mixes are used, the proposed mix design shall achieve a compressive strength 8.3 MPa (1200 psi) in excess of $f'c$. For concrete strengths above 35 Mpa (5000 psi), the proposed mix design shall achieve a compressive strength 9.7 MPa (1400 psi) in excess of $f'c$.
 2. Lightweight Structural Concrete. Pump mixes may require higher cement values.
 3. For concrete exposed to high sulfate content soils maximum water cement ratio is 0.44.
 4. Determined by Laboratory in accordance with ACI 211.1 for normal concrete or ACI 211.2 for lightweight structural concrete.
- E. Maximum Slump: Maximum slump, as determined by ASTM C143 with tolerances as established by ASTM C94, for concrete to be vibrated shall be as shown in Table II.

TABLE II - MAXIMUM SLUMP, MM (INCHES)

Type of Construction	Normal Weight Concrete
Reinforced Footings and Substructure Walls	75mm (3 inches)
Slabs, Beams, Reinforced Walls, and Building Columns	100 mm (4 inches)

- F. Slump may be increased by the use of the approved high-range water-reducing admixture (superplasticizer). Tolerances as established by ASTM C94. Concrete containing the high-range-water-reducing admixture may have a maximum slump of 225 mm (9 inches). The concrete shall arrive at the job site at a slump of 50 mm to 75 mm (2 inches to 3 inches), and 75 mm to 100 mm (3 inches to 4 inches) for lightweight concrete. This should be verified, and then the high-range-water-reducing admixture added to increase the slump to the approved level.

- G. Air-Entrainment: Air-entrainment of normal weight concrete shall conform with Table III. Determine air content by either ASTM C173 or ASTM C231.

**TABLE III - TOTAL AIR CONTENT
FOR VARIOUS SIZES OF COARSE AGGREGATES (NORMAL CONCRETE)**

Nominal Maximum Size of Total Air Content	Coarse Aggregate, mm (Inches) Percentage by Volume
10 mm (3/8 in).6 to 10	13 mm (1/2 in).5 to 9
20 mm (3/4 in).4 to 8	25 mm (1 in).3-1/2 to 6-1/2
40 mm (1 1/2 in).3 to 6	

- H. High early strength concrete, made with Type III cement or Type I cement plus non-corrosive accelerator, shall have a 7-day compressive strength equal to specified minimum 28-day compressive strength for concrete type specified made with standard Portland cement.
- I. Concrete slabs placed at air temperatures below 10 degrees C (50 degrees Fahrenheit) use non-corrosive, non-chloride accelerator. Concrete required to be air entrained use approved air entraining admixture. Pumped concrete, synthetic fiber concrete, architectural concrete, concrete required to be watertight, and concrete with a water/cement ratio below 0.50 use high-range water-reducing admixture (superplasticizer).
- J. Durability: Use air entrainment for exterior exposed concrete subjected to freezing and thawing and other concrete shown or specified. For air content requirements see Table III.
- K. Enforcing Strength Requirements: Test as specified in Section 01 45 29, TESTING LABORATORY SERVICES, during the progress of the work. Seven-day tests may be used as indicators of 28-day strength. Average of any three 28-day consecutive strength tests of laboratory-cured specimens representing each type of concrete shall be equal to or greater than specified strength. No single test shall be more than 3.5 MPa (500 psi) below specified strength. Interpret field test results in accordance with ACI 214. Should strengths shown by test specimens fall below required values, the COR may require any one or any combination of the following corrective actions, at no additional cost to the Government:
1. Require changes in mix proportions by selecting one of the other appropriate trial mixes or changing proportions, including cement content, of approved trial mix.

2. Require additional curing and protection.
3. If five consecutive tests fall below 95 percent of minimum values given in Table I or if test results are so low as to raise a question as to the safety of the structure, the COR may direct Contractor to take cores from portions of the structure. Use results from cores tested by the Contractor retained testing agency to analyze structure.
4. If strength of core drilled specimens falls below 85 percent of minimum value given in Table I, the COR may order load tests, made by Contractor retained testing agency, on portions of building so affected. Load tests in accordance with ACI 318 and criteria of acceptability of concrete under test as given therein.
5. Concrete work, judged inadequate by structural analysis, by results of load test, or for any reason, shall be reinforced with additional construction or replaced, if directed by the COR.

2.4 BATCHING AND MIXING

- A. General: Concrete shall be "Ready-Mixed" and comply with ACI 318 and ASTM C94, except as specified. Batch mixing at the site is permitted. Mixing process and equipment must be approved by the COR. With each batch of concrete, furnish certified delivery tickets listing information in Paragraph 16.1 and 16.2 of ASTM C94. Maximum delivery temperature of concrete is 38 degrees C (100 degrees Fahrenheit). Minimum delivery temperature as follows:

Atmospheric Temperature	Minimum Concrete Temperature
-1. degrees to 4.4 degrees C (30 degrees to 40 degrees F)	15.6 degrees C (60 degrees F.)
-17 degrees C to -1.1 degrees C (0 degrees to 30 degrees F.)	21 degrees C (70 degrees F.)

1. Services of aggregate manufacturer's representative shall be furnished during the design of trial mixes. Services will be required until field controls indicate that concrete of required quality is being furnished. Representative shall be thoroughly familiar with the adjustment and control of mixes to produce concrete of required quality. Representative shall assist and advise the COR.

PART 3 - EXECUTION

3.1 FORMWORK

- A. General: Design in accordance with ACI 347 is the responsibility of the Contractor. The Contractor shall retain a registered Professional Engineer to design the formwork, shores, and reshores.
 - 1. Form boards and plywood forms may be reused for contact surfaces of exposed concrete only if thoroughly cleaned, patched, and repaired and the COR approves their reuse.
 - 2. Provide forms for concrete footings unless the COR determines forms are not necessary.
- B. Treating and Wetting: Treat or wet contact forms as follows:
 - 1. Coat plywood and board forms with non-staining form sealer. In hot weather, cool forms by wetting with cool water just before concrete is placed.
 - 2. Clean and coat removable metal forms with light form oil before reinforcement is placed. In hot weather, cool metal forms by thoroughly wetting with water just before placing concrete.
 - 3. Use sealer on reused plywood forms as specified for new material.
- C. Size and Spacing of Studs: Size and space studs, wales and other framing members for wall forms so as not to exceed safe working stress of kind of lumber used nor to develop deflection greater than 1/270 of free span of member.
- D. Unlined Forms: Use plywood forms to obtain a smooth finish for concrete surfaces. Tightly butt edges of sheets to prevent leakage. Back up all vertical joints solidly and nail edges of adjacent sheets to same stud with 6d box nails spaced not over 150 mm (6 inches) apart.
- E. Lined Forms: May be used in lieu of unlined plywood forms. Back up form lining solidly with square edge board lumber securely nailed to studs with all edges in close contact to prevent bulging of lining. No joints in lining and backing may coincide. Nail abutted edges of sheets to same backing board. Nail lining at not over 200 mm (8 inches) on center along edges and with at least one nail to each square foot of surface area; nails to be 3d blue shingle or similar nails with thin flatheads.
- F. Architectural Liner: Attach liner as recommended by the manufacturer with tight joints to prevent leakage.

- G. Wall Form Ties: Locate wall form ties in symmetrically level horizontal rows at each line of wales and in plumb vertical tiers. Space ties to maintain true, plumb surfaces. Provide one row of ties within 150 mm (6 inches) above each construction joint. Space through-ties adjacent to horizontal and vertical construction joints not over 450 mm (18 inches) on center.
1. Tighten row of ties at bottom of form just before placing concrete and, if necessary, during placing of concrete to prevent seepage of concrete and to obtain a clean line. Ties to be entirely removed shall be loosened 24 hours after concrete is placed and shall be pulled from least important face when removed.
 2. Coat surfaces of all metal that is to be removed with paraffin, cup grease or a suitable compound to facilitate removal.
- H. Inserts, Sleeves, and Similar Items: Flashing reglets, steel strips, masonry ties, anchors, wood blocks, nailing strips, grounds, inserts, wire hangers, sleeves, drains, guard angles, forms for floor hinge boxes, inserts or bond blocks for elevator guide rails and supports, and other items specified as furnished under this and other sections of specifications and required to be in their final position at time concrete is placed shall be properly located, accurately positioned, and built into construction, and maintained securely in place.
1. Install sleeves, inserts and similar items for mechanical services in accordance with drawings prepared specially for mechanical services. Contractor is responsible for accuracy and completeness of drawings and shall coordinate requirements for mechanical services and equipment.
 2. Minimum clear distance of embedded items such as conduit and pipe is at least three times diameter of conduit or pipe, except at stub-ups and other similar locations.
 3. Provide recesses and blockouts in floor slabs for door closers and other hardware as necessary in accordance with manufacturer's instructions.
- I. Construction Tolerances:
1. Set and maintain concrete formwork to assure erection of completed work within tolerances specified and to accommodate installation of other rough and finish materials. Accomplish remedial work necessary for correcting excessive tolerances. Erected work that exceeds

specified tolerance limits shall be remedied or removed and replaced, at no additional cost to the Government.

2. Permissible surface irregularities for various classes of materials are defined as "finishes" in specification sections covering individual materials. They are to be distinguished from tolerances specified which are applicable to surface irregularities of structural elements.

3.2 PLACING REINFORCEMENT

- A. General: Details of concrete reinforcement in accordance with ACI 318 unless otherwise shown.
- B. Placing: Place reinforcement conforming to CRSI DA4, unless otherwise shown.
 1. Place reinforcing bars accurately and tie securely at intersections and splices with 1.6 mm (16 gauge) black annealed wire. Secure reinforcing bars against displacement during the placing of concrete by spacers, chairs, or other similar supports. Portions of supports, spacers, and chairs in contact with formwork shall be made of plastic in areas that will be exposed when building is occupied. Type, number, and spacing of supports conform to ACI 318. Where concrete slabs are placed on ground, use concrete blocks or other non-corrodible material of proper height, for support of reinforcement. Use of brick or stone supports will not be permitted.
- C. Spacing: Minimum clear distances between parallel bars, except in columns and multiple layers of bars in beams shall be equal to nominal diameter of bars. Minimum clear spacing is 25 mm (1 inch) or 1-1/3 times maximum size of coarse aggregate.
- D. Splicing: Splices of reinforcement made only as required or shown or specified. Accomplish splicing as follows:
 1. Lap splices: Do not use lap splices for bars larger than Number 36 (Number 11). Minimum lengths of lap as shown.
 2. Welded splices: Splicing by butt-welding of reinforcement is not permitted.
 3. Mechanical Splices: Develop in tension and compression at least 125 percent of the yield strength (f_y) of the bars. Stresses of transition splices between two reinforcing bar sizes based on area of smaller bar. Provide mechanical splices at locations indicated. Use approved exothermic, tapered threaded coupling, or swaged and

threaded sleeve. Exposed threads and swaging in the field not permitted.

- a. Initial qualification: In the presence of the COR, make three test mechanical splices of each bar size proposed to be spliced. Department of Veterans Affairs retained testing laboratory will perform load test.
 - b. During installation: Furnish, at no additional cost to the Government, one companion (sister) splice for every 50 splices for load testing. Department of Veterans Affairs retained testing laboratory will perform the load test.
- E. Bending: Bend bars cold, unless otherwise approved. Do not field bend bars partially embedded in concrete, except when approved by the COR.
- F. Cleaning: Metal reinforcement, at time concrete is placed, shall be free from loose flaky rust, mud, oil, or similar coatings that will reduce bond.
- G. Future Bonding: Protect exposed reinforcement bars intended for bonding with future work by wrapping with felt and coating felt with a bituminous compound unless otherwise shown.

3.3 VAPOR RETARDER

- A. Except where membrane waterproofing is required, interior concrete slab on grade shall be placed on a continuous vapor retarder.
1. Vapor retarder joints lapped 150 mm (6 inches) and sealed with compatible waterproof pressure-sensitive tape.
 2. Patch punctures and tears.

3.4 SLABS RECEIVING RESILIENT COVERING

- A. Slab shall be allowed to cure for 6 weeks minimum prior to placing resilient covering. After curing, slab shall be tested by the Contractor for moisture in accordance with ASTM D4263 or ASTM F1869. Moisture content shall be less than 3 pounds per 1000 sf prior to placing covering.
- B. In lieu of curing for 6 weeks, Contractor has the option, at his own cost, to utilize the Moisture Vapor Emissions & Alkalinity Control Sealer as follows:
1. Sealer is applied on the day of the concrete pour or as soon as harsh weather permits, prior to any other chemical treatments for concrete slabs either on grade, below grade or above grade receiving

resilient flooring, such as, sheet vinyl, vinyl composition tile, rubber, wood flooring, epoxy coatings and overlays.

2. Manufacturer's representative will be on the site the day of concrete pour to install or train its application and document. He shall return on every application thereafter to verify that proper procedures are followed.
 - a. Apply Sealer to concrete slabs as soon as final finishing operations are complete and the concrete has hardened sufficiently to sustain floor traffic without damage.
 - b. Spray apply Sealer at the rate of 20 m² (200 square feet) per gallon. Lightly broom product evenly over the substrate and product has completely penetrated the surface.
 - c. If within two (2) hours after initial application areas are subjected to heavy rainfall and puddling occurs, reapply Sealer product to these areas as soon as weather condition permits.

3.5 CONSTRUCTION JOINTS

- A. Unless otherwise shown, location of construction joints to limit individual placement shall not exceed 24,000 mm (80 feet) in any horizontal direction, except slabs on ground which shall have construction joints shown. Allow 48 hours to elapse between pouring adjacent sections unless this requirement is waived by the COR.
- B. Locate construction joints in suspended floors near the quarter-point of spans for slabs. Provide keys and inclined dowels as shown. Provide longitudinal keys as shown.
- C. Place concrete for walls slowly and in one operation between joints. Install joints in concrete walls at underside of deepest slab framing into wall.
- D. Allow 2 hours to elapse after wall is cast before concrete of supported slab is placed.
- E. Install polyvinyl chloride or rubber water seals, as shown in accordance with manufacturer's instructions, to form continuous watertight seal.

3.6 EXPANSION JOINTS AND CONTRACTION JOINTS

- A. Clean expansion joint surfaces before installing premolded filler and placing adjacent concrete.

- B. Install polyvinyl chloride or rubber water seals, as shown in accordance with manufacturer's instructions, to form continuous watertight seal.
- C. Provide contraction (control) joints in floor slabs as indicated on the contract drawings. Joints shall be either formed or saw cut, to the indicated depth after the surface has been finished. Complete saw joints within 4 to 12 hours after concrete placement. Protect joints from intrusion of foreign matter.

1.10 3.7 PLACING CONCRETE

- A. Preparation:
 - 1. Remove hardened concrete, wood chips, shavings and other debris from forms.
 - 2. Remove hardened concrete and foreign materials from interior surfaces of mixing and conveying equipment.
 - 3. Have forms and reinforcement inspected and approved by the COR before depositing concrete.
 - 4. Provide runways for wheeling equipment to convey concrete to point of deposit. Keep equipment on runways which are not supported by or bear on reinforcement. Provide similar runways for protection of vapor retarder on coarse fill.
- B. Bonding: Before depositing new concrete on or against concrete which has been set, thoroughly roughen and clean existing surfaces of laitance, foreign matter, and loose particles.
 - 1. Preparing surface for applied topping:
 - a. Remove laitance, mortar, oil, grease, paint, or other foreign material by sand blasting. Clean with vacuum type equipment to remove sand and other loose material.
 - b. Broom clean and keep base slab wet for at least four hours before topping is applied.
 - c. Use a thin coat of one part Portland cement, 1.5 parts fine sand, bonding admixture; and water at a 50: 50 ratio and mix to achieve the consistency of thick paint. Apply to a damp base slab by scrubbing with a stiff fiber brush. New concrete shall be placed while the bonding grout is still tacky.
- C. Conveying Concrete: Convey concrete from mixer to final place of deposit by a method which will prevent segregation. Method of conveying concrete is subject to approval of the COR.

- D. Placing: For special requirements see Paragraphs, HOT WEATHER and COLD WEATHER.
1. Do not place concrete when weather conditions prevent proper placement and consolidation, or when concrete has attained its initial set, or has contained its water or cement content more than 1 1/2 hours.
 2. Deposit concrete in forms as near as practicable in its final position. Prevent splashing of forms or reinforcement with concrete in advance of placing concrete.
 3. Do not drop concrete freely more than 3000 mm (10 feet) for concrete containing the high-range water-reducing admixture (superplasticizer) or 1500 mm (5 feet) for conventional concrete. Where greater drops are required, use a tremie or flexible spout (canvas elephant trunk), attached to a suitable hopper.
 4. Discharge contents of tremies or flexible spouts in horizontal layers not exceeding 500 mm (20 inches) in thickness, and space tremies such as to provide a minimum of lateral movement of concrete.
 5. Continuously place concrete until an entire unit between construction joints is placed. Rate and method of placing concrete shall be such that no concrete between construction joints will be deposited upon or against partly set concrete, after its initial set has taken place, or after 45 minutes of elapsed time during concrete placement.
 6. On bottom of members with severe congestion of reinforcement, deposit 25 mm (1 inch) layer of flowing concrete containing the specified high-range water-reducing admixture (superplasticizer). Successive concrete lifts may be a continuation of this concrete or concrete with a conventional slump.
- E. Consolidation: Conform to ACI 309. Immediately after depositing, spade concrete next to forms, work around reinforcement and into angles of forms, tamp lightly by hand, and compact with mechanical vibrator applied directly into concrete at approximately 450 mm (18 inch) intervals. Mechanical vibrator shall be power driven, hand operated type with minimum frequency of 5000 cycles per minute having an intensity sufficient to cause flow or settlement of concrete into place. Vibrate concrete to produce thorough compaction, complete

embedment of reinforcement and concrete of uniform and maximum density without segregation of mix. Do not transport concrete in forms by vibration.

1. Use of form vibration shall be approved only when concrete sections are too thin or too inaccessible for use of internal vibration.
2. Carry on vibration continuously with placing of concrete. Do not insert vibrator into concrete that has begun to set.

3.8 HOT WEATHER

- A. Follow the recommendations of ACI 305 or as specified to prevent problems in the manufacturing, placing, and curing of concrete that can adversely affect the properties and serviceability of the hardened concrete. Methods proposed for cooling materials and arrangements for protecting concrete shall be made in advance of concrete placement and approved by the COR.

3.9 COLD WEATHER

- A. Follow the recommendations of ACI 306 or as specified to prevent freezing of concrete and to permit concrete to gain strength properly. Use only the specified non-corrosive, non-chloride accelerator. Do not use calcium chloride, thiocyanates or admixtures containing more than 0.05 percent chloride ions. Methods proposed for heating materials and arrangements for protecting concrete shall be made in advance of concrete placement and approved by the COR.

3.10 PROTECTION AND CURING

- A. Conform to ACI 308: Initial curing shall immediately follow the finishing operation. Protect exposed surfaces of concrete from premature drying, wash by rain and running water, wind, mechanical injury, and excessively hot or cold temperatures. Keep concrete not covered with membrane or other curing material continuously wet for at least 7 days after placing, except wet curing period for high-early-strength concrete shall be not less than 3 days. Keep wood forms continuously wet to prevent moisture loss until forms are removed. Cure exposed concrete surfaces as described below. Other curing methods may be used if approved by the COR.
 1. Liquid curing and sealing compounds: Apply by power-driven spray or roller in accordance with the manufacturer's instructions. Apply immediately after finishing. Maximum coverage 10m²/L (400 square feet per gallon) on steel troweled surfaces and 7.5m²/L (300 square feet

- per gallon) on floated or broomed surfaces for the curing/sealing compound.
2. Plastic sheets: Apply as soon as concrete has hardened sufficiently to prevent surface damage. Utilize widest practical width sheet and overlap adjacent sheets 50 mm (2 inches). Tightly seal joints with tape.
 3. Paper: Utilize widest practical width paper and overlap adjacent sheets 50 mm (2 inches). Tightly seal joints with sand, wood planks, pressure-sensitive tape, mastic or glue.

3.11 REMOVAL OF FORMS

- A. Remove in a manner to assure complete safety of structure after the following conditions have been met.
 1. Where structure as a whole is supported on shores, forms for beams and girder sides, columns, and similar vertical structural members may be removed after 24 hours, provided concrete has hardened sufficiently to prevent surface damage and curing is continued without any lapse in time as specified for exposed surfaces.
- B. Control Test: Use to determine if the concrete has attained sufficient strength and curing to permit removal of supporting forms. Cylinders required for control tests taken in accordance with ASTM C172, molded in accordance with ASTM C31, and tested in accordance with ASTM C39. Control cylinders cured and protected in the same manner as the structure they represent. Supporting forms or shoring not removed until strength of control test cylinders have attained at least 70 percent of minimum 28-day compressive strength specified. Exercise care to assure that newly unsupported portions of structure are not subjected to heavy construction or material loading.
- C. Reshoring: Reshoring is required if superimposed load plus dead load of the floor exceeds the capacity of the floor at the time of loading. In addition, for flat slab/plate, reshoring is required immediately after stripping operations are complete and not later than the end of the same day. Reshoring accomplished in accordance with ACI 347 at no additional cost to the Government.

3.12 CONCRETE SURFACE PREPARATION

- A. Metal Removal: Unnecessary metal items cut back flush with face of concrete members.

- B. Patching: Maintain curing and start patching as soon as forms are removed. Do not apply curing compounds to concrete surfaces requiring patching until patching is completed. Use cement mortar for patching of same composition as that used in concrete. Use white or gray Portland cement as necessary to obtain finish color matching surrounding concrete. Thoroughly clean areas to be patched. Cut out honeycombed or otherwise defective areas to solid concrete to a depth of not less than 25 mm (1 inch). Cut edge perpendicular to surface of concrete. Saturate with water area to be patched, and at least 150 mm (6 inches) surrounding before placing patching mortar. Give area to be patched a brush coat of cement grout followed immediately by patching mortar. Cement grout composed of one part Portland cement, 1.5 parts fine sand, bonding admixture, and water at a 50:50 ratio, mix to achieve consistency of thick paint. Mix patching mortar approximately 1 hour before placing and remix occasionally during this period without addition of water. Compact mortar into place and screed slightly higher than surrounding surface. After initial shrinkage has occurred, finish to match color and texture of adjoining surfaces. Cure patches as specified for other concrete. Fill form tie holes which extend entirely through walls from unexposed face by means of a pressure gun or other suitable device to force mortar through wall. Wipe excess mortar off exposed face with a cloth.
- C. Upon removal of forms, clean vertical concrete surface that is to receive bonded applied cementitious application with wire brushes or by sand blasting to remove unset material, laitance, and loose particles to expose aggregates to provide a clean, firm, granular surface for bond of applied finish.

3.13 CONCRETE FINISHES

- A. Vertical and Overhead Surface Finishes:
1. Unfinished areas: Vertical and overhead concrete surfaces exposed in pipe basements, elevator and dumbwaiter shafts, pipe spaces, pipe trenches, above suspended ceilings, manholes, and other unfinished areas will not require additional finishing.
 2. Interior and exterior exposed areas to be painted: Remove fins, burrs and similar projections on surfaces flush, and smooth by mechanical means approved by the COR, and by rubbing lightly with a

- fine abrasive stone or hone. Use ample water during rubbing without working up a lather of mortar or changing texture of concrete.
3. Interior and exterior exposed areas finished: Give a grout finish of uniform color and smooth finish treated as follows:
 - a. After concrete has hardened and laitance, fins and burrs removed, scrub concrete with wire brushes. Clean stained concrete surfaces by use of a hone stone.
 - b. Apply grout composed of one part of Portland cement, one part fine sand, smaller than a 600 μm (No. 30) sieve. Work grout into surface of concrete with cork floats or fiber brushes until all pits, and honeycombs are filled.
 - c. After grout has hardened slightly, but while still plastic, scrape grout off with a sponge rubber float and, about 1 hour later, rub concrete vigorously with burlap to remove any excess grout remaining on surfaces.
 - d. In hot, dry weather use a fog spray to keep grout wet during setting period. Complete finish of area in same day. Make limits of finished areas at natural breaks in wall surface. Leave no grout on concrete surface overnight.
 4. Textured: Finish as specified. Maximum quantity of patched area 0.2 m^2 (2 square feet) in each 93 m^2 (1000 square feet) of textured surface.
- B. Slab Finishes:
1. Monitoring and Adjustment: Provide continuous cycle of placement, measurement, evaluation and adjustment of procedures to produce slabs within specified tolerances. Monitor elevations of structural steel in key locations before and after concrete placement to establish typical deflection patterns for the structural steel. Determine elevations of cast-in-place slab soffits prior to removal of shores. Provide information to the COR and floor consultant for evaluation and recommendations for subsequent placements.
 2. Set perimeter forms to serve as screed using either optical or laser instruments. For slabs on ground, wet screeds may be used to establish initial grade during strike-off, unless the COR determines that the method is proving insufficient to meet required finish tolerances and directs use of rigid screed guides. Where wet screeds are allowed, they shall be placed using grade stakes set by optical

- or laser instruments. Use rigid screed guides, as opposed to wet screeds, to control strike-off elevation for all types of elevated (non slab-on-ground) slabs. Divide bays into halves or thirds by hard screeds. Adjust as necessary where monitoring of previous placements indicates unshored structural steel deflections to other than a level profile.
3. Place slabs monolithically. Once slab placement commences, complete finishing operations within same day. Slope finished slab to floor drains where they occur, whether shown or not.
 4. Use straightedges specifically made for screeding, such as hollow magnesium straightedges or power strike-offs. Do not use pieces of dimensioned lumber. Strike off and screed slab to a true surface at required elevations. Use optical or laser instruments to check concrete finished surface grade after strike-off. Repeat strike-off as necessary. Complete screeding before any excess moisture or bleeding water is present on surface. Do not sprinkle dry cement on the surface.
 5. Immediately following screeding, and before any bleed water appears, use a 3000 mm (10 foot) wide highway straightedge in a cutting and filling operation to achieve surface flatness. Do not use bull floats or darbys, except that darbying may be allowed for narrow slabs and restricted spaces.
 6. Wait until water sheen disappears and surface stiffens before proceeding further. Do not perform subsequent operations until concrete will sustain foot pressure with maximum of 6 mm (1/4 inch) indentation.
 7. Scratch Finish: Finish base slab to receive a bonded applied cementitious application as indicated above, except that bull floats and darbys may be used. Thoroughly coarse wire broom within two hours after placing to roughen slab surface to insure a permanent bond between base slab and applied materials.
 8. Float Finish: Slabs to receive unbonded toppings, steel trowel finish, fill, mortar setting beds, or a built-up roof, and ramps, stair treads, platforms (interior and exterior), and equipment pads shall be floated to a smooth, dense uniform, sandy textured finish. During floating, while surface is still soft, check surface for flatness using a 3000 mm (10 foot) highway straightedge. Correct

- high spots by cutting down and correct low spots by filling in with material of same composition as floor finish. Remove any surface projections and re-float to a uniform texture.
9. Steel Trowel Finish: Concrete surfaces to receive resilient floor covering or carpet, monolithic floor slabs to be exposed to view in finished work, future floor roof slabs, applied toppings, and other interior surfaces for which no other finish is indicated. Steel trowel immediately following floating. During final troweling, tilt steel trowel at a slight angle and exert heavy pressure to compact cement paste and form a dense, smooth surface. Finished surface shall be smooth, free of trowel marks, and uniform in texture and appearance.
 10. Broom Finish: Finish exterior slabs, ramps, and stair treads with a bristle brush moistened with clear water after surfaces have been floated. Brush in a direction transverse to main traffic. Match texture approved by the COR from sample panel.
 11. Finished slab flatness (FF) and levelness (FL) values comply with the following minimum requirements:
 - a. Areas covered with carpeting, or not specified otherwise in b. below:
 - 1) Slab on Ground:
 - a) Specified overall value F_F 25/ F_L 20
 - b) Minimum local value F_F 17/ F_L 15
 - 2) Level suspended slabs (shored until after testing):
 - a) Specified overall value FF 25/ FL 20
 - b) Minimum local value FF 17/ FL 15
 - 3) Unshored suspended slabs:
 - a) Specified overall value FF 25
 - b) Minimum local value FF 17
 - 4) Level tolerance such that 80 percent of all points fall within a 20 mm (3/4 inch) envelope +10 mm, -10 mm (+3/8 inch, -3/8 inch) from the design elevation.
 - b. Areas that will be exposed, receive thin-set tile or resilient flooring, or roof areas designed as future floors:
 - 1) Slab on ground:
 - a) Specified overall value FF 36/ FL 20
 - b) Minimum local value FF 24/ FL 15

- 2) Level suspended slabs (shored until after testing):
 - a) Specified overall value FF 30/FL 20
 - b) Minimum local value FF 24/FL 15
- 3) Unshored suspended slabs:
 - a) Specified overall value FF 30
 - b) Minimum local value FF 24
- 4) Level tolerance such that 80 percent of all points fall within a 20 mm (3/4 inch) envelope +10 mm, -10 mm (+3/8 inch, -3/8 inch) from the design elevation.
- c. "Specified overall value" is based on the composite of all measured values in a placement derived in accordance with ASTM E1155.
- d. "Minimum local value" (MLV) describes the flatness or levelness below which repair or replacement is required. MLV is based on the results of an individual placement and applies to a minimum local area. Minimum local area boundaries may not cross a construction joint or expansion joint. A minimum local area will be bounded by construction and/or control joints, or by column lines and/or half-column lines, whichever is smaller.

12. Measurements

- a. Department of Veterans Affairs retained testing laboratory will take measurements as directed by the COR, to verify compliance with FF, FL, and other finish requirements. Measurements will occur within 72 hours after completion of concrete placement (weekends and holidays excluded). Make measurements before shores or forms are removed to insure the "as-built" levelness is accurately assessed. Profile data for above characteristics may be collected using a laser level or any Type II apparatus (ASTM E1155, "profileograph" or "dipstick"). Contractor's surveyor shall establish reference elevations to be used by Department of Veterans Affairs retained testing laboratory.
- b. Contractor not experienced in using FF and FL criteria is encouraged to retain the services of a floor consultant to assist with recommendations concerning adjustments to slab thicknesses, finishing techniques, and procedures on measurements of the finish as it progresses in order to achieve the specific flatness and levelness numbers.

13. Acceptance/ Rejection:

- a. If individual slab section measures less than either of specified minimum local F_F/F_L numbers, that section shall be rejected and remedial measures shall be required. Sectional boundaries may be set at construction and contraction (control) joints, and not smaller than one-half bay.
 - b. If composite value of entire slab installation, combination of all local results, measures less than either of specified overall F_F/F_L numbers, then whole slab shall be rejected and remedial measures shall be required.
14. Remedial Measures for Rejected Slabs: Correct rejected slab areas by grinding, planing, surface repair with underlayment compound or repair topping, retopping, or removal and replacement of entire rejected slab areas, as directed by the COR, until a slab finish constructed within specified tolerances is accepted.

3.14 SURFACE TREATMENTS:

- A. Use on exposed concrete floors and concrete floors to receive carpeting except those specified to receive non-slip finish.
- B. Liquid Densifier/Sealer: Apply in accordance with manufacturer's directions just prior to completion of construction.
- C. Non-Slip Finish: Except where safety nosing and tread coverings are shown, apply non-slip abrasive aggregate to treads and platforms of concrete steps and stairs, and to surfaces of exterior concrete ramps and platforms. Broadcast aggregate uniformly over concrete surface at rate of application of 8 percent per 1/10th m^2 (7.5 percent per square foot) of area. Trowel concrete surface to smooth dense finish. After curing, rub treated surface with abrasive brick and water to slightly expose abrasive aggregate.

3.17 RETAINING WALLS

- A. Use air-entrained concrete.
- B. Expansion and contraction joints, waterstops, weep holes, reinforcement and railing sleeves installed and constructed as shown.
- C. Exposed surfaces finished to match adjacent concrete surfaces, new or existing.
- D. Place porous backfill as shown.

3.18 PRECAST CONCRETE ITEMS

- A. Precast concrete items, not specified elsewhere. Cast using 25 MPa (3000 psi) air-entrained concrete to shapes and dimensions shown. Finish to match corresponding adjacent concrete surfaces. Reinforce with steel for safe handling and erection.

**SECTION 04 05 13
MASONRY MORTARING**

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies mortar materials and mixes.

1.2 RELATED WORK:

- A. Mortar used in Section:
1. Section 04 05 16, MASONRY GROUTING.
 2. Section 04 20 00, UNIT MASONRY.
 3. Section 04 72 00, CAST STONE MASONRY.

1.3 TESTING LABORATORY-CONTRACTOR RETAINED

- A. Engage a commercial testing laboratory approved by Resident Engineer to perform tests specified below.
- B. Submit information regarding testing laboratory's facilities and qualifications of technical personnel to Resident Engineer.

1.4 TESTS

- A. Test materials proposed for use for compliance with specifications in accordance with test methods contained in referenced specifications and as follows:
- B. Mortar:
1. Test for compressive strength and water retention; ASTM C270.
 2. Mortar compressive strengths 28 days as follows:
Type M: Minimum 17230 kPa (2500 psi) at 28 days.
Type S: Minimum 12400 kPa (1800 psi) at 28 days.
Type N: Minimum 5170 kPa (750 psi) at 28 days.
- C. Cement:
1. Test for water soluble alkali (nonstaining) when nonstaining cement is specified.
 2. Nonstaining cement shall contain not more than 0.03 percent water soluble alkali.
- D. Sand: Test for deleterious substances, organic impurities, soundness and grading.

1.5 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Certificates:

1. Testing laboratory's facilities and qualifications of its technical personnel.
2. Indicating that following items meet specifications:
 - a. Portland cement.
 - b. Masonry cement.
 - c. Mortar cement.
 - d. Hydrated lime.
 - e. Fine aggregate (sand).
 - f. Color admixture.
- C. Laboratory Test Reports:
 1. Mortar, each type.
 2. Admixtures.
- D. Manufacturer's Literature and Data:
 1. Cement, each kind.
 2. Hydrated lime.
 3. Admixtures.
 4. Liquid acrylic resin.

1.6 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Deliver masonry materials in original sealed containers marked with name of manufacturer and identification of contents.
- B. Store masonry materials under waterproof covers on planking clear of ground, and protect damage from handling, dirt, stain, water and wind.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C40-11Organic Impurities in Fine Aggregates for
Concrete
 - C91-12Masonry Cement
 - C109-11Compressive Strength of Hydraulic Cement
Mortars (Using 2-in. or 50-MM Cube Specimens)
 - C144-04Aggregate for Masonry Mortar
 - C150-12Portland Cement
 - C207-06(2011)Hydrated Lime for Masonry Purposes
 - C270-12Mortar for Unit Masonry
 - C595-13Blended Hydraulic Cement

C780-10Preconstruction and Construction Evaluation of
Mortars for Plain and Reinforced Unit Masonry
C979-10Pigments for Integrally Colored Concrete
C1329-12Mortar Cement

PART 2 - PRODUCTS

2.1 HYDRATED LIME

ASTM C207, Type S.

2.2 AGGREGATE FOR MASONRY MORTAR

A. ASTM C144 and as follows:

1. Light colored sand for mortar for laying face brick.
2. White plastering sand meeting sieve analysis for mortar joints for pointing and laying of structural facing tile units except that 100 percent passes No. 8 sieve, and not more than 5 percent retained on No. 16 sieve.

B. Test sand for color value in accordance with ASTM C40. Sand producing color darker than specified standard is unacceptable.

2.3 MASONRY CEMENT

A. ASTM C91. Type N, S, or M.

B. Use white masonry cement whenever white mortar is specified.

2.4 MORTAR CEMENT

ASTM C1329, Type N, S or M.

2.5 PORTLAND CEMENT

A. ASTM C150, Type I.

B. Use white Portland cement wherever white mortar is specified.

2.6 LIQUID ACRYLIC RESIN

A formulation of acrylic polymers and modifiers in liquid form designed for use as an additive for mortar to improve physical properties.

2.7 WATER

Potable, free of substances that are detrimental to mortar, masonry, and metal.

2.8 POINTING MORTAR

A. For Cast Stone or Precast Concrete: Proportion by volume; One part white Portland cement, two parts white sand, and 1/5 part hydrated lime.

B. Pointing Mortar for Glazed Structural Facing Tile:

1. Proportion by volume: One part white Portland cement, two parts of graded white sand passing Number 50 sieve, and 1/8 part hydrated lime.
2. Pointing mortar in shower: Add aluminum tri-stearate, calcium stearate, or ammonium stearate in amount of two percent of weight of cement used.

2.9 MASONRY MORTAR

- A. Conform to ASTM C270.
- B. Admixtures:
 1. Do not use mortar admixtures, except color admixtures if approved by Resident Engineer.
 2. Submit laboratory test report showing effect of proposed admixture on strength, water retention, and water repellency of mortar.
 3. Do not use antifreeze compounds.
- C. Colored Mortar:
 1. Maintain uniform mortar color for exposed work throughout.
 2. Match mortar color in approved sample or mock-up.
 3. Color of mortar for exposed work in alteration work to match color of existing mortar unless specified otherwise in section 09 06 00, SCHEDULE FOR FINISHES.
- D. Color Admixtures:
 1. Proportion as specified by manufacturer.

2.10 COLOR ADMIXTURE

- A. Pigments: ASTM C979.
- B. Use mineral pigments only. Organic pigments are not acceptable.
- C. Pigments inert, stable to atmospheric conditions, nonfading, alkali resistant and water insoluble.

PART 3 - EXECUTION

3.1 MIXING

- A. Mix in a mechanically operated mortar mixer.
 1. Mix mortar for at least three minutes but not more than five minutes.
- B. Measure ingredients by volume. Measure by the use of a container of known capacity.
- C. Mix water with dry ingredients in sufficient amount to provide a workable mixture which will adhere to vertical surfaces of masonry units.

- D. Mortar that has stiffened because of loss of water through evaporations:
1. Re-tempered by adding water to restore to proper consistency and workability.
 2. Discard mortar that has reached its initial set or has not been used within two hours.
- E. Pointing Mortar:
1. Mix dry ingredients with enough water to produce a damp mixture of workable consistency which will retain its shape when formed into a ball.
 2. Allow mortar to stand in dampened condition for one to 1-1/2 hours.
 3. Add water to bring mortar to a workable consistency prior to application.

3.2 MORTAR USE LOCATION

- A. Use Type M mortar for precast concrete panels, and waterproof parging below grade, .
- B. Use Type S mortar for masonry containing vertical reinforcing bars (non-engineered) masonry below grade masonry solar screens and setting cast stone and engineered reinforced unit masonry work .
- C. For brick veneer over frame back up walls, use Type N portland cement-lime mortar or Type S masonry cement or mortar cement mortar.
- D. Use Type N mortar for other masonry work, except as otherwise specified.
- E. Use Type N mortar for tuck pointing work.
- F. Use pointing mortar for items specified.

- - - E N D - - -

**SECTION 04 05 16
MASONRY GROUTING**

PART 1 - GENERAL

1.1 DESCRIPTION:

Section specifies grout materials and mixes.

1.2 RELATED WORK:

- A. Grout used in Section:
 - 1. Section 04 20 00, UNIT MASONRY.
 - 2. Section 04 72 00, CAST STONE MASONRY.

1.3 TESTS:

- A. Certified test reports for grout and materials specified.
- B. Identify materials by type, brand name and manufacturer or by origin.
- C. After tests have been made and materials approved, do not change without additional test and approval of Resident Engineer.
- D. Testing:
 - 1. Grout:
 - a. Test for compressive strength; ASTM C1019.
 - b. Grout compressive strength of 13790 kPa (2000 psi) at 28 days.
 - 2. Cement:
 - a. Test for water soluble alkali (nonstaining) when nonstaining cement is specified.
 - b. Nonstaining cement shall contain not more than 0.03 percent water soluble alkali.
 - 3. Sand: Test for deleterious substances, organic impurities, soundness and grading.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Certificates:
 - 1. Indicating that following items meet specifications:
 - a. Portland cement.
 - b. Masonry cement.
 - c. Grout.
 - d. Hydrated lime.
 - e. Fine aggregate (sand).

- f. Coarse aggregate for grout.
- g. Color admixture.
- C. Laboratory Test Reports:
 - 1. Grout, each type.
 - 2. Admixtures.
- D. Manufacturer's Literature and Data:
 - 1. Cement, each kind.
 - 2. Hydrated lime.
 - 3. Admixtures.
 - 4. Liquid acrylic resin.

1.5 PRODUCT DELIVERY, STORAGE AND HANDLING:

- A. Deliver masonry materials in original sealed containers marked with name of manufacturer and identification of contents.
- B. Store masonry materials under waterproof covers on planking clear of ground, and protect damage from handling, dirt, stain, water and wind.

1.6 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - C40-11Organic Impurities in Fine Aggregates for
Concrete
 - C91-12Masonry Cement
 - C150-12Portland Cement
 - C207-06(2011)Hydrated Lime for Masonry Purposes
 - C404-11Aggregate for Masonry Grout
 - C476-10Grout for Masonry
 - C595-13Blended Hydraulic Cement
 - C979-10Pigments for Integrally Colored Concrete
 - C1019-11Sampling and Testing Grout

PART 2 - PRODUCTS

2.1 HYDRATED LIME:

ASTM C207, Type S.

2.2 AGGREGATE FOR MASONRY GROUT:

ASTM C404, Size 8.

2.3 MASONRY CEMENT:

- A. ASTM C91. Type N, S, or M.
- B. Use white masonry cement whenever white mortar is specified.

2.4 PORTLAND CEMENT:

- A. ASTM C150, Type I.
- B. Use white Portland cement wherever white mortar is specified.

2.5 LIQUID ACRYLIC RESIN:

A formulation of acrylic polymers and modifiers in liquid form designed for use as an additive for mortar to improve physical properties.

2.6 WATER:

Potable, free of substances that are detrimental to grout, masonry, and metal.

2.7 GROUT:

- A. Conform to ASTM C476 except as specified.
- B. Grout type proportioned by volume as follows:
 - 1. Fine Grout:
 - a. Portland cement or blended hydraulic cement: one part.
 - b. Hydrated lime: 0 to 1/10 part.
 - c. Fine aggregate: 2-1/4 to three times sum of volumes of cement and lime used.
 - 2. Coarse Grout:
 - a. Portland cement or blended hydraulic cement: one part.
 - b. Hydrated lime: 0 to 1/10 part.
 - c. Fine aggregate: 2-1/4 to three times sum of volumes of cement and lime used.
 - d. Coarse aggregate: one to two times sum of volumes of cement and lime used.
 - 3. Sum of volumes of fine and coarse aggregates: Do not exceed four times sum of volumes of cement and lime used.

2.8 COLOR ADMIXTURE:

- A. Pigments: ASTM C979.
- B. Use mineral pigments only. Organic pigments are not acceptable.
- C. Pigments inert, stable to atmospheric conditions, nonfading, alkali resistant and water insoluble.

PART 3 - EXECUTION

3.1 MIXING:

- A. Mix in a mechanically operated grout mixer.

1. Mix grout for at least five minutes.
- B. Measure ingredients by volume.
- C. Mix water with grout dry ingredients in sufficient amount to bring grout mixture to a pouring consistency.

3.2 GROUT USE LOCATIONS:

- A. Use fine grout for filling wall cavities and cells of concrete masonry units where the smallest dimension is 50 mm (2 inches) or less.
- B. Use either fine grout or coarse grout for filling wall cavities and cells of concrete masonry units where the smallest dimension is greater than 50 mm (2 inches).
- C. Do not use grout for filling bond beam or lintel units.

- - - E N D - - -

SECTION 04 20 00
UNIT MASONRY

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes: Concrete masonry unit (CMU) and Face brick assemblies for:
1. Exterior walls.
 2. Interior walls and partitions .

1.2 RELATED REQUIREMENTS

- A. Sealants and Sealant Installation: Section 07 92 00, JOINT SEALANTS.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. American Concrete Institute (ACI):
1. 315-99 - Details and Detailing of Concrete Reinforcement.
 2. 530.1/ASCE 6/TMS 602-13 - Specification for Masonry Structures.
- C. ASTM International (ASTM):
1. A615/A615M-15ae1 - Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
 2. A951/A951M-14 - Steel Wire for Masonry Joint Reinforcement.
 3. A1064/A1064M-15 - Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
 4. C55-14a - Concrete Building Brick.
 5. C62-13a - Building Brick (Solid Masonry Units Made from Clay or Shale).
 6. C67-14 - Sampling and Testing Brick and Structural Clay Tile.
 7. C90-14 - Load-Bearing Concrete Masonry Units.
 8. C216-15 - Facing Brick (Solid Masonry Units Made From Clay or Shale).
 9. C612-14 - Mineral Fiber Block and Board Thermal Insulation.
Units.
 10. D1056-14 - Flexible Cellular Materials - Sponge or Expanded Rubber.
 11. D2240-05(2010) - Rubber Property-Durometer Hardness.
 12. F1667-15 - Driven Fasteners: Nails, Spikes, and Staples.
- D. American Welding Society (AWS):
1. D1.4/D1.4M-11 - Structural Welding Code - Reinforcing Steel.

- E. Brick Industry Association (BIA):
 - 1. TN 11B-88 - Guide Specifications for Brick Masonry, Part 3.
- F. Federal Specifications (Fed. Spec.):
 - 1. FF-S-107C(2) - Screws, Tapping and Drive.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 - 1. Fabrication, bending, and placement of reinforcing bars. Comply with ACI 315. Show bar schedules, diagrams of bent bars, stirrup spacing, lateral ties and other arrangements and assemblies.
 - 2. Special masonry shapes, profiles, and placement.
 - 3. Masonry units for typical window and door openings, and, for special conditions as affected by structural conditions.
- C. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Installation instructions.
- D. Samples:
 - 1. Face brick: Sample panel, 200 mm by 400 mm (8 inches by 16 inches,) showing full color range and texture of bricks, bond, and proposed mortar joints.
 - 2. Anchors and Ties: Each type.
 - 3. Joint Reinforcing: 1200 mm (48 inches) long each type.
- E. Sustainable Construction Submittals:
 - 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.
- F. Certificates: Certify products comply with specifications.
 - 1. Face brick.
 - 2. Solid and load-bearing concrete masonry units, including fire-resistant rated units.
- G. Delegated Design Drawings and Calculations: Signed and sealed by responsible design professional.

1.5 QUALITY ASSURANCE

- A. Welders and Welding Procedures Qualifications: AWS D1.4/D1.4M.
- B. Mockups:

1. Before starting masonry, build a mockup panel minimum 1800 mm by 1800 mm (6 feet by 6 feet) with 600 mm (24 inch) 90 degree return for outside corner.
 - a. Use masonry units from random cubes of units delivered on site.
 - b. Include structural backup, reinforcing, ties, and anchors.
2. Mockup panel approved by Contracting Officer's Representative set workmanship and aesthetic quality for masonry work.
3. Clean sample panel to test cleaning methods.
4. Remove mockup panel when directed by Contracting Officer's Representative.

1.6 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

- A. Store products above grade, protected from contamination.
- B. Protect products from damage during handling and construction operations.

1.8 FIELD CONDITIONS

- A. Hot and Cold Weather Requirements: Comply with ACI 530.1/ASCE 6/TMS 602.

1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

- A. Delegated Design: Prepare submittal documents including design calculations and drawings signed and sealed by registered design professional, licensed in state where work is located.

2.2 PRODUCTS - GENERAL

- A. Provide each product from one manufacturer and from one production run .
- B. Sustainable Construction Requirements:
 - 1. Brick Concrete Masonry Unit Recycled Content: 15 total recycled content, minimum. Select products with recycled content to achieve overall Project recycled content requirement.
 - a. Post-Consumer Recycled Content: 5, minimum.
 - b. Pre-Consumer Recycled Content: 10, minimum.
 - 2. Steel Recycled Content: 30 percent total recycled content, minimum.

2.3 UNIT MASONRY PRODUCTS

- A. Brick:
 - 1. Face Brick:
 - a. ASTM C216, Grade SW, Type FBS.
 - b. Brick when tested according to ASTM C67: Classified slightly efflorescent or better.
 - c. Size:
 - 1) Modular.
 - 2. Building Brick: ASTM C62, Grade MW for backup and interior work; Grade SW where in contact with earth.
- B. Concrete Masonry Units (CMU):
 - 1. Hollow and Solid Load-Bearing Concrete Masonry Units: ASTM C90.
 - a. Normal weight .
 - b. Fire rated units for fire rated partitions.
 - 2. Sizes: Modular, 200 mm by 400 mm (8 inches by 16 inches) nominal face dimension; thickness as indicated on drawings.
 - 3. For molded faces used as a finished surface, use concrete masonry units with uniform fine to medium surface texture unless specified otherwise.
 - 4. Use bullnose concrete masonry units at corners exposed in finished work with 25 mm (1 inch) minimum radius rounded vertical exterior corners (bullnose units).

2.4 ANCHORS, TIES, AND REINFORCEMENT

- A. Steel Reinforcing Bars: ASTM A615/A615M; Grade 60, deformed bars.
- B. Joint Reinforcement:

1. Form from wire complying with ASTM A951/A951M.
 2. Hot dipped galvanized after fabrication.
 3. Width of joint reinforcement 40 mm (1.6 inches) less than nominal thickness of masonry wall or partition.
 4. Cross wires welded to longitudinal wires.
 5. Joint reinforcement minimum 3000 mm (10 feet) long, factory cut.
 6. Joint reinforcement with crimp formed drip is not acceptable.
 7. Maximum spacing of cross wires 400 mm (16 inch) to longitudinal wires.
 8. Trussed Design:
 - a. Longitudinal and cross wires minimum 4 mm (0.16 inch nominal) diameter.
 - b. Longitudinal wires deformed.
 9. Multiple Wythes and Cavity Wall Ties:
 - a. Longitudinal wires 4 mm (0.16 inch), two in each wythe with ladder truss wires 4 mm (0.16 inch) overlay, welded to each longitudinal wire.
 - b. Longitudinal wires 4 mm (0.16 inch) with U shape 4 mm (0.16 inch) rectangular ties extending into other wythe minimum 75 mm (3 inches) spaced 400 mm on center (16 inches). Adjustable type with U shape tie designed to receive 4 mm (0.16 inch) pintle projecting into other wythe 75 mm (3 inches min.).
- C. Adjustable Veneer Anchor for Framed Walls:
1. Two piece, adjustable anchor and tie.
 2. Anchor and tie may be either loop or angle type; provide only one type throughout.
- D. Dovetail Anchors:
1. Corrugated steel dovetail anchors formed of 1.5 mm (0.06 inch) thick by 25 mm (1 inch) wide galvanized steel, 90 mm (3-1/2 inches) long where used to anchor 100 mm (4 inch) nominal thick masonry units, 140 mm (5-1/2 inches) long for masonry units more than 100 mm (4 inches) thick.
 2. Triangular wire dovetail anchor 100 mm (4 inch) wide formed of 4 mm (9 gage) steel wire with galvanized steel dovetail insert. Anchor length to extend minimum 75 mm (3 inches) into masonry, 25 mm (1 inch) into 40 mm (1-1/2 inch) thick units.

3. Form dovetail anchor slots from 0.6 mm (0.02 inch) thick galvanized steel (with felt or fiber filler).

E. Individual Ties:

1. Rectangular ties: Form from 5 mm (3/16 inch) diameter galvanized steel rod to rectangular shape minimum 50 mm (2 inches) wide by sufficient length for ends of ties to extend within 25 mm (1 inch) of each face of wall. Ties that are crimped to form drip are not acceptable.
2. Adjustable Cavity Wall Ties:
 - a. Adjustable wall ties may be furnished at Contractor's option.
 - b. Two piece type permitting up to 40 mm (1-1/2 inch) adjustment.
 - c. Form ties from 5 mm (3/16 inch) diameter galvanized steel wire.
 - d. Form one piece to rectangular shape 105 mm (4-1/8 inches) wide by length required to extend into bed joint 50 mm (2 inches).
 - e. Form other piece to 75 mm (3 inch) long by 75 mm (3 inch) wide shape, having 75 mm (3 inch) long bent section for engaging 105 mm (4-1/8 inch) wide piece to form adjustable connection.

F. Wall Ties, (Mesh or Wire):

1. Mesh wall ties formed of ASTM A1064/A1064M, W0.5, 2 mm, (0.08 inch) galvanized steel wire 13 mm by 13 mm (1/2 inch by 1/2 inch) mesh, 75 mm (3 inches) wide by 200 mm (8 inches) long.
2. Rectangular wire wall ties formed of W1.4, 3 mm, (0.12 inch) galvanized steel wire 50 mm (2 inches) wide by 200 mm (8 inches) long.

G. Adjustable Steel Column Anchor:

1. Two piece anchor consisting of a 6 mm (1/4 inch) diameter steel rod to be welded to steel with offset ends, rod to permit 100 mm (4 inch) vertical adjustment of wire anchor.
2. Triangular shaped wire anchor 100 mm (4 inches) wide formed from 5 (3/16 inch) diameter galvanized wire, to extend minimum 75 mm (3 inches) into joints of masonry.
3. Other lengths as indicated on drawings.

2.5 ACCESSORIES

A. Shear Keys:

1. Solid extruded cross-shaped section of rubber, neoprene, or polyvinyl chloride, with durometer hardness of approximately 80 when

tested according to ASTM D2240, and minimum shear strength of 3.5 MPa (500 psi).

2. Shear Key Dimensions: Nominal 70 mm by 8 mm for long flange and 38 mm by 16 mm for short flange (2-3/4 inches by 5/16 inch for long flange, and 1-1/2 inches by 5/8 inch for short flange).

B. Weeps:

1. Weep Hole: Flexible PVC louvered configuration with rectangular closure strip at top.

C. Cavity Drain Material: Open mesh polyester sheets or strips to prevent mortar droppings from clogging the cavity.

D. Preformed Compressible Joint Filler:

1. Thickness and depth to fill joint.
2. Closed Cell Neoprene: ASTM D1056, Type 2, Class A, Grade 1, B2F1.
3. Non-Combustible Type: ASTM C612, Type 5, Max. Temp.1800 degrees F.

E. Masonry Cleaner:

1. Detergent type cleaner selected for each type masonry.
2. Acid cleaners are not acceptable.
3. Use soapless type specially prepared for cleaning brick or concrete masonry as appropriate.

F. Fasteners:

1. Concrete Nails: ASTM F1667, Type I, Style 11, 19 mm (3/4 inch) minimum length.
2. Masonry Nails: ASTM F1667, Type I, Style 17, 19 mm (3/4 inch) minimum length.
3. Screws: FS-FF-S-107, Type A, AB, SF thread forming or cutting.

G. Welding Materials: AWS D1.4/D1.4M, type to suit application.

PART 3 - EXECUTION

3.1 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Keep finish work free from mortar smears or spatters, and leave neat and clean.

C. Wall Openings:

1. Fill hollow metal frames built into masonry walls and partitions solid with mortar as laying of masonry progresses.
2. When items are not available when walls are built, prepare openings for subsequent installation.

D. Tooling Joints:

1. Do not tool until mortar has stiffened enough to retain thumb print when thumb is pressed against mortar.
2. Tool while mortar is soft enough to be compressed into joints and not raked out.
3. Finish joints in exterior face masonry work with jointing tool, and provide smooth, water-tight concave joint unless specified otherwise.
4. Tool Exposed interior joints in finish work concave unless specified otherwise.

E. Partition Height:

1. Extend partitions minimum 100 mm (4 inches) above suspended ceiling or to overhead construction where no ceiling occurs.
2. Extend following partitions to overhead construction.
 - a. Full height partitions, and fire partitions and smoke partitions indicated on drawings.
 - b. Both walls at expansion joints.
 - c. Corridor walls.
 - d. Walls at stairway and stair halls, elevators, dumbwaiters, trash and laundry chute shafts, and other vertical shafts.
 - e. Walls at refrigerator space.
 - f. Reinforced masonry partitions.
3. Extend finished masonry partitions minimum 100 mm (4 inches) above suspended ceiling and continue with concrete masonry units or structural clay tile to overhead construction:

F. Wall, Furring, and Partition Units:

1. Lay out field units to provide one-half running bond, unless indicated otherwise.
2. Align head joints of alternate vertical courses.
3. At sides of openings, balance head joints in each course on vertical center lines of openings.

4. Minimum Masonry Unit Length: 100 mm (4 inches).
 5. On interior partitions provide 6 mm (1/4 inch) open joint for caulking between existing construction, exterior walls, concrete work, and abutting masonry partitions.
 6. Use minimum 100 mm (4 inches) nominal thick masonry for free standing furring, unless indicated otherwise.
 7. Do not abut existing plastered surfaces except suspended ceilings with new masonry partitions.
- G. Use minimum 100 mm (4 inches) nominal thick masonry for fireproofing steel columns unless indicated otherwise.
- H. Before connecting new masonry with previously laid masonry, remove loosened masonry or mortar, and clean and wet work in place as specified under wetting.
- I. When new masonry partitions start on existing floors, machine cut existing floor finish material down to concrete surface.
- J. Wetting and Wetting Test:
1. Test and wet brick and clay tile according to BIA TN 11B.
 2. Do not wet concrete masonry units or glazed structural facing tile before laying.
- K. Temporary Formwork: Provide formwork and shores as required for temporary support of reinforced masonry elements.
- L. Construct formwork to conform to shape, line and dimensions indicated on drawings. Make sufficiently tight to prevent mortar, grout, or concrete leakage. Brace, tie and support formwork as required to maintain position and shape during construction and curing of reinforced masonry.
- M. Do not remove forms and shores until reinforced masonry members have hardened sufficiently to carry their own weight and other reasonable temporary construction loads.
- N. Minimum Curing Times Before Removing Shores and Forms:
1. Girders and Beams: 10 days.
 2. Slabs: 7 days.

3.2 INSTALLATION - ANCHORAGE

- A. Veneer to Framed Walls:
1. Install adjustable veneer anchors.

2. Fasten anchor to stud through sheathing with self-drilling and tapping screw, one at both ends of loop type anchor.
 3. Space anchors maximum 400 mm (16 inches) on center vertically at each stud.
- B. Masonry Facing to Backup and Cavity Wall Ties:
1. Use individual ties for new work.
 2. Stagger ties in alternate courses, and space at 400 mm (16 inches) maximum vertically, and 400 mm (16 inches) horizontally.
 3. At openings, provide additional ties spaced maximum 900 mm (36 inches) apart vertically around perimeter of opening, and within 300 mm (12 inches) from edge of opening.
 4. Anchor new masonry facing to existing masonry with adjustable cavity wall ties spaced at 400 mm (16 inch) maximum vertical intervals and at every second masonry unit horizontally. Fasten ties to masonry with masonry nails.
 5. Option: Install joint reinforcing for multiple wythes and cavity wall ties spaced maximum 400 mm (16 inches) vertically.
 6. Tie interior and exterior wythes of reinforced masonry walls together with individual ties. Provide ties at intervals maximum 400 mm (16 inches) on center horizontally, and 400 mm (16 inches) on center vertically. Lay ties in the same line vertically in order to facilitate vibrating of the grout pours.
- C. Anchorage of Abutting Masonry:
1. Anchor interior 100 mm (4 inch) thick masonry partitions to exterior masonry walls with wall ties. Space ties at 600 mm (24 inches) maximum vertical intervals. Extend ties 100 mm (4 inches) minimum into masonry.
 2. Anchor interior masonry bearing walls or interior masonry partitions over 100 mm (4 inches) thick to masonry walls with rigid wall anchors spaced at 400 mm (16 inch) maximum vertical intervals.
 3. Anchor abutting masonry walls and partitions to concrete with dovetail anchors. Install dovetail slots vertically in concrete at centerline of abutting wall or partition. Locate dovetail anchors at 400 mm (16 inch) maximum vertical intervals. Secure anchors to existing wall with two 9 mm (3/8 inch) by 75 mm (3 inch) expansion bolts or two power-driven fasteners.

4. Anchor abutting interior masonry partitions to existing concrete and existing masonry construction, with adjustable wall ties. Extend ties minimum 100 mm (4 inches) into joints of new masonry. Fasten ties to existing concrete and masonry construction, with powder actuated drive pins, nail or other means that provides rigid anchorage. Install anchors at 400 mm (16 inch) maximum vertical intervals.

3.3 INSTALLATION - REINFORCEMENT

A. Joint Reinforcement:

1. Install joint reinforcement in CMU wythe of combination brick and CMU, cavity walls, and single wythe concrete masonry unit walls or partitions.
2. Reinforcing is acceptable in lieu of individual ties for anchoring brick facing to CMU backup in exterior masonry walls.
3. Locate joint reinforcement in mortar joints at 400 mm (16 inch) maximum vertical intervals.
4. Additional joint reinforcement is required in mortar joints at both 200 mm (8 inches) and 400 (16 inches) above and below windows, doors, louvers and similar openings in masonry.

B. Steel Reinforcing Bars:

1. Install reinforcing bars in cells of hollow masonry units where required for vertical reinforcement and in bond beam units for horizontal reinforcement. Install in wall cavities of reinforced masonry walls where indicated on drawings.

3.4 INSTALLATION - BRICK EXPANSION AND CMU CONTROL JOINTS

- A. Provide brick expansion joint (EJ) and CMU control joints (CJ) where indicated on drawings.
- B. Keep joint free of mortar and other debris.
- C. Joints Occur In Masonry Walls:
 1. Install preformed compressible joint filler in brick wythe.
 2. Install cross shaped shear keys in concrete masonry unit wythe with preformed compressible joint filler on both sides of shear key.
- D. Use standard notched concrete masonry units (sash blocks) made in full and half-length units where shear keys are used to create a continuous

vertical joint. Alter Structural clay tile units to accommodate shear key flanges.

- E. Interrupt joint reinforcement at expansion and control joints.
- F. Fill opening in exposed face of expansion and control joints with sealant as specified in Section 07 92 00, JOINT SEALANTS.

3.5 INSTALLATION - BUILDING EXPANSION AND SEISMIC JOINTS

- A. Keep expansion and seismic joints open and free of mortar. Remove mortar and other debris.
- B. Install non-combustible, compressible type joint filler to fill space completely except where sealant is shown on joints in exposed finish work.
- C. Fill opening in exposed face of expansion and seismic joints with sealant as specified in Section 07 92 00, JOINT SEALANTS.

3.6 INSTALLATION - ISOLATION JOINT

- A. Where full height walls and partitions lie parallel or perpendicular to and under structural beams and shelf angles, provide minimum 9 mm (3/8 inch) separation between walls and partitions and bottom of beams and shelf angles.
- B. Insert continuous full width strip of non-combustible type compressible joint filler.
- C. Fill opening in exposed face of isolation joints with sealant as specified in Section 07 92 00, JOINT SEALANTS.

3.7 INSTALLATION - BRICKWORK

- A. Lay clay brick according to BIA TN 11B.
- B. Laying:
 - 1. Lay brick in one-half running bond with bonded corners, unless indicated otherwise. Match bond of existing building on alterations and additions.
 - 2. Maintain bond pattern throughout.
 - 3. Do not use brick smaller than half-brick at any angle, corner, break, and jamb.
 - 4. Where length of cut brick is greater than one half length, maintain vertical joint location.
 - 5. Lay exposed brickwork joints symmetrical about center lines of openings.

6. Before starting work, lay facing brick on foundation wall and adjust bond to openings, angles, and corners.
 7. Lay brick for sills with wash and drip.
 8. Build solid brickwork as required for anchorage of items.
- C. Joints:
1. Exterior And Interior Joint Widths: Lay for three equal joints in 200 mm (8 inches) vertically, unless shown otherwise.
 2. Rake joints for pointing with colored mortar when colored mortar is not full depth.
- D. Weep Holes:
1. Install weep holes at 600 mm (24 inches) on center in bottom of vertical joints of exterior masonry veneer or cavity wall facing over foundations, bond beams, and other water stops in wall.
 2. Form weep holes using wicks made of mineral fiber insulation strips turned up 200 mm (8 inches) in cavity. Anchor top of strip to backup to securely hold in place.
 3. Install sand or pea gravel in cavity approximately 75 mm (3 inches) high between weep holes.
 4. Coordinate with building insulation for thickness of insulation and allowance of air space behind exterior wythe.
- E. Cavity Walls:
1. Keep air space clean of mortar accumulations and debris.
 2. Lay the interior wythe of the masonry wall full height where dampproofing air barrier is required on cavity face. Coordinate to install air barrier before laying outer wythe.
 3. Insulated Cavity Type Exterior Walls:
 - a. Install insulation against cavity face of inner masonry wythe.
 - b. Place insulation between rows of ties or joint reinforcing. Adhere insulation to masonry surface with a bonding agent as recommended by insulation manufacturer.
 - c. Lay outer masonry wythe up with air space between insulation and masonry units.
 4. Veneer Framed Walls:
 - a. Build with 100 mm (4 inches) of face brick over sheathed stud wall with air space.
 - b. Keep air space clean of mortar accumulations and debris.

3.8 POINTING

- A. Fill joints with pointing mortar using rubber float trowel to apply mortar solidly into raked joints.
- B. Wipe off excess mortar from joints of glazed masonry units with dry cloth.
- C. Tool exposed joints to smooth concave joint.
- D. At joints with existing work, match existing joint.

3.9 GROUTING

- A. Preparation:
 1. Clean grout space of mortar droppings before placing grout.
 2. Close cleanouts.
 3. Install vertical solid masonry dams across grout space for full height of wall at intervals of maximum 9000 mm (30 feet). Do not bond dam units into wythes as masonry headers.
 4. Verify reinforcing bars are installed as indicated on drawings.
- B. Placing:
 1. Place grout in grout space in lifts as specified.
 2. Consolidate each grout lift after free water has disappeared but before plasticity is lost.
 3. Do not slush with mortar or use mortar with grout.
 4. Interruptions:
 - a. When grouting must be stopped for more than an hour, top off grout 40 mm (1-1/2 inches) below top of last masonry course.
 - b. Grout from dam to dam on high lift method.
 - c. Longitudinal run of masonry may be stopped off only by raking back one-half masonry unit length in each course and stopping grout 100 mm (4 inches) back of rake on low lift method.
- C. Puddling Method:
 1. Consolidate by puddling with grout stick during and immediately after placing.
 2. Grout cores of concrete masonry units containing reinforcing bars solid as masonry work progresses.
- D. Low Lift Method:
 1. Construct masonry to 1.5 m (5 feet) maximum height before grouting.

2. Grout in one continuous operation and consolidate grout by mechanical vibration and reconsolidate after initial water loss and settlement has occurred.

3.10 PLACING REINFORCEMENT

- A. General: Clean reinforcement of loose rust, mill scale, earth, ice or other materials which will reduce bond to mortar or grout. Do not use reinforcement bars with kinks or bends not shown on drawings or approved submittal drawings, or bars with reduced cross-section due to excessive rusting or other causes.
- B. Position reinforcement accurately at spacing indicated on drawings. Support and secure vertical bars against displacement. Install horizontal reinforcement as masonry work progresses. Where vertical bars are shown in close proximity, provide clear distance between bars of minimum one bar diameter or 25 mm (1 inch), whichever is greater.
- C. Splice reinforcement bars only where indicated on drawings, unless approved by Contracting Officer's Representative. Provide lapped splices. In splicing vertical bars or attaching to dowels, lap ends, place in contact and wire tie.
- D. Provide minimum lap as indicated on approved submittal drawings, or if not indicated, minimum 48 bar diameters.
- E. Weld splices where indicated on drawings according to AWS D1.4/D1.4M.
- F. Embed metal ties in mortar joints as work progresses, with minimum mortar cover of 15 mm (5/8 inch) on exterior face of walls and 13 mm (1/2 inch) at other locations.
- G. Embed prefabricated horizontal joint reinforcement as work progresses, with minimum cover of 15 mm (5/8 inch) on exterior face of walls and 13 mm (1/2 inch) at other locations. Lap joint reinforcement minimum 150 mm (6 inches) at ends. Use prefabricated "L" and "T" sections to provide continuity at corners and intersections. Cut and bend joint reinforcement for continuity at returns, offsets, column fireproofing, pipe enclosures and other special conditions.
- H. Anchoring: Anchor reinforced masonry work to supporting structure as indicated on drawings.
- I. Anchor reinforced masonry walls at intersections with non-reinforced masonry.

3.11 INSTALLATION OF REINFORCED BRICK MASONRY

A. Mortar Jointing and Bedding:

1. Pattern Bond: Lay exterior wythes in pattern bond shown, or if not shown, lay in 1/2 running bond with vertical joints in each course centered on units in courses above and below. Lay inner wythes (if any) with units in each wythe bonded by lapping minimum 50 mm (2 inches). Bond and interlock each course of each wythe at corners and intersections. Do not use units with less than 100 mm (4 inch) nominal horizontal face dimension at corners or jambs.
2. Lay exterior wythes with bed (horizontal) and head (vertical) joints between units completely filled with mortar. Top of bed joint mortar may be sloped toward center of walls. Butter ends of units with sufficient mortar to completely fill head joints and shove into place. Do not furrow bed joints or slush head joints. Remove any mortar fins which protrude into grout space.
3. Maintain joint widths shown for head and bed joints, except for minor variations required to maintain pattern bond. If not shown, lay with 9 mm (3/8 inch) head and bed joints.

3.12 CONSTRUCTION TOLERANCES

- A. Lay masonry units plumb, level and true to line within tolerances according to ACI 530.1/ASCE 6/TMS 602 and as follows:
- B. Maximum variation from plumb:
 1. In 3000 mm (10 feet) - 6 mm (1/4 inch).
 2. In 6000 mm (20 feet) - 9 mm (3/8 inch).
 3. In 12,000 mm (40 feet) or more - 13 mm (1/2 inch).
- C. Maximum variation from level:
 1. In any bay or up to 6000 mm (20 feet) - 6 mm (1/4 inch).
 2. In 12,000 mm (40 feet) or more - 13 mm (1/2 inch).
- D. Maximum variation from linear building lines:
 1. In any bay or up to 6000 mm (20 feet) - 13 mm (1/2 inch).
 2. In 12,000 mm (40 feet) or more - 19 mm (3/4 inch).
- E. Maximum variation in cross-sectional dimensions of columns and thickness of walls from dimensions shown:
 1. Minus 6 mm (1/4 inch).
 2. Plus 13 mm (1/2 inch).
- F. Maximum variation in prepared opening dimensions:

1. Accurate to minus 0 mm (0 inch).
2. Plus 6 mm (1/4 inch).

3.13 CLEANING AND REPAIR

A. General:

1. Clean exposed masonry surfaces on completion.
2. Protect adjoining construction materials and landscaping during cleaning operations.
3. Cut out defective exposed new joints to depth of approximately 19 mm (3/4 inch) and repoint.
4. Remove mortar droppings and other foreign substances from wall surfaces.

B. Brickwork:

1. First wet surfaces with clean water, then wash down with detergent solution. Do not use muriatic acid.
2. Brush with stiff fiber brushes while washing, and immediately wash with clean water.
3. Remove traces of detergent, foreign streaks, or stains of any nature.

C. Concrete Masonry Units:

1. Immediately following setting, brush exposed surfaces free of mortar or other foreign matter.
2. Allow mud to dry before brushing.

- - E N D - -

**SECTION 04 72 00
CAST STONE MASONRY**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies manufactured concrete units to simulate a natural stone.
- B. Installation of cast stone units.
- C. Water Repellant.

1.2 RELATED WORK

- A. Joint sealant and application: Section 07 92 00, JOINT SEALANTS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Samples:
 - 1. Cast stone, sample panel, size 100 by 300 by 300 mm (4 by 12 by 12 inches) each color and finish.
 - 2. Show finish on two 100 mm (4-inch) edges and 300 by 300 mm (12 by 12 inch) surface.
- C. Shop Drawings:
 - 1. Cast stone showing exposed faces, profiles, cross sections, anchorage, reinforcing, jointing and sizes.
 - 2. Setting drawings with setting mark.
- D. Certificates: Test results indicating that the cast stone meets specification requirements and proof of plant certification.
- E. Submit manufacturers test results of cast stone previously made by manufacturer.
- F. Laboratory Data: Description of testing laboratories facilities and qualifications of its principals and key personnel.
- G. List of jobs furnished by the manufacturer, which were similar in scope and at least three (3) years of age.

1.4 PRODUCT DELIVERY, STORAGE AND HANDLING

- A. Store cast stone under waterproof covers on planking clear of ground.
- B. Protect from handling, dirt, stain, and water damage.
- C. Mark production units with the identification marks as shown on the shop drawings.

- D. Package units and protect them from staining or damage during shipping and storage.
- E. Provide an itemized list of product to support the bill of lading.

1.5 WARRANTY

Warranty exterior masonry walls against moisture leaks, any defects and subject to terms of "Warranty of Construction", FAR clause 52.246-21, except that warranty period shall be two years.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by the basic designation only. Comply with applicable provisions and recommendations of the following, except as otherwise shown or specified.
- B. Cast Stone Institute Technical Manual and Cast Stone Institute standard specifications.
- C. American Society for Testing and Materials (ASTM):
 - A167-99(R2009)Stainless and Heat Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
 - A185-07Steel, Welded Wire Fabric, Plain for Concrete
 - A615/A615M-09Deformed and Plain Billet-Steel Bars for Concrete Reinforcement
 - C33-11Concrete Aggregates
 - C150-09Portland Cement
 - C979-10Pigments for Integrally Colored Concrete
 - C1194-03Compressive Strength of Architectural Cast Stone
 - C1195-03Absorption of Architectural Cast Stone
 - C1364-10Architectural Cast Stone.
 - D2244-09Calculation of Color Differences from Instrumentally Measured Color Coordinates.

1.7 QUALITY ASSURANCE

- A. The Manufacturer:
 - 1. Must have 5 years minimum continuous operating experience and have facilities for manufacturing cast stone as described herein. Manufacturer shall have sufficient plant facilities to produce the shapes, quantities and size of cast stone required in accordance with the project schedule.
 - 2. Must be a member of the Cast Stone Institute.

3. Must have a certified plant (certification by the Cast Stone Institute).
- B. Stone setter: Must have 5 years' experience setting cast or natural building stone.
- C. Testing: One (1) sample from production units may be selected at random from the field for each 500 cubic feet (14 m³) delivered to the job:
 1. Three (3) field cut cube specimens from each of these sample shall have an average minimum compressive strength of not less than 85% with no single specimen testing less than 75% of design strength as specified.
 2. Three (3) field cut cube specimens from each of these samples shall have an average maximum cold-water absorption of 6%.
 3. Field specimens shall be tested in accordance with ASTM C 1194 and C 1195.
 4. Manufacturer shall submit a written list of projects similar and at least three (3) years of age, along with owner, architect and contractor references.

1.8 MANUFACTURING TOLERANCES

- A. Cross section dimensions shall not deviate by more than + 1/8 in. (3 mm) from approved dimension.
- B. Length of units shall not deviate by more than length /360 or + 1/8 in. (3mm), whichever is greater, not to exceed + 1/4 in (6 mm). Maximum length of any unit shall not exceed 15 times the average thickness of such unit unless otherwise agreed by the manufacturer.
- C. Warp bow or twist of units shall not exceed length/360 or + 1/8 in. (3 mm), whichever is greater.
- D. Location of dowel holes, anchor slots, flashing grooves, false joints and similar features - On formed sides of unit, 1/8 in (3 mm), on unformed sides of unit, 3/8 in (9 mm) maximum deviation.

1.9 MOCK-UP

Provide full size unit(s) for use in construction of sample wall. The mock-up becomes the standard of workmanship for the project.

PART 2 - PRODUCTS

2.1 ARCHITECTURAL CAST STONE

- A. Comply with ASTM C 1364
- B. Physical properties: Provide the following:

1. Compressive Strength - ASTM C 1194: 6,500 psi (45 Mpa) minimum for products at 28 days.
 2. Absorption - ASTM C 1195: 6% maximum by the cold water method, or 10% maximum by the boiling method for products as 28 days.
 3. Air Content - ASTM C173 or C231, for wet cast product shall be 4-8% for units exposed to freeze-thaw environments. Air entrainment is not required for vibrant dry tamp (VDT) products.
 4. Freeze thaw - ASTM C 1364L The cumulative percent weight loss (CPWL) shall be less than 5% after 300 cycles of freezing and thawing.
 5. Linear Shrinkage - ASTM C 426L Shrinkage shall not exceed 0.065%.
- C. Job site testing - One (1) sample from production units may be selected at random from the field for each 500 cubic feet (14m³) delivered to the job site:
1. Three (3) field cut cube specimens from each of these samples shall have an average minimum compressive strength of not less than 85% with no single specimen testing less than 75% of design strength as allowed by ACI 318.
 2. Three (3) field cut cube specimens from each of these samples shall have an average maximum cold-water absorption of 6%.
 3. Field specimens shall be tested in accordance with ASTM C 1194 and C 1195.

2.2 RAW MATERIALS

- A. Portland cement - Type I or Type III, white and/or grey, ASTM C 150.
- B. Coarse aggregates - Granite, quartz or limestone, ASTM C 33, except for gradation, and are optional for the vibrant dry tamp (VDT) casting method.
- C. Fine aggregates - Manufactured or natural sands, ASTM C 33, except for gradation.
- D. Colors - Inorganic iron oxide pigments, ASTM C 979 except that carbon black pigments shall not be used.
- E. Admixtures- Comply with the following:
 1. ASTM C 260 for air-entraining admixtures.
 2. ASTM C 494/C 495 M Types A-G for water reducing, retarding, accelerating and high range admixtures.
 3. Other admixtures: integral water repellents and other chemicals, for which no ASTM Standard exists, shall be previously established as

suitable for use in concrete by proven field performance or through laboratory testing.

4. ASTM C 618 mineral admixtures of dark and variable colors shall not be used in surfaces intended to be exposed to view.
5. ASTM C 989 granulated blast furnace slag may be used to improve physical properties. Tests are required to verify these features.

F. Water - Potable

G. Reinforcing bars:

1. ASTM A 615/A 615M. Grade 40 or 60 steel galvanized or epoxy coated when cover is less than 1.5 in. (37 mm).
2. Welded Wire Fabric: ASTM A 185 where applicable for wet cast units.

H. All anchors, dowels and other anchoring devices and shims shall be standard building stone anchors commercially available in a non-corrosive material such as zinc plated, galvanized steel, brass, or stainless steel Type 302 or 304.

2.3 COLOR AND FINISH

- A. To be selected from manufacturers full range to match existing building.
- B. All surfaces intended to be exposed to view shall have a fine-grained texture similar to natural stone, with no air voids in excess of 1/32 in. (0.8 mm) and the density of such voids shall be less than 3 occurrences per any 1 in² (25mm²) and not obvious under direct daylight illumination at a 5 ft. (1.5m) distance.
- C. Units shall exhibit a texture approximately equal to the approved sample when viewed under direct daylight illumination at a 10 ft (3m) distance.
- D. ASTM D 2244 permissible variation in color between units of comparable age subjected to similar weathering exposure.
 1. Total color difference - not greater than 6 units.
 2. Total hue difference-not greater than 2 units.

2.4 REINFORCING

- A. Reinforce the units as required by the drawings and for safe handling and structural stress.
 1. Minimum reinforcing shall be 0.25 percent of the cross section area.
- B. Reinforcement shall be non-corrosive where faces exposed to weather are covered with less than 1.5in. (38 mm) of concrete material. All

reinforcement shall have minimum coverage of twice the diameter of the bars.

- C. Minor chipping resulting from shipment and delivery shall not be grounds for rejection. Minor chips shall not be obvious under direct daylight illumination from a 20-ft (6m) distance.
- D. The occurrence of crazing or efflorescence shall not constitute a cause for rejection.
- E. Remove cement film, if required, from exposed surface prior to packaging for shipment.

2.5 WATER REPELLANT

- A. Siloxane, Penetrating Water Repellent: Clear, containing 10 percent or more solids of oligomeric alkylalkoxysiloxanes; with alcohol, ethanol, mineral spirits, water, or other proprietary solvent carrier; and with 400 g/L or less of VOCs.

2.6 CURING

- A. Cure units in a warm curing chamber 100 F (37.8 C) at 95 percent relative humidity for approximately 12 hours, or cure in a 95 percent moist environment at a minimum 70F (21.1 C) for 16 hours after casting. Additional yard curing at 95 percent relative humidity shall be 350-degree-days (i.e. 7 days @ 50F (10.0 C) or 5 days @ 70F (21.0 C) prior to shipping. Form cured units shall be protected from moisture evaporation with curing blankets or curing compounds after casting.

PART 3 - EXECUTION

3.1 EXAMINATION

Installing contractor shall check cast stone materials for fit and finish prior to installation. Do not set unacceptable units.

3.2 SETTING TOLERANCES

- A. Comply with Cast Stone Institute SM Technical Manual.
- B. Set stones 1/8 in. (3 mm) or less, within the plane of adjacent units.
- C. Joints, plus - 1/6 in. (1.5 mm), minus - 1/8 in. (3 mm).

3.3 JOINTING

- A. Joint size:
 - 1. At stone/brick joints 3/8 in. (9.5 mm).
 - 2. At stone/stone joints in vertical position 1/4 in. (6 mm) (3/8 in. (9.5 mm) optional).
 - 3. Stone/stone joint exposed on top 3/8 in. (9.5 mm).

B. Joint Materials:

1. Mortar, Type N, ASTM C 270.
2. Use a full bed of mortar at all bed joints.
3. Flush vertical joints full with mortar.
4. Leave all joints with exposed tops or under relieving angles open for sealant.
5. Leave head joints in coping and projecting components open for sealant.

B. Location of joints:

1. As shown on shop drawings.
2. At control and expansion joints unless otherwise shown.

3.4 SETTING

- A. Drench units with clean water prior to setting.
- B. Fill dowel holes and anchor slots completely with mortar or non-shrink grout.
- C. Set units in full bed of mortar, unless otherwise detailed.
- D. Rake mortar joints 3/4 in. (18 mm) in. for pointing.
- E. Remove excess mortar from unit faces immediately after setting.
- F. Tuck point unit joints to a slight concave profile.

3.5 JOINT PROTECTION

- A. Comply with requirements of Section 07 92 00, JOINT SEALANTS.
- B. Prime ends of units, insert properly sized backing rod and install required sealant.

3.6 REPAIR AND CLEANING

- A. Repair chips with touchup materials furnished by manufacturer.
- B. Saturate units to be cleaned prior to applying an approved masonry cleaner.
- C. Consult with manufacturer for appropriate cleaners.

3.7 INSPECTION AND ACCEPTANCE

Inspect finished installation according to Bulletin #36 published by the Cast Stone Institute.

- - - E N D - - -

SECTION 05 31 00
STEEL DECKING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Single pan fluted metal roof deck as roof substrate.

1.2 RELATED WORK

- A. Section 01 81 13. SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Section 05 21 00, STRUCTURAL STEEL FRAMING: Structural Steel Shapes.
- C. Section 09 06 00, SCHEDULE FOR FINISHES: Color.
- D. Section 09 91 00, PAINTING: Finish Painting.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. AISI - American Iron and Steel Institute.
S100-16Specification for the Design of Cold-formed
Steel Structural Members.
- C. American Welding Society (AWS):
D1.1/D1.1M-20Structural Welding Code - Steel.
1.3/D1.3M-18Structural Welding Code - Sheet Steel.
- D. ASTM International (ASTM):
A36/A36M-19Standard Specification for Carbon Structural
Steel.
A653/A653M-20Standard Specification for Steel Sheet,
Zinc-Coated (Galvanized) or Zinc-Iron
Alloy-Coated (Galvannealed) by the Hot-Dip
Process.
A1008/A1008M-20Standard Specification for Steel, Sheet,
Cold-Rolled, Carbon, Structural, High-Strength
Low-Alloy, High-Strength Low-Alloy with
Improved Formability, Solution Hardened, and
Baked Hardenable.
C423-17Standard Test Method for Sound Absorption and
Sound Absorption Coefficients by the
Reverberation Room Method.
E119-20Standard Test Methods for Fire Tests of
Building Construction and Materials.
- E. FM Global (FM):

- 1-28-15Wind Design.
Factory Mutual Research Approval Guide.
- F. Master Painters Institute (MPI):
No. 18Primer, Zinc Rich, Organic.
- G. Military Specifications (Mil. Spec.):
MIL-P-21035B Paint, High Zinc Dust Content, Galvanizing
Repair.
- H. Steel Deck Institute (SDI):
No. 31-07Design Manual for Composite Deck, Form Decks,
and Roof Decks.
- I. UL LLC (UL):
Listed Online Certifications Directory.
580Tests for Uplift Resistance of Roof Assemblies.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. All items indicated below are required submittals requiring Contracting Officer's Representative (COR) review and approval.
- B. Submittal Drawings:
 - 1. Show layout, connections to supporting members, anchorage, sump pans, accessories, deck openings and reinforcements.
 - 2. Show similar information necessary for completing installation as shown and specified, including supplementary framing, ridge and valley plates, cant strips, cut openings, special jointing or other accessories.
 - 3. Show welding, side lap, closure, deck reinforcing and closure reinforcing details.
 - 4. Show openings required for work of other trades, including openings not shown on structural drawings. Indicate where temporary shoring is required to satisfy design criteria.
- C. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Show steel decking section properties and structural characteristics.
- D. Sustainable Construction Submittals:
 - 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.

- E. Certificates: Certify each product complies with specifications.
 - 1. Show steel decking is UL Listed for specified application.
- F. Qualifications: Substantiate qualifications comply with specifications.
 - 1. Welders and welding procedures.
- G. Insurance Certification: Assist the Government in preparation and submittal of roof installation acceptance certification as may be necessary in connection with fire and extended coverage insurance.

1.5 QUALITY ASSURANCE

- A. Welders and Welding Procedures Qualifications: AWS D1.3/D1.3M.

1.6 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

- A. Design steel decking and accessories according to AISI S100.
 - 1. Wind Uplift Resistance and Corner Conditions: UL 580, Class 60 or higher UL Class required by wind loading in the location of the project.
 - 2. Design side and end closures and attachment to supporting steel to safely support wet weight of concrete and construction loads.
 - 3. Cantilever Closure Deflection: 3 mm (1/8 inch), maximum.

2.2 MATERIALS

- A. Galvanized Steel Sheet: ASTM A653/A653M; G60 coating.
- B. Painted Steel Sheet: ASTM A1008/A1008M, Grade C or D, shop primed.
- C. Primer for Shop Painted Sheets: Manufacturer's standard primer (2 coats). When finish painting of steel decking is specified in Section 09 91 00, PAINTING primer coating shall be compatible with specified finish painting.
- D. Steel Shapes: ASTM A36/A36M.

2.3 PRODUCTS - GENERAL

- A. Basis of Design: Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Sustainable Construction Requirements:
 - 1. Steel Recycled Content: 30 percent total recycled content, minimum.

2.4 METAL ROOF DECK

- A. Metal Roof Deck: UL Listed as metal roof deck panels.
 - 1. Steel decking of the type, depth, thickness, and section properties as shown.

- B. Metal Roof Deck: Single pan fluted units with flat horizontal top surfaces as permanent support for superimposed loads.
 - 1. Deck Style:
 - a. Wide Rib (Type B) deck.
 - 2. Depth and Thickness: As indicated on drawings.
 - 3. Material: Galvanized sheet steel with underside shop primed.
- C. Do not use steel deck for hanging supports of building components including suspended ceilings, electrical light fixtures, plumbing, heating, or air conditioning pipes or ducts or electrical conduits.
- D. Include integral system for steel decking units used for interstitial levels.
 - 1. Provide system suitable for simple point of attachment for light duty hanger devices.
 - 2. Provide system suitable to allow for flexibility for attaching hangers for support of suspended ceilings, electrical, plumbing, heating, or air conditioning items, weight not to exceed 50 kg/m² (10 psf).
 - 3. Provide a minimum spacing pattern of 300 mm (12 inches) on centers longitudinally and 600 mm (24 inches) on centers transversely.
 - 4. Maximum allowable load suspended from any hanger: 23 kg (50 pounds).
 - 5. System consisting of fold-down type hanger tabs or lip hanger is acceptable.

2.5 FABRICATION

- A. Fabricate steel decking in sufficient lengths to extend over 3 or more supports, except for interstitial levels.
 - 1. Cut metal deck units to proper length in shop.
- B. Fabricate accessories required to complete installation of steel decking.
 - 1. Exposed to View: Fabricate from sheet steel matching metal decking.
 - 2. Concealed from View: Fabricate from galvanized sheet steel.
- C. Sheet Metal Accessories:
 - 1. Metal Cover Plates: For end-abutting decking, to close gaps at changes in deck direction, columns, walls and openings.
 - a. Sheet Steel: Minimum 1.0 mm (0.04 inch) thick.
 - 2. Continuous Sheet Metal Edging: At openings, concrete slab edges and roof deck edges.
 - a. Sheet Steel: Minimum 1.0 mm (0.04 inch) thick.

3. Metal Closure Strips: For openings between decking and other construction. Form to configurations required to provide tight-fitting closures at open ends of flutes and sides of decking.
 - a. Sheet Steel: Minimum 1.0 mm (0.04 inch) thick.
4. Ridge and Valley Plates: Minimum 100 mm (4 inch) wide ridge and valley plates where roof slope exceeds 1/24 (1/2 inch per foot).
 - a. Sheet Steel: Minimum 1.0 mm (0.04 inch) thick.
5. Cant Strips: Provide bent metal 45 degree leg cant strips where indicated on the drawings. Fabricate cant strips with minimum 125 mm (5 inch) face width.
 - a. Sheet Steel: Minimum 0.8 mm (0.03 inch) thick.
6. Seat Angles for Deck: Provide where beam does not frame into column.
7. Sump Pans for Roof Drains: Fabricated from single piece galvanized sheet steel with level bottoms and sloping sides to direct water flow to drain. Provide sump pans of adequate size to receive roof drains and with bearing flanges minimum 75 mm (3 inches) wide. Recess pans minimum 38 mm (1-1/2 inches) below roof deck surface, unless otherwise shown or required by deck configuration. Drain holes will be field cut.
 - a. Sheet Steel: Minimum 1.7 mm (0.06 inch) thick.

2.6 FINISHES

- A. Shop prime painted sheet steel with two coats of primer.

2.7 ACCESSORIES

- A. Primer: Manufacturer's standard primer compatible with finish painting specified in Section 09 91 00, PAINTING.
- B. Welding Materials: AWS D1.1, type to suit application.
- C. Galvanizing Repair Paint: MPI No. 18.
- D. Touch-Up Paint: Match shop finish.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove contaminates from structural steel surfaces where steel decking will be welded.
- D. Verify structural steel framing installation is completed, plumbed, and aligned with temporary bracing installed where required.

- E. Coordinate with structural steel erector to prevent overloading of structural members when placing steel decking for installation.

3.2 ERECTION

- A. Do not use floor deck units for storage or working platforms until permanently secured. Do not overload deck units once placed. Replace deck units that become damaged after erection and before casting concrete at no cost additional to the Government.
- B. Place steel decking at right angles to supporting members with ends located over supports.
- C. Lap end joints 50 mm (2 inches), minimum.
- D. Roof Deck Fastening:
 - 1. Fasten decking to steel supporting members by welding.
 - a. Welds: 16 mm (5/8 inch) diameter puddle welds or elongated welds of equal strength.
 - b. Weld Spacing: Maximum 300 mm (12 inches) on center at every support. Use closer spacing where required for lateral force resistance by diaphragm action.
 - 2. Fasten split or partial decking panels to structure in every valley.
 - 3. Fasten decking to each supporting member at ribs where side laps occur.
 - a. Power driven fasteners is acceptable in lieu of welding if strength equivalent to welding specified above is provided. Submit test data and design calculations verifying equivalent design strength.
 - 4. Mechanically fasten decking side laps with self-tapping No. 8 or larger machine screws.
 - a. Fastener Locations: Mid-span and maximum 900 mm (3 feet) on center.
 - 5. Provide additional fastening necessary to comply with UL Listing for specified performance.
- E. Cutting and Fitting:
 - 1. Field cut steel decking to accommodate columns and other penetrating items.
 - 2. Cut openings located and dimensioned on Structural Drawings.
 - 3. Coordinate openings for other penetrations shown on approved submittal drawings but not shown on Structural Drawings.
 - a. Cut and reinforce required opening.

4. Make cuts neat and trim using metal saw, drill or punch-out device. Cutting with torches is prohibited.
 5. Do not make cuts in the metal deck that are not shown on the approved metal decking submittal drawings.
 - a. When additional openings are required, submit scaled drawing, locating required opening and other openings and supports in immediate area.
 - b. Do not cut the opening until drawing is approved by Contracting Officer's Representative.
 - c. Provide additional reinforcing and framing required for opening.
 - d. Failure to comply with these requirements is cause for rejection of the work and removal and replacement of the affected steel decking.
 6. Opening Reinforcement: Provide additional metal reinforcement and closure pieces as required for strength, continuity of decking, and support of other work.
- F. Touch up damaged factory finishes.
1. Apply galvanizing repair paint to damaged galvanized surfaces.
 2. Apply touch up paint to damaged shop painted surfaces.

- - E N D - -

**SECTION 05 50 00
METAL FABRICATIONS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies items and assemblies fabricated from structural steel shapes and other materials as shown and specified.
- B. Items specified.
 - 1. Frames:
 - 2. Guards
 - 3. Covers and Frames for Pits and Trenches.
 - 4. Gratings for elevator pit
 - 5. Loose Lintels
 - 6. Shelf Angles
 - 7. Ladders
 - 8. Stainless Steel Railings:
 - 9. Concealed Countertop Brackets

1.2 RELATED WORK

- A. Railings attached to steel stairs: Section 05 51 00, METAL STAIRS.
- B. Colors, finishes, and textures: Section 09 06 00, SCHEDULE FOR FINISHES.
- C. Prime and finish painting: Section 09 91 00, PAINTING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:

Grating, each type	Floor plate

- C. Shop Drawings:
 - 1. Each item specified, showing complete detail, location in the project, material and size of components, method of joining various

components and assemblies, finish, and location, size and type of anchors.

2. Mark items requiring field assembly for erection identification and furnish erection drawings and instructions.
 3. Provide templates and rough-in measurements as required.
- D. Manufacturer's Certificates:
1. Anodized finish as specified.
 2. Live load designs as specified.
- E. Design Calculations for specified live loads including dead loads.
- F. Furnish setting drawings and instructions for installation of anchors to be preset into concrete and masonry work, and for the positioning of items having anchors to be built into concrete or masonry construction.

1.4 QUALITY ASSURANCE

- A. Each manufactured product shall meet, as a minimum, the requirements specified, and shall be a standard commercial product of a manufacturer regularly presently manufacturing items of type specified.
- B. Each product type shall be the same and be made by the same manufacturer.
- C. Assembled product to the greatest extent possible before delivery to the site.
- D. Include additional features, which are not specifically prohibited by this specification, but which are a part of the manufacturer's standard commercial product.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
B18.6.1-97Wood Screws
B18.2.2-87 (R2010)Square and Hex Nuts
- C. American Society for Testing and Materials (ASTM):
A36/A36M-14Structural Steel
A47-99 (R2014)Malleable Iron Castings
A48-03 (R2012)Gray Iron Castings
A53-12Pipe, Steel, Black and Hot-Dipped, Zinc-Coated
Welded and Seamless

- A123-15Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
- A240/A240M-15Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet and Strip for Pressure Vessels and for General Applications.
- A269-15Seamless and Welded Austenitic Stainless Steel Tubing for General Service
- A307-14Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
- A391/A391M-07 (R2015) ...Grade 80 Alloy Steel Chain
- A786/A786M-15Rolled Steel Floor Plate
- B221-14Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
- B456-11Electrodeposited Coatings of Copper Plus Nickel Plus Chromium and Nickel Plus Chromium
- B632-08Aluminum-Alloy Rolled Tread Plate
- C1107-13Packaged Dry, Hydraulic-Cement Grout (Nonshrink)
- D3656-13Insect Screening and Louver Cloth Woven from Vinyl-Coated Glass Yarns
- F436-16Hardened Steel Washers
- F468-06 (R2015)Nonferrous Bolts, Hex Cap Screws, Socket Head Cap Screws and Studs for General Use
- F593-13Stainless Steel Bolts, Hex Cap Screws, and Studs
- F1667-15Driven Fasteners: Nails, Spikes and Staples
- D. American Welding Society (AWS):
 - D1.1-15Structural Welding Code Steel
 - D1.2-14Structural Welding Code Aluminum
 - D1.3-18Structural Welding Code Sheet Steel
- E. National Association of Architectural Metal Manufacturers (NAAMM)
 - AMP 521-01 (R2012)Pipe Railing Manual
 - AMP 500-06Metal Finishes Manual
 - MBG 531-09 (R2017)Metal Bar Grating Manual
 - MBG 532-09Heavy Duty Metal Bar Grating Manual

F. Structural Steel Painting Council (SSPC)/Society of Protective Coatings:

- SP 1-15No. 1, Solvent Cleaning
- SP 2-04No. 2, Hand Tool Cleaning
- SP 3-04No. 3, Power Tool Cleaning

G. Federal Specifications (Fed. Spec):

- RR-T-650ETreads, Metallic and Nonmetallic, Nonskid

PART 2 - PRODUCTS

2.1 DESIGN CRITERIA

- A. In addition to the dead loads, design fabrications to support the following live loads unless otherwise specified.
- B. Ladders and Rungs: 120 kg (250 pounds) at any point.

2.2 MATERIALS

- A. Structural Steel: ASTM A36.
- B. Stainless Steel: ASTM A240, Type 302 or 304.
- C. Aluminum, Extruded: ASTM B221, Alloy 6063-T5 unless otherwise specified. For structural shapes use alloy 6061-T6 and alloy 6061-T4511.
- D. Floor Plate:
 - 1. Steel ASTM A786.
 - 2. Aluminum: ASTM B632.
- E. Steel Pipe (Bollard): ASTM A53.
 - 1. Galvanized for exterior locations.
 - 2. Type S, Grade A unless specified otherwise.
 - 3. NPS (inside diameter) as shown.
- F. Cast-Iron: ASTM A48, Class 30, commercial pattern.
- G. Malleable Iron Castings: A47.
- H. Primer Paint: As specified in Section 09 91 00, PAINTING.
- I. Stainless Steel Tubing: ASTM A269, type 302 or 304.
- J. Modular Channel Units:
 - 1. Factory fabricated, channel shaped, cold formed sheet steel shapes, complete with fittings bolts and nuts required for assembly.
 - 2. Form channel within turned pyramid shaped clamping ridges on each side.
 - 3. Provide case hardened steel nuts with serrated grooves in the top edges designed to be inserted in the channel at any point and be

- given a quarter turn so as to engage the channel clamping ridges.
Provide each nut with a spring designed to hold the nut in place.
4. Factory finish channels and parts with oven baked primer when exposed to view. Channels fabricated of ASTM A525, G90 galvanized steel may have primer omitted in concealed locations. Finish screws and nuts with zinc coating.
 5. Fabricate snap-in closure plates to fit and close exposed channel openings of not more than 0.3 mm (0.0125 inch) thick stainless steel.

K. Grout: ASTM C1107, pourable type.

2.3 HARDWARE

A. Rough Hardware:

1. Furnish rough hardware with a standard plating, applied after punching, forming and assembly of parts; galvanized, cadmium plated, or zinc-coated by electro-galvanizing process. Galvanized G-90 where specified.
2. Use G90 galvanized coating on ferrous metal for exterior work unless non-ferrous metal or stainless is used.

B. Fasteners:

1. Bolts with Nuts:
 - a. ASME B18.2.2.
 - b. ASTM A307 for 415 MPa (60,000 psi) tensile strength bolts.
 - c. ASTM F468 for nonferrous bolts.
 - d. ASTM F593 for stainless steel.
2. Screws: ASME B18.6.1.
3. Washers: ASTM F436, type to suit material and anchorage.
4. Nails: ASTM F1667, Type I, style 6 or 14 for finish work.

2.4 FABRICATION GENERAL

A. Material

1. Use material as specified. Use material of commercial quality and suitable for intended purpose for material that is not named or its standard of quality not specified.
2. Use material free of defects which could affect the appearance or service ability of the finished product.

B. Size:

1. Size and thickness of members as shown.

2. When size and thickness is not specified or shown for an individual part, use size and thickness not less than that used for the same component on similar standard commercial items or in accordance with established shop methods.

C. Connections

1. Except as otherwise specified, connections may be made by welding, riveting or bolting.
2. Field riveting will not be approved.
3. Design size, number and placement of fasteners, to develop a joint strength of not less than the design value.
4. Holes, for rivets and bolts: Accurately punched or drilled and burrs removed.
5. Size and shape welds to develop the full design strength of the parts connected by welds and to transmit imposed stresses without permanent deformation or failure when subject to service loadings.
6. Use Rivets and bolts of material selected to prevent corrosion (electrolysis) at bimetallic contacts. Plated or coated material will not be approved.
7. Use stainless steel connectors for removable members machine screws or bolts.

D. Fasteners and Anchors

1. Use methods for fastening or anchoring metal fabrications to building construction as shown or specified.
2. Where fasteners and anchors are not shown, design the type, size, location and spacing to resist the loads imposed without deformation of the members or causing failure of the anchor or fastener, and suit the sequence of installation.
3. Use material and finish of the fasteners compatible with the kinds of materials which are fastened together and their location in the finished work.
4. Fasteners for securing metal fabrications to new construction only, may be by use of threaded or wedge type inserts or by anchors for welding to the metal fabrication for installation before the concrete is placed or as masonry is laid.
5. Fasteners for securing metal fabrication to existing construction or new construction may be expansion bolts, toggle bolts, power

actuated drive pins, welding, self drilling and tapping screws or bolts.

E. Workmanship

1. General:

- a. Fabricate items to design shown.
- b. Furnish members in longest lengths commercially available within the limits shown and specified.
- c. Fabricate straight, true, free from warp and twist, and where applicable square and in same plane.
- d. Provide holes, sinkages and reinforcement shown and required for fasteners and anchorage items.
- e. Provide openings, cut-outs, and tapped holes for attachment and clearances required for work of other trades.
- f. Prepare members for the installation and fitting of hardware.
- g. Cut openings in gratings and floor plates for the passage of ducts, sumps, pipes, conduits and similar items. Provide reinforcement to support cut edges.
- h. Fabricate surfaces and edges free from sharp edges, burrs and projections which may cause injury.

2. Welding:

- a. Weld in accordance with AWS.
- b. Welds shall show good fusion, be free from cracks and porosity and accomplish secure and rigid joints in proper alignment.
- c. Where exposed in the finished work, continuous weld for the full length of the members joined and have depressed areas filled and protruding welds finished smooth and flush with adjacent surfaces.
- d. Finish welded joints to match finish of adjacent surface.

3. Joining:

- a. Miter or butt members at corners.
- b. Where frames members are butted at corners, cut leg of frame member perpendicular to surface, as required for clearance.

4. Anchors:

- a. Where metal fabrications are shown to be preset in concrete, weld 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 150 mm (6 inches) long with 25 mm (one inch) hooked end, to back of member at 600 mm (2 feet) on center, unless otherwise shown.

- b. Where metal fabrications are shown to be built into masonry use 32 x 3 mm (1-1/4 by 1/8 inch) steel strap anchors, 250 mm (10 inches) long with 50 mm (2 inch) hooked end, welded to back of member at 600 mm (2 feet) on center, unless otherwise shown.
5. Cutting and Fitting:
- a. Accurately cut, machine and fit joints, corners, copes, and miters.
 - b. Fit removable members to be easily removed.
 - c. Design and construct field connections in the most practical place for appearance and ease of installation.
 - d. Fit pieces together as required.
 - e. Fabricate connections for ease of assembly and disassembly without use of special tools.
 - f. Joints firm when assembled.
 - g. Conceal joining, fitting and welding on exposed work as far as practical.
 - h. Do not show rivets and screws prominently on the exposed face.
 - i. The fit of components and the alignment of holes shall eliminate the need to modify component or to use exceptional force in the assembly of item and eliminate the need to use other than common tools.

F. Finish:

- 1. Finish exposed surfaces in accordance with NAAMM AMP 500 Metal Finishes Manual.
- 2. Aluminum: NAAMM AMP 501.
 - a. Mill finish, AA-M10, as fabricated, use unless specified otherwise.
 - b. Clear anodic coating, AA-C22A41, chemically etched medium matte, with Architectural Class 1, 0.7 mils or thicker.
 - c. Painted: AA-C22R10.
- 3. Steel and Iron: NAAMM AMP 504.
 - a. Zinc coated (Galvanized): ASTM A123, G90 unless noted otherwise.
 - b. Surfaces exposed in the finished work:
 - 1) Finish smooth rough surfaces and remove projections.
 - 2) Fill holes, dents and similar voids and depressions with epoxy type patching compound.

c. Shop Prime Painting:

1) Surfaces of Ferrous metal:

- a) Items not specified to have other coatings.
- b) Galvanized surfaces specified to have prime paint.
- c) Remove all loose mill scale, rust, and paint, by hand or power tool cleaning as defined in SSPC-SP2 and SP3.
- d) Clean of oil, grease, soil and other detrimental matter by use of solvents or cleaning compounds as defined in SSPC-SP1.
- e) After cleaning and finishing apply one coat of primer as specified in Section 09 91 00, PAINTING.

2) Non ferrous metals: Comply with MAAMM-500 series.

G. Protection:

1. Insulate aluminum surfaces that will come in contact with concrete, masonry, plaster, or metals other than stainless steel, zinc or white bronze by giving a coat of heavy-bodied alkali resisting bituminous paint or other approved paint in shop.
2. Spot prime all abraded and damaged areas of zinc coating which expose the bare metal, using zinc rich paint on hot-dip zinc coat items and zinc dust primer on all other zinc coated items.

2.5 SUPPORTS

A. General:

1. Fabricate ASTM A36 structural steel shapes as shown.
2. Use clip angles or make provisions for welding hangers and braces to overhead construction.
3. Field connections may be welded or bolted.

B. For Ceiling Hung Toilet Stall:

1. Use a continuous steel channel above pilasters with hangers centered over pilasters.
2. Make provision for installation of stud bolts in lower flange of channel.
3. Provide a continuous steel angle at wall and channel braces spaced as shown.
4. Use threaded rod hangers.

C. For Wall Mounted Items:

1. For items supported by metal stud partitions.
2. Steel strip or hat channel minimum of 1.5 mm (0.0598 inch) thick.

3. Steel strip minimum of 150 mm (6 inches) wide, length extending one stud space beyond end of item supported.
4. Steel hat channels where shown. Flange cut and flatted for anchorage to stud.
5. Structural steel tube or channel for grab bar at water closets floor to structure above with clip angles or end plates formed for anchors.
6. Use steel angles for thru wall counters. Drill angle for fasteners at ends and not over 100 mm (4 inches) on center between ends.
6. Use modular channel where shown with manufacturers bolts and fittings.
 - a. Weld ends of steel angle braces to steel plates and secure to modular channel units as shown. Drill plates for anchor bolts.
 - b. Fabricate eye bolt, special clamp bolt, and plate closure full length of modular channel at ceiling line and secure to modular channel unit with manufacturers standard fittings.
- E. Supports for Accordion Partition Tracks, Exercise Equipment, and Items at Various Conditions at Suspended Ceilings:
 1. Fabricate of structural steel shapes as shown.
 2. Drill for anchor bolts of suspended item.

2.6 FRAMES

- A. Channel Door Frames:
 1. Fabricate of structural steel channels of size shown.
 2. Miter and weld frames at corners.
 3. Where anchored to masonry or embedded in concrete, weld to back of frame at each jamb, 5 mm (3/16 inch) thick by 44 mm (1-3/4 inch) wide steel strap anchors with ends turned 50 mm (2 inches), and of sufficient length to extend at least 300 mm (12 inches) into wall. Space anchors 600 mm (24 inches) above bottom of frame and 600 mm (24 inches) o.c. to top of jamb. Weld clip angles to bottom of jambs and provide holes for expansion bolts.
 4. Where anchored to concrete or masonry in prepared openings, drill holes at jambs for anchoring with expansion bolts. Weld clip angles to bottom of frame and provide holes for expansion bolt anchors as shown. Drill holes starting 600 mm (24 inches) above bottom of frame and 600 mm (24 inches) o.c. to top of jamb and at top of jamb. Provide pipe spacers at holes welded to channel.

5. Where closure plates are shown, continuously weld them to the channel flanges.
 6. Weld continuous 19 x 19 x 3 mm (3/4 x 3/4 x 1/8 inch) thick steel angles to the interior side of each channel leg at the head and jambs to form a caulking groove.
 7. Prepare frame for installation of hardware specified in Section 08 71 00, DOOR HARDWARE.
 - a. Cut a slot in the lock jamb to receive the lock bolt.
 - b. Where shown use continuous solid steel bar stops at perimeter of frame, weld or secure with countersunk machine screws at not more than 450 mm (18 inches) on center.
- C. Frames for Breech Opening:
1. Fabricate from steel channels, or combination of steel plates and angles to size and contour shown.
 2. Weld strap anchors on back of frame at not over 600 mm (2 feet) on centers for concrete or masonry openings.

2.7 GRATINGS FOR ELEVATOR PIT

- A. Fabricate gratings to support live loads specified and a concentrated load as specified.
- B. Provide clearance at all sides to permit easy removal of grating.
- C. Make cutouts in gratings with 6 mm (1/4 inch) minimum to 25 mm (one inch) maximum clearance for penetrations or passage of pipes and ducts. Edge band cutouts.
- D. Fabricate in sections not to exceed 2.3 m² (25 square feet) in area and 90 kg (200 pounds) in weight.
- E. Fabricate sections of grating with end-banding bars.
- F. Fabricate angle frames and supports, including anchorage as shown.
 1. Fabricate intermediate supporting members from "T's" or angles.
 2. Locate intermediate supports to support grating section edges.
 3. Fabricate frame to finish flush with top of grating.
 4. Locate anchors at ends and not over 600 mm (24 inches) o.c.
 5. Butt or miter, and weld angle frame at corners.
- G. Steel Bar Gratings:
 1. Fabricate grating using steel bars, frames, supports and other members shown in accordance with Metal Bar Grating Manual.

2. Galvanize steel members after fabrication in accordance with ASTM A123, G-90 for exterior gratings, gratings in concrete floors, and interior grating where specified.

2.8 LOOSE LINTELS

- A. Furnish lintels of sizes shown. Where size of lintels is not shown, provide the sizes specified.
- B. Fabricate lintels with not less than 150 mm (6 inch) bearing at each end for nonbearing masonry walls, and 200 mm (8 inch) bearing at each end for bearing walls.
- C. Provide one angle lintel for each 100 mm (4 inches) of masonry thickness as follows except as otherwise specified or shown.
 1. Openings 750 mm to 1800 mm (2-1/2 feet to 6 feet) - 100 x 90 x 8 mm (4 x 3-1/2 x 5/16 inch).
 2. Openings 1800 mm to 3000 mm (6 feet to 10 feet) - 150 x 90 x 9 mm (6 x 3-1/2 x 3/8 inch).
- D. For 150 mm (6 inch) thick masonry openings 750 mm to 3000 mm (2-1/2 feet to 10 feet) use one angle 150 x 90 x 9 mm (6 x 3-1/2 x 3/8 inch).
- E. Provide bearing plates for lintels where shown.
- F. Weld or bolt upstanding legs of double angle lintels together with 19 mm (3/4 inch bolts) spaced at 300 mm (12 inches) on centers.
- G. Insert spreaders at bolt points to separate the angles for insertion of metal windows, louver, and other anchorage.
- H. Where shown or specified, punch upstanding legs of single lintels to suit size and spacing of anchor bolts.

2.9 SHELF ANGLES

- A. Fabricate from steel angles of size shown.
- B. Fabricate angles with horizontal slotted holes for 19 mm (3/4 inch) bolts spaced at not over 900 mm (3 feet) on centers and within 300 mm (12 inches) of ends.
- C. Provide adjustable malleable iron inserts for embedded in concrete framing.

2.10 PLATE DOOR SILL

- A. Fabricate of checkered plate as detailed.
 1. Aluminum Plate: ASTM B632, 3 mm (0.125 inch) thick.
 2. Steel Plate: ASTM A786, 3 mm (0.125 inch thick), galvanized G90.

- B. Fabricate for anchorage with flat head countersunk bolts at each end and not over 300 mm (12 inches), o.c.

2.11 SAFETY NOSINGS

- A. Fed. Spec. RR-T-650, Type C.
 - 1. Aluminum: Class 2, Style 2.
 - 2. Cast iron: Class 4.
- B. Fabricate nosings for exterior use from cast aluminum, and nosings for interior use from either cast aluminum or cast iron. Use one Class throughout.
- C. Fabricate nosings approximately 100 mm (4 inches) wide with not more than 9 mm (3/8 inch) nose.
- D. Provide nosings with integral type anchors spaced not more than 100 mm (4 inches) from each end and intermediate anchors spaced approximately 375 mm (15 inches) on center.
- E. Fabricate nosings to extend within 100 mm (4 inches) of ends of concrete stair treads except where shown to extend full width.
- F. Fabricate nosings to extend full width between stringers of metal stairs and full width of door openings.
- G. On curved steps fabricate to terminate at point of curvature of steps having short radius curved ends.

2.12 LADDER AT ELEVATOR PIT

- A. Aluminum Ladders:
 - 1. Fixed-rail type, constructed of structural aluminum, with mill finish.
 - 2. Fabricate side rails and rungs of size and design shown, with the rungs shouldered and headed into and welded to the rails.
 - 3. Where shown fabrication side rails curved, twisted and formed into gooseneck.
 - 4. Fabricate angle brackets at top and bottom and intermediate brackets where shown. Drill for bolting.
- B. Ladder Rungs:
 - 1. Fabricate from 25 mm (one inch) diameter steel bars.
 - 2. Fabricate so that rungs will extend at least 100 mm (4 inches) into wall with ends turned 50 mm (2 inches), project out from wall 175 mm (7 inches), be 400 mm (16 inches) wide and be designed so that foot cannot slide off end.

2.13 HANDRAILS

A. Stainless Steel Railings:

1. Fabricate from 38 mm (1-1/2 inches) outside diameter stainless steel tubing, ASTM A269, having a wall thickness of 1.6 mm (0.065 inch).
2. Join sections by an internal connector to form hairline joints where field assembled.
3. Fabricate with continuous welded connections.
4. Fabricate brackets of stainless steel to design shown.
5. Fabricate stainless steel sleeves at least 150 mm (6 inches) deep having internal dimensions at least 13 mm (1/2 inch) greater than external dimensions of post.

2.13 CONCEALED COUNTERTOP BRACKETS

- ### A. Heavy-Duty concealed countertop brackets. 1/8-inch thick, galvanized steel with horizontal and vertical leg. Acceptable product: Richelieu or approved equal.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- #### A. Set work accurately, in alignment and where shown, plumb, level, free of rack and twist, and set parallel or perpendicular as required to line and plane of surface.
- #### B. Items set into concrete or masonry.
1. Provide temporary bracing for such items until concrete or masonry is set.
 2. Place in accordance with setting drawings and instructions.
 3. Build strap anchors, into masonry as work progresses.
- #### C. Set frames of gratings, covers, corner guards, trap doors and similar items flush with finish floor or wall surface and, where applicable, flush with side of opening.
- #### D. Field weld in accordance with AWS.
1. Design and finish as specified for shop welding.
 2. Use continuous weld unless specified otherwise.
- #### E. Install anchoring devices and fasteners as shown and as necessary for securing metal fabrications to building construction as specified.

Power actuated drive pins may be used except for removable items and where members would be deformed or substrate damaged by their use.

- F. Spot prime all abraded and damaged areas of zinc coating as specified and all abraded and damaged areas of shop prime coat with same kind of paint used for shop priming.
- G. Isolate aluminum from dissimilar metals and from contact with concrete and masonry materials as required to prevent electrolysis and corrosion.
- H. Secure escutcheon plate with set screw.

3.2 INSTALLATION OF SUPPORTS

- A. Anchorage to structure.
 - 1. Secure angles or channels and clips to overhead structural steel by continuous welding unless bolting is shown.
 - 2. Secure supports to concrete inserts by bolting or continuous welding as shown.
 - 3. Secure supports to mid height of concrete beams when inserts do not exist with expansion bolts and to slabs, with expansion bolts. unless shown otherwise.
 - 4. Secure steel plate or hat channels to studs as detailed.
- B. Supports for Wall Mounted items:
 - 1. Locate center of support at anchorage point of supported item.
 - 2. Locate support at top and bottom of wall hung cabinets.
 - 3. Locate support at top of floor cabinets and shelving installed against walls.
 - 4. Locate supports where required for items shown.

3.3 DOOR FRAMES

- A. Secure clip angles at bottom of frames to concrete slab with expansion bolts as shown.
- B. Level and plumb frame; brace in position required.
- C. At masonry, set frames in walls so anchors are built-in as the work progresses unless shown otherwise.
- D. Set frames in formwork for frames cast into concrete.
- E. Where frames are set in prepared openings, bolt to wall with spacers and expansion bolts.

3.4 OTHER FRAMES

- A. Set frame flush with surface unless shown otherwise.

- B. Anchor frames at ends and not over 450 mm (18 inches) on centers unless shown otherwise.
- C. Set in formwork before concrete is placed.

3.5 STEEL LINTELS

- A. Use lintel sizes and combinations shown or specified.
- B. Install lintels with longest leg upstanding, except for openings in 150 mm (6 inch) masonry walls install lintels with longest leg horizontal.
- C. Install lintels to have not less than 150 mm (6 inch) bearing at each end for nonbearing walls, and 200 mm (8 inch) bearing at each end for bearing walls.

3.6 SHELF ANGLES

- A. Anchor shelf angles with 19 mm (3/4 inch) bolts unless shown otherwise in adjustable malleable iron inserts, set level at elevation shown.
- B. Provide expansion space at end of members.

3.7 LADDERS

- A. Anchor ladders to walls and floors with expansion bolts through turned lugs or angle clips or brackets.
- B. In elevator pits, set ladders to clear all elevator equipment where shown on the drawings.
 - 1. Where ladders are interrupted by division beams, anchor ladders to beams by welding, and to floors with expansion bolts.
 - 2. Where ladders are adjacent to division beams, anchor ladders to beams with bent steel plates, and to floor with expansion bolts.
- C. Ladder Rungs:
 - 1. Set ladder rungs into formwork before concrete is placed. Build ladder rungs into masonry as the work progresses.
 - 2. Set step portion of rung 150 mm (6 inches) from wall.
 - 3. Space rungs approximately 300 mm (12 inches) on centers.
 - 4. Where only one rung is required, locate it 400 mm (16 inches) above the floor.

3.8 STEEL COMPONENTS FOR MILLWORK ITEMS

Coordinate and deliver to Millwork fabricator for assembly where millwork items are secured to metal fabrications.

3.9 INSTALLATION OF STEEL PIPE BOLLARD

Set bollards vertically in concrete piers. Compressive strength of concrete piers shall be 21MPa 3000psi. For dimensions of concrete piers See standard detail SD320523-04.

3.10 CLEAN AND ADJUSTING

- A. Adjust movable parts including hardware to operate as designed without binding or deformation of the members centered in the opening or frame and, where applicable, contact surfaces fit tight and even without forcing or warping the components.
- B. Clean after installation exposed prefinished and plated items and items fabricated from stainless steel, aluminum and copper alloys, as recommended by the metal manufacture and protected from damage until completion of the project.

- - - E N D - - -

**TRANSLUCENT RESIN PANEL
SECTION 060660**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the Plastic Fabrication as shown and specified in the described system(s):

- 1. Wall Cladding

1.3 SUBMITTALS

- A. General: Submit the following in accordance with conditions of contract and Division 1 specification section 01 33 00 "Submittal Procedures".

- B. Product Data: Submit manufacturer's product data; include product description, fabrication information, and compliance with specified performance requirements.

- C. Submit product test reports from a qualified independent 3rd party testing agency indicating each type and class of panel system complies with the project performance requirements, based on comprehensive testing of current products. Previously completed test reports will be acceptable if for current manufacturer and indicative of products used on this project.

- 1. Test reports required are:

- a. Rate of Burning (ASTM D 635)
 - b. Self-Ignition Temperature (ASTM D 1929)
 - c. Density of Smoke (ASTM D 2843)
 - d. Flame spread and Smoke developed testing (ASTM E 84)

- e. Room Corner Burn Test (NFPA 286)
 - f. Extent of Burning (UL 94)
 - g. Impact strength (ASTM D 3763)
 - h. Safety glazing impact resistance (ANSI Z97.1-2004)
 - i. UPITT Test for Combustion Product Toxicity
 - j. Dynamic environmental testing (ASTM standards D 5116 and D 6670)
- D. Shop Drawings: Include plans, elevations, sections, panel dimensions, details, and attachments to other work.
- E. Samples for Initial Selection:
- 1. Submit minimum 2-inch by 2-inch samples. Indicate full color, texture and pattern variation.
- F. Samples for Verification:
- 1. Submit minimum 4-inch by 4-inch sample for each type, texture, pattern and color of solid plastic fabrication.
- G. Maintenance Data: Submit manufacturer's care and maintenance data, including care, repair and cleaning instructions. Include in Project closeout documents.

1.4 QUALITY ASSURANCE

- A. Manufacturers Qualifications
- 1. Materials and systems shall be manufactured by a company continuously and regularly employed in the manufacture of specified materials for a period of at least five (5) consecutive years and which can show evidence of those materials being satisfactorily used on at least six (6) projects of similar size, scope and location. At least three (3) of the projects shall have been successful for use five (5) years or longer.
 - 2. Manufactured panels must be produced from a minimum of 40% post-industrial recycle content. This recycle content

must be certified by a recognized 3rd party certification group, such as Scientific Certification Systems (SCS).

3. Manufacturer must offer a documented reclaim process that will take back, at the manufacturers cost, panels that are at their end-of life cycle.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver Plastic Fabrications, systems and specified items in manufacturer's standard protective packaging.
- B. Do not deliver Plastic Fabrications, system, components and accessories to Project site until areas are ready for installation.
- C. Store materials in a flat orientation in a dry place that is not exposed to exterior elements.
- D. Handle materials to prevent damage to finished surfaces. Provide protective coverings to prevent damage or staining following installation for duration of project.
- E. Before installing Plastic Fabrications, permit them to reach room temperature.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Do not install Solid Polymer Fabrications until spaces are enclosed and weatherproof, and ambient temperatures and humidity conditions are maintained at the levels indicated for Project when occupied for its intended use.

1.7 WARRANTY

- A. Manufacturer's Special Warranty on Plastic Fabrications: Manufacturer's standard form agreeing to repair or replace units that fail in material or workmanship within the specified warranty period.

- B. Warranty Period: 2 year after the date of substantial completion.
- C. The warranty shall not deprive the owner of other rights or remedies the Owner may have under other provisions of the Contract Documents, and is in addition to and runs concurrent with other warranties made by the Contractor under the requirements of the Contract Documents.

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. Basis of Design: 3form, Inc., Salt Lake City, Utah, USA / telephone 801-649-2500

2.2 MATERIALS

- A. Varia™ produced from ecoresin™ Sheet
 1. Engineered polyester resin
 2. Sheet Size: Maximum 4' x 10'
 3. Thickness: As indicated on the Drawings.
 4. Basis of Design Product: The design of Plastic Fabrications is based on Varia™ produced with ecoresin™ as provided by 3form, Inc. Products from other manufacturers must be approved by the Architect or Designer prior to bidding in accordance with the Instructions to Bidders and Section 10 60 00 "Product Requirements".
- B. Interlayer Materials: Compatible with polyesters and bonding process to create a monolithic sheet of material when complete.
- C. Sheet minimum performance attributes:
 1. Rate of Burning (ASTM D 635). Material must attain CC1 Rating for a nominal thickness of 1.5 mm (0.060 in.) and greater.
 2. Self-Ignition Temperature (ASTM D 1929). Material must have a Self-ignition temperature greater than 650°F.

3. Density of Smoke (ASTM D 2843). Material must have a smoke density less than 75%.
4. Flame spread and Smoke developed testing (ASTM E 84). Material must be able to meet a level of Class A (Flame spread less than 25 and smoke less than 450) at thickness of 1".
5. Room Corner Burn Test (NFPA 286). Material must meet Class A criteria at ¼" thickness as described by the 2003 *International Building Code*.
6. Extent of Burning (UL 94). Must submit UL card.
7. Impact strength. Minimum impact strength test as measured by ASTM D 3763 of 20 ft. lbs. (for durability, shipping, installation, and use).
8. Safety Glazing. Material must attain a Class A impact rating in accordance with ANSI Z97.1-2004 at 1/8" thickness.
9. UPITT Test for Combustion Product Toxicity: Product must be recorded as "not more toxic than wood".
10. Dynamic environmental testing (ASTM standards D 5116 and D 6670). Panels must not have detectable VOC off-gassing agents and must be have Greenguard™ Indoor Air Quality certified.
11. Panels must be produced from a minimum of 40% post-industrial recycle content. This recycle content must be certified by a recognized 3rd party certification group, such as Scientific Certification Systems (SCS).
12. Building Approvals: Plastic Fabrications are to have been evaluated and must be registered with and comply to requirements of the following jurisdictions:
 - a. New York Department of Buildings (Product must have an MEA Materials and Equipment Acceptance number) for use as Interior Finishes

2.3 FABRICATION

- A. General: Fabricate Plastic Fabrications to designs, sizes and thicknesses indicated and to comply with indicated standards. Sizes, profiles and other characteristics are indicated on the drawings.
 - B. Comply with manufacturer's written recommendations for fabrication.
 - C. Machining: Acceptable means of machining are listed below. Ensure that material is not chipped or warped by machining operations.
 - 1. Sawing: Select equipment and blades suitable for type of cut required.
 - 2. Drilling: Drills specifically designed for use with plastic products.
 - 3. Milling: Climb cut where possible.
 - 4. Routing
 - 5. Tapping
 - D. Forming: Form products to shapes indicated using the appropriate method listed below. Comply with manufacturer's written instructions.
 - 1. Cold Bending
 - 2. Hot Bending
 - 3. Thermoforming: Acceptable only on uncoated material.
 - 4. Drape Forming
 - 5. Matched Mold Forming
 - 6. Mechanical Forming
- 2.4 MISCELLANEOUS MATERIALS
- A. General: Provide products of material, size, and shape required for application indicated, and with a proven record of compatibility with surfaces contacted in installation.
 - B. Cleaner: Type recommended by manufacturer.

- C. Fasteners: Use screws designed specifically for plastics. Self-threading screws are acceptable for permanent installations. Provide threaded metal inserts for applications requiring frequent disassembly such as light fixtures.
- D. Bonding Cements: May be achieved with solvents or adhesives, suitable for use with product and application.
- E. Provide silicone gaskets compatible with plastics for expansion and contraction.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions where installation of Plastic Fabrications will occur, with Installer present, for compliance with manufacturer's requirements. Verify that substrates and conditions are satisfactory for installation and comply with requirements specified.

3.2 INSTALLATION

- A. General: Comply with manufacturer's written instructions for the installation of Plastic Fabrications.
- B. Manufacturer's shop to fabricate items to the greatest degree possible.
- C. Utilize fasteners, adhesives and bonding agents recommended by manufacturer for type of installation indicated. Material that is chipped, warped, hazed or discolored as a result of installation or fabrication methods will be rejected.
- D. Install components plumb, level and rigid, scribed to adjacent finishes, in accordance with approved shop drawings and product data.
- E. Form field joints using manufacturer's recommended procedures. Locate seams in panels so that they are not directly in line with seams in substrates.

F. Polish all exposed edges below 96-inches above finished floor.

3.3 CLEANING AND PROTECTION

A. Protect surfaces from damage until date of substantial completion. Repair work or replace damaged work, which cannot be repaired to Architect's satisfaction.

END OF SECTION

PRODUCT DATA SHEET 1 - Solid Polymer Fabrication #1 (SPF-1)

Product: [Replace with Collection and product name]

Color: [Replace with color name]

Gauge: [1/16"][1/8"][3/16"][1/4"][3/8"][1/2"][3/4"][1"][As indicated on drawings][As required to meet deflection requirements]

Surface Finish: [Patent][Markerboard Plus][Patina][Pixel][Sandstone][Stucco][Supermatte][Other]

UV Protection: [required][not required]

Edge Sealing: [required][not required]

Expansion/Contraction Allowance:

Orientation: [Horizontal][Vertical]

**SECTION 061600
SHEATHING**

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Sheathing for exterior walls.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of process and factory-fabricated product.

1.3 INFORMATIONAL SUBMITTALS

- A. Evaluation Reports: For the following, from ICC-ES:
1. Exterior gypsum sheathing

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Fire-Resistance Ratings: As tested according to ASTM E 119; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
1. Fire-Resistance Ratings: Indicated by design designations from UL's "Fire Resistance Directory" or from the listings of another qualified testing agency.

2.2 SHEATHING FOR VESTIBULE CEILING

- A. Glass-Mat Gypsum Sheathing: ASTM C 1177/1177M.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. CertainTeed Corporation.
 - b. Georgia-Pacific Gypsum LLC.
 - c. USG Corporation.
 2. Type and Thickness: Type X, 5/8 inch (15.9 mm) thick.

2.3 FASTENERS

A. General: Provide fasteners of size and type indicated that comply with requirements specified in this article for material and manufacture.

1. For wall sheathing, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M.

2.4 SHEATHING JOINT-AND-PENETRATION TREATMENT MATERIALS

A. Sealant for Glass-Mat Gypsum Sheathing: Silicone emulsion sealant complying with ASTM C 834, compatible with sheathing tape and sheathing and recommended by tape and sheathing manufacturers for use with glass-fiber sheathing tape and for covering exposed fasteners.

1. Sheathing Tape: Self-adhering glass-fiber tape, minimum 2 inches (50 mm) wide, 10 by 10 or 10 by 20 threads/inch (390 by 390 or 390 by 780 threads/m), of type recommended by sheathing and tape manufacturers for use with silicone emulsion sealant in sealing joints in glass-mat gypsum sheathing and with a history of successful in-service use.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Do not use materials with defects that impair quality of sheathing or pieces that are too small to use with minimum number of joints or optimum joint arrangement. Arrange joints so that pieces do not span between fewer than three support members.
- B. Cut panels at penetrations, edges, and other obstructions of work; fit tightly against abutting construction unless otherwise indicated.
- C. Securely attach to substrate by fastening as indicated, complying with the following:
 1. Table 2304.9.1, "Fastening Schedule," in the ICC's International Building Code.
- D. Do not bridge building expansion joints; cut and space edges of panels to match spacing of structural elements.

3.2 GYPSUM SHEATHING INSTALLATION

- A. Comply with GA-253 and with manufacturer's written instructions.

1. Fasten gypsum sheathing to cold-formed metal framing with screws.
2. Install panels with a 3/8-inch (9.5-mm) gap where non-load-bearing construction abuts structural elements.
3. Install panels with a 1/4-inch (6.4-mm) gap where they abut masonry or similar materials that might retain moisture, to prevent wicking.

END OF SECTION 061600

SECTION 07 14 16.11

COLD, FLUID-APPLIED WATERPROOFING

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Fluid-applied membrane waterproofing and accessory products.
- B. Materials and their installation as indicated on drawings, for primarily- vertical, below-grade, foundation wall surfaces, consisting of:
 - 1. Waterproofing plus drainage waterproofing membrane fully-adhered to substrate and overlying drainage composite with perimeter drainage system, all from the same manufacturer. Waterproofing membrane provides barrier to water under hydrostatic head, while drainage materials remove hydrostatic pressure from waterproofing membrane while also serving as a protection course during backfill.

1.2 RELATED SECTIONS

- A. Division 03 - Concrete
- B. Section 04 20 00 - Unit Masonry
- C. Section 07 90 00 Joint Protection
- D. Division 22 - Plumbing
- E. Division 31 - Earthwork

1.3 REFERENCES

- A. ASTM C 920 Standard Specification for Elastomeric Joint Sealants
- B. ASTM C 836 Standard Specification for High Solids Content, Cold Liquid-Applied Elastomeric Waterproofing Membrane for use with Separate Wearing Course

- C. ASTM D 412 Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension
- D. ASTM D 903 Standard Test Method for Peel and Stripping Strength of Adhesive Bonds
- E. ASTM D 1970 Standard Specification for Self-Adhering Polymer Modified Bituminous Sheet Materials Used as Steep Roofing Underlayment for Ice Dam Protection
- F. ASTM D 4541 Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
- G. ASTM E 96 Standard Test Methods for Water Vapor Transmission of Materials.

1.4 PERFORMANCE REQUIREMENTS

- A. Product provided by this Section shall be a water-based, rubberized asphalt emulsion which rapidly cures in place to provide a seamless waterproofing membrane.
- B. Product shall be solvent free, have VOC content of not more than 30 grams per liter and shall be free of noxious odors.
- C. Product, when applied at minimum 0.060 inch (60 mils) cured thickness, shall meet the following requirements:

Water Vapor	Not more than 0.1 Perm	ASTM E-96, Method B
Tensile	Not less than 500	ASTM D-412
Low Temperature Flexibility	No cracking, 180 degree bend over 1-inch mandrel at	ASTM D 1970
Low-Temperature	Withstand 10 cycles at	ASTM C 836
Peel adhesion on HDPE film, concrete and	Not less than 10 lb per inch of width OR	ASTM D 903
Pull adhesion on concrete and concrete	Not less than 16 lb per square inch	ASTM D 4541

1.5 SUBMITTALS

- A. Provide submittals in accordance with Section 01 33 00

- B. At bid submission, provide evidence to the Architect of installer qualification by Manufacturer.
- C. Shop drawings showing locations and extent of waterproofing and details of typical conditions.
- D. Manufacturer's technical data sheets and material safety data sheets for Product and Accessories.
- E. Manufacturer's installation instructions.
- F. Manufacturer's documentation of volatile organic compounds (VOC) content for Product and Accessories.
- G. Certification of compatibility by Manufacturer, listing all materials on the Project with which the Product and Accessories may come into contact.
- H. Samples, 3 inch by 4 inch minimum size, of cured Product.

1.6 QUALITY ASSURANCE

- A. Installer shall be experienced in applying the same or similar materials and shall be specifically approved in writing by Manufacturer.
 - B. Single-Source Responsibility: Obtain Product and Accessories from single manufacturer.
- 1.7 Product and Accessories shall comply with all state and local regulations controlling use of volatile organic compounds (VOCs).
- D. Comply with the provisions of the Owner's Building Envelope Commissioning program in accordance with Section 01 91 15.
 - E. Pre-Installation/Construction Meetings: Convene one week prior to commencing Work of this section.
 - F. Cooperate and coordinate with the Owner's inspection and testing agency.
Do not cover any installed Product unless it has been inspected, tested and approved.

1.7 DELIVERY, STORAGE AND HANDLING

- A. Deliver Product and Accessories to Project site in original packages with seals unbroken, labeled with Manufacturer's name, product name, lot number and directions for storage.
- B. Protect Product from freezing.
- C. Store Product and Accessories in their original, undamaged packages in clean, dry, protected location and within temperature range required by Manufacturer.
- D. Avoid spillage. Immediately notify Owner, if spillage occurs and start clean up procedures. Clean spills and leave area as it was prior to spill.

1.8 WASTE MANAGEMENT AND DISPOSAL

- A. Separate and recycle waste materials in accordance with Section 01 74 19 - Construction Waste Management and Disposal, and with the Waste Reduction Work Plan.
- B. Place materials defined as hazardous or toxic waste in designated containers.
- C. Ensure emptied containers are stored safely for disposal away from children.

1.9 PROJECT CONDITIONS

- A. Do not apply Product or Accessories during rain or accumulating snowfall.
- B. Apply Product and Accessories within approved ambient and substrate temperature range stated in Manufacturer's literature.
- C. Do not apply Product or Accessories over incompatible materials.
- D. Observe safety and environmental measures indicated in Manufacturer's MSDS, and mandated by federal, state and local regulations.

1.10 WARRANTIES: Provide the Manufacturer's minimum [five] year material warranty under provisions of Section 01 78 36 - Warranties.

PART 2 PRODUCTS

- 2.1 Basis of Design: Provide as manufactured by Carlisle Coatings & Waterproofing, Incorporated. 900 Hensley Lane, Wylie, TX 75098. Phone 1-800-527-7092. Website <http://www.carlisle-ccw.com> :
- A. Spray-Grade: Barricoat™-S pourable consistency, water-based, polymer- modified asphalt
 - B. Roller-Grade: Barricoat™-R paste consistency, water-based, polymer- modified asphalt
- 2.2 ACCESSORIES: Provide as manufactured by Carlisle Coatings & Waterproofing, Incorporated:
- A. Co-Spray: Barricure™ chloride-free liquid concentrate.
 - B. Transition Membrane: 60 mil thickness self-adhering waterproofing membrane strips provided in rolls of various widths. Select either:
 - 1. MiraDRI 860 Strips
 - 2. MiraDRI 861 Strips
 - C. Reinforcing Fabric: DCH Reinforcing Fabric woven, white polyester provided in rolls of various widths.
 - D. Contact Adhesive, select any:
 - 1. CCW-702 OR CCW-702 LV Solvent-Based
 - E. Mastic, select either:
 - 1. LM 800 XL solvent-based synthetic rubber
 - 2. CCW-704 solvent-based rubberized asphalt
 - F. Fill Compound, select either:
 - 1. CCW-703 V Trowel-Grade Polyurethane, 2-part
 - G. Aerosol Contact Adhesive: CAV-GRIP™
 - H. Drainage Composite: MiraDRAIN as recommended by Manufacturer for the Project.
 - I. Protection Board: CCW Protection Board V
 - J. Joint Sealant, select either:
 - 1. CCW-201 non-sag, 2-part polyurethane
 - 2. Product by others as approved by Manufacturer. Shall conform to
ASTM C 920 Type 1 or 2, Grade NS, Class 25 or 50.
 - K. Board Insulation, select either:
 - 1. Insulfoam BG expanded polystyrene, as manufactured by

- Insulfoam -
A Carlisle Company. Available in various
thicknesses and compressive strengths.
 - 2. Product by others, as approved by Architect
- L. Insulation Adhesive, select either:
- 1. CAV-GRIP™
 - 2. Product by others as approved by board insulation and
waterproofing membrane manufacturer.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Before any waterproofing work is started, the waterproofing applicator shall thoroughly examine all surfaces for any deficiencies. Should any deficiencies exist, the COR shall be notified in writing and corrections made.
- B. Concrete shall be cured for a minimum of three days.
- C. Condition of Concrete Surfaces:
 - 1. The concrete surfaces shall be of sound structural grade, minimum of
2500 PSI compressive strength, and shall have a
continuous surface, free of fins, ridges, voids or
entrained air holes.
 - 2. Concrete shall be cured by water during method. Curing
compounds must be of the pure sodium silicate type and
be approved by the
Carlisle representative or pass ASTM D 4263.
 - 3. Control joints and/or expansion joints shall have been
properly
installed at strategic points throughout the field of
the deck to control cracking caused by deflection and
shrinkage.
 - 4. Voids, rock pockets and excessively rough surfaces
shall be repaired with approved non-shrink grout or
ground to match the unrepaired areas.
- D. Condition of Concrete Masonry Unit (CMU) Surfaces:
 - 1. Mortar joints shall be struck flush to face of concrete
block.
 - 2. Voids and holes greater than $\frac{1}{2}$ inch across shall be
filled with mortar or non-shrink grout.
 - 3. Cracks, gaps and joints exceeding $\frac{1}{4}$ inch width shall
be filled with mortar or non-shrink grout.

4. Surface irregularities exceeding $\frac{1}{4}$ inch in height or sharp to touch shall be ground smooth or made flush.
 5. If surfaces cannot be made smooth to the satisfaction of the Architect, they shall be covered with a parge coat, typically consisting of one part cement to three parts sand, over area to receive fluid-applied waterproofing.
 6. Mortar droppings shall be removed from surfaces.
- E. Rough gaps around mechanical, electrical and similar penetrations shall be filled with non-shrink grout, mortar, Joint Sealant or Fill Compound and struck flush.
- F. Surfaces shall be sound, dry and free of oil, grease, form release agents, dirt or other contaminants.
- G. Honeycomb in concrete shall be filled with non-shrink grout or Fill Compound

3.2 SURFACE PREPARATION

- A. Prepare areas to receive Transition Membrane with Contact Adhesive.
Contact Adhesive shall be provided at recommended coverage rate and visible for 1 inch minimum beyond edge of installed Transition Membrane.
- B. Install Transition Membrane according to Manufacturer's instructions in literature.
- C. Encapsulate Reinforcing Fabric as follows: Coat substrate with approximately 30 wet mils of Roller Grade Product, lay fabric into wet surface, coat fabric with approximately 30 more wet mils of Roller Grade Product.
- D. Apply Transition Membrane or Reinforcing Fabric encapsulated in Roller- Grade Product according to Manufacturers instructions and drawings in the following areas:
1. Cold joints
 2. Cracks
 3. Expansion joints
 4. Control joints
 5. Inside/outside corners and other change in plane
 6. Mechanical/electrical penetrations
 7. Transition to different substrate.

3.3 INSTALLATION

- A. Allow materials used during surface preparation to cure fully before applying Product.
- B. Spray-Grade Product: Dispense in tandem with Co-Spray according to instructions in Manufacturer's literature.
- C. Roller-Grade Product: Apply according to according to instructions in Manufacturer's literature
- D. Cured membrane thickness shall measure a minimum of 0.060 inch (60 mils).
- E. Provide complete coverage without pinholes or voids. Apply greater thickness of Product as necessary to provide continuous coating over rough surfaces and irregularities.
- F. Allow Product to dry completely before application of Protection Board, Board Insulation or Drainage Composite

3.4 SCHEDULE

- A. Seal penetrations made through installed Product according to Manufacturer's instructions and drawings.
- B. Protection Board installed after Product: Attach to surface of Product with Aerosol Contact Adhesive.
- C. Board Insulation installed after Product: Install in accordance with Section 07 21 13 Board Insulation. Attach to surface of Product with Insulation Adhesive.
- D. Drainage Composite installed after Product: Install with fabric side facing soil and connect to Perimeter Drainage System according to Manufacturer's instructions and drawings. Use Aerosol Contact adhesive, to attach Drainage Composite to surface of Product or to surface of board insulation overlying Product.
- E. Backfill to permanently secure Drainage Composite, Board Insulation and Protection Board.
- F. Avoid damaging Product and Accessories during backfill.

3.5 REPAIR AND PROTECTION

- A. Protect from damage during application and remainder of construction period.

- B. Inspect before covering. Repair or replace damaged material according to Manufacturer's instructions and drawings.
- C. Product and Accessories are not designed for permanent exposure. Cover with Drainage Composite, Protection Board or Board Insulation and backfill as soon as schedule allows.
- D. Outdoor exposure of installed Product shall not exceed 30 days.

END OF SECTION

SECTION 07 21 13
THERMAL INSULATION

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Thermal insulation.
 - a. Board or block insulation at foundation perimeter.
 - b. Batt or blanket insulation at exterior framed and furred walls.
 - c. Board or block insulation at floor assemblies above unconditioned spaces.
 - d. Board insulation at masonry cavity walls.
 - e. Mineral Wool at cavity wall voids.
2. Acoustical insulation.
 - a. Semi-rigid insulation at interior framed partitions.
 - b. Batt and blanket insulation at interior framed partitions and ceilings .

1.2 RELATED REQUIREMENTS

- A. Adhesives VOC Limits: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Insulation for Cavity Face of Masonry: Section 04 20 00, UNIT MASONRY.
- C. Safing Insulation: Section 07 84 00, FIRESTOPPING.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
 1. C552-15 - Cellular Glass Thermal Insulation.
 2. C553-13 - Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications.
 3. C578-15 - Rigid, Cellular Polystyrene Thermal Insulation.
 4. C591-15 - Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation.
 5. C612-14 - Mineral Fiber Block and Board Thermal Insulation.
 6. C665-12 - Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing.

7. C954-15 - Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Base to Steel Studs From 0.033 (0.84 mm) inch to 0.112 inch (2.84 mm) in thickness.
8. C1002-14 - Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs.
9. D312/D312M-15 - Asphalt Used in Roofing.
10. E84-15a - Surface Burning Characteristics of Building Materials.
11. F1667-15 - Driven Fasteners: Nails, Spikes, and Staples.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 1. Show insulation type, thickness, and R-value for each location.
- C. Manufacturer's Literature and Data:
 1. Description of each product.
 2. Adhesive indicating manufacturer recommendation for each application.
- D. Sustainable Construction Submittals:
 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.
 2. Low Pollutant-Emitting Materials:
 - a. Show volatile organic compound types and quantities.

1.5 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.6 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.
- C. Protect foam plastic insulation from UV exposure.

1.7 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 INSULATION - GENERAL

- A. Insulation Thickness:
1. Provide thickness required by R-value shown on drawings.
 2. Provide thickness indicated when R-value is not shown on drawings.
- B. Insulation Types:
1. Provide one insulation type for each application.
- C. Sustainable Construction Requirements:
1. Insulation Recycled Content:
 - a. Polyisocyanurate/polyurethane rigid foam: 9 percent recovered material.
 - b. Glass fiber reinforced: 6 percent recovered material.
 - c. Rock wool material: 75 percent recovered material.
 2. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Non-Flooring Adhesives and Sealants.

2.2 THERMAL INSULATION

- A. Perimeter Insulation In Contact with Soil:
1. Polystyrene Board: ASTM C578, Type IV.
- B. Exterior Framing or Furring Insulation:
1. Mineral Fiber: ASTM C665, Type II, Class C, Category I where concealed by thermal barrier.
 2. Mineral Fiber: ASTM C665, Type III, Class A at other locations.
- C. Masonry Cavity Wall Insulation:
1. Polyisocyanurate Board: ASTM C591, Type I, with vapor retarder facing; maximum permeance 29 ng/Pa/s/sq. m (0.5 perms).

2.3 ACOUSTICAL INSULATION

- A. Semi Rigid, Batts and Blankets:
1. Widths and lengths to fit tight against framing.
 2. Mineral Fiber Batt or Blankets: ASTM C665 FSK faced unfaced .

3. Maximum Surface Burning Characteristics: ASTM E84.
 - a. Flame Spread Rating: 25.
 - b. Smoke Developed Rating: 450.

2.4 ACCESSORIES

- A. Fasteners:
 1. Staples or Nails: ASTM F1667, zinc-coated, size and type to suit application.
 2. Screws: ASTM C954 or ASTM C1002, size and length to suit application with washer minimum 50 mm (2 inches) diameter.
 3. Impaling Pins: Steel pins with head minimum 50 mm (2 inches) diameter.
 - a. Length: As required to extend beyond insulation and retain cap washer when washer is placed on pin.
 - b. Adhesive: Type recommended by manufacturer to suit application.
- B. Insulation Adhesive:
 1. Nonflammable type recommended by insulation manufacturer to suit application.
- C. Tape:
 1. Pressure sensitive adhesive on one face.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.

3.2 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings.
 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Install insulation with vapor barrier facing the heated side, unless indicated otherwise.

- C. Install board and block insulation with joints close and flush, in regular courses, and with end joints staggered.
- D. Install batt and blanket insulation with joints tight. Fill framing voids completely. Seal penetrations, terminations, facing joints, facing cuts, tears, and unlapped joints with tape.
- E. Fit insulation tight against adjoining construction and penetrations, unless indicated otherwise.

3.3 THERMAL INSULATION

- A. Perimeter Insulation In Contact with Soil:
 - 1. Vertical insulation:
 - a. Fill joints of insulation with same material used for bonding.
 - 2. Horizontal insulation under concrete floor slab:
 - a. Lay insulation boards and blocks horizontally on level, compacted and drained fill.
 - b. Extend insulation from foundation walls towards center of building minimum 600 mm (24 inches).
- B. Exterior Framing or Furring Insulation:
 - 1. General:
 - a. Open voids are not acceptable.
 - b. Pack insulation around door frames and windows, in building expansion joints, door soffits, and other voids.
 - c. Pack behind outlets, around pipes, ducts, and services encased in walls.
 - d. Hold insulation in place with pressure sensitive tape.
 - e. Lap facing flanges together over framing for continuous surface. Seal penetrations through insulation and facings.
 - 2. Metal Studs:
 - a. Fasten insulation between metal studs, framing, and furring with pressure sensitive tape continuous along flanged edges.
 - 3. Ceilings and Soffits:
 - a. Metal Framing:
 - 1) Fasten insulation between metal framing with pressure sensitive tape continuous along flanged edges.
 - 2) At metal framing and ceilings suspension systems, install insulation above suspended ceilings and metal framing at right angles to main runners and framing.

- 3) Tape insulation tightly together without gaps. Cover metal framing members with insulation.

b. Ceiling Transitions:

- 1) In areas where suspended ceilings transition to structural ceiling, install blanket or batt insulation.
- 2) Extend insulation from suspended ceiling to underside of structure above.
- 3) Secure blanket and batt with continuous cleats to structure above.

C. Inside Face of Exterior Wall Insulation:

1. Location: On interior face of solid masonry and concrete walls, beams, beam soffits, underside of floors, and to face of studs to support interior wall finish where indicated.
2. Bond insulation to solid vertical surfaces with adhesive. Fill joints with adhesive cement.
3. Fasten board insulation to face of studs with screws, nails or staples. Space fastenings maximum 300 mm (12 inches) on center. Stagger fasteners at board joints. Install fasteners at each corner.

D. Floor Assemblies Above Unconditioned Spaces:

1. Use impaling pins for attach insulation to underside of horizontal surfaces. Space fastenings as required to hold insulation in place and prevent sagging.
 - a. Bond insulation with adhesive when separate vapor retarder is used.

E. Masonry Cavity Wall Insulation:

1. Install insulation on exterior faces of concrete and masonry inner wythes of cavity walls.
2. Bond polyurethane or polyisocyanurate board, and perlite board to surfaces with adhesive.
3. Fill insulation joints with same material used for bonding.

3.4 ACOUSTICAL INSULATION

A. General:

1. Install insulation without voids.
2. Pack insulation around door frames and windows, in building expansion joints, door soffits, and other voids.

3. Pack behind outlets, around pipes, ducts, and services encased in walls.
 4. Hold insulation in place with pressure sensitive tape.
 5. Lap facer flanges together over framing for continuous surface. Seal all penetrations through the insulation and facers.
 6. Do not compress insulation below required thickness except where embedded items prevent required thickness.
- B. Semi Rigid, Batts and Blankets:
1. When insulation is not full thickness of cavity, adhere insulation to one side of cavity, maintaining continuity of insulation and covering penetrations or embedments.
 - a. Metal Framing:
 - 1) Fasten insulation between metal framing with pressure sensitive tape continuous along flanged edges.
 - 2) At metal framing or ceilings suspension systems, install blanket insulation above suspended ceilings or metal framing at right angles to the main runners or framing.
 - 3) Tape insulation tightly together so no gaps occur and metal framing members are covered by insulation.

3.5 CLEANING

- A. Remove excess adhesive before adhesive sets.

3.6 PROTECTION

- A. Protect insulation from construction operations.
- B. Repair damage.

- - E N D - -

SECTION 07 22 00
ROOF AND DECK INSULATION

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
- B. Roof and deck insulation, vapor retarder, and cover board on new metal deck substrates ready to receive roofing or waterproofing membrane.
- C. Repairs and alteration work to existing roof insulation.

1.2 RELATED REQUIREMENTS

- A. Non-Flooring Adhesives and Sealants VOC Limits: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Wood Cants, Blocking, and Edge Strips: Section 06 10 00, ROUGH CARPENTRY.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. American Society of Heating, Refrigeration and Air Conditioning (ASHRAE):
 - 1. Standard 90.1-13 - Energy Standard for Buildings Except Low-Rise Residential Buildings.
- C. ASTM International (ASTM):
 - 1. C208-12 - Cellulosic Fiber Insulating Board.
 - 2. C552-15 - Cellular Glass Thermal Insulation.
 - 3. C726-05 - Mineral Fiber Roof Insulation Board.
 - 4. C728-15 - Perlite Thermal Insulation Board.
 - 5. C1177/C1177M-13 - Glass Mat Gypsum Substrate for Use as Sheathing.
 - 6. C1278/C1278M-07a(2015) - Fiber-Reinforced Gypsum Panel.
 - 7. C1289-15 - Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board.
 - 8. C1396/C1396M-14a - Gypsum Board.
 - 9. D41/D41M-11 - Asphalt Primer Used in Roofing, Dampproofing, and Waterproofing.
 - 10. D312-06 - Asphalt Used in Roofing.
 - 11. D4586/D4586M-07(2012)e1 - Asphalt Roof Cement, Asbestos-Free.
 - 12. E84-15a - Surface Burning Characteristics of Building Materials.
 - 13. F1667-15 - Driven Fasteners: Nails, Spikes, and Staples.

- D. National Roofing Contractors Association (NRCA):
 - 1. Manual-15 - The NRCA Roofing Manual: Membrane Roof Systems.
- E. U.S. Department of Agriculture (USDA):
 - 1. USDA BioPreferred Program Catalog.
- F. UL LLC (UL):
 - 1. Listed - Online Certifications Directory.
- G. U.S. Department of Commerce National Institute of Standards and Technology (NIST):
 - 1. DOC PS 1-09 - Structural Plywood.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 - 1. Show size, configuration, and installation details.
 - a. Nailers, cants, and terminations.
 - b. Layout of insulation showing slopes, tapers, penetrations, and edge conditions.
- C. Manufacturer's Literature and Data:
 - 1. Description of each product.
- D. Samples:
 - 1. Roof insulation, each type.
 - 2. Fasteners, each type.
- E. Sustainable Construction Submittals:
 - 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.
 - 2. Biobased Content:
 - a. Show type and quantity for each product.
 - 3. Low Pollutant-Emitting Materials:
 - a. Show volatile organic compound types and quantities.
 - b. Certify each composite wood and agrifiber product contain no added urea formaldehyde.
- F. Qualifications: Substantiate qualifications meet specifications.
 - 1. Installer.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Same installer as Division 07 roofing section installer.

1.6 DELIVERY

- A. Comply with recommendations of NRCA Manual.
- B. Deliver products in manufacturer's original sealed packaging.
- C. Mark packaging, legibly. Indicate manufacturer's name or brand, type, and manufacture date.
- D. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

- A. Comply with recommendations of NRCA Manual.
- B. Store products indoors in dry, weathertight facility.
- C. Protect products from damage during handling and construction operations.

1.8 FIELD CONDITIONS

- A. Environment:
 - 1. Install products when existing and forecasted weather permit installation according to manufacturer's instructions.

1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant substrate board, vapor retarder, insulation, and cover board against material and manufacturing defects as part of Division 07 roofing system warranty.

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

- A. Insulation Thermal Performance:
 - 1. Overall Average R-Value: RSI-57 (R-33), minimum.
 - 2. Any Location R-Value: RSI-17 (R-10), minimum.
- B. Fire and Wind Uplift Resistance: Provide roof insulation complying with requirements specified in Division 07 roofing section.
- C. Insulation on Combustible Metal Decking: UL labeled indicating compliance with one of the following:
 - 1. UL Listed.
 - 2. Insulation Surface Burning Characteristics: When tested according to ASTM E84.
 - a. Flame Spread Rating: 75 maximum.

b. Smoke Developed Rating: 150 maximum.

2.2 PRODUCTS - GENERAL

- A. Provide each product from one manufacturer.
- B. Sustainable Construction Requirements:
 - 1. Insulation Recycled Content:
 - a. Glass Fiber Reinforced Rigid Foam: 6 percent total recycled content, minimum.
 - 2. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Non-flooring adhesives and sealants.

2.3 ADHESIVES

- A. Primer: ASTM D41/D41M.
- B. Asphalt: ASTM D312, Type III or IV for vapor retarders and insulation.
- C. Modified Asphaltic Insulation Adhesive: Insulation manufacturer's recommended modified asphaltic, asbestos-free, cold-applied adhesive formulated to adhere roof insulation to substrate or to another insulation layer.
- D. Full-Spread Applied Urethane Insulation Adhesive: Insulation manufacturer's recommended spray-applied, low-rise, two-component urethane adhesive formulated to adhere roof insulation to substrate or to another insulation layer.
- E. Roof Cement: Asbestos free, ASTM D2822/D2822M, Type I or Type II; or, ASTM D4586/D4586M, Type I or Type II.

2.4 ROOF AND DECK INSULATION

- A. Roof and Deck Insulation, General: Preformed roof insulation boards approved by roofing manufacturer.
- B. Polyisocyanurate Board Insulation: ASTM C1289, Type II, Class 1, Grade 2, faced with glass fiber reinforced cellulosic felt facers on both major surfaces of the core foam.
- C. Tapered Roof Insulation System:
 - 1. Fabricate of mineral fiberboard, polyisocyanurate, perlite board, or cellular glass. Use only one insulation material for tapered sections. Use only factory-tapered insulation.
 - 2. Cut to provide high and low points with crickets and slopes as shown.

3. Minimum thickness of tapered sections; 38 mm (1-1/2 inch).
4. Minimum slope 1/48 (1/4 inch per 12 inches).

2.5 INSULATION ACCESSORIES

- A. Glass (Felt): ASTM D2178/D2178M, Type VI, heavy duty ply sheet.
- B. Cants and Tapered Edge Strips:
 1. Wood Cant Strips: Refer to Section 06 10 00, ROUGH CARPENTRY.
 2. Insulation Cant Strips: ASTM C208, Type II, Grade 1, cellulosic-fiber insulation board.
 3. Tapered Edge Strips: 1/12 (1 inch per 12 inches), from 0 mm (0 inches), 300 mm to 450 mm (12 inches to 18 inches) wide.
 - a. Cellulosic Fiberboard: ASTM C208.
 - b. Mineral Fiberboard: ASTM C726.
 - c. Perlite Board: ASTM C728.
- C. Vapor Retarder:
 1. Self-Adhering Sheet Vapor Retarder: ASTM D1970/D1970M, minimum 1.0 mm (40 mils) thick membrane of HDPE film fully coated with asphalt adhesive, or 0.76 to 1.0 mm (30 to 40 mils) thick membrane of butyl rubber based adhesive backed by a layer of high density cross-laminated polyethylene; maximum permeance rating of 6 ng/Pa/s/sq. m (0.1 perms).
 2. Gypsum Board: ASTM C1396/C1396M, 16 mm (5/8 inch) thick, Type X.
- D. Cover Board:
 1. Glass-Mat, Water-Resistant Gypsum Roof Board:
ASTM C1177/C1177M, 13 mm (1/2 inch) thick, factory primed.

2.6 ACCESSORIES

- A. Fasteners: Corrosion-resistant carbon steel fasteners and galvalume-coated steel or plastic round plates for fastening substrate board and insulation to roof deck.
- B. Nails: ASTM F1667; type to suit application.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Comply with requirements of Division 07 roofing section.

3.2 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.

3.3 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions.
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Comply with requirements of UL for insulated steel roof deck.
- C. Attach substrate board and other products to meet requirements of Division 07 roofing section.

3.4 VAPOR RETARDER INSTALLATION

- A. Vapor Retarder Installation, General:
 - 1. Install continuous vapor retarder on roof decks where indicated.
 - 2. At vertical surfaces, turn up vapor retarder to top of insulation or base flashing.
 - 3. Seal penetrations through vapor retarder with roof cement to prevent moisture entry from below.

3.5 INSULATION INSTALLATION

- A. Insulation Installation, General:
 - 1. Base Sheet: Where required by roofing system, install one lapped base sheet specified in Division 07 roofing section by mechanically fastening to roofing substrate before installation of insulation.
 - 2. Cant Strips: Install preformed insulation cant strips wood cant strips specified in Section 06 10 00 ROUGH CARPENTRY at junctures of roofing system with vertical construction.
 - 3. Use same insulation as existing for roof repair and alterations unless specified otherwise.
- B. Insulation Thickness:
 - 1. Thickness of roof insulation shown on drawings is nominal. Provide thickness required to comply with specified thermal performance.
 - 2. Insulation on Metal Decks: Provide insulation in minimum thickness recommended by insulation manufacturer to span deck flutes. Support edges of insulation on metal deck ribs.
 - 3. When actual insulation thickness differs from drawings, coordinate alignment and location of roof drains, flashing, gravel stops, fascias and similar items.
 - 4. Where tapered insulation is used, maintain insulation thickness at high points and roof edges shown on drawings.

- a. Low Point Thickness: Minimum 38 mm (1-1/2 inches).
- 5. Use minimum two layers of insulation when required thickness is 68 mm (2.7 inch) or greater.
- C. Lay insulating units with close joints, in regular courses and with end joints staggered.
 - 1. Stagger joints between layers minimum 150 mm (6 inches).
- D. Lay units with long dimension perpendicular to the rolled (longitudinal) direction of the roofing felt.
- E. Seal cut edges at penetrations and at edges against blocking with bitumen or roof cement.
- F. Cut to fit tightly against blocking or penetrations.
- G. Cover all insulation installed on the same day; comply with temporary protection requirements of Division 07 roofing section.
- H. Installation Method:
 - 1. Mechanically Fastened and Adhered Insulation:
 - a. Fasten first layer of insulation according to "Mechanically Fastened Insulation" requirements.
 - b. Fasten each subsequent layer of insulation according to "Adhered Insulation" requirements.

3.6 COVER BOARD INSTALLATION

- A. Install cover boards over insulation with long joints in continuous straight lines with staggered end joints.
- B. Offset cover board joints from insulation joints 150 mm (6 inches), minimum.
- C. Secure cover boards according to "Adhered Insulation" "Mechanically Fastened Insulation" requirements.

- - E N D - -

SECTION 07 24 00
EXTERIOR INSULATION AND FINISH SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Exterior insulation and finish systems (EIFS).

1.2 RELATED REQUIREMENTS

- A. Gypsum Board Sheathing 09 29 00, GYPSUM SHEATHING.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.

B. American National Standards Institute (ANSI):

1. A108/A118/A136-14 - Installation of Ceramic Tile.
2. A137.1-12 - Ceramic Tile - Version 1.

C. ASTM International (ASTM):

1. B117-11 - Operating Salt Spray (Fog) Apparatus.
2. C67-14 - Sampling and Testing Brick and Structural Clay Tile.
3. C177-13 - Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded-Hot-Plate Apparatus.
4. C297/C297M-15 - Flatwise Tensile Strength of Sandwich Constructions.
5. C578-15 - Rigid, Cellular Polystyrene Thermal Insulation.
6. C666/C666M-15 - Resistance of Concrete to Rapid Freezing and Thawing.
7. C920-14a - Elastomeric Joint Sealants.
8. D968-15 - Abrasion Resistance of Organic Coatings by Falling Abrasive.
9. D2794-93(2010) - Resistance of Organic Coatings to the Effects of Rapid Deformation (Impact).
10. E84-15a - Surface Burning Characteristics of Building Materials.
11. E96/E96M-15 - Water Vapor Transmission of Materials.
12. E119-15 - Fire Tests of Building Construction and Materials.
13. E330/E330M-14 - Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference.
14. E331-00(2009) - Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Wall by Uniform Static Air Pressure Differences.

15. E2486/E2486M-13 - Impact Resistance of Class PB and PI Exterior Insulation and Finish Systems (EIFS).
16. G90-10 - Performing Accelerated Outdoor Weathering of Nonmetallic Materials Using Concentrated Natural Sunlight.

1.4 PREINSTALLATION MEETINGS

- A. Conduct preinstallation meeting at project site minimum 30 days before beginning Work of this section.
 1. Required Participants:
 - a. Contracting Officer's Representative.
 - b. Architect/Engineer.
 - c. Inspection and Testing Agency.
 - d. Contractor.
 - e. Installer.
 - f. Manufacturer's field representative.
 - g. Other installers responsible for adjacent and intersecting work, including air barriers and sealants.
 2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
 - a. Installation schedule.
 - b. Installation sequence.
 - c. Preparatory work.
 - d. Protection before, during, and after installation.
 - e. Installation.
 - f. Terminations.
 - g. Transitions and connections to other work.
 - h. Inspecting and testing.
 - i. Other items affecting successful completion.
 3. Document and distribute meeting minutes to participants to record decisions affecting installation.

1.5 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 1. Show size, configuration, and fabrication and installation details.

2. Show details for corner treatment, sills, soffits, dentils, quoins, lintels, openings, penetrations, flashing, and other special applications.
- C. Manufacturer's Literature and Data:
 1. Description of each product.
 2. Installation instructions.
 3. Warranty.
- D. Samples:
 1. Two 300 mm (1 foot) square samples of EIFS simulated synthetic stucco finishes over cement board identical to proposed installation in thickness, color, texture insulation and workmanship.
- E. Test reports: Certify each product and complete system complies with specifications.
- F. Qualifications: Substantiate qualifications comply with specifications.
 1. Installer with project experience list .

1.6 QUALITY ASSURANCE

- A. Installer Qualifications:
 1. Regularly installs specified products.
 2. Installed specified products with satisfactory service on five similar installations for minimum five years.
 - a. Project Experience List: Provide contact names and addresses for completed projects.

1.7 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.8 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight conditioned facility.
- B. Protect products from damage during handling and construction operations.

1.9 FIELD CONDITIONS

- A. Environment:

1. Unless greater temperature is required by system manufacturer, install products only when ambient air temperature is minimum 7 degrees C (45 degrees F) and rising and predicted to persist for 24 hours after installation.

1.10 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant EIFS system materials against material and manufacturing defects.
 1. Warranty Period: 10 years.

PART 2 - PRODUCTS

2.1 PRODUCTS - GENERAL

- A. Basis of Design: Dryvit Outsulation MD System.
- B. Provide system components from one manufacturer and from one production run .

2.2 EXTERIOR INSULATION AND FINISH SYSTEM (EIFS)

- A. Description: Polymer-Based (PB) system consists of Type I molded rigid polystyrene insulation adhered to sheathing and finished with glass-fiber-mesh reinforced based-coat and textured finish coat.
- B. Performance Requirements:
 1. Surface Burning Characteristics: When tested according to ASTM E84.
 - a. Flame Spread Rating: 25 maximum.
 - b. Smoke Developed Rating: 450 maximum.
 2. Full Scale Wall Fire Test: No significant surface flaming or propagation of vertical or lateral flames when tested according to ASTM E119.
 3. Impact Resistance (Sample to be cured. Finish, base coat and fabric over 25 mm (1 inch) insulation typical of project application), ASTM E2486/E2486M:
 - a.
 - b. High Impact Resistance - 10.2 to 17J (90-150 inch-lbs.).
 - c.
 4. Structural Performance: (Test panels 1200 mm x 1200 mm (4 feet by 4 feet) typical of project application): ASTM E330/E330M, no

- permanent deformation, delamination or deterioration for positive and negative pressures as required.
- a. Wind Loads: Uniform pressure as indicated on Drawings.
5. Water Penetration: ASTM E331, no water penetration minimum 720Pa (15psf) for windows and 300 Pa (6.24 psf) for curtain wall assembly.
 6. Abrasion Resistance: ASTM D968, 500 liters of sand with slight smoothing and no loss of film integrity.
 7. Accelerated Weathering: ASTM G90; 2000 hours with no deterioration.
 8. Salt Spray Resistance: ASTM B117; Withstand 300 hours with no deleterious effects.
 9. Water Vapor: ASTM E96/E96M; Maximum 12 g/h/sq. m (18 grains/hour/sf.).
 10. Absorption-Freeze-Thaw (Pre-weighed 100 mm x 200 mm (4 inch by 8 inch) specimens; 25 mm (1 inch) insulation, faced with finish coat cured and stored in air; tested with edges and back open), ASTM C67.
 - a. 50 Cycles: 20 hours at 9 degrees C (4 degrees F); 4-hour thaw in water.
 - b. After 50 cycles; total weight gain of maximum 6.2 grams. No checking splitting, or cracking.
- C. Adhesive: Manufacturers standard product including primer compatible with sheathing.
- D. Insulation:
1. Thermal Resistance: Thermal resistance (R-value), as indicated, measured by ASTM C177.
 2. Insulating Material: ASTM C578, as recommended by EIFS manufacturer and treated to be compatible with EIFS components. Age insulation minimum of 6 weeks before installation.
 3. Provide Type I Molded Expanded Polystyrene (MEPS) insulation board for Type PB systems, in sizes as required except maximum 600 mm X 1200 mm (24 X 48 inches) boards, and maximum 100 mm (4 inches) thick.
- E. Mechanical Anchors: As recommended by EIFS manufacturer.
- F. Accessories:
1. Trim, control joints, weep screed, edging, anchors, expansion joints, and other items required for proper installation as recommended by EIFS manufacturer.
 2. Metal Items and Fasteners: Corrosion resistant.

- G. Reinforcing Fabric: Balanced, open weave, glass fiber fabric made from twisted multi-end strands specifically treated for compatibility with the other materials of system.
 - 1. Minimum weight 100 g/sq. m (4.3 oz./sq. yd.).
- H. Base Coat: Manufacturer's standard.
- I. Finish Coat: Manufacturer's standard. Minimum thickness 1.5 mm (1/16 inch), complying with performance requirements. Finish, Color, and Texture to be selected from manufacturers full range.
- J. Sealant: ASTM C920; Class 50 with 100 percent recovery. Type, grade and use as recommended by sealant manufacturer.
 - 1. When required, provide non-staining primer, bond breaker, and backer rods as recommended by sealant manufacturer.
 - 2. Do not use absorptive materials as backer rods.
- K. Sealant: ASTM C920; Class 50 with 100 percent recovery. Type, grade and use recommended by sealant manufacturer.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Notify Contracting Officer's Representative in writing of conditions detrimental to proper completion of work.
- D. Do not proceed with work until unsatisfactory conditions are corrected.

3.2 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

3.3 CONTROL JOINT INSTALLATION

- A. See drawings for location of building control joints and surface control joints.
- B. Install surface control joints as follows:
 - 1. Exterior Insulation and Finish System. Install at 15 meters (50 feet) maximum in both directions and at building expansion

joints, floor lines and where EIFS intersects other materials per manufacturer's recommendations.

3.4 SEALANT INSTALLATION

- A.
- B. Exterior Insulation and Finish System: Apply sealant according to EIFS manufacturer's recommendation.
- C. Do not apply sealant in locations intended for water drainage.

3.5 EXTERIOR INSULATION AND FINISH SYSTEM INSTALLATION

- A. Insulation Board Layout: Place horizontally from level base line. Stagger vertical joints and interlock at corners. Butt joints tightly. Provide flush surfaces at joints. Offset insulation board joints from joints in sheathing minimum 200 mm (8 inches). Do not align joints with corners of doors, windows and other openings. Do not leave insulation board exposed longer than recommended by insulation manufacturer.
- B. Adhesive: Apply directly to entire back surface of the insulation board as recommended by the system manufacturer and immediately apply to gypsum board substrate. Apply firm pressure over entire board to ensure uniform contact and level surface. Allow adhesive to cure for 24 hours minimum before sanding.
- C. Create means of drainage between insulation board and gypsum board sheathing.
- D. Flash penetrations and terminations to discharge water to exterior.
- E. Mechanical Fasteners: Fasten with manufacturer's standard anchors, spaced as recommended by manufacturer, maximum 600 mm (24 inches) on center horizontally and vertically.
- F. Sanding: Sand entire surface of insulation before applying base coat, level high joints and remove dirt and weathering damage. Do not pre-fill low areas with basecoat.
- G. Base Coat: Trowel apply uniform thickness of base coat to insulation with minimum thickness of 1-1/2 times reinforcing fabric thickness and minimum 2.4 mm (3/32 inches) wet thickness.
- H. Install reinforcing fabric embedded in base coat. Provide diagonal reinforcement at opening corners, back wrapping, and other reinforcement recommended by EIFS manufacturer. Ensure fabric pattern is not visible beneath the surface of the basecoat after installation. Cure basecoat 24 hours minimum before applying finish coat.

I. Finish Coat:

1. Inspect basecoat for damage or defects and repair before applying finish coat.
2. Trowel apply finish coat minimum 1.6 mm (1/16 inch) thick.
3. Texture finish as required.
4. Surface Tolerance: Maximum 1/500 (1/4 inch in 10 feet) deviation from plumb and plane.

- - E N D - -

**SECTION 072600
UNDER SLAB VAPOR BARRIER**

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Vapor barrier, seam tape, and mastic for installation under concrete slabs.

B. Related Sections:

1. 033000 Cast-in-Place Concrete.

1.2 REFERENCES

A. American Society of Testing and Materials (ASTM):

1. ASTM E 1745-09 Standard Specification for Plastic Water Vapor Retarders Used in Contact with Soil or Granular Fill Under Concrete Slabs.
2. ASTM E 154-99 (2005) Standard Test Methods for Water Vapor Retarders Used in Contact with Earth Under Concrete Slabs, on Walls, or as Ground Cover.
3. ASTM E 96-05 Standard Test Methods for Water Vapor Transmission of Materials.
4. ASTM F 1249-06 Standard Test Method for Water Vapor Transmission Rate Through Plastic Film and Sheeting Using a Modulated Infrared Sensor.
5. ASTM E 1643-09 Selection, Design, Installation, and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs.

B. American Concrete Institute (ACI):

1. ACI 302.2R-06 Guide for Concrete Slabs that Receive Moisture-Sensitive Flooring Materials.

1.3 SUBMITTALS

A. Product Data: Provide physical properties.

B. Quality Assurance:

1. Summary of test results as per paragraph 8.3 of ASTM E 1745.
2. Manufacturer's samples, literature.

3. Manufacturer's installation instructions for placement, seaming and penetration repair instructions.

C. Manufacturer Certification: for Installation.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: A firm acceptable to the manufacturer for installation of specified products.

1.5 DELIVERY STORAGE AND HANDLING

- A. Deliver materials to Project site in original packages with seals unbroken, labeled with manufacturer's name, product brand name and type, date of manufacture, and directions for storing and mixing with other components.
- B. Store materials in their original undamaged packages in a clean, dry, protected location and within temperature range required by the manufacturer.
- C. Remove and replace materials that cannot be applied within their stated shelf life.
- D. Protect stored materials from direct sunlight. Do not expose materials vulnerable to water or sun damage in quantities greater than can be installed the same day.
- E. Store materials within temperature ranges recommended by product manufacturers.

1.6 WARRANTY

- A. Manufacturer warrants the product will perform to meet the specified reference standards.
- B. Manufacturer will visit Project site to inspect the work and certify the installation meets their recommendations.

PART 2 - PRODUCTS

2.1 MANUFACTURER

1. Basis of Design: Subject to compliance with requirements, provide Stego Wrap Vapor Barrier 15-mil by Stego Industries LLC or one of the following comparable products:

- a. Premolded membrane by W.R. Meadows.
- b. VaporGuard by Reef Industries, Inc.

B. Vapor barrier must have all of the following qualities:

1. Permeance of less than 0.01 Perms when tested in accordance with ASTM E 1745 Section 7.
2. Strength: ASTM E 1745 Class A.
3. Thickness: 15 mils minimum.
4. Provide tape, mastic, and other accessories recommended by the manufacturer. All system components shall be from the same manufacturer.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Ensure that base material is approved by the Architect and Geotechnical Engineer.
 1. Level and compact base material.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install vapor barrier in accordance with manufacturer's instructions and ASTM E 1643.
 1. Unroll vapor barrier with the longest dimension parallel with the direction of the concrete placement.
 2. Lap vapor barrier over footings and/or seal to foundation walls.
 3. Overlap joints 6 inches and seal with manufacturer's tape.
 4. Seal all penetrations (including pipes) per manufacturer's instructions.
 5. No penetration of the vapor barrier is allowed except for reinforcing steel and permanent utilities.
 6. Repair damaged areas by cutting patches of vapor barrier, overlapping damaged area 6 inches and taping all sides with tape.

END OF SECTION 072600

SECTION 07 27 27
FLUID-APPLIED MEMBRANE AIR BARRIERS, VAPOR RETARDING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Fluid-applied vapor-retarding air barrier at exterior above grade wall assemblies.
 2. Connection to adjacent air barrier components providing a durable, continuous, full building air barrier.

1.2 RELATED REQUIREMENTS

- A. General Quality Assurance and Quality Control Requirements: Section 01 45 29 TESTING LABORATORY SERVICES.
- B. General Sustainable Construction Requirements: Section 01 81 13 SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- C. Joint Sealants: Section 07 92 00 JOINT SEALANTS.
- D. Exterior Wall Openings Requiring Air Barrier Transitions: Division 08 sections for louvers and vents .
- E. Sheathings Substrates: Section 06 16 00.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. Air Barrier Association of America (ABAA):
1. Quality Assurance Program.
- C. ASTM International (ASTM):
1. C920-14a - Elastomeric Joint Sealants.
 2. C1193-13 - Use of Joint Sealants.
 3. D412-06a(2013) - Vulcanized Rubber and Thermoplastic Elastomers-Tension.
 4. E84-15a - Surface Burning Characteristics of Building Materials.
 5. E96/E96M-15 - Water Vapor Transmission of Materials.
 6. E162-15a - Surface Flammability of Materials Using a Radiant Heat Energy Source.
 7. E783-02(2010) - Field Measurement of Air Leakage Through Installed Exterior Windows and Doors.
 8. E1186-03(2009) - Air Leakage Site Detection in Building Envelopes and Air Barrier Systems.

9. E2178-13 - Air Permeance of Building Materials.
 10. E2357-11 - Determining Air Leakage of Air Barrier Assemblies.
- D. U.S. Environmental Protection Agency (EPA):
1. 40 CFR 59, Subpart D National Volatile Organic Compound Emission Standards for Consumer and Commercial Products.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
1. Indicate size, configuration, and fabrication and installation details.
- B. Manufacturer's Literature and Data:
1. Description of each product.
 2. Installation instructions.
- C. Sustainable Construction Submittals:
1. Low Pollutant-Emitting Materials:
 - a. Show volatile organic compound types and quantities.
- D. Test reports:
1. Submit field inspection and test reports.
- E. Certificates: Certify each product complies with specifications.
- F. Qualifications: Substantiate qualifications comply with specifications.
1. Manufacturer with project experience list.
 2. Installer with project experience list.
 - a. Certify installer approval by air barrier manufacturer.
- G. Installation Audit:
1. Submit audit report.

1.5 QUALITY ASSURANCE

- A. Coordinate work with adjacent and related work to provide continuous, unbroken, durable air barrier system.
- B. Manufacturer Qualifications:
1. Regularly and presently manufactures specified products.
 2. Manufactured specified products with satisfactory service on five similar installations for minimum five years.
 3. Accreditation by ABAA.
- C. Installer Qualifications:
1. Regularly and presently installs specified products.

2. Approved by manufacturer.
 3. Accredited by ABAA.
 4. Applicators certified according to ABAA Quality Assurance Program.
 5. Applicators trained and certified by manufacturer of air barrier system.
 6. Full time on-site field supervisor has completed three projects of similar scope within last year.
 7. Field Supervisor: Holds Sealant, Waterproofing, and Restoration Institute (SWRI) Wall Coating Validation Program Certificate, or similar qualification acceptable to Contracting Officer's Representative.
 8. Field supervisor accredited by ABAA as Level 3 Accredited Installer.
- D. Testing Agency Qualifications:
1. Accredited by International Accreditation Service, Inc. or American Association for Laboratory Accreditation.
 2. Certified perform ABAA Quality Assurance Program installer audits.
 3. Staff experienced in installation of specified system and qualified to perform observation and inspection specified and determine compliance with project requirements.

1.6 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight, conditioned facility.
- B. Protect products from damage during handling and construction operations.

1.8 FIELD CONDITIONS

- A. Environment:
 1. Work Area Ambient Temperature Range: 4 to 32 degrees C (40 to 90 degrees F) continuously, beginning 48 hours before installation.
- B. Surface Requirements: visibly dry, and complying with manufacturer's instructions.

1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

- A. Air-Barrier Assembly Air Leakage: Maximum 0.2 L/s/sq. m (0.04 cfm/sq. ft.) of surface area at 75 Pa (1.57 psf) differential pressure when tested according to ASTM E2357.
- B. Full Building Air Leakage: Refer to Section 01 45 29 TESTING LABORATORY SERVICES.
- C. Provide full system of compatible materials under conditions of service and application required. Compatibility based on testing by material manufacturer.
- D. Perform as continuous vapor retarding air barrier and moisture drainage plane.
- E. Transition to adjacent flashings and discharge water to building exterior.
- F. Accommodate substrate movement and seal expansion and control joints, construction material transitions, opening transitions, penetrations, and perimeter conditions without moisture deterioration and air leakage exceeding performance requirements.

2.2 PRODUCTS - GENERAL

- A. Provide air barrier system components from one manufacturer.
- B. Sustainable Construction Requirements:
 - 1. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Non-Flooring Adhesives and Sealants.

2.3 AIR BARRIER

- A. Fluid-Applied, Vapor-Retarding Membrane Air Barrier:
 - 1. Elastomeric, modified bituminous or synthetic polymer membrane.
 - 2. Air Permeance: ASTM E2178: 0.2 L/s/sq. m (0.04 cfm/sq. ft.) of surface area at 75 Pa (1.57 psf) differential pressure.

3. Vapor Permeance: ASTM E96/E96M: Maximum 5.8 ng/Pa/s/sq. m (0.1 perms).
4. Elongation: Ultimate, ASTM D412, Die C: 500 percent, minimum.
5. Thickness: Minimum 1.0 mm (40 mils) dry film thickness, applied in single continuous coat.
6. Surface Burning Characteristics: When tested according to ASTM E84S.
 - a. Flame Spread Rating: 25 maximum.
 - b. Smoke Developed Rating: 450 maximum.

2.4 ACCESSORIES

- A. Primer: Waterborne primer complying with VOC requirements, recommended air barrier manufacturer to suit application.
- B. Counterflashing Sheet: Modified bituminous, minimum 1.0 mm (40 mils) thick, self-adhering composite sheet consisting of minimum 0.8 mm (33 mils) of rubberized asphalt laminated to polyethylene film.
- C. Substrate Patching Material: Manufacturer's standard trowel-grade filler material.
- D. Sprayed Polyurethane Foam Sealant: Foamed-in-place, 24 to 32 kg/cu. m (1.5 to 2.0 pcf) density, with maximum flame-spread index of 25 when tested according to ASTM E84.
- E. Flexible Opening Transition: Cured low-modulus silicone extrusion with reinforcing ribs, sized to fit opening widths, designed for adhesion to or insertion into aluminum framing extrusions, and compatible with air barrier system materials and accessories.
- F. Joint Sealant: ASTM C920, single-component, neutral-curing silicone; Class 100/50 (low modulus), Grade NS, Use NT related to exposure, approved by membrane air barrier manufacturer for adhesion and compatibility with membrane air barrier and accessories.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Correct substrate deficiencies:
 1. Remove projections and excess materials and fill voids with substrate patching material.

2. Remove contaminants capable of affecting subsequently installed product's performance.

D. Prepare and treat substrate joints and cracks according to ASTM C1193 and membrane air barrier manufacturer's instructions.

3.2 INSTALLATION - AIR BARRIER

A. Install products according to manufacturer's instructions and approved submittals drawings.

1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

B. Install air barrier components according to requirements of ABAA Quality Assurance Program.

C. Apply primer.

D. Install transition strips and accessory materials.

E. Seal air barrier to adjacent components of building air barrier system.

F. Install flexible opening transition at each opening perimeter. Extend transition onto each substrate minimum 75 mm (3 inches).

1. Fill gaps at perimeter of openings with foam sealant.

G. At penetrations, seal transition strips around penetrating objects with termination mastic.

1. Fill gaps at perimeter of penetrations with sprayed polyurethane foam sealant.

H. At top of through-wall flashings, seal with continuous transition strip of manufacturer's recommended material to suit application.

I. Apply air barrier in full contact with substrate to produce continuous seal with transitions.

J. Apply fluid membrane in thickness recommended by manufacturer, and minimum specified thickness.

K. Leave air barrier exposed until tested and inspected and tested by Contracting Officer's Representative.

3.3 FIELD QUALITY CONTROL

A. Field Inspections and Tests: Performed by testing laboratory specified in Section 01 45 29, TESTING LABORATORY SERVICES.

1. Perform inspections and tests before concealing air barrier with subsequent work.

B. Inspections:

1. Compatibility of materials within air barrier system and adjacent materials.
2. Suitability of substrate and support for air barrier.
3. Suitability of conditions under which air barrier is applied.
4. Adequacy of substrate priming.
5. Application and treatment of joints and edges of transition strips, flexible opening transitions, and accessory materials.
6. Continuity and gap-free installation of air barrier, transition strips, and accessory materials.

C. Field Tests:

1. Qualitative air-leakage testing according to ASTM E1186.
2. Quantitative air-leakage testing according to ASTM E783.

D. Inspection and Test Frequency: Determined by installed air barrier surface area.

1. Up to 900 sq. m (10,000 sq. ft.): One inspection.

E. Submit inspection and test reports to Contracting Officer's Representative within seven calendar days of completing inspection and test.

F. Audit:

1. Provide installer and site inspection audit by ABAA.
2. Coordinate scheduling of work and associated audit inspections.
3. Cooperate with ABAA's testing agency. Allow access to work and staging areas.
4. Notify ABAA in writing of schedule for Work of this Section to allow sufficient time for testing and inspection.
5. Pay for site inspections by ABAA to verify conformance with the ABAA Quality Assurance Program.

G. Defective Work:

1. Correct deficiencies, make necessary repairs, and retest as required to demonstrate compliance with specified requirements.

3.4 CLEANING

- A. Remove masking materials.
- B. Clean spills and overspray using cleaning agents recommended by manufacturers of affected construction.

3.5 PROTECTION

- A. Protect air barrier from construction operations.
- B. Protect air barrier from exposure to UV light exposure exceeding manufacturer's recommendation.
- C. Replace overexposed materials and retest.

- - E N D - -

SECTION 074100
METAL ROOF PANELS

PART 1 GENERAL

1.1 SUMMARY

A. Section Includes: Sheet metal roofing panels, metal trim, accessories, fasteners, closures, and sealants.

B. Related Sections:

1. Section 051200 Structural Steel
2. Section 053100 Steel Deck
3. Section 054000 Cold-Formed Metal Framing
4. Section 072200 Roof and Deck Insulation
5. Section 076200 Sheet Metal Flashing and Trim
6. Section 079200 Joint Sealants

1.2 REFERENCES

A. General: Reference latest edition of applicable codes and standards.

B. American Society for Testing and Materials (ASTM):

1. ASTM A792/A792M-*Standard Specification for Steel Sheet, 55% Aluminum-Zinc-Alloy-Coated by the Hot-Dip Process.*
2. ASTM E1592-*Standard Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference.*
3. ASTM E1646-*Standard Test Method for Water Penetration of Exterior Metal Roof Panel Systems by Uniform Static Air Pressure Difference.*
4. ASTM E1680-*Standard Test Method for Rate of Air Leakage through Exterior Metal Roof Panel Systems*

C. *AISI Cold-Formed Steel Design Manual*, American Iron and Steel Institute (AISI).

D. *AISC Manual of Steel Construction*, American Institute of Steel Construction (AISC).

E. *UL Roofing Materials Directory*, Underwriters Laboratories, Inc. (UL).

1. UL Standard 580-Tests for Uplift Resistance of Roof Assemblies. [Specifier Note: Edit paragraphs below to suit project requirements]

F. Building Codes and Design Standards:

1. ASCE-7, Minimum Design Loads for Buildings and Other Structures, American Society of Civil Engineers (ASCE).

2. BOCA National Building Code, Building Officials and Code Administrators, International (BOCA).
3. Uniform Building Code (UBC), International Conference of Building Code Officials (IBCO).
4. International Building Code (IBC), International Code Council (ICC).

1.3 SYSTEM DESCRIPTION

A. Design Requirements:

1. Provide structural standing seam metal roof system with a min. 1-3/4" high "vertical" seam side joint, snap-together seam, with factory applied sealant.
2. Attach roof panels to support substrate with concealed anchor clips designed to allow for thermal movement of the panels. There shall be no exposed fasteners except at panel fixing line and flashing details or as indicated on approved panel drawings.
3. Provide metal roof panel system which has been manufactured and installed to withstand specified design loads and maintains performance requirements without defects, damage, or failure.

B. Performance Requirements:

1. Design Loads: Design loads shall be as specified below or as indicated on the contract drawings.
 - a. The structural standing seam metal roof system shall be designed to safely resist the positive and negative wind loads as specified below or as indicated on the contract drawings:
 - b. The structural standing seam metal roof system shall be designed to safely resist a 21 psf roof live load.
 - c. The structural standing seam metal roof system shall be designed to safely resist a 20 psf roof snow load. Unbalanced roof snow loads and snow drifts shall be determined in accordance with.
 - d. Roof systems that incorporate foam plastic insulation must be tested by the foam plastic manufacturer in accordance with NFPA-285.

2. Deflection Criteria: Roof panel deflection shall be limited to L/240 for positive loading.

A. Performance Testing: Tests shall have been conducted or witnessed by a recognized independent laboratory or independent professional engineer.

1. Allowable uniform uplift load capacity shall be determined in accordance with ASTM E1592.

- a. The factor of safety against ultimate failure of panel, batten, or clip shall be 1.65, with no increase due to wind.
 - b. Allowable uplift capacity for conditions of gage, span, or loading other than those tested may be determined by interpolation of the test results. Extrapolation of conditions outside the range of the tests is not acceptable.
2. Roof panel system shall be tested for resistance to water penetration in accordance with ASTM E 1646, at a static pressure of 7.0 psf. There shall be no uncontrolled water penetration through the panel side joints.
 3. Roof panel system shall be tested for resistance to air leakage in accordance with ASTM E1680, at a static air pressure of 4.0 psf. There shall be no measurable leakage.
 4. Roof panel system shall be tested in accordance with UL Standard 580 and have a Class 90 rating.

1.4 SUBMITTALS

- A. Product Data: Submit manufacturer's product data sheet and/or product design and installation manual.
- B. Shop Drawings: Submit panel shop drawings consisting of design and erection drawings, finish specifications, and other data necessary to clearly describe design, materials, sizes, layouts, construction details, fasteners, and erection. Submit small scale layouts of panels and large scale details of edge conditions, joints, fastener and sealant placement, flashings, penetrations and curbs, and special details. Distinction must be made between factory and field assembled work. Drawings must be approved and field verification of all dimensions must occur prior to fabrication.
- C. Samples:
 1. Panel: Two (2) required, full panel width by 12" long.
 2. Anchor Clips: Two (2) required.
 3. Fasteners: Two (2) of each type with a statement of intended use.
 4. Sealants: One (1) sample of each type, with a statement of intended use.
- D. Warranties: Submit manufacturer's applicable sample warranties of products.
- E. Quality Assurance Submittals:
 1. Calculations: Submit structural design calculations certified by a registered professional engineer to verify load carrying capacity of the panel system.
 2. Test Reports: Submit certified test reports showing that the roof system has been tested and conforms to the specified performance testing requirements.
 3. Certificates:

- a. A written statement from the manufacturer certifying conformance with the specified manufacturer's qualifications listed in article 1.05 QUALITY ASSURANCE.
- b. A written statement from the installer certifying conformance with the specified installer qualifications listed in article 1.05 QUALITY ASSURANCE.

1.5 QUALITY ASSURANCE

A. Qualifications:

1. Manufacturers Qualifications: The manufacturer shall have had at least fifteen (15) years in architectural metal roofing design and installation. The manufacturer shall have a permanent, stationary, indoor, production facility.

2. Installer Qualifications:

- a. The installer shall have had a minimum of five (5) years experience in the installation of metal roofing.
- b. The installer shall be manufacturer certified.

B. Pre-installation Meeting: Conduct pre-installation meeting to verify project requirements, substrate conditions, manufacturer's installation instructions, and manufacturer's warranty requirements.

1.6 DELIVERY, STORAGE, AND HANDLING

A. Delivery: Material shall be delivered to the site in a dry and undamaged condition and unloaded per the manufacturers instructions. The installer shall inspect materials for damage and stains upon arrival at the site.

B. Storage: Materials shall be stored out of contact with the ground in weather tight coverings to keep them dry per the manufacturer's recommendations. Storage accommodations shall provide good air circulation and protection from surface staining.

C. Handling: Exercise care in unloading, storing, and handling of panels to prevent bending, warping, twisting, or surface damage. Follow manufacturer's recommendations for material handling.

1.07 WARRANTIES

A. Manufacturer's Warranties

1. Material Warranty: The manufacturer shall warrant that the material furnished will remain free from defects in material and workmanship for a period of two (2) years from date of shipment.

2. Metal Substrate Warranty: The manufacturer shall warrant that the metal roof panel substrate will not rupture or perforate due to corrosion within a period of twenty (20) years from date of shipment.

3. Finish Warranty: The manufacturer shall warrant against fading, chalking, peeling, cracking, checking, chipping, or erosion to base metal of the roof panel paint finish for a period of twenty (20) years from date of shipment.
- b. Standard Warranty: The manufacturer shall warrant against water penetration of the metal roof panel system, including panel side joint and trim conditions for a period of 5 years from date of substantial completion. During the first two (2) years of the warranty, the roofing contractor shall be liable for all such costs and expenses of repair, refinishing, or replacement of the roofing system as covered by the warranty. Coverage shall be limited to material and installation. Manufacturer's liability shall be limited to material value paid to the manufacturer. Erector's liability shall be limited to the dollar amount paid for erection.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. The CENTRIA SDP 175 structural standing seam metal roof system as manufactured by CENTRIA,

2.2 MATERIALS

- A. Metal Panels: SDP 175 structural standing seam panel as manufactured by CENTRIA.
1. Fabricate metal panels from aluminum-zinc coated steel conforming to ASTM A792 Grade 50B with AZ50 coating when painted or AZ55 coating when unpainted. Thickness shall be minimum 22 gage.
 2. Panels shall be a min. of 16" wide with a 1-3/4" vertical seam height.
 3. Panels shall have longitudinal stiffening ribs in the pan to minimize "oil canning" effect, or be flat in the pan with no minor ribs.
- B. Concealed Anchor Panel Clips: Fasten metal roof panels to support substrate with concealed anchor clips eliminating all through fastener penetrations.
1. Panel Clips shall be a one piece clip 18ga minimum thickness made from 300 series stainless steel.

2.3 FINISHES

- B. Paint Finishes: Coating systems shall have been tested in accordance with ASTM standard test methods for factory color finish. Exterior color shall be chosen from manufacturer's standard colors.
1. Polyvinylidene Fluoride (PVDF): Two-coat system consisting of a nominal 0.2 mil corrosion inhibitive primer on both sides with a 0.75 mil fluoropolymer exterior topcoat and 0.30 mil backer finish.

2.4 ACCESSORIES

A. Fasteners: Use only high quality fasteners as recommended or approved by the roof system manufacturer. Follow fastener manufacturers' recommendations for fastener installation.

1. Screws: Self-drilling screws shall be min. #10 diameter. Self-tapping screws shall be min. #14 diameter.
 - a. Exposed self-drilling and self-tapping screws shall have a zinc die-cast head with neoprene washer or be 300 series stainless steel with neoprene washer. All exposed fasteners shall be painted to match panel color.
 - b. Concealed screws shall be carbon steel with corrosion resistant coating or 300 series stainless steel as required.

2. Rivets:

- a. Structural bulbed rivets shall be min. 3/16" diameter, standard dome head, aluminum rivet and mandrel, with a weather tight EPDM washer under the head. Min. 5/16" diameter, large flange head, aluminum rivet and mandrel, with a weather tight EPDM washer under the head is required at panel endlaps.
- b. Trim rivets shall be min. 5/32" diameter, stainless steel body and stem with open end or aluminum body and stem with closed end.
- c. Rivets shall be painted to match panel color.

B. Closures:

1. All panel end closures shall be field-formed from metal "Z" closures, manufactured from the same material, color, and finish as the roofing.

C. Sealants: Use only high quality sealants as recommended or approved by the roof system manufacturer. Sealants must not contain oils, asbestos, or asphalts.

1. Non-Curing Butyl: One-part, non-skinning, non-drying, synthetic butyl elastomer. Use for metal-to-metal sealing or bedding of panel and flashing seams or joints.
2. Butyl Tape (Webbed Mastic): Extruded polymeric butyl tape, non-skinning and not easily displaced under compression. Use for critical sealing of panel ends, endlaps, penetrations, closures, and flashings.
3. Self-Adhering Roof Underlayment: Acceptable Product: Grace Ice and Water Shield.
4. Urethane: One-part moisture curing, gun grade polyurethane sealant. Used for sealing in all exposed conditions.

2.5 FLASHING

A. All flashing shall be of the same material, gage, finish, color, and texture as the panels unless otherwise noted.

- B. Flashing design shall conform to details submitted and approved by the Architect and, if required, the panel manufacturer.

2.6 FABRICATION

- A. Where possible panels shall be manufactured in continuous lengths, full length of panel runs.

PART 3 EXECUTION

3.01 EXAMINATION

- A. The installer shall inspect the building to verify that the structure is ready for roofing installation.
 - 1. All supports shall be in place with all bracing and connections tightened before work proceeds.
 - 2. Field-check dimensions and check support alignment with a taut string or wire; panel misalignment may induce "oil canning" and potentially restrict panel movement.
 - a. Panel/purlin erection tolerances:
 - 1. Maximum out-of-plane deviation shall be limited to +/-3/16" from control.
 - 2. Maximum deviation of 1/8" between adjacent purlins or L/500 which ever is less.
 - 3. Do not proceed until unsatisfactory conditions are corrected.

3.2 INSTALLATION

- A. Install metal roofing system in accordance with approved erection drawings and manufacturer's installation instructions.
- B. Install metal roofing system so that it is weather-tight, without waves, warps, buckles, fastening stress or distortion.
- C. Do not walk on panels until panels are fastened to substructure and seams are snapped together.
- D. Protect installed panels from abuse by other trades. The general contractor shall be responsible for protecting the roofing from wet cement, plaster, and paint operations. The installer shall provide walk boards in heavy traffic areas to prevent damage to the panels.

3.3 DAMAGED MATERIAL AND CLEANING

- A. Replace panels and other components of work which have been damaged beyond repair.
- B. To prevent rust staining, remove immediately from finished surfaces any filings caused by drilling or cutting.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

C. Wipe down each area after erection is complete for final acceptance.

SECTION 07 42 13.13

METAL WALL PANELS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Exposed fastener metal wall panels, as part of the assembly described in Section 2.1.

1.2 RELATED REQUIREMENTS

- A. Division 01 Section "Sustainable Design Requirements" for related requirements.
- B. Division 07 Section "Sheet Metal Flashing and Trim" for sheet metal copings, flashings, reglets and roof drainage items.
- C. Division 07 Section "Joint Sealants" for field-applied joint sealants.

1.3 REFERENCES

- A. American Architectural Manufacturer's Association (AAMA):
 - 1. AAMA 620 - Voluntary Specification for High Performance Organic Coatings on Coil Coated Architectural Aluminum Substrates.
 - 2. AAMA 621 - Voluntary Specification for High Performance Organic Coatings on Coil Coated Architectural Hot Dipped Galvanized (HDG) and Zinc-Aluminum Coated Steel Substrates.
- B. American Society of Civil Engineers (ASCE):
 - 1. ASCE 7 - Minimum Design Loads for Buildings and Other Structures.
- C. ASTM International (ASTM):
 - 1. ASTM A 653/A 653M - Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
 - 2. ASTM A 666 - Standard specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.
 - 3. ASTM A 755/A 755M - Specification for Steel Sheet, Metallic Coated by the Hot-Dip Process and Prepainted by the Coil-Coating Process for Exterior Exposed Building Products.
 - 4. ASTM A 792/A 792M - Standard specification for Steel Sheets, 55% Aluminum - Zinc Alloy. Coated by hot-dip process.
 - 5. ASTM B 209 - Specification for Aluminum and Aluminum Alloy Sheet and Plate.
 - 6. ASTM C 754 - Specification for Installation of Steel Framing Members to Receive Screw Attached Gypsum Panel Products.

7. ASTM C 920 - Specification for Elastomeric Joint Sealants.
8. ASTM E 72 - Standard Test Methods of Conducting Strength Tests of Panels for Building Construction.
9. ASTM E 283 - Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors under Specified Pressure Differences across the Specimen.
10. ASTM E 331 - Test Method for Water Penetration of Exterior Windows, Curtain Walls, and Doors by Uniform Static Air Pressure Difference.

D. Sheet Metal and Air Conditioning Contractors National Association, Inc. (SMACNA):

1. Architectural Sheet Metal Manual.

1.4 PERFORMANCE REQUIREMENTS

- A. General: Provide metal wall panel assemblies meeting performance requirements as determined by application of specified tests by a qualified testing agency on manufacturer's standard assemblies.
- B. Air Infiltration: When installed over Insulated Composite Backup Panels or Metal Liner Panels, maximum 0.06 cfm/sq. ft. (0.3 L/s per sq. m) per ASTM E 283 at a static-air-pressure difference of 1.57 lbf/sq. ft. (75 Pa), using minimum 10-by-10 foot (3050-by-3050 mm) test panel that includes side joints.
- C. Water Penetration, Static Pressure: When installed over Insulated Composite Backup Panels or Metal Liner Panels, no uncontrolled water penetration per ASTM E 331 at a minimum static differential pressure of 6.24 lbf/sq. ft. (299 Pa), using minimum 10-by-10 foot (3050-by-3050 mm) test panel that includes side joints.
- D. Florida State Building Code Compliance: Provide wall panels that comply with the requirements for installation under Florida State Building Code aside of the High Velocity Hurricane Zone.
- E. Maximum allowable deflection limitation.
 1. Single Skin Panels Less than 1-inch (25-mm) in Depth: Limited to L/90 deflection of panel perimeter normal to plane of wall.
 2. Single Skin Panels greater than 1-inch (25-mm) in Depth: Limited to L/120 deflection of panel perimeter normal to plane of wall.
 3. All Exposed Fastener Series panels specified with Liner Panels: Limited to L/180 deflection of panel perimeter normal to plane of wall.
- F. Secondary Metal Framing: Design secondary metal framing for metal wall panel assembly according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions."
- G. Thermal Movements: Allow for thermal movements from variations in both ambient and internal temperatures. Accommodate movement of support structure caused by thermal expansion and contraction.

1.5 QUALITY ASSURANCE

- A. Manufacturer/Source: Provide metal wall panel and panel accessories from a single manufacturer.
- B. Manufacturer Qualifications: Approved manufacturer listed in this Section with minimum 10 years experience in manufacture of similar products in successful use in similar applications.
 - 1. Approval of Comparable Products: Submit the following in accordance with project substitution requirements, within time allowed for substitution review:
 - a. Product data, including certified independent test data indicating compliance with requirements.
 - b. Samples of each component.
 - c. Project references: Minimum of 5 installations not less than 5 years old, with Owner and Architect contact information.
 - d. Sample warranty.
 - 2. Substitutions following award of contract are not allowed except as stipulated in Division 01 General Requirements.
 - 3. Approved manufacturers must meet separate requirements of Submittals Article.
- C. Wall Systems Installer Qualifications: Experienced Installer with minimum of 5 years experience with successfully completed projects of a similar nature and scope.

1.6 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Conduct preinstallation meeting at site attended by Owner, Architect, manufacturer's representative, and other trade contractors.
 - 1. Coordinate building framing in relation to metal wall panel assembly.
 - 2. Coordinate installation of building air and water barrier behind metal wall panel assembly.
 - 3. Coordinate window, door and louver, and other openings and penetrations of metal wall panel assembly.

1.7 ACTION SUBMITTALS

- A. Product Data: Manufacturer's data sheets, for specified products.
 - 1. Include data indicating compliance with performance requirements.
- B. Shop Drawings: Provide shop drawings prepared by manufacturer or manufacturer's authorized Installer. Include full elevations showing openings and penetrations. Include details of each condition of installation and attachment. Provide details at a minimum scale 1-1/2-inch per foot (1:8) of all required trim and extrusions needed for a complete installation.

1. Indicate points of supporting structure that must coordinate with metal wall panel assembly installation.
 - C. Samples for Initial Selection: For each product specified. Provide representative color charts of manufacturer's full range of colors.
 - D. Samples for Verification: Provide 12-inch (300 mm) section of panel(s) showing finishes. Provide 12-inch (300 mm) long pieces of trim pieces and other exposed components.
- 1.8 INFORMATIONAL SUBMITTALS
- A. Product Test Reports: Indicating compliance of products with requirements, from a qualified independent testing agency.
 - B. Buy American Act Certification: Submit documentation certifying that products comply with provisions of the Buy American Act 41 U.S.C 10a - 10d.
 - C. Qualification Information: For Installer firm.
 - D. Manufacturer's warranty: Submit sample warranty.
- 1.9 CLOSEOUT SUBMITTALS
- A. Maintenance data.
- 1.10 DELIVERY, STORAGE, AND HANDLING
- A. Protect metal wall panel products during shipping, handling, and storage to prevent staining, denting, deterioration of components or other damage.
 1. Deliver, unload, store, and erect metal wall panel products and accessory items without misshaping panels or exposing panels to surface damage from weather or construction operations.
- 1.11 WARRANTY
- A. Special Manufacturer's Warranty: On manufacturer's standard form, in which manufacturer agrees to repair or replace components of metal wall panel assemblies that fail in materials and workmanship within [two] years from date of Substantial Completion.
 - B. Special Panel Finish Warranty: On manufacturer's standard form, in which manufacturer agrees to repair or replace metal wall panels that display evidence of deterioration of finish within 20 years from the date of substantial completion.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Metal Wall Panels and Metal Liner Panel Wall System: Single-skin exposed fastener metal wall panels applied as the exterior cladding over wall framing specified in Division 05 Section "Cold-Formed Metal Framing". Metal wall panel installation specified in this Section includes secondary metal subgirt framing for panel attachment and an interior sealed-joint metal liner panel that provides air and water vapor control.
1. Water-resistive barrier is required for Horizontal Liner applications and is under Division 07 Section "Weather Barriers."
 2. Air, moisture, and water vapor control membrane is provided under Division 07 Section "Air Barriers."

2.2 MANUFACTURERS

- A. Basis of Design: CENTRIA, IW Series IW-10A or comparable product.
1. CENTRIA Architectural Systems; Moon Township, PA 15108-2944. Tel: (800)759-7474. Tel: (412)299-8000. Fax: (412)299-8317. Email: info@CENTRIA.com. Web: www.CENTRIA.com.

2.3 METAL WALL PANEL MATERIALS

- A. Metallic-Coated Steel Face Sheet: Coil-coated, ASTM A 755/A 755M.
1. Zinc-Coated (Galvanized) Steel Sheet: ASTM A 653/A 653M, G90 (Class Z275), structural steel.
 2. Face Sheet: Minimum 0.036 inch/20 gage (0.91 mm) [nominal uncoated thickness.
 3. Surface: Smooth.

2.4 EXPOSED FASTENER PROFILE METAL WALL PANELS

- A. Metal Wall Panels, General: Factory-formed, Exposed fastener panels with interconnecting side joints, fastened to supports with exposed fasteners, with field-applied sealants in side laps when required to meet performance requirements.
1. Fluoropolymer Two-Coat System: 0.8 mil primer with 0.8 mil 70 percent PVDF fluoropolymer color coat, AAMA 621.
 - a. Basis of Design: CENTRIA Duragard.
- B. Color:
1. Exterior Surface: As selected by Architect from manufacturer's standard colors.
 2. Interior Surface: Manufacturer's standard primer color.

2.5 METAL WALL PANEL ACCESSORIES

- A. Metal Wall Panel Backup System: Refer to Division 07 Section "Insulated-Composite Backup Panel System."
- B. Metal Wall Panel Accessories, General: Provide complete metal wall panel assembly incorporating trim, copings, fasciae, parapet caps, soffits, sills, inside and outside corners, and miscellaneous flashings. Fabricate accessories in accordance with SMACNA Manual. Provide manufacturer's factory-formed clips, shims, flashings, gaskets, lap strips, closure strips, and caps for a complete installation as required for the following:
 - 1. Single-skin application over insulated, sheathed frame wall with air and water resistant barrier.
- C. Extruded Trim: Manufacturer's complementary aluminum extrusions for head, jamb, sill, base, flush, reveal, inside and outside corner, end wall, and expansion joint details. Finish to match metal wall panels.
 - 1. Basis of Design: CENTRIA, Microline Extrusions.
- D. Mitered Corners: Structurally-bonded horizontal interior and exterior trimless corners matching metal wall panel material, profile, and factory-applied finish, fabricated and finished by metal wall panel manufacturer.
 - 1. Welded, riveted, fastened, or field-fabricated corners do not meet the requirements of this specification.
 - 2. Basis of Design: CENTRIA, MicroSeam Corners.
- E. Formed Flashing and Trim: Match material, thickness, and color of metal wall panel face sheets.
- F. Sealants: Type recommended by metal wall panel manufacturer for application, meeting requirements of Division 07 Section "Joint Sealants."
- G. Flashing Tape: 4-inch wide self-adhering butyl flashing tape.
- H. Fasteners: Self-tapping screws, bolts, nuts, and other acceptable fasteners recommended by panel manufacturer. All exposed fasteners must be stainless steel with heads matching color of metal wall panels by means of factory-applied coating.

2.6 SECONDARY METAL FRAMING

- A. Miscellaneous Framing Components, General: Cold-formed metallic-coated steel sheet, ASTM A 653/A 653M, G90 (Z180).
 - 1. Hat Channels: 0.06 inch/16 ga. (1.52 mm) minimum - nominal thickness.
 - 2. Sill Channels: 0.06 inch/16 ga. (1.52 mm) minimum - nominal thickness.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine metal wall panel substrate with Installer present. Inspect for erection tolerances and other conditions that would adversely affect installation of metal wall panels.
- B. Wall Substrate: Confirm that wall substrate is within tolerances acceptable to metal wall panel system manufacturer.
 - 1. Maximum deviations acceptable:
 - a. 1/4-inch in 20 feet (6.4 mm in 6 m) vertically or horizontally from face plane of framing.
 - b. 1/2-inch (12.7 mm) across building elevation.
 - c. 1/8-inch in 5 feet (3.2 mm in 1.5 m).
- C. Framing: Inspect framing that will support metal wall panels to determine if support components are installed as indicated on approved shop drawings. Confirm presence of acceptable framing members at recommended spacing to match installation requirements of metal wall panels.
- D. Openings: Verify that windows, doors, louvers and other penetrations match layout on shop drawings.
- E. Air/Moisture Barriers: Confirm that work has been completed, inspected, and tested as required.
- F. Advise G.C, in writing, of out-of-tolerance work and other deficient conditions prior to proceeding with metal wall panel system installation.
- G. Correct out of tolerance work and other deficient conditions prior to panel installation.

3.2 SECONDARY FRAMING INSTALLATION

- A. Secondary Metal Framing: Install secondary metal framing components to tolerances indicated, as shown on approved shop drawings. Install secondary metal framing and other metal panel supports per ASTM C 1007 and metal wall panel manufacturer's recommendations.

3.3 METAL WALL PANEL INSTALLATION

- A. General: Install metal wall panels in accordance with approved shop drawings and manufacturer's recommendations. Install metal wall panels in orientation, sizes, and locations indicated. Anchor metal wall panels and other components securely in place.
- B. Attach panels to metal framing using recommended screws, fasteners, sealants, and adhesives indicated on approved shop drawings.

1. Fasteners for Steel Wall Panels: Stainless-steel for exterior locations and locations exposed to moisture; carbon steel for interior use only.
2. Provide weatherproof escutcheons for pipe and conduit penetrating exterior walls.
3. Dissimilar Materials: Where elements of metal wall panel system will come into contact with dissimilar materials, treat faces and edges in contact with dissimilar materials as recommended by manufacturer.

C. Joint Sealers: Install joint sealants where indicated on approved shop drawings.

3.4 ACCESSORY INSTALLATION

A. General: Install metal wall panel accessories with positive anchorage to building. Coordinate installation with flashings and other components.

1. Install related flashings and sheet metal trim per requirements of Division 07 Section "Sheet Metal Flashing and Trim."
2. Install components required for a complete metal wall panel assembly, including trim, copings, corners, lap strips, flashings, sealants, fillers, closure strips, and similar items.
3. Comply with performance requirements and manufacturer's written installation instructions.
4. Set units true to line and level as indicated.

3.5 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a service representative authorized by metal wall panel manufacturer to inspect completed installation. Submit written report.
- B. Correct deficiencies noted in manufacturer's report.

3.6 CLEANING AND PROTECTION

- A. Remove temporary protective films. Clean finished surfaces as recommended by metal wall panel manufacturer. Clear weep holes and drainage channels of obstructions, dirt, and sealant. Maintain in a clean condition during construction.
- B. Replace damaged panels and accessories that cannot be repaired by finish touch-up or minor repair.

END OF SECTION

SECTION 07 53 23
ETHYLENE-PROPYLENE-DIENE-MONOMER ROOFING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Ethylene Propylene Diene Monomer (EPDM) sheet roofing adhered metal roof deck.
2. Fire rated roof system.

1.2 RELATED REQUIREMENTS

- A. Non-Flooring Adhesives and Sealants VOC Limits: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Vapor Retarder, Roof Insulation: Section 07 22 00, ROOF AND DECK INSULATION.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. American National Standards Institute/Single-Ply Roofing Institute (ANSI/SPRI):
 1. FX-1-01(R2006) - Standard Field Test Procedure for Determining the Withdrawal Resistance of Roofing Fasteners.
 2. RP-4 2013 - Wind Design Standard for Ballasted Single-ply Roofing Systems.
- C. American Society of Civil Engineers/Structural Engineering Institute (ASCE/SEI):
 1. 7-10 - Minimum Design Loads For Buildings and Other Structures.
- D. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):
 1. 90.1-13 - Energy Standard for Buildings Except Low-Rise Residential Buildings.
- E. ASTM International (ASTM):
 1. A276/A276M-15 - Stainless Steel Bars and Shapes.
 2. B209-14 - Aluminum and Aluminum-Alloy Sheet and Plate.
 3. B209M-14 - Aluminum and Aluminum-Alloy Sheet and Plate (Metric).
 4. C67-14 - Sampling and Testing Brick and Structural Clay Tile.
 5. C140/C140M-15 - Sampling and Testing Concrete Masonry Units and Related Units.
 6. C936/C936M-15 - Solid Concrete Interlocking Paving Units.

7. C1371-15 - Determination of Emittance of Materials Near Room Temperature Using Portable Emissometers.
 8. C1549-09(2014) - Determination of Solar Reflectance Near Ambient Temperature Using a Portable Solar Reflectometer.
 9. D751-06(2011) - Coated Fabrics.
 10. D1248-12 - Polyethylene Plastics Extrusion Materials for Wire and Cable.
 11. D1876-08(2015)e1 - Peel Resistance of Adhesives (T-Peel Test).
 12. D2103-15 - Polyethylene Film and Sheeting.
 13. D2240-05(2010) - Rubber Property-Durometer Hardness.
 14. D3884-09(2013)e1 - Abrasion Resistance of Textile Fabrics (Rotary Platform, Double-Head Method).
 15. D4263-83(2012) - Indicating Moisture in Concrete by the Plastic Sheet Method.
 16. D4586/D4586M-07(2012)e1 - Asphalt Roof Cement, Asbestos-Free.
 17. D4637/D4637M-14e1 - EPDM Sheet Used In Single-Ply Roof Membrane.
 18. E96/E96M-15 - Water Vapor Transmission of Materials.
 19. E408-99(2015) - Total Normal Emittance of Surfaces Using Inspection-Meter Techniques.
- F. National Roofing Contractors Association (NRCA):
1. Manual-15 - The NRCA Roofing Manual: Membrane Roof Systems.
- G. U.S. Department of Agriculture (USDA): USDA BioPreferred Catalog.
- H. UL LLC (UL):
1. 580-06 - Tests for Uplift Resistance of Roof Assemblies.
 2. 1897-15 - Uplift Tests for Roof Covering Systems.
- I. U.S. Department of Commerce National Institute of Standards and Technology (NIST):

1.4 PREINSTALLATION MEETINGS

- A. Conduct preinstallation meeting at the Project site minimum 30 days before beginning Work of this section.
1. Required Participants:
 - a. Contracting Officer's Representative.
 - b. Architect/Engineer.
 - c. Inspection and Testing Agency.
 - d. Contractor.
 - e. Installer.

2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
 - a. Installation schedule.
 - b. Installation sequence.
 - c. Preparatory work.
 - d. Protection before, during, and after installation.
 - e. Installation.
 - f. Terminations.
 - g. Transitions and connections to other work.
 - h. Inspecting and testing.
 - i. Other items affecting successful completion.
 - j. Pull out test of fasteners.
 - k. Material storage, including roof deck load limitations.
3. Document and distribute meeting minutes to participants to record decisions affecting installation.

1.5 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 1. Roofing membrane layout.
 2. Roofing membrane fastener pattern and spacing.
 3. Roofing membrane seaming and joint details.
 4. Roof membrane penetration details.
 5. Base flashing and termination details.
- C. Manufacturer's Literature and Data:
 1. Description of each product.
 2. Minimum fastener pull out resistance.
 3. Installation instructions.
 4. Warranty.
- D. Sustainable Construction Submittals:
 1. Low Pollutant-Emitting Materials:
 - a. Show volatile organic compound types and quantities.
- E. Samples:
 1. Roofing Membrane: 150 mm (6 inch) square.
 2. Base Flashing: 150 mm (6 inch) square.
 3. Fasteners: Each type.
 4. Roofing Membrane Seam: 300 mm (12 inches) square.

- F. Certificates: Certify products comply with specifications.
 - 1. Fire and windstorm classification.
 - 2. Energy performance requirements.
- G. Qualifications: Substantiate qualifications comply with specifications.
 - 1. Installer, including supervisors with project experience list .
 - 2. Manufacturer's field representative with project experience list .
- H. Field quality control reports.
- I. Operation and Maintenance Data:
 - 1. Maintenance manuals.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications:
 - 1. Approved by roofing system manufacturer as installer for roofing system with specified warranty.
 - 2. Regularly installs specified products.
 - 3. Installed specified products with satisfactory service on five similar installations for minimum five years.
 - a. Project Experience List: Provide contact names and addresses for completed projects.
 - 4. Employs full-time supervisors experienced installing specified system and able to communicate with Contracting Officer's Representative and installer's personnel.
- B. Manufacturer's Field Representative:
 - 1. Manufacturer's full-time technical employee or independent roofing inspector.
 - 2. Individual certified by Roof Consultants Institute as Registered Roof Observer.

1.7 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.8 STORAGE AND HANDLING

- A. Comply with NRCA Manual storage and handling requirements.
- B. Store products indoors in dry, weathertight facility.
- C. Store adhesives according to manufacturer's instructions.

- D. Protect products from damage during handling and construction operations.
- E. Products stored on the roof deck must not cause permanent deck deflection.

1.9 FIELD CONDITIONS

- A. Environment:
 - 1. Product Temperature: Minimum 4 degrees C (40 degrees F) and rising before installation.
 - 2. Weather Limitations: Install roofing only during dry current and forecasted weather conditions.

1.10 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant roofing system against material and manufacturing defects and agree to repair any leak caused by a defect in the roofing system materials or workmanship of the installer.
 - 1. Warranty Period: 10 years.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Roofing System: Adhered roofing membrane, base flashing, roof insulation, fasteners, vapor retarders copings.

2.2 SYSTEM PERFORMANCE

- A. Design roofing system meeting specified performance:
 - 1. Load Resistance: ASCE/SEI 7; Design criteria as indicated on Drawings.

2.3 PRODUCTS - GENERAL

- A. Basis of Design: Carlisle Syntec.
- B. Provide roof system components from one manufacturer.
- C. Sustainable Construction Requirements:
 - 1. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Non-flooring adhesives and sealants.

2.4 EPDM ROOFING MEMBRANE

- A. EPDM Sheet: ASTM D4637/D4637M, Type II - internally reinforced.
 - 1. Thickness: 1.5 mm (60 mils).
- B. Additional Properties:

PROPERTY	TEST METHOD	REQUIREMENT
Shore A Hardness	ASTM D2240	55 to 75 Durometer
Water Vapor Permeance	ASTM E96/E96M	Minimum 8 ng/Pa/s/sq. m (0.14 perms) Water Method
Fungi Resistance	ASTM G21	After 21 days, no sustained growth or discoloration.

- 1. Use fire retardant membrane when not protected by ballast or pavers. Verify for UL or approval.

2.5 MEMBRANE ACCESSORY MATERIALS

- A. Sheet roofing manufacturer's specified products.
- B. Flashing Sheet: Manufacturer's standard; same material, and color as roofing membrane.
 - 1. Self-curing EPDM flashing adaptable to irregular shapes and surfaces.
 - 2. Minimum Thickness: 1.5 mm (0.060 inch).
- C. Factory Formed Flashings: Inside and outside corners, pipe boots, and other special flashing shapes to minimize field fabrication.
- D. Splice Adhesive or Tape: Manufacturer's standard for roofing membrane and flashing sheet.
- E. Splice Lap Sealant: Liquid EPDM rubber for exposed lap edge.
- F. Bonding Adhesive: Manufacturer's standard, water solvent based, to suit substrates.
- G. Termination Bars: Manufacturer's standard, stainless steel or aluminum, 25 mm wide by 3 mm thick (1 inch wide by 1/8 inch thick) factory drilled for fasteners.
- H. Pipe Compression Clamp:
 - 1. Stainless steel drawband.
- I. Fasteners: Manufacturer's standard coated steel with metal or plastic plates, to suit application.

- J. Fastener Sealer: One part elastomeric adhesive sealant.
- K. Temporary Closure Sealers (Night Sealant): Polyurethane two part sealer.
- L. Primers, Splice Tapes, Cleaners, and Butyl Rubber Seals: As specified by roof membrane manufacturer.
- M. Asphalt Roof Cement: ASTM D4586/D4586M.

2.6 FASTENERS

- A. Fasteners and washers required for securing pavers together with straps and to walls or other anchorage:
 - 1. Straps for Securing Pavers Together:
 - a. Stainless Steel: ASTM A276/A276M, Type 302 or 304, minimum 0.46 mm (0.018 inch) thick.
 - b. Aluminum Strap: ASTM B209/B209M, minimum 2.39 mm (0.094 inch) thick.
 - c. Round corners on straps.
 - d. Form straps 38 mm (1-1/2 inches) wide, 3 m (10 feet) maximum length with 6 by 10 mm (1/4 by 3/8 inch) punched slotted holes at 100 mm (4 inch) centers centered on width of strap. Punch hole size 2 mm (1/16 inch) larger than fastener shank when shank is thicker than 5 mm (3/16 inch).
- B. Fasteners or Connectors for Pavers:
 - 1. For Concrete Pavers: Extruded interlocking hollow shape polyethylene connector:
 - a. ASTM D1248, Type 1, low density, Class C, black weather resistant, Grade E6, tensile strength 15 MPa (2200 psi), Shore D hardness of 4, brittleness low temperature - 82 degrees C (180 degrees F), softening temperature above 80 degrees C (176 degrees F).
 - b. Length: 50 mm (2 inches), with center stop and insert leg with ribs to resist withdrawal; minimum 1.3 mm (0.05 inch) thick.
 - 2. Fasteners for Pavers Straps:
 - a. Stainless steel as recommended by manufacturer of paver in which fastener is anchored.
 - b. Fasteners that are not acceptable include:
 - Impact or power actuated fasteners.
 - Fasteners that do not require a predrilled pilot hole.
 - Fasteners with lead or white metal anchors.

Plastic anchors not stabilized against ultraviolet light.

- C. SEPARATION SHEET 2.7 VAPOR BARRIER Polyethylene Film: ASTM D2103, 0.2 mm (6 mils) thick.

2.8 WALKWAY PADS

- D. Manufacturer's standard, slip resistant, approximately 450 mm by 450 mm (30 by 30 inches) square and 5 mm (3/16 inch) thick with rounded corners.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine and verify substrate suitability for product installation with roofing installer and roofing inspector present.
1. Verify roof penetrations are complete, secured against movement, and firestopped .
 2. Verify roof deck is adequately secured to resist wind uplift.
 3. Verify roof deck is clean, dry, and in-plane ready to receive roofing system.
- B. Correct unsatisfactory conditions before beginning roofing work.

3.2 PREPARATION

- A. Complete roof deck construction before beginning roofing work:
1. Curbs, blocking, edge strips, and other components to which roofing and base flashing is attached in place ready to receive insulation and roofing.
 2. Coordinate roofing membrane installation with flashing work and roof insulation work so insulation and flashing are installed concurrently to permit continuous roofing operations.
 3. Complete installation of flashing, insulation, and roofing in same day except for the area where temporary protection is required when work is stopped for inclement weather or end of work day.
- B. Dry out surfaces including roof deck flutes, that become wet from any cause during progress of the work before roofing work is resumed. Apply materials to dry substrates, only.
- C. Broom clean roof decks. Remove dust, dirt and debris.
- D. Remove projections capable of damaging roofing materials.

3.3 TEMPORARY PROTECTION

- A. Install temporary protection consisting of a temporary seal and water cut-offs at the end of each day's work and when work is halted for an indefinite period or work is stopped when precipitation is imminent.
- B. Install temporary cap flashing over top of base flashings where permanent flashings are not in place to protect against water intrusion into roofing system. Securely anchor in place to prevent blow off and damage by construction activities.
- C. Temporarily seal exposed insulation surfaces within roofing membrane.
 - 1. Apply temporary seal and water cut off by extending roofing membrane beyond insulation and securely embedding edge of the roofing membrane in 6 mm (1/4 inch) thick by 50 mm (2 inches) wide strip of temporary closure sealant. Weight roofing membrane edge with sandbags, to prevent displacement; space sandbags maximum 2400 mm (8 feet) on center.
 - 2. Direct water away from work. Provide drainage, preventing water accumulation.
 - 3. Check daily to ensure temporary seal remains watertight. Reseal open areas and weight down.
- D. Before the work resumes, cut off and discard portions of roof membrane in contact with temporary seal.
 - 1. Cut minimum 150 mm (6 inches) back from sealed edges and surfaces.
- E. Remove sandbags and store for reuse.

3.4 INSTALLATION, GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Comply with NRCA Manual installation requirements.
- C. Comply with UL 580 for uplift resistance.
- D. Do not allow membrane and flashing to contact surfaces contaminated with asphalt, coal tar, oil, grease, or other substances incompatible with EPDM.

3.5 ROOFING INSTALLATION

- A. Install membrane perpendicular to long dimension of insulation boards.

- B. Begin membrane installation at roof low point and work towards high point. Lap membrane shingled in water flow direction.
- C. Position membrane free of buckles and wrinkles.
- D. Roll membrane out; inspect for defects as membrane is unrolled. Remove defective areas:
 - 1. Allow 30 minutes for membrane to relax before proceeding.
 - 2. Lap edges and ends minimum 75 mm (3 inches). Clean lap surfaces.
 - 3. Install seam adhesive or tape, unless furnished with factory applied adhesive strips. Apply pressure to develop full adhesion.
 - 4. Check seams to ensure continuous adhesion and correct defects.
 - 5. Finish seam edges with beveled bead of lap sealant.
 - 6. Finish seams same day as membrane is installed.
 - 7. Anchor membrane perimeter to roof deck and parapet wall as indicated on drawings.
- E. Adhered System Installation:
 - 1. Apply bonding adhesive in quantities required by roofing membrane manufacturer.
 - 2. Fold sheet back on itself, clean and coat the bottom side of the membrane and the top of substrate with adhesive. Do not coat the lap joint area.
 - 3. After adhesive has set according to adhesive manufacturer's instructions, roll roofing membrane into adhesive minimizing voids and wrinkles.
 - 4. Repeat for other half of sheet.
 - 5. Cut voids and wrinkles to lay flat. Clean and patch cut area.

3.6 FLASHING INSTALLATION

- A. Install flashings on same day as roofing membrane is installed. When flashing cannot be completely installed in one day, complete installation until flashing is watertight and provide temporary covers or seals.
- B. Flashing Roof Drains:
 - 1. Install roof drain flashing according to roofing membrane manufacturer's instructions.
 - a. Coordinate to set the metal drain flashing in asphalt roof cement, holding cement back from the edge of the metal flange.
 - b. Do not allow roof cement to contact EPDM roofing membrane.
 - c. Adhere roofing membrane to metal flashing with bonding adhesive.

2. Turn metal drain flashing and roofing membrane down into drain body.
Install clamping ring and strainer.
- C. Installing Base Flashing and Pipe Flashing:
1. Install flashing sheet to pipes, walls and curbs to minimum 200 mm (8 inches) height above roof surfaces and extend roofing manufacturer's standard lap dimension onto roofing membranes.
 - a. Adhere flashing with bonding adhesive.
 - b. Form inside and outside corners of flashing sheet according to NRCA Manual. Form pipe flashing according to NRCA Manual.
 - c. Lap ends roofing manufacturer's standard dimension.
 - d. Adhesively splice flashing sheets together, and adhesively splice flashing sheets to roofing membranes. Finish exposed edges with lap sealant.
 2. Anchor top of flashing to walls and curbs with fasteners spaced maximum 150 mm (6 inches) on center. Use surface mounted fastening strip with sealant on ducts. Use pipe clamps on pipes or other round penetrations.
 3. Apply sealant to top edge of flashing.
- D. Repairs to Membrane and Flashings:
1. Remove sections of roofing membrane or flashing sheet that are creased, wrinkled, or fishmouthed.
 2. Cover removed areas, cuts and damaged areas with patch extending 100 mm (4 inches) beyond damaged, cut, or removed area. Adhesively splice patch to roofing membrane or flashing sheet. Finish edge of lap with lap sealant.

3.7 WALKWAY PAD INSTALLATION

- A. Clean membrane where pads are applied.
- B. Adhere pads to membrane with splicing cement.
- C. Layout with minimum 25 mm (1 inch) and maximum 50 mm (2 inch) space between pads.

3.8 FIELD QUALITY CONTROL

- A. Field Tests: Performed by testing laboratory specified in Section 01 45 29, TESTING LABORATORY SERVICES.
 1. Fastener Pull Out Tests: ANSI/SPRI FX-1; one test for every 230 sq. m (2,500 sq. ft.) of deck. Perform tests for each

combination of fastener type and roof deck type before installing roof insulation.

- a. Test at locations selected by Contracting Officer's Representative.
- b. Do not proceed with roofing work when pull out resistance is less than manufacturer's required resistance.
- c. Test Results:

Repeat tests using different fastener type or use additional fasteners achieve pull out resistance required to meet specified wind uplift performance.

Patch cementitious deck to repair areas of fastener tests holes.

2. Examine and probe roofing membrane and flashing seams in presence of Contracting Officer's Representative and Manufacturer's field representative.
 3. Probe seams to detect marginal bonds, voids, skips, and fishmouths.
 4. Cut 100 mm (4 inch) wide by 300 mm (12 inch) long samples through seams where directed by Contracting Officer's Representative.
 5. Cut one sample for every 450 m (1500 feet) of seams.
 6. Cut samples perpendicular to seams.
 7. Failure of samples to pass ASTM D1876 test will be cause for rejection of work.
 8. Repair areas where samples are taken and where marginal bond, voids, and skips occur.
 9. Repair fishmouths and wrinkles by cutting to lay flat. Install patch over cut area extending 100 mm (4 inches) beyond cut.
- B. Manufacturer Services:
1. Inspect initial installation, installation in progress, and completed work.
 2. Issue supplemental installation instructions necessitated by field conditions.
 3. Prepare and submit inspection reports.
 4. Certify completed installation complies with manufacturer's instructions and warranty requirements.

3.9 CLEANING

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed roofing surfaces. Remove contaminants and stains.

3.10 PROTECTION

- A. Protect roofing system from traffic and construction operations.
 - 1. Protect roofing system when used for subsequent work platform, materials storage, or staging.
 - 2. Distribute scaffolding loads to exert maximum 50 percent roofing system materials compressive strength.
- B. Loose lay temporary insulation board overlaid with plywood or OSB.
 - 1. Weight boards to secure against wind uplift.
- C. Remove protection when no longer required when directed by Contacting Officer's Representative .
- D. Repair damage.

- - E N D - -

**SECTION 07 60 00
FLASHING AND SHEET METAL**

PART 1 - GENERAL

1.1 DESCRIPTION

Formed sheet metal work for wall and roof flashing, and formed expansion joint covers are specified in this section.

1.2 RELATED WORK

- A. Manufactured flashing, copings, roof edge metal, and fasciae: Section 07 71 00 ROOF SPECIALTIES.
- B. Flashing components of factory finished roofing and wall systems: Division 07 roofing and wall system sections.
- C. Joint Sealants: Section 07 92 00, JOINT SEALANTS.
- D. Color of factory coated exterior architectural metal and anodized aluminum items: Section 09 06 00, SCHEDULE FOR FINISHES.
- E. Integral flashing components of manufactured roof specialties and accessories or equipment: Section 07 71 00, ROOF SPECIALTIES

1.3 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only. Editions of applicable publications current on date of issue of bidding documents apply unless otherwise indicated.
- B. Aluminum Association (AA):
 - AA-C22A41Aluminum Chemically etched medium matte, with clear anodic coating, Class I Architectural, 0.7-mil thick
 - AA-C22A42Chemically etched medium matte, with integrally colored anodic coating, Class I Architectural, 0.7 mils thick
 - AA-C22A44Chemically etched medium matte with electrolytically deposited metallic compound, integrally colored coating Class I Architectural, 0.7-mil thick finish
- C. American National Standards Institute/Single-Ply Roofing Institute (ANSI/SPRI):

ANSI/SPRI ES-1-03Wind Design Standard for Edge Systems Used with
Low Slope Roofing Systems

D. American Architectural Manufacturers Association (AAMA):

AAMA 620Voluntary Specification for High Performance
Organic Coatings on Coil Coated Architectural
Aluminum

AAMA 621Voluntary Specification for High Performance
Organic Coatings on Coil Coated Architectural
Hot Dipped Galvanized (HDG) and Zinc-Aluminum
Coated Steel Substrates

E. ASTM International (ASTM):

A240/A240M-14Standard Specification for Chromium and
Chromium-Nickel Stainless Steel Plate, Sheet
and Strip for Pressure Vessels and for General
Applications.

A653/A653M-11Steel Sheet Zinc-Coated (Galvanized) or Zinc
Alloy Coated (Galvanized) by the Hot- Dip
Process

B32-08Solder Metal

B209-10Aluminum and Aluminum-Alloy Sheet and Plate

B370-12Copper Sheet and Strip for Building
Construction

D173-03 (R2011)Bitumen-Saturated Cotton Fabrics Used in
Roofing and Waterproofing

D412-06 (R2013)Vulcanized Rubber and Thermoplastic Elastomers-
Tension

D1187-97 (R2011)Asphalt Base Emulsions for Use as Protective
Coatings for Metal

D1784-11Rigid Poly (Vinyl Chloride) (PVC) Compounds and
Chlorinated Poly (Vinyl Chloride) (CPVC)
Compounds

D3656-07Insect Screening and Louver Cloth Woven from
Vinyl-Coated Glass Yarns

D4586-07Asphalt Roof Cement, Asbestos Free

F. Sheet Metal and Air Conditioning Contractors National Association
(SMACNA): Architectural Sheet Metal Manual.

G. National Association of Architectural Metal Manufacturers (NAAMM):

AMP 500-06Metal Finishes Manual

H. Federal Specification (Fed. Spec):

A-A-1925AShield, Expansion; (Nail Anchors)

UU-B-790ABuilding Paper, Vegetable Fiber

I. International Code Commission (ICC): International Building Code,
Current Edition

1.4 PERFORMANCE REQUIREMENTS

A. Wind Uplift Forces: Resist the following forces per FM Approvals 1-49:

1. Wind Zone 1: 0.48 to 0.96 kPa (10 to 20 lbf/sq. ft.): 1.92-kPa
(40-lbf/sq. ft.) perimeter uplift force, 2.87-kPa (60-lbf/sq. ft.)
corner uplift force, and 0.96-kPa (20-lbf/sq. ft.) outward force.

2. Wind Zone 1: 1.00 to 1.44 kPa (21 to 30 lbf/sq. ft.): 2.87-kPa
(60-lbf/sq. ft.) perimeter uplift force, 4.31-kPa (90-lbf/sq. ft.)
corner uplift force, and 1.44-kPa (30-lbf/sq. ft.) outward force.

3. Wind Zone 2: 1.48 to 2.15 kPa (31 to 45 lbf/sq. ft.): 4.31-kPa
(90-lbf/sq. ft.) perimeter uplift force, 5.74-kPa (120-lbf/sq. ft.)
corner uplift force, and 2.15-kPa (45-lbf/sq. ft.) outward force.

4. Wind Zone 3: 2.20 to 4.98 kPa (46 to 104 lbf/sq. ft.): 9.96-kPa
(208-lbf/sq. ft.) perimeter uplift force, 14.94-kPa (312-lbf/sq.
ft.) corner uplift force, and 4.98-kPa (104-lbf/sq. ft.) outward
force.

B. Wind Design Standard: Fabricate and install copings, flashings tested
per ANSI/SPRI ES-1 to resist design pressure.

1.5 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT
DATA, AND SAMPLES.

B. Shop Drawings: For all specified items, including:

1. Flashings
2. Copings

C. Manufacturer's Literature and Data: For all specified items, including:

1. Two-piece counterflashing
2. Thru wall flashing
3. Expansion joint cover, each type

- D. Certificates: Indicating compliance with specified finishing requirements, from applicator and contractor.

PART 2 - PRODUCTS

2.1 FLASHING AND SHEET METAL MATERIALS

- A. Stainless Steel: ASTM A240, Type 302B, dead soft temper.
- B. Aluminum Sheet: ASTM B209, alloy 3003-H14 except alloy used for color anodized aluminum shall be as required to produce specified color. Alloy required to produce specified color shall have the same structural properties as alloy 3003-H14.

2.2 FLASHING ACCESSORIES

- A. Solder: ASTM B32; flux type and alloy composition as required for use with metals to be soldered.
- B. Rosin Paper: Fed-Spec. UU-B-790, Type I, Grade D, Style 1b, Rosin-sized sheathing paper, weighing approximately 3 Kg/10 m² (6 lbs/100 sf).
- C. Bituminous Paint: ASTM D1187, Type I.
- D. Fasteners:
1. Use copper, copper alloy, bronze, brass, or stainless steel for copper and copper clad stainless steel, and stainless steel for stainless steel and aluminum alloy. Use galvanized steel or stainless steel for galvanized steel.
 2. Nails:
 - a. Minimum diameter for aluminum nails 3 mm (0.105 inch).
 - b. Minimum diameter for stainless steel nails: 2 mm (0.095 inch) and annular threaded.
 - c. Length to provide not less than 22 mm (7/8 inch) penetration into anchorage.
 3. Rivets: Not less than 3 mm (1/8 inch) diameter.
 4. Expansion Shields: Fed Spec A-A-1925A.
- E. Sealant: As specified in Section 07 92 00, JOINT SEALANTS for exterior locations.
- F. Roof Cement: ASTM D4586.

2.3 SHEET METAL THICKNESS

- A. Except as otherwise shown or specified use thickness or weight of sheet metal as follows:
- B. Concealed Locations (Built into Construction):
 - 1. Flexible Stainless steel: 0.25 mm (0.010 inch) thick.
- C. Exposed Locations:
 - 1. Stainless steel: 0.4 mm (0.015 inch).

2.4 FABRICATION, GENERAL

- A. Jointing:
 - 1. In general, copper, stainless steel and copper clad stainless steel joints, except expansion and contraction joints, shall be locked and soldered.
 - 2. Jointing of copper over 0.5 Kg (20 oz) weight or stainless steel over 0.45 mm (0.018 inch) thick shall be done by lapping, riveting and soldering.
 - 3. Joints shall conform to following requirements:
 - a. Flat-lock joints shall finish not less than 19 mm (3/4 inch) wide.
 - b. Lap joints subject to stress shall finish not less than 25 mm (one inch) wide and shall be soldered and riveted.
 - c. Unsoldered lap joints shall finish not less than 100 mm (4 inches) wide.
 - 4. Flat and lap joints shall be made in direction of flow.
 - 5. Edges of bituminous coated copper, copper covered paper, nonreinforced elastomeric sheeting and polyethylene coated copper shall be jointed by lapping not less than 100 mm (4 inches) in the direction of flow and cementing with asphalt roof cement or sealant as required by the manufacturer's printed instructions.
 - 6. Soldering:
 - a. Pre tin both mating surfaces with solder for a width not less than 38 mm (1 1/2 inches) of uncoated copper, stainless steel, and copper clad stainless steel.
 - b. Wire brush to produce a bright surface before soldering lead coated copper.

- c. Treat in accordance with metal producers recommendations other sheet metal required to be soldered.
 - d. Completely remove acid and flux after soldering is completed.
- B. Expansion and Contraction Joints:
1. Fabricate in accordance with the Architectural Sheet Metal Manual recommendations for expansion and contraction of sheet metal work in continuous runs.
 2. Space joints as shown or as specified.
 3. Space expansion and contraction joints for copper, stainless steel, and copper clad stainless steel at intervals not exceeding 7200 mm (24 feet).
 4. Space expansion and contraction joints for aluminum at intervals not exceeding 5400 mm (18 feet), except do not exceed 3000 mm (10 feet) for gravel stops and fascia-cant systems.
 5. Fabricate slip-type or loose locked joints and fill with sealant unless otherwise specified.
 6. Fabricate joint covers of same thickness material as sheet metal served.
- C. Cleats:
1. Fabricate cleats to secure flashings and sheet metal work over 300 mm (12 inches) wide and where specified.
 2. Provide cleats for maximum spacing of 300 mm (12 inch) centers unless specified otherwise.
 3. Form cleats of same metal and weights or thickness as the sheet metal being installed unless specified otherwise.
 4. Fabricate cleats from 50 mm (2 inch) wide strip. Form end with not less than 19 mm (3/4 inch) wide loose lock to item for anchorage. Form other end of length to receive nails free of item to be anchored and end edge to be folded over and cover nail heads.
- D. Edge Strips or Continuous Cleats:
1. Fabricate continuous edge strips where shown and specified to secure loose edges of the sheet metal work.
 2. Except as otherwise specified, fabricate edge strips or minimum 0.6 mm (0.024 inch) thick stainless steel, or 1.25 mm (0.050 inch) thick aluminum, whichever is applicable.
 3. Use material compatible with sheet metal to be secured by the edge strip.

4. Fabricate in 3000 mm (10 feet) maximum lengths with not less than 19 mm (3/4 inch) loose lock into metal secured by edge strip.
5. Fabricate Strips for fascia anchorage to extend below the supporting wood construction to form a drip and to allow the flashing to be hooked over the lower edge at least 19 mm (3/4-inch).
6. Fabricate anchor edge maximum width of 75 mm (3 inches) or of sufficient width to provide adequate bearing area to insure a rigid installation using 0.8 mm (0.031 inch) thick stainless steel, or 1.6 mm (0.0625 inch) thick aluminum, whichever is applicable.

E. Drips:

1. Form drips at lower edge of sheet metal counter-flashings (cap flashings), fascias, gravel stops, wall copings, by folding edge back 13 mm (1/2 inch) and bending out 45 degrees from vertical to carry water away from the wall.
2. Form drip to provide hook to engage cleat or edge strip for fastening for not less than 19 mm (3/4 inch) loose lock where shown.

F. Edges:

1. Edges of flashings concealed in masonry joints opposite drain side shall be turned up 6 mm (1/4 inch) to form dam, unless otherwise specified or shown otherwise.
2. Finish exposed edges of flashing with a 6 mm (1/4 inch) hem formed by folding edge of flashing back on itself when not hooked to edge strip or cleat. Use 6 mm (1/4 inch) minimum penetration beyond wall face with drip for through-wall flashing exposed edge.
3. All metal roof edges shall meet requirements of IBC, current edition.

G. Metal Options:

1. Stainless steel may be used in concealed locations for fasteners of other metals exposed to view.

2.5 FINISHES

- A. Use same finish on adjacent metal or components and exposed metal surfaces unless specified or shown otherwise.

- B. In accordance with NAAMM Metal Finishes Manual AMP 500, unless otherwise specified.
- C. Finish exposed metal surfaces as follows, unless specified otherwise:
 - 1. Stainless Steel: Finish No. 2B or 2D.
 - 2. Aluminum:
 - a. Clear Finish: AA-C22A41 medium matte, clear anodic coating, Class 1 Architectural, 18 mm (0.7 mils) thick.

2.6 THROUGH-WALL FLASHINGS

- A. Form through-wall flashing to provide a mechanical bond or key against lateral movement in all directions. Install a sheet having 2 mm (1/16 inch) deep transverse channels spaced four to every 25 mm (one inch), or ribbed diagonal pattern, or having other deformation unless specified otherwise.
 - 1. Fabricate in not less than 2400 mm (8 feet) lengths; 3000 mm (10 feet) maximum lengths.
 - 2. Fabricate so keying nests at overlaps.
- B. For Masonry Work When Concealed Except for Drip:
 - 1. Either copper, stainless steel, or copper clad stainless steel.
 - 2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
 - 3. Form exposed portions of flashing with drip, approximately 6 mm (1/4 inch) projection beyond wall face.
- C. For Masonry Work When Exposed Edge Forms a Receiver for Counter Flashing:
 - 1. Use same metal and thickness as counter flashing.
 - 2. Form an integral dam at least 5 mm (3/16 inch) high at back edge.
 - 3. Form exposed portion as snap lock receiver for counter flashing upper edge.
- D. For Flashing at Architectural Precast Concrete Panels or Stone Panels.
 - 1. Use plan flat sheet of stainless steel.
 - 2. Form exposed portions with drip as specified or receiver.
- E. Window Sill Flashing and Lintel Flashing:
 - 1. Use either copper, stainless steel, copper clad stainless steel plane flat sheet, or nonreinforced elastomeric sheeting, bituminous coated copper, copper covered paper, or polyethylene coated copper.

2. Fabricate flashing at ends with folded corners to turn up 5 mm (3/16 inch) in first vertical masonry joint beyond masonry opening.
3. Turn up back edge as shown.
4. Form exposed portion with drip as specified or receiver.

F. Basis of Design: York Multi-Flash Stainless Steel

1. Type: Stainless steel core with polymer fabric laminated to the bottom stainless steel face with non-asphalt adhesive. The top face (exposed side) must not be covered with a polymer fabric.
2. Stainless steel: type 304, ASTM A240. Domestically sourced per DFARS 252.225-7008 and/or DFARS 252.225-7009.
3. Fabric: polymer fabric; laminated back face (non-exposed side) of stainless steel core.

:

2.7 BASE FLASHING

- A. Do not use galvanized steel for base flashing.
- B. Use metal base flashing at vertical surfaces intersecting built-up roofing without cant strips or where shown.
 1. Use either copper, or stainless steel, thickness specified unless specified otherwise.
 2. When flashing is over 250 mm (10 inches) in vertical height or horizontal width use either 0.5 Kg (20 oz) copper or 0.5 mm (0.018 inch) stainless steel.
 3. Use stainless steel at aluminum roof curbs where flashing contacts the aluminum.
 4. Use either copper, or stainless steel at pipe flashings.
- C. Fabricate metal base flashing up vertical surfaces not less than 200 mm (8 inch) nor more than 400 mm (16 inch).
- D. Fabricate roof flange not less than 100 mm (4 inches) wide unless shown otherwise. When base flashing length exceeds 2400 mm (8 feet) form flange edge with 13 mm (1/2 inch) hem to receive cleats.
- E. Form base flashing bent from strip except pipe flashing. Fabricate ends for riveted soldered lap seam joints. Fabricate expansion joint ends as specified.
- F. Pipe Flashing: (Other than engine exhaust or flue stack)
 1. Fabricate roof flange not less than 100 mm (4 inches) beyond sleeve on all sides.

2. Extend sleeve up and around pipe and flange out at bottom not less than 13 mm (1/2 inch) and solder to flange and sleeve seam to make watertight.
3. At low pipes 200 mm (8 inch) to 450 mm (18 inch) above roof:
 - a. Form top of sleeve to turn down into the pipe at least 25 mm (one inch).
 - b. Allow for loose fit around and into the pipe.
4. At high pipes and pipes with goosenecks or other obstructions which would prevent turning the flashing down into the pipe:
 - a. Extend sleeve up not less than 300 mm (12 inch) above roofing.
 - b. Allow for loose fit around pipe.

2.8 COUNTERFLASHING (CAP FLASHING OR HOODS)

- A. Either copper or stainless steel, unless specified otherwise.
- B. Fabricate to lap base flashing a minimum of 100 mm (4 inches) with drip:
 1. Form lock seams for outside corners. Allow for lap joints at ends and inside corners.
 2. In general, form flashing in lengths not less than 2400 mm (8 feet) and not more than 3000 mm (10 feet).
 3. Two-piece, lock in type flashing may be used in-lieu-of one piece counter-flashing.
 4. Manufactured assemblies may be used.
 5. Where counterflashing is installed at new work use an integral flange at the top designed to be extended into the masonry joint or reglet in concrete.
 6. Where counterflashing is installed at existing work use surface applied type, formed to provide a space for the application of sealant at the top edge.
- C. One-piece Counterflashing:
 1. Back edge turned up and fabricate to lock into reglet in concrete.
 2. Upper edge formed to extend full depth of masonry unit in mortar joint with back edge turned up 6 mm (1/4 inch).
- D. Two-Piece Counterflashing:
 1. Receiver to extend into masonry wall depth of masonry unit with back edge turned up 6 mm (1/4 inch) and exposed edge designed to receive and lock counterflashing upper edge when inserted.

2. Counterflashing upper edge designed to snap lock into receiver.
- E. Surface Mounted Counterflashing; one or two piece:
1. Use at existing or new surfaces where flashing can not be inserted in vertical surface.
 2. One piece fabricate upper edge folded double for 65 mm (2 1/2 inches) with top 19 mm (3/4 inch) bent out to form "V" joint sealant pocket with vertical surface. Perforate flat double area against vertical surface with horizontally slotted fastener holes at 400 mm (16 inch) centers between end holes. Option: One piece surface mounted counter-flashing (cap flashing) may be used. Fabricate as detailed on Plate 51 of SMACNA Architectural Sheet Metal Manual.
 3. Two pieces: Fabricate upper edge to lock into surface mounted receiver. Fabricate receiver joint sealant pocket on upper edge and lower edge to receive counterflashing, with slotted fastener holes at 400 mm (16 inch) centers between upper and lower edge.
- F. Pipe Counterflashing:
1. Form flashing for water-tight umbrella with upper portion against pipe to receive a draw band and upper edge to form a "V" joint sealant receiver approximately 19 mm (3/4 inch) deep.
 2. Fabricate 100 mm (4 inch) over lap at end.
 3. Fabricate draw band of same metal as counter flashing. Use 0.6 Kg (24 oz) copper or 0.33 mm (0.013 inch) thick stainless steel or copper coated stainless steel.
 4. Use stainless steel bolt on draw band tightening assembly.
 5. Vent pipe counter flashing may be fabricated to omit draw band and turn down 25 mm (one inch) inside vent pipe.
- G. Where vented edge decks intersect vertical surfaces, form in one piece, shape to slope down to a point level with and in front of edge-set notched plank; then, down vertically, overlapping base flashing.

2.9 GRAVEL STOPS

- A. General:
1. Fabricate in lengths not less than 2400 mm (8 feet) long and maximum of 3000 mm (10 feet).
 2. Fabricate internal and external corners as one-piece with legs not less than 600 mm (2 feet) or more than 1200 mm (4 feet) long.
 3. Fabricate roof flange not less than 100 mm (4 inches) wide.

4. Fabricate top edge to extend above roof not less than 25 mm (one inch) for embedded gravel aggregate and not less than 100 mm (4 inches) for loose laid ballast.
 5. Fabricate lower edge outward at an angle of 45 degrees to form drip and as fascia or as counter flashing as shown:
 - a. Fabricate of one-piece material of suitable width for fascia height of 250 mm (10 inch) maximum or counterflashing lap of not less than 100 mm (4 inch) over base flashing.
 - b. Fabricate bottom edge of formed fascia to receive edge strip.
 - c. When fascia bottom edge forms counter flashing over roofing lap roofing not less than 150 mm (6 inches).
- B. Formed Flat Sheet Metal Gravel Stops and Fascia:
1. Fabricate as shown of .05 mm (0.018 inch) thick stainless steel or 1.25 mm (0.050 inch) thick aluminum, whichever is applicable.
 2. When fascia exceeds 150 mm (6 inches) in depth, form one or more horizontal stops not less than 13 mm (1/2 inch) high in the fascia.
 3. Fabricate as two-piece fascia when fascia depth exceeds 250 mm (10 inches).
 4. At joint between ends of sheets, provide a concealed clip soldered or welded near one end of each sheet to hold the adjoining sheet in lapped position. The clip shall be approximately 100 mm (4 inches) wide and shall be the full depth of the fascia less 25 mm (one inch) at top and bottom. Clip shall be of the same thickness as the fascia.
 5. Provide edge strip as specified with lower hooked edge bent outward at an angle of 45 degrees.

2.10 BOX HANGING GUTTERS (TYPE A)

- A. Fabricate gutters of not less than the following:
 - 1.
 3. 0.051//inch) thick aluminum.
- B. Fabricate hanging gutters in sections not less than 2400 mm (8 feet) long, except at ends of runs where shorter lengths are required.
- C. Building side of gutter shall be same height as exterior side.
- D. Gutter Bead: Stiffen outer edge of gutter by folding edge over approximately 19 mm (3/4 inch) toward roof and down approximately 19 mm (3/4 inch) unless shown otherwise.

E. Gutter Spacers:

1. Fabricate of same material and thickness as gutter.
2. Fabricate 25 mm (one inch) wide strap and fasten to gutters not over 900 mm (36 inches) on center.
3. Turn back edge up 25 mm (one inch) and lap front edge over gutter bead.
4. Rivet and solder to gutter except rivet and seal to aluminum.

F. Outlet Tubes:

1. Form outlet tubes to connect gutters to conductors of same metal and thickness as gutters extend into the conductor 75 mm (3 inch). Flange upper end of outlet tube 13 mm (1/2 inch).
- 2.

G. Gutter Brackets:

1. Fabricate of same metal as gutter. Use the following:
c. 6 by 25 mm (1/4 by 1 inch) aluminum.
2. Fabricate to gutter profile.
3. Drill two 5 mm (3/16 inch) diameter holes in anchor leg for countersunk flat head screws.

2.11 CONDUCTORS (DOWNSPOUTS)

- A. Fabricate conductors of same metal and thickness as gutters in sections approximately 3000 mm (10 feet) long [with 19 mm (3/4 inch) wide flat locked seams].
1. Fabricate open face channel shape with hemmed longitudinal edges.
- B. Fabricate elbows by mitering, riveting, and soldering except seal aluminum in lieu of solder. Lap upper section to the inside of the lower piece.
- C. Fabricate conductor brackets or hangers of same material as conductor, 2 mm (1/16 inch) thick by 25 mm (one inch) minimum width. Form to support conductors 25 mm (one inch) from wall surface in accordance with Architectural Sheet Metal Manual Plate 34, Design E for round shapes.
- D. Conductor Heads:
1. Fabricate of same material as conductor.
 2. Fabricate conductor heads to not less than 250 mm (10 inch) wide by 200 mm (8 inch) deep by 200 mm (8 inches) from front to back.

3. Form front and side edges channel shape not less than 13 mm (1/2 inch) wide flanges with edge hemmed.
4. Slope bottom to sleeve to conductor or downspout at not less than 60 degree angle.
5. Extend wall edge not less than 25 mm (one inch) above front edge.
6. Solder joints for water tight assembly.
7. Fabricate outlet tube or sleeve at bottom not less than 50 mm (2 inches) long to insert into conductor.

2.15 INSULATED EXPANSION JOINT COVERS

- A. Either type optional, use only one type throughout.
- B. Types:
 1. Construct of two preformed, stainless steel strips, not less than 0.4 mm (0.015 inch) thick, mechanically and adhesively bonded to both sides of a 2 mm (1/16 inch) thick neoprene or butyl sheet, or to a 0.4 mm (32 mil) thick reinforced chlorinated polyethylene sheet. Adhesively attach a 10 mm (3/8 inch) thick sheet of closed cell, neoprene foam insulation, to the underside of the neoprene, butyl, or chlorinated polyethylene sheet.
 2. Constructed of a 2 mm (1/16 inch) thick vinyl sheet, flanged at both sides with stainless steel strips not less than 0.4 mm (0.015 inch) thick. Vinyl sheet locked and encased by the stainless steel strip and prepunched for nailing. A 10 mm (3/8 inch) thick closed cell polyvinyl chloride foam insulating strip shall be heat laminated to the underside of the vinyl sheet between the stainless steel strips.
- C. Expansion joint covers shall have factory fabricated mitered corners, crossing tees, and other necessary accessories. Furnish in the longest available lengths.
- D. Metal flange of sufficient width to extend over the top of the curb and down curb sides 50 mm (2 inches) with hemmed edge for lock to edge strip.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General:
 1. Install flashing and sheet metal items as shown in Sheet Metal and Air Conditioning Contractors National Association, Inc.,

- publication, ARCHITECTURAL SHEET METAL MANUAL, except as otherwise shown or specified.
2. Apply Sealant as specified in Section 07 92 00, JOINT SEALANTS.
 3. Apply sheet metal and other flashing material to surfaces which are smooth, sound, clean, dry and free from defects that might affect the application.
 4. Remove projections which would puncture the materials and fill holes and depressions with material compatible with the substrate. Cover holes or cracks in wood wider than 6 mm (1/4 inch) with sheet metal compatible with the roofing and flashing material used.
 5. Coordinate with masonry work for the application of a skim coat of mortar to surfaces of unit masonry to receive flashing material before the application of flashing.
 6. Apply a layer of 7 Kg (15 pound) saturated felt followed by a layer of rosin paper to wood surfaces to be covered with copper. Lap each ply 50 mm (2 inch) with the slope and nail with large headed copper nails.
 7. Confine direct nailing of sheet metal to strips 300 mm (12 inch) or less wide. Nail flashing along one edge only. Space nail not over 100 mm (4 inches) on center unless specified otherwise.
 8. Install bolts, rivets, and screws where indicated, specified, or required in accordance with the SMACNA Sheet Metal Manual. Space rivets at 75 mm (3 inch) on centers in two rows in a staggered position. Use neoprene washers under fastener heads when fastener head is exposed.
 9. Coordinate with roofing work for the installation of metal base flashings and other metal items having roof flanges for anchorage and watertight installation.
 10. Nail continuous cleats on 75 mm (3 inch) on centers in two rows in a staggered position.
 11. Nail individual cleats with two nails and bend end tab over nail heads. Lock other end of cleat into hemmed edge.
 12. Install flashings in conjunction with other trades so that flashings are inserted in other materials and joined together to provide a water tight installation.

13. Where required to prevent galvanic action between dissimilar metal isolate the contact areas of dissimilar metal with sheet lead, waterproof building paper, or a coat of bituminous paint.
14. Isolate aluminum in contact with dissimilar metals others than stainless steel, white bronze or other metal compatible with aluminum by:
 - a. Paint dissimilar metal with a prime coat of zinc-chromate or other suitable primer, followed by two coats of aluminum paint.
 - b. Paint dissimilar metal with a coat of bituminous paint.
 - c. Apply an approved caulking material between aluminum and dissimilar metal.
15. Paint aluminum in contact with or built into mortar, concrete, plaster, or other masonry materials with a coat of bituminous paint.
16. Paint aluminum in contact with absorptive materials that may become repeatedly wet with two coats of bituminous paint or two coats of aluminum paint.
17. Bitumen Stops:
 - a. Install bitumen stops for built-up roof opening penetrations through deck and at formed sheet metal gravel stops.
 - b. Nail leg of bitumen stop at 300 mm (12 inch) intervals to nailing strip at roof edge before roofing material is installed.

3.2 THROUGH-WALL FLASHING

A. General:

1. Install continuous through-wall flashing between top of concrete foundation walls and bottom of masonry building walls; at top of concrete floors; under masonry, concrete, or stone copings and elsewhere as shown.
2. Where exposed portions are used as a counterflashings, lap base flashings at least 100 mm (4 inches) and use thickness of metal as specified for exposed locations.
3. Exposed edge of flashing may be formed as a receiver for two piece counter flashing as specified.
4. Terminate exterior edge beyond face of wall approximately 6 mm (1/4 inch) with drip edge where not part of counter flashing.
5. Turn back edge up 6 mm (1/4 inch) unless noted otherwise where flashing terminates in mortar joint or hollow masonry unit joint.

6. Terminate interior raised edge in masonry backup unit approximately 38 mm (1 1/2 inch) into unit unless shown otherwise.
7. Under copings terminate both edges beyond face of wall approximately 6 mm (1/4 inch) with drip edge.
8. Lap end joints at least two corrugations, but not less than 100 mm (4 inches). Seal laps with sealant.
9. Where dowels, reinforcing bars and fastening devices penetrate flashing, seal penetration with sealing compound. Sealing compound is specified in Section 07 92 00, JOINT SEALANTS.
10. Coordinate with other work to set in a bed of mortar above and below flashing so that total thickness of the two layers of mortar and flashing are same as regular mortar joint.
11. Where ends of flashing terminate turn ends up 25 mm (1 inch) and fold corners to form dam extending to wall face in vertical mortar or veneer joint.
12. Turn flashing up not less than 200 mm (8 inch) between masonry or behind exterior veneer.
13. When flashing terminates in reglet extend flashing full depth into reglet and secure with lead or plastic wedges spaced 150 mm (6 inch) on center.
14. Continue flashing around columns:
 - a. Where flashing cannot be inserted in column reglet hold flashing vertical leg against column.
 - b. Counterflash top edge with 75 mm (3 inch) wide strip of saturated cotton unless shown otherwise. Secure cotton strip with roof cement to column. Lap base flashing with cotton strip 38 mm (1 1/2 inch).
- B. Flashing at Top of Concrete Foundation Walls Where concrete is exposed. Turn up not less than 200 mm (8 inch) high and into masonry backup mortar joint or reglet in concrete backup as specified.
- C. Flashing at Top of Concrete Floors (except where shelf angles occur): Place flashing in horizontal masonry joint not less than 200 mm (8 inch) below floor slab and extend into backup masonry joint at floor slab 38 mm (1 1/2 inch).
- D. Flashing at Cavity Wall Construction: Where flashing occurs in cavity walls turn vertical portion up against backup under waterproofing, if

any, into mortar joint. Turn up over insulation, if any, and horizontally through insulation into mortar joint.

E. Flashing at Veneer Walls:

1. Install near line of finish floors over shelf angles or where shown.
2. Turn up against sheathing.
3. At stud framing, hem top edge 19 mm (3/4 inch) and secure to each stud with stainless steel fasteners through sheathing.
4. At concrete backing, extend flashing into reglet as specified.
5. Coordinate with installation of waterproofing or asphalt felt for lap over top of flashing.

F. Lintel Flashing when not part of shelf angle flashing:

1. Install flashing full length of lintel to nearest vertical joint in masonry over veneer.
2. Turn ends up 25 mm (one inch) and fold corners to form dam and extend end to face of wall.
3. Turn back edge up to top of lintel; terminate back edge as specified for back-up wall.

3.3 BASE FLASHING

A. Limit use of metal base flashing to small penetrations; less than 3000 mm (10 feet) in length and pipes, where possible.

B. Install where roof membrane type base flashing is not used and where shown.

1. Install flashing at intersections of roofs with vertical surfaces or at penetrations through roofs, to provide watertight construction.
2. Install metal flashings and accessories having flanges extending out on top of the built-up roofing before final bituminous coat and roof aggregate is applied.
3. Set flanges in heavy trowel coat of roof cement and nail through flanges into wood nailers over bituminous roofing.
4. Secure flange by nailing through roofing into wood blocking with nails spaced 75 mm (3 inch) on centers or, when flange over 100 mm (4 inch) wide terminate in a 13 mm (1/2 inch) folded edge anchored with cleats spaced 200 mm (8 inch) on center. Secure one end of cleat over nail heads. Lock other end into the seam.

- C. For long runs of base flashings install in lengths of not less than 2400 mm (8 feet) nor more than 3000 mm (ten feet). Install a 75 mm (3 inch) wide slip type, loose lock expansion joint filled with sealant in joints of base flashing sections over 2400 mm (8 feet) in length. Lock and solder corner joints at corners.
- D. Extend base flashing up under counter flashing of roof specialties and accessories or equipment not less than 75 mm (3 inch).

3.4 COUNTERFLASHING (CAP FLASHING OR HOODS)

A. General:

- 1. Install counterflashing over and in conjunction with installation of base flashings, except as otherwise specified or shown.
- 2. Install counterflashing to lap base flashings not less than 100 mm (4 inch).
- 3. Install upper edge or top of counterflashing not less than 225 mm (9 inch) above top of the roofing.
- 4. Lap joints not less than 100 mm (4 inch). Stagger joints with relation to metal base flashing joints.
- 5. Use surface applied counterflashing on existing surfaces and new work where not possible to integrate into item.
- 6. When fastening to concrete or masonry, use screws driven in expansion shields set in concrete or masonry. Use screws to wood and sheet metal. Set fasteners in mortar joints of masonry work.

B. One Piece Counterflashing:

- 1. Where flashing is installed at new masonry, coordinate to insure proper height, embed in mortar, and end lap.
- 2. Where flashing is installed in reglet in concrete insert upper edge into reglet. Hold flashing in place with lead wedges spaced not more than 200 mm (8 inch) apart. Fill joint with sealant.
- 3. Where flashing is surface mounted on flat surfaces.
 - a. When top edge is double folded anchor flat portion below sealant "V" joint with fasteners spaced not over 400 mm (16 inch) on center:
 - 1) Locate fasteners in masonry mortar joints.
 - 2) Use screws to sheet metal or wood.
 - b. Fill joint at top with sealant.
- 4. Where flashing or hood is mounted on pipe.

- a. Secure with draw band tight against pipe.
 - b. Set hood and secure to pipe with a one by 25 mm x 3 mm (1 x 1/8 inch) bolt on stainless steel draw band type clamp, or a stainless worm gear type clamp.
 - c. Completely fill joint at top with sealant.
- C. Two-Piece Counterflashing:
1. Where receiver is installed at new masonry coordinate to insure proper height, embed in mortar, and lap.
 2. Surface applied type receiver:
 - a. Secure to face construction in accordance, with manufacturers instructions.
 - b. Completely fill space at the top edge of receiver with sealant.
 3. Insert counter flashing in receiver in accordance with fabricator or manufacturer's instructions and to fit tight against base flashing.
- D. Where vented edge occur install so lower edge of counterflashing is against base flashing.
- E. When counter flashing is a component of other flashing install as shown.

3.5 REGLETS

- A. Install reglets in a manner to provide a watertight installation.
- B. Locate reglets not less than 225 mm (9 inch) nor more than 400 mm (16 inch) above roofing, and not less than 125 mm (5 inch) nor more than 325 mm (13 inch) above cant strip.
- C. Butt and align end joints or each section of reglet and securely hold in position until concrete or mortar are hardened:
 1. Coordinate reglets for anchorage into concrete with formwork construction.
 2. Coordinate reglets for masonry to locate horizontally into mortar joints.

3.6 GRAVEL STOPS

- A. General:
 1. Install gravel stops and fascias with allowance for expansion at each joint; minimum of 6 mm (1/4 inch).

2. Extend roof flange of gravel stop and splice plates not less than four inches out over roofing and nail or screw to wood nailers. Space fasteners on 75 mm (3 inch) centers in staggered pattern.
3. Install continuous cleat for fascia drip edge. Secure with fasteners as close to lower edge as possible on 75 mm (3 inch) centers.
4. Where ends of gravel stops and fascias abut a vertical wall, provide a watertight, flashed and sealant filled joint.
5. Set flange in roof cement when installed over built-up roofing.
6. Edge securement for low-slope roofs: Low-slope membrane roof systems metal edge securement, except gutters, shall be designed in accordance with ANSI/SPRI ES-1, except the basic wind speed shall be determined from Figure 1609, of IBC 2003.

B. Sheet metal gravel stops and fascia:

1. Install with end joints of splice plates sheets lapped three inches.
2. Hook the lower edge of fascia into a continuous edge strip.
3. Lock top section to bottom section for two piece fascia.

C. Corrugated sheet gravel stops and fascia:

1. Install 300 mm (12 inch) wide sheet flashing centered under joint. A combination bottom and cover plate, extending above and beneath the joint, may be used.
2. Hook lower edge of fascia into a continuous edge strip.

D. Scuppers:

1. Install scupper with flange behind gravel stops; leave 6 mm (1/4 inch) joint to gravel stop.
2. Set scupper at roof water line and fasten to wood blocking.
3. Use sealant to seal joint with fascia gravel stops at ends.
4. Coordinate to lap over conductor head and to discharge water into conductor head.

3.7 COPINGS

A. General:

1. On walls topped with a wood plank, install a continuous edge strip on the front and rear edge of the plank. Lock the coping to the edge strip with a 19 mm (3/4 inch) loose lock seam.
2. Where shown turn down roof side of coping and extend down over base flashing as specified for counter-flashing. Secure counter-flashing to lock strip in coping at continuous cleat.

3. Install ends adjoining existing construction so as to form space for installation of sealants. Sealant is specified in Section 07 92 00, JOINT SEALANTS.

B. Aluminum Coping:

1. Install with 6 mm (1/4 inch) joint between ends of coping sections.
2. Install joint covers, centered at each joint, and securely lock in place.

C. Stainless steel Copings:

1. Join ends of sheets by a 19 mm (3/4 inch) locked and soldered seam, except at intervals of 9600 mm (32 feet), provide a 38 mm (1 1/2 inch) loose locked expansion joint filled with sealant or mastic.
2. At straight runs between 7200 mm (24 feet) and 19200 mm (64 feet) locate expansion joint at center.
3. At straight runs that exceed 9600 mm (32 feet) and form the leg of a corner locate the expansion joint not more than 4800 mm (16 feet) from the corner.

3.8 EXPANSION JOINT COVERS, INSULATED

- A. Install insulated expansion joint covers at locations shown on curbs not less than 200 mm (8 inch) high above roof surface.
- B. Install continuous edge strips of same metal as expansion joint flange, nailed at not less than 75 mm (3 inch) centers.
- C. Install insulated expansion joint covers in accordance with manufacturer's directions locking edges to edge strips.

3.9 ENGINE EXHAUST PIPE OR STACK FLASHING

- A. Set collar where shown and secure roof tabs or flange of collar to structural deck with 13 mm (1/2 inch) diameter bolts.
- B. Set flange of sleeve base flashing not less than 100 mm (4 inch) beyond collar on all sides as specified for base flashing.
- C. Install hood to above the top of the sleeve 50 mm (2 inch) and to extend from sleeve same distance as space between collar and sleeve beyond edge not sleeve:
 1. Install insect screen to fit between bottom edge of hood and side of sleeve.
 2. Set collar of hood in high temperature sealant and secure with one by 3 mm (1/8 inch) bolt on stainless steel draw band type, or

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
07-01-14

stainless steel worm gear type clamp. Install sealant at top of
head.

- - - E N D - - -

**SECTION 07 71 00
ROOF SPECIALTIES**

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies copings, gravel stops, fascias, and expansion joints.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Sealant Material and Installation: Section 07 92 00, JOINT SEALANTS.
- C. General Insulation: Section 07 21 13, THERMAL INSULATION
- D. Rigid Insulations for Roofing: Section 07 22 00, ROOF AND DECK INSULATION

1.3 QUALITY CONTROL:

- A. Provide roof accessories that products of manufacturers regularly engaged in producing the kinds of products specified.
- B. For each accessory type provide products made by the same manufacturer.
- C. Assemble each accessory to the greatest extent possible before delivery to the site.
- D. Provide each accessory with FM approval listing for class specified.

1.4 PERFORMANCE REQUIREMENTS:

- A. Provide roof accessories that withstand exposure to weather and resist thermal movement without failure, rattling, leaking, or fastener disengagement due to defective manufacture, fabrication, or installation.
- B. Provide roof accessories listed in FM Approvals "RoofNav" and approved for windstorm classification Class. Identify materials with FM Approval markings.
- C. Manufacture and install roof accessories to allow for thermal movements from ambient and surface temperature changes to prevent buckling, opening of joints, hole elongation, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects.
 - 1. Provide clips that resist rotation and avoid shear stress as a result of thermal movements.

2. For design purposes, base provisions for thermal movement on assumed ambient temperature (range) from minus 18 degrees C (0 degrees F), ambient to 82 degrees C (180 degrees F).

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 1. Postconsumer and preconsumer recycled content as specified in PART 2 - PRODUCTS.
- C. Samples: Representative sample panel of color-anodized aluminum not less than 101 x 101 mm (4 x 4 inches), except extrusions are to be of a width not less than section to be used. Submit sample that shows coating with integral color and texture. Include manufacturer's identifying label.
- D. Shop Drawings: Each item specified showing design, details of construction, installation and fastenings.
- E. Manufacturer's Literature and Data: Each item specified.
- F. Certificates: Stating that aluminum has been given specified thickness of anodizing.

1.6 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
 - A240/A240M-14Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
 - A653/A653M-13Steel Sheet Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) by the Hot Dip Process
 - A666-10Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar
 - B209-14Aluminum and Aluminum Alloy-Sheet and Plate
 - B209M-14Aluminum and Aluminum Alloy-Sheet and Plate (Metric)
 - B221-14Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes

- B221M-13Aluminum-Alloy Extruded Bars, Rods, Wire,
Shapes, and Tubes (Metric)
- B32-08 (R2014)Solder Metal
- C612-14Mineral Fiber Block and Board Thermal
Insulation
- D1187/D1187M-97 (R2011) Asphalt-Base Emulsions for Use as Protective
Coatings for Metal
- D1970/D1970M-14Self-Adhering Polymer Modified Bituminous Sheet
Materials Used as Steep Roofing Underlayment
for Ice Dam Protection
- D226/D226M-09Asphalt-Saturated Organic Felt Used in Roofing
and Waterproofing
- C. National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500-06Metal Finishes Manual
- D. American Architectural Manufacturers Association (AAMA):
2605-11High Performance Organic Coatings on
Architectural Extrusions and Panels.
611-14Anodized Architectural Aluminum
- E. FM Global (FM):
RoofNavApproved Roofing Assemblies and Products

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Aluminum, Extruded: ASTM B221M (B221).
- B. Aluminum Sheet: ASTM B209M (B209).
- C. Galvanized Sheet Steel: ASTM A653/A653M; G-90 coating.
- D. Stainless-Steel Sheet: ASTM A240/A240M or ASTM A666, Type 304.
- E. Insulation: ASTM C612, Class 1 or 2.
- F. Asphalt Coating: ASTM D1187, Type I, quick setting.

2.2 UNDERLAYMENT:

- A. Self-Adhering Modified Bitumen Underlayment:
 - 1. Provide self-adhering modified bitumen membrane underlayment material in compliance with ASTM D1970/D1970M, suitable for use as underlayment for metal copings and fascias.

2. Provide membrane resistant to cyclical elevated temperatures for extended period of time in high heat service conditions (stable after testing at 116 degrees C (240 degrees F)).
3. Provide membrane with integral non-tacking top surface of polyethylene film or other surface material to serve as separator between bituminous material and metal products to be applied above.
4. Provide primer.

2.4 COPINGS:

- A. Fabricate of aluminum sheet not less than (0.063 inch) thick;
- B. Turn outer edges down each face of wall as shown on construction documents.
- C. Maximum lengths of 3.05 M (10 feet).
- D. Shop fabricate external and internal corners as one-piece assemblies with not less than 305 mm (12 inch) leg lengths.
- E. Provide 101 mm (4 inch) wide 0.81 mm (0.032 inch) thick watertight joint covers.
- F. Provide anchor gutter bar of 0.81 mm (0.032 inch) thick with anchor holes formed for underside of joint.
- G. Provide concealed guttered splice plate of 0.81 mm (0.032 inch) thick with butyl or other resilient seal strips anchored to splice plate for underside of joint. Use galvanized steel anchor plate providing compression spring anchoring of coping cover.
- H. Finish: Two-coat fluoropolymer .

2.5 EXTRUDED ALUMINUM GRAVEL STOPS AND FASCIAS:

- A. Basis of Design: SecurEdge 200 Fascia System by Carlisle
- B. Fabricate of aluminum not less than 2 mm (0.078 inch) thick.
- C. Turn fascia down face of wall and up above roof as shown in construction documents.
- D. Maximum lengths of 3.05 M (10-feet).
- E. Shop fabricate external and internal corners as one (1)-piece assemblies with not less than 305 mm (12 inch) leg lengths.
- F. Provide 101 mm (4 inch) wide 2 mm (0.078 inch) thick watertight joint covers with 152 mm (6 inch) wide 0.8 mm (0.030 inch) thick underside joint flashing.

G. Finish: Two-coat fluoropolymer. Color to be selected from manufacturers full range.

I. Finish on aluminum: Two-coat fluoropolymer Color to be selected

2.7 EXTRUDED ALUMINUM ROOF EXPANSION JOINT COVERS:

A. Fabricate in 3.0 M (10 foot) lengths with fastener openings slotting for expansion not over 610 mm (24 inch) centers.

B. Provide four-way expansion, for joint widths shown on construction documents.

C. Mill finish.

D. Form waterstop or moisture seals of continuous sheets of neoprene, not less than 0.81 mm (0.032 inch) thick.

E. Fabricate corners as one (1) piece assembly with mitered and welded joint and least dimension legs not less than 300 mm (12 inches) long.

F. Factory fabricate end caps and transitions to insure waterproof assembly.

G. Five (5) piece assembly:

1. Roof expansion joint cover system consists of an extruded aluminum cover, extruded frame or curb vertical section, galvanized steel cant, and aluminum compression clamp counter flashing, complete with moisture seals. Form cover and vertical section from extruded aluminum, 2 mm (0.080 inch) minimum thickness with spring stainless steel tension or pivot bar.

2. Form cant from galvanized steel not less than 0.8 mm (0.029 inch) thick formed to profile shown on construction documents.

3. Form splice plates of not less than 0.81 mm (0.032 inch) thick aluminum sheet.

4. Form counter flashing member of 1.3 mm (0.050 inch) thick sheet aluminum, secured with screws to the top edge of the vertical section and providing compression clamp over base flashing.

5. Provide compression gasket separating cover from curb bearing.

H. Two (2) piece assembly:

1. Roof expansion joint system consists of an extruded aluminum cover combination extruded aluminum frame or curb with integral adjustable counter flashing flange, and moisture seals.

2. Form cover from extruded aluminum 2 mm (0.078 inch) minimum thickness.
3. Form cover anchor system of stainless steel pivot bar.
4. Form frame assembly of not less than 2 mm (0.076 inch) aluminum except for flashing portion.
5. Provide compression gasket separating cover from curb at bearing.

2.8 FINISH:

- A. In accordance with NAAMM AMP 500-505.
- B. Aluminum, Clear Anodic Finish AAMA 611: AA-M12C22A41, Class I, 0.017 mm (0.7 mil) thick (min.). AA12C22A31 Class II, Architectural, 0.010 mm (0.4 mil) thick (min.).
- C. Aluminum Color Anodic Finish AAMA 611: AA-C22A42 (anodized or AA0C22A44 (electrolytically deposited metallic compound), Class 1, Architectural, 0.017 mm (0.7 mil) thick (min.) . Dyes will not be accepted.
 1. Two-Coat Fluoropolymer: AAMA 2605. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in color coat.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Examine substrates, areas, and conditions, to verify actual locations, dimensions, and other conditions affecting performance of the Work.
- B. Verify that substrate is sound, dry, smooth, clean, sloped for drainage where applicable, and securely anchored.
- C. Underlayment Installation:
 1. Self-Adhering Sheet Underlayment:
 - a. Apply primer as required by manufacturer.
 - b. Comply with temperature restrictions of underlayment manufacturer for installation.
 - c. Apply wrinkle free, in shingle fashion to shed water, and with end laps of not less than 152 mm (6 inches) staggered 610 mm (24 inches) between courses.
 - d. Overlap side edges not less than 89 mm (3-1/2 inches). Roll laps with roller.
 - e. Cover underlayment within 14 days.

- f. Apply continuously under copings and roof-edge fascias and gravel stops.
 - g. Coordinate application of self-adhering sheet underlayment under roof specialties with requirements for continuity with adjacent air barrier materials.
- D. Install roof accessories where indicated in construction documents.
- E. Secure with fasteners in accordance with manufacture's printed installation instructions and approved shop drawings unless shown otherwise. Provide fasteners suitable for application, for metal types being secured and designed to meet performance requirements.
- F. Where soldered joints are required, clean surfaces to be soldered, removing oils and foreign matter.
- 1. Pre-tin edges of sheets to be soldered to a width of 38 mm (1-1/2 inches).
 - 2. Reduce pre-tinning where pre-tinned surface would show in completed work.
 - 3. Tin edges of uncoated copper sheets using solder for copper.
 - 4. Do not use torches for soldering.
 - 5. Heat surfaces to receive solder and flow solder into joint.
 - 6. Fill joint completely.
 - 7. Completely remove flux and spatter from exposed surfaces.
- G. Coordinate to install insulation where shown; see Section 07 21 13, THERMAL INSULATION and Section 07 22 00, ROOF AND DECK INSULATION.
- H. Comply with section 07 92 00, JOINT SEALANTS to install sealants where required by manufactures installation instructions.
- I. Coordinate with roofing work for installation of items in sequence to prevent water infiltration.
- J. Aluminum Coping:
- 1. Install sections of coping with approximately 6 mm (1/4-inch) space between ends of sections.
 - 2. Center joint gutter bar and covers at joints and lock in place.
 - 3. When snap-on system is installed ensure front and back edges are locked in place.
- K. Fascia-Cant System:
- 1. Install galvanized steel cant; coordinate with roofing work and after completion of roofing work install extruded aluminum fascia,

concealed joint cover plate, and aluminum compression clamp, where shown in construction documents.

2. Install system to allow for expansion and contraction with 6 mm (1/4 inch) space between extruded aluminum members and galvanized steel cant as required by manufacturer of system.
3. Offset joints in extruded aluminum members from galvanized steel cant joints.

L. Expansion Joint Covers:

1. Install to terminate base flashing 203 mm (8 inches) above roof.
2. Install moisture seals to drain water to outlets that do not permit water to enter building.
3. Provide stainless steel screws when exposed.
4. Three piece assembly:
 - a. Install curb section with screws to wood blocking, allowing 6 mm (1/4 inch) at butt joints between sections with splice plate at joint.
 - b. Install cant to wood blocking by nailing along horizontal flange every 152 mm (6 inches), with galvanized roofing nails 25 mm (1 inch) long.
 - c. After completion of base flashing install cap flashing and compression clamp and fasten to the curb or metal cant with stainless steel self-tapping screws with neoprene washers under head spaced approximately 457 mm (18 inches) on center.
 - d. Install expansion joint cover with a 6 mm (1/4 inch) wide end joints.
 - e. Install over end joint a cover plate complete with concealed aluminum flashing, centered under each joint. Fabricate flashing to lap cover not less than 101 mm (4 inches).
5. Two piece assembly:
 - a. Install curb section with screws allowing 6 mm (1/4 inch) space at end joints with splice plate at joint.
 - b. After completion of base flashing bend down cap flashing flange and secure to blocking with screws.
 - c. Install expansion joint cover with 6 mm (1/4 inch) wide space at end joints and tension bars at 610 mm (24 inches) on center.

- d. Install cover plates with formed aluminum flashing concealed and centered on joint. Flashing to lap cover not less than 101 mm (4 inches).

3.2 PROTECTION OF ALUMINUM:

- A. Provide protection for aluminum against galvanic action wherever dissimilar materials are in contact, by painting the contact surfaces of the dissimilar material with two (2) coats of asphalt coating (complete coverage), or by separating the contact surfaces with a preformed neoprene tape having pressure sensitive adhesive coating on one (1) side.
- B. Paint aluminum in contact with wood, concrete and masonry, or other absorptive materials, that may become repeatedly wet, with two (2) coats of asphalt coating.

3.3 ADJUSTING:

- A. Adjust expansion joints to close tightly and be watertight; insuring maximum allowance for building movement.

3.4 PROTECTION:

- A. Protect roof accessories from damage during installation and after completion of the work from subsequent construction.

- - - E N D - - -

SECTION 07 72 00
ROOF ACCESSORIES

PART 1 - GENERAL

1.1 DESCRIPTION:

A. This section specifies equipment supports; gravity ventilators;.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Sealant material and installation: Section 07 92 00, JOINT SEALANTS.
- C. General insulation: Section 07 21 13, THERMAL INSULATION. Rigid insulations for roofing: Section 07 22 00, ROOF AND DECK INSULATION

1.3 QUALITY ASSURANCE:

- A. Provide roof accessories that are the products of manufacturers regularly engaged in producing the kinds of products specified.
- B. For each accessory type provide the same product made by the same manufacturer.
- C. Assemble each accessory to the greatest extent possible before delivery to the site.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 - 1. Postconsumer and preconsumer recycled content as specified in PART 2 - PRODUCTS.
- C. Samples: Submit representative sample panel of color anodized aluminum not less than 101 x 101mm (4 x 4 inches). For extrusions, submit width not less than section to be installed. Show coating with integral color and texture and include manufacturer's identifying label.
- D. Shop Drawings: Each item specified showing design, details of construction, installation and fastenings.
- E. Manufacturer's Literature and Data: Each item specified.
- F. Certificates: Stating that aluminum has been given specified thickness of anodizing.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extend referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - RR-G-1602DGrating, Metal, Other Than Bar Type (Floor, Except for Naval Vessels)
- C. ASTM International (ASTM):
 - A653/A653M-10Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) By the Hot-Dip Process
 - B209-14Aluminum and Aluminum Alloy-Sheet and Plate
 - B209M-14Aluminum and Aluminum-Alloy Sheet and Plate (Metric)
 - B221-14Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - B221M-13Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes (Metric)
 - C726-12Mineral Wool Roof Insulation Board
 - C1289-14aFaced Rigid Cellular Polyisocyanurate Thermal Insulation Board
 - D1187/D1187M-97 (R2011) .Asphalt-Base Emulsions for Use as Protective Coatings for Metal
- D. National Association of Architectural Metal Manufacturers (NAAMM):
 - AMP 500 SeriesMetal Finishes Manual
- E. American Architectural Manufacturers Association (AAMA):
 - 2603-13Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions and Panels
 - 2605-13High Performance Organic Coatings on Architectural Extrusions and Panels.
 - 611-14Anodized Architectural Aluminum
 - 621-02High Performance Organic Coatings on Coil Coated Architectural Hot Dipped Galvanized (HDG) and Zinc-Aluminum Coated Steel Substrates
- F. American Society of Civil Engineers (ASCE):

ASCE 7-10Minimum Design Loads for Buildings and Other
Structures

- G. U.S. National Archives and Records Administration (NARA):
29 CFR 1910.23Guarding Floor and Wall Openings and Holes

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Aluminum, Extruded: ASTM B221M (B221).
- B. Aluminum Sheet: ASTM B209M (B209).
- C. Galvanized Sheet Steel: ASTM A653/A653M; G-90 coating.
- D. Metal Grating for Roof Walkway: Fed. Spec. RR-G-1602.
- E. Recycled Content of Metal Products: Postconsumer recycled content plus one-half of preconsumer recycled content not less than 30 percent.
- F. Asphalt Coating: ASTM D1187/D1187M, Type I, quick setting.

2.2 ROOF HATCH (SCUTTLE) WITH LADDER:

- A. Performance Characteristics:
 - 1. Cover to be reinforced to support a minimum live load of 195 kg per sq. m (40 lb. per sq. ft.) with a maximum deflection of 1/150th of the span or 97 kg per sq. m (20 lb. per sq. ft.) wind uplift.
 - 2. Operation of the Cover: Smooth and easy with controlled operation throughout the entire arc of opening and closing.
 - 3. Operation of the Cover: Not affected by temperature.
 - 4. Entire Hatch: Weathertight with fully welded corner joints on cover and curb.
- B. Shop fabricate from aluminum with mill finish.
- C. Curb and Cover:
 - 1. Exterior facing: Minimum 2.3 mm (0.09 inch) thick sheet aluminum with mill finish.
 - 2. Interior facing: Minimum 1 mm (0.04 inch) thick sheet aluminum.
 - 3. Minimum of 50 mm (2 inch) thick polyisocyanurate insulation (ASTM C1289) with a U-value = 0.47 W/m² K (R-value = 12) between facings of cover and over exterior face of curb.
 - 4. Form exterior curb facing with an integral 76 mm (3 inch) wide roof flange and cap flashing minimum 2.3 mm (0.09 inch) thick sheet aluminum.

5. Make curb 305 mm (12 inches) above finish roof surface.
6. Form cover to lap curb and cap flashing.
7. Size opening as shown on construction documents.
8. Finish: Mill

D. Hardware:

1. Provide spring snap latch with inside and outside operating handles and padlock hasp on inside. Provide two snap latches when hinge side is over 2100 mm (7 feet) long. Bolt hardware into heavy gauge channel reinforcement welded to the underside of the cover and concealed within the insulation space.
2. Provide heavy duty pintle hinges.
3. Provide automatic hold open and operating arm with enclosed torsion or compression spring lifting mechanism.
4. Latch Strike: Stamped component bolted or welded to the curb assembly.
5. Automatically lock in the open position at not less than 70 degrees.
6. Provide weatherstripping at cover closure.
7. Galvanize all hardware items.

E. Assembly:

1. Shop assemble roof scuttle.
2. Weld joints exposed to the weather and built into the roofing.
3. Finish weld smooth where exposed.

F. Safety Accessories:

1. Ladder Assist Post: Provide a telescoping tubular section that locks automatically when fully extended. Control upward and downward movement by a stainless steel spring balancing mechanism. Provide unit completely assembled with fasteners for securing to the ladder rungs in accordance with the manufacturer's instructions.
2. Safety Railing: Provide a fixed, attached to the roof hatch railing assembly including rails, clamps, fasteners, safety barrier at railing opening, and accessories required for a complete installation; complying with 29 CFR 1910.23 requirements.

2.3 EQUIPMENT SUPPORTS:

- A. Supported Load Capacity: .

- B. Fabricate equipment supports from 1.3 mm (0.0516 inch) thick galvanized ASTM A653/A653M steel fabricate with welded corners and with seams joined by continuous water and air tight welds.
- C. Equipment supports to be internally reinforced with angles 1.22 m (48 inches) on center.
- D. Form exterior curb with integral base, and deck closures for curbs installed on steel decking.
- E. Use galvanized steel liners for curbs having inside dimension over 305 mm (12 inches).
- F. Internally insulate with 38 mm (1-1/2 inch) glass-fiber board insulation (ASTM C726).
- G. Fabricate curb with a minimum height of 203 mm (8 inches) above roof surface.
- H. Attach preservative treated wood nailers to top of curb. Provide 50 mm (2 inch) by 50 mm (2 inch) minimum nominal size on curb with openings and 50 mm (2 inch) thick, width of curb up to 305 mm (12 inches) on equipment support curbs.
- H. Make size of supports suit size of equipment furnished, with height as shown on construction documents, but not less than 203 mm (8 inches) above roof surface.
- I. Top of Equipment Supports: Level with pitch built into curb when deck slopes. Equip supports with water diverter or cricket on side that obstructs water flow.

2.6 FINISH:

- A. In accordance with NAAMM AMP 500 Series.
- B. Aluminum, Mill Finish: AA-MIX, as fabricated.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Install roof specialties where indicated on construction documents.
- B. Secure with fasteners in accordance with manufacture's printed installation instructions and approved shop drawings unless shown otherwise.
- C. Coordinate to install insulation where shown; see Section 07 21 13, THERMAL INSULATION and Section 07 22 00, ROOF AND DECK INSULATION.

- D. Comply with section 07 92 00, JOINT SEALANTS to install sealants where required by manufactures installation instructions require sealant.
- E. Coordinate with roofing work for installation of items in sequence to prevent water infiltration.
 - 1. After completion of base flashing bend down cap flashing flange and secure to blocking with screws.
 - 2. Install expansion joint cover with 6 mm (1/4 inch) wide space at end joints and tension bars at 610 mm (24 inches) on center.
 - 3. Install cover plates with formed aluminum flashing concealed and centered on joint. Flashing to lap cover not less than 101 mm (4 inches).
- F. Equipment Supports: Do not anchor to insulating concrete or metal deck. Anchor only to building structure as per manufacturers recommendations.

3.2 PROTECTION OF ALUMINUM:

- A. Provide protection for aluminum against galvanic action wherever dissimilar materials are in contact, by painting the contact surfaces of the dissimilar material with two (2) coats of asphalt coating (complete coverage), or by separating the contact surfaces with a preformed neoprene tape having pressure sensitive adhesive coating on side.
- B. Paint aluminum in contact with wood, concrete and masonry, or other absorptive materials, that may become repeatedly wet, with two coats of asphalt coating.

3.3 ADJUSTING:

- A. Adjust roof hatch hardware to operate freely and so that cover will operate without binding, close tightly at perimeter, and latch securely.

3.4 PROTECTION:

- A. Protect roof accessories from damage during installation and after completion of the work from subsequent construction.

- - - E N D - - -

**SECTION 07 81 00
APPLIED FIREPROOFING**

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies spray-applied mineral fiber and cementitious coverings to provide fire resistance to interior structural steel members shown.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 - 1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.
- C. Installer qualifications.
- D. Testing laboratory accreditations.
- E. Manufacturer's Literature and Data:
 - 1. Manufacturer's complete and detailed application instructions and specifications.
 - 2. Manufacturer's repair and patching instructions.
- F. Certificates:
 - 1. Certificate from testing laboratory attesting fireproofing material and application method meet the specified fire ratings.
 - a. List thickness and density of material required to meet fire ratings.
 - b. Accompanied by complete test report and test record.
 - 2. Manufacturer's certificate indicating sprayed-on fireproofing material supplied under the Contract is same within manufacturing tolerance as fireproofing material tested.
- G. Miscellaneous:
 - 1. Manufacturer's written approval of surfaces to receive sprayed-on fireproofing.
 - 2. Manufacturer's written approval of completed installation.

3. Manufacturer's written approval of the applicators of fireproofing material.

1.3 PRODUCT DELIVERY, STORAGE AND HANDLING:

- A. Deliver to job-site in sealed containers marked and labeled to show manufacturer's name and brand and UL certification markings of compliance with the specified requirements.
- B. Remove damaged or opened containers from the site.
- C. Store the materials off the ground, under cover, away from damp surfaces.
- D. Keep dry until ready for use.
- E. Remove materials that have been exposed to water before installation from the site.

1.4 FIELD CONDITIONS:

- A. Temperature: Do not apply fireproofing when substrate or ambient temperature is below 4 degrees C (40 degrees F) unless temporary protection and heat are provided to maintain temperature at or above stated value during application and for 24 hours before and after application.
- B. Humidity: Maintain relative humidity levels within limits recommended by fireproofing manufacturer.
- C. Ventilation: Provide ventilation to properly dry the fireproofing after application. Provide a minimum of four (4) air exchanges per hour by forced air circulation. When permitted by Contracting Officer Representative (COR), ventilate by natural circulation.

1.5 QUALITY ASSURANCE:

- A. Installer Qualifications: A firm or individual certified, licensed, or otherwise qualified by fireproofing manufacturer as experienced and with sufficient trained staff to install manufacturer's products according to specified requirements. Submit manufacturer's certification that each installer is trained and qualified to install the specified fireproofing. Submit evidence that each installer has a minimum of three (3) years' experience and a minimum of four (4) installations using the specified fireproofing.
- B. Testing Laboratory Accreditation Requirements: Construction materials testing laboratories must be accredited by a laboratory accreditation authority. Submit a copy of the Certificate of Accreditation and Scope of Accreditation.

- C. Test for fire endurance in accordance with ASTM E119, for fire rating specified, in a nationally recognized laboratory.
- D. Manufacturer's inspection and approval of surfaces to receive fireproofing.
- E. Manufacturer's approval of fireproofing applications.
- F. Manufacturer's approval of completed installation.
- G. Manufacturer's representative is to observe and advise at the commencement of application, and is required to visit the site as required thereafter for the purpose of ascertaining proper application.
- H. Pre-Application Test Area.

- 1. Apply a test area consisting of a typical overhead fireproofing installation, including not less than 4.5 m (15 feet) of beam and deck.
 - a. Apply to one (1) column.
 - b. Apply for the hourly ratings required in the construction documents.
- 2. Install in location selected by the COR, for approval by the representative of the fireproofing material manufacturer and the COR.
- 3. Perform Bond test for cohesive and adhesive strength in accordance with ASTM E736 for each applied fireproofing design used.
- 4. Perform density test in accordance with ASTM E736 for each applied fireproofing design used.
- 5. Do not proceed in other areas until installation of test area has been completed and approved.
- 6. Keep approved installation area open for observation as criteria for sprayed-on fireproofing.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
 - C841-03(R2013)Installation of Interior Lathing and Furring
 - C847-14Metal Lath
 - E84-14Surface Burning Characteristics of Building
Materials

- E119-12aFire Tests of Building Construction and
Materials
- E605-93 (R2011)Thickness and Density of Sprayed Fire-Resistive
Materials Applied to Structural Members
- E736-00 (R2011)Cohesion/Adhesion of Sprayed Fire-Resistive
Materials Applied to Structural Members
- E759-92 (R2011)The Effect of Deflection on Sprayed Fire-
Resistive Material Applied to Structural
Members
- E760-92 (R2011)Impact on Bonding of Sprayed Fire-Resistive
Material Applied to Structural Members
- E761-92 (R2011)Compressive Strength of Fire-Resistive Material
Applied to Structural Members
- E859-93 (R2011)Air Erosion of Sprayed Fire-Resistive Materials
Applied to Structural Members
- E937-93 (R2011)Corrosion of Steel by Sprayed Fire-Resistive
Material Applied to Structural Members
- E1042-02 (R2014)Acoustically, Absorptive Materials Applied by
Trowel or Spray.
- G21-13Determining Resistance of Synthetic Polymeric
Materials to Fungi
- C. Underwriters Laboratories, Inc. (UL):
Fire Resistance Directory...Latest Edition including Supplements
- D. Warnock Hersey (WH):
Certification Listings .Latest Edition
- E. Factory Mutual System (FM):
Approval GuideLatest Edition including Supplements
- F. Environmental Protection Agency (EPA):
40 CFR 59(2014)National Volatile Organic Compound Emission
Standards for Consumer and Commercial Products

PART 2 - PRODUCTS

2.1 SPRAYED-ON FIREPROOFING:

- A. ASTM E1042, Class (a), Category A.
 - 1. Type I, factory mixed cementitious materials with approved aggregate.

2. Type II, factory mixed mineral fiber with integral inorganic binders minimum 240 kg per cubic meter (15 lb. per cubic feet) density per ASTM E605 test unless specified otherwise. Use in areas that are completely encased.

B. Materials containing asbestos are not permitted.

C. Fireproofing characteristics when applied in the thickness and density required to achieve the fire-rating specified.

	Characteristic	Test	Results
1.	Deflection	ASTM E759	No cracking, spalling, or delamination when backing to which it is applied has a deflection up to 1/120 in 3 m (10 ft.)
2.	Corrosion-Resistance	ASTM E937	No promotion of corrosion of steel.
3.	Bond Impact	ASTM E760	No cracking, spalling, or delamination.
4.	Cohesion/Adhesion (Bond Strength)	ASTM E736	Minimum cohesive/adhesive strength of 9.57 kPa (200 lbf per sq. ft.) for protected areas. 19.15 kPa (400 lbf per sq. ft.) for exposed areas.
5.	Air Erosion	ASTM E859	Maximum gain weight of the collecting filter 0.27 gm per sq. meter (0.025 gm per sq. ft.).

6.	Compressive Strength	ASTM E761	Minimum compressive strength 48 kPa (1000 psf).
7.	Surface Burning Characteristics with adhesive and sealer to be used	ASTM E84	Flame spread 25 or less smoke developed 50 or less
8.	Fungi Resistance	ASTM G21	Resistance to mold growth when inoculated with aspergillus niger (28 days for general application)

2.2 ADHESIVE:

- A. Bonding adhesive for Type II (fibrous) materials as recommended and supplied by the fireproofing material manufacturer.
- B. Adhesive may be an integral part of the material or applied separately to surface receiving fireproofing material.

2.3 SEALER:

- A. Sealer for Type II (fibrous) material as recommended and supplied by the fireproofing material manufacturer.
- B. Surface burning characteristics as specified for fireproofing material.
- C. Fungus resistant.
- D. Sealer may be an integral part of the material or applied separately to the exposed surface. When applied separately use contrasting color pigmented sealer, white preferred.
- E. VOC content: Product to comply with VOC content limits of authorities having jurisdiction and the following VOC limits when calculated according to 40 CFR 59, (EPA Method 24):
 - 1. Flat Paints and Coatings: 50 g/L.
 - 2. Nonflat Paints and Coatings: 150 g/L.
 - 3. Primers, Sealers, and Undercoaters: 200 g/L.

2.4 WATER:

- A. Clean, fresh, and free from organic and mineral impurities.
- B. pH of 6.9 to 7.1.

2.5 MECHANICAL BOND MATERIAL:

- A. Expanded Metal Lath: ASTM C847, minimum weight of 0.92 kg per square meter (1.7 pounds per square yard) or as required, according to fire-resistance designs indicated and fire proofing manufacturer's written instructions.
- B. Fasteners: ASTM C841.

- C. Reinforcing Fabric: Glass- or carbon-fiber fabric of type, weight, and form required to comply with fire-resistance designs indicated; approved and provided by fireproofing manufacturer.
- D. Reinforcing Mesh: Metallic mesh reinforcement of type, weight, and form required to comply with fire-resistance design indicated; approved and provided by fireproofing manufacturer. Include pins and attachments.

PART 3 - EXECUTION

3.1 EXAMINATION:

- A. Verify surfaces to receive fireproofing are clean and free of dust, soot, oil, grease, water soluble materials or any foreign substance which would prevent adhesion of the fireproofing material.
- B. Verify hangers, inserts and clips are installed before the application of fireproofing material.
- C. Verify ductwork, piping, and other obstructing material and equipment is not installed that will interfere with fireproofing installation.
- D. Verify concrete work on steel decking and concrete encased steel is completed.
- E. When applied in conjunction with roof structures or roof decks, verify that roofing, installation of rooftop HVAC equipment, and other related work are complete.
- F. Verify temperature and enclosure conditions required by fire-proofing material manufacturer.
- G. Conduct tests according to fireproofing manufacturer's written instructions to verify that substrates are free of substances capable of interfering with bond. Submit test report.

3.2 APPLICATION:

- A. Do not start application until written approval has been obtained from manufacturer of fireproofing materials that surfaces have been inspected by the manufacturer or his representative, and are suitable to receive sprayed-on fireproofing.
- B. Coordinate application of fireproofing material with other trades.
- C. Cover other work and exterior openings subject to damage from fallout or overspray of fireproofing materials during application.
- D. Application of Metal Lath:
 - 1. Apply to beam and columns having painted surfaces which fail ASTM E736 Bond Test requirements in pre-application test area.
 - 2. Apply to beam flanges 305 mm (12-inches) or more in width.

3. Apply to column flanges 406 mm (16-inches) or more in width.
 4. Apply to beam or column web 406 mm (16-inches) or more in depth.
 5. Tack weld or mechanically fasten on maximum of 305 mm (12-inch) center.
 6. Lap and tie lath member in accordance with ASTM C841.
- E. Mix and apply in accordance with manufacturer's instructions.
1. Mechanically control material and water ratios.
 2. Apply adhesive and sealer, when not an integral part of the materials, in accordance with the manufacturer's instructions.
 3. Apply to density and thickness indicated in UL Fire Resistance Directory, FM Approval Guide, or WH Certification Listings unless specified otherwise. Test in accordance with ASTM E119.
 4. Minimum ASTM E605 applied dry density per cubic meter (cubic foot) for the underside of the walk on deck (interstitial) hung purlin or beam and steel deck, columns in interstitial spaces and mechanical equipment rooms to be as follows:
 - a. Type II - 240 kg per cubic meter (15 lb. per cubic ft.).
 - b. Provide materials with higher density of 640 kg per cubic metric (40 lb. per cubic feet) in mechanical rooms and parking garages.
- F. Complete application is to be completed in one area. Inspection and approval by COR is required before removal of application equipment and proceeding with further work.

3.3 FIELD TESTS:

- A. The applied fireproofing to be tested by a COR approved independent testing laboratory and paid for by the Contractor. Submit test reports documenting results of tests on the applied material in the project.
- B. COR will select area to be tested in specific bays on each floor using a geometric grid pattern. Apply test sample every 929 square meters (10,000 square feet) of floor area or two (2) for each floor, whichever produces the greatest number of test areas.
- C. Test for thickness and density in accordance with ASTM E605. Areas showing thickness less than that required as a result of fire endurance test are not acceptable.
- D. Areas showing less than required fireproofing characteristics are not suitable for the following field tests.
 1. Test for cohesion/adhesion: ASTM E736.

2. Test for bond impact strength: ASTM E760.

3.4 PATCHING AND REPAIRING:

- A. Inspect after mechanical, electrical and other trades have completed work in contact with fireproofing material, but before sprayed material is covered by subsequent construction.
- B. Perform corrective measures in accordance with fireproofing material manufacturer's recommendations.
 - 1. Respray areas requiring additional fireproofing material to provide the required thickness, and replace dislodged or removed material.
 - 2. Spray material for patching by machine directly on point to be patched, or into a container and then hand apply.
 - 3. Do not hand mix material.
- C. Repair:
 - 1. Respray test and rejected areas.
 - 2. Patch fireproofing material which is removed or disturbed after approval.
- D. Perform final inspection of sprayed areas after patching and repair.

3.6 SCHEDULE:

- A. Apply fireproofing material in interior structural steel members and on underside of interior steel floor and roof decks , except on following surfaces:
 - 1. Structural steel.
 - 2.

- - - E N D - - -

SECTION 07 84 00
FIRESTOPPING

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. Provide UL or equivalent approved firestopping system for the closures of openings in walls, floors, and roof decks against penetration of flame, heat, and smoke or gases in fire resistant rated construction.
- B. Provide UL or equivalent approved firestopping system for the closure of openings in walls against penetration of gases or smoke in smoke partitions.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Sealants and application: Section 07 92 00, JOINT SEALANTS.
- C. Fire and smoke damper assemblies in ductwork: Section 23 31 00, HVAC DUCTS AND CASINGS Section 23 37 00, AIR OUTLETS AND INLETS.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 - 1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.
- C. Installer qualifications.
- D. Inspector qualifications.
- E. Manufacturers literature, data, and installation instructions for types of firestopping and smoke stopping used.
- F. List of FM, UL, or WH classification number of systems installed.
- G. Certified laboratory test reports for ASTM E814 tests for systems not listed by FM, UL, or WH proposed for use.
- H. Submit certificates from manufacturer attesting that firestopping materials comply with the specified requirements.

1.4 DELIVERY AND STORAGE:

- A. Deliver materials in their original unopened containers with manufacturer's name and product identification.
- B. Store in a location providing protection from damage and exposure to the elements.

1.5 QUALITY ASSURANCE:

- A. FM, UL, or WH or other approved laboratory tested products will be acceptable.
- B. Installer Qualifications: A firm that has been approved by FM Global according to FM Global 4991 or been evaluated by UL and found to comply with UL's "Qualified Firestop Contractor Program Requirements." Submit qualification data.
- C. Inspector Qualifications: Contractor to engage a qualified inspector to perform inspections and final reports. The inspector to meet the criteria contained in ASTM E699 for agencies involved in quality assurance and to have a minimum of two years' experience in construction field inspections of firestopping systems, products, and assemblies. The inspector to be completely independent of, and divested from, the Contractor, the installer, the manufacturer, and the supplier of material or item being inspected. Submit inspector qualifications.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
 - E84-14Surface Burning Characteristics of Building Materials
 - E699-09Standard Practice for Evaluation of Agencies Involved in Testing, Quality Assurance, and Evaluating of Building Components
 - E814-13aFire Tests of Through-Penetration Fire Stops
 - E2174-14Standard Practice for On-Site Inspection of Installed Firestops
 - E2393-10aStandard Practice for On-Site Inspection of Installed Fire Resistive Joint Systems and Perimeter Fire Barriers
- C. FM Global (FM):
 - Annual Issue Approval Guide Building Materials
 - 4991-13Approval of Firestop Contractors
- D. Underwriters Laboratories, Inc. (UL):
 - Annual Issue Building Materials Directory
 - Annual Issue Fire Resistance Directory

723-10(2008)Standard for Test for Surface Burning
Characteristics of Building Materials

1479-04(R2014)Fire Tests of Through-Penetration Firestops

E. Intertek Testing Services - Warnock Hersey (ITS-WH):
Annual Issue Certification Listings

F. Environmental Protection Agency (EPA):

40 CFR 59(2014)National Volatile Organic Compound Emission
Standards for Consumer and Commercial Products

PART 2 - PRODUCTS

2.1 FIRESTOP SYSTEMS:

- A. Provide either factory built (Firestop Devices) or field erected (through-Penetration Firestop Systems) to form a specific building system maintaining required integrity of the fire barrier and stop the passage of gases or smoke. Firestop systems to accommodate building movements without impairing their integrity.
- B. Through-penetration firestop systems and firestop devices tested in accordance with ASTM E814 or UL 1479 using the "F" or "T" rating to maintain the same rating and integrity as the fire barrier being sealed. "T" ratings are not required for penetrations smaller than or equal to 101 mm (4 in.) nominal pipe or 0.01 sq. m (16 sq. in.) in overall cross sectional area.
- C. Firestop sealants used for firestopping or smoke sealing to have the following properties:
 - 1. Contain no flammable or toxic solvents.
 - 2. Release no dangerous or flammable out gassing during the drying or curing of products.
 - 3. Water-resistant after drying or curing and unaffected by high humidity, condensation or transient water exposure.
 - 4. When installed in exposed areas, capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.
 - 5. VOC Content: Firestopping sealants and sealant primers to comply with the following limits for VOC content when calculated according to 40 CFR 59, (EPA Method 24):
 - a. Sealants: 250 g/L.
 - b. Sealant Primers for Nonporous Substrates: 250 g/L.
 - c. Sealant Primers for Porous Substrates: 775 g/L.

- D. Firestopping system or devices used for penetrations by glass pipe, plastic pipe or conduits, unenclosed cables, or other non-metallic materials to have following properties:
 - 1. Classified for use with the particular type of penetrating material used.
 - 2. Penetrations containing loose electrical cables, computer data cables, and communications cables protected using firestopping systems that allow unrestricted cable changes without damage to the seal.
- E. Maximum flame spread of 25 and smoke development of 50 when tested in accordance with ASTM E84 or UL 723. Material to be an approved firestopping material as listed in UL Fire Resistance Directory or by a nationally recognized testing laboratory.
- F. FM, UL, or WH rated or tested by an approved laboratory in accordance with ASTM E814.
- G. Materials to be nontoxic and noncarcinogen at all stages of application or during fire conditions and to not contain hazardous chemicals. Provide firestop material that is free from Ethylene Glycol, PCB, MEK, and asbestos.
- H. For firestopping exposed to view, traffic, moisture, and physical damage, provide products that do not deteriorate when exposed to these conditions.
 - 1. For piping penetrations for plumbing and wet-pipe sprinkler systems, provide moisture-resistant through-penetration firestop systems.
 - 2. For floor penetrations with annular spaces exceeding 101 mm (4 in.) or more in width and exposed to possible loading and traffic, provide firestop systems capable of supporting the floor loads involved either by installing floor plates or by other means acceptable to the firestop manufacturer.
 - 3. For penetrations involving insulated piping, provide through-penetration firestop systems not requiring removal of insulation.

2.2 SMOKE STOPPING IN SMOKE PARTITIONS:

- A. Provide silicone sealant in smoke partitions as specified in Section 07 92 00, JOINT SEALANTS.
- B. Provide mineral fiber filler and bond breaker behind sealant.
- C. Sealants to have a maximum flame spread of 25 and smoke developed of 50 when tested in accordance with ASTM E84.

- D. When used in exposed areas capable of being sanded and finished with similar surface treatments as used on the surrounding wall or floor surface.

PART 3 - EXECUTION

3.1 EXAMINATION:

- A. Submit product data and installation instructions, as required by article, submittals, after an on-site examination of areas to receive firestopping.
- B. Examine substrates and conditions with installer present for compliance with requirements for opening configuration, penetrating items, substrates, and other conditions affecting performance of firestopping. Do not proceed with installation until unsatisfactory conditions have been corrected.

3.2 PREPARATION:

- A. Remove dirt, grease, oil, laitance and form-release agents from concrete, loose materials, or other substances that prevent adherence and bonding or application of the firestopping or smoke stopping materials.
- B. Remove insulation on insulated pipe for a distance of 150 mm (6 inches) on each side of the fire rated assembly prior to applying the firestopping materials unless the firestopping materials are tested and approved for use on insulated pipes.
- C. Prime substrates where required by joint firestopping system manufacturer using that manufacturer's recommended products and methods. Confine primers to areas of bond; do not allow spillage and migration onto exposed surfaces.
- D. Masking Tape: Apply masking tape to prevent firestopping from contacting adjoining surfaces that will remain exposed upon completion of work and that would otherwise be permanently stained or damaged by such contact or by cleaning methods used to remove smears from firestopping materials. Remove tape as soon as it is possible to do so without disturbing seal of firestopping with substrates.

3.3 INSTALLATION:

- A. Do not begin firestopping work until the specified material data and installation instructions of the proposed firestopping systems have been submitted and approved.

- B. Install firestopping systems with smoke stopping in accordance with FM, UL, WH, or other approved system details and installation instructions.
- C. Install smoke stopping seals in smoke partitions.

3.4 CLEAN-UP:

- A. As work on each floor is completed, remove materials, litter, and debris.
- B. Clean up spills of liquid type materials.
- C. Clean off excess fill materials and sealants adjacent to openings and joints as work progresses by methods and with cleaning materials approved by manufacturers of firestopping products and of products in which opening and joints occur.
- D. Protect firestopping during and after curing period from contact with contaminating substances or from damage resulting from construction operations or other causes so that they are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated firestopping immediately and install new materials to provide firestopping complying with specified requirements.

3.5 INSPECTIONS AND ACCEPTANCE OF WORK:

- A. Do not conceal or enclose firestop assemblies until inspection is complete and approved by the Contracting Officer Representative (COR).
- B. Furnish service of approved inspector to inspect firestopping in accordance with ASTM E2393 and ASTM E2174 for firestop inspection, and document inspection results. Submit written reports indicating locations of and types of penetrations and type of firestopping used at each location; type is to be recorded by UL listed printed numbers.

- - - E N D - - -

SECTION 07 92 00
JOINT SEALANTS

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section covers interior and exterior sealant and their application, wherever required for complete installation of building materials or systems.

1.2 RELATED WORK (INCLUDING BUT NOT LIMITED TO THE FOLLOWING):

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Sealing of Site Work Concrete Paving: Section 32 05 23, CEMENT AND CONCRETE FOR EXTERIOR IMPROVEMENTS.
- C. Masonry Control and Expansion Joint: Section 04 20 00, UNIT MASONRY.
- B. Firestopping Penetrations: Section 07 84 00, FIRESTOPPING.
- C. Mechanical Work: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.3 QUALITY ASSURANCE:

- A. Installer Qualifications: An experienced installer with a minimum of three (3) years' experience and who has specialized in installing joint sealants similar in material, design, and extent to those indicated for this Project and whose work has resulted in joint-sealant installations with a record of successful in-service performance. Submit qualification.
- B. Source Limitations: Obtain each type of joint sealant through one (1) source from a single manufacturer.
- C. Product Testing: Obtain test results from a qualified testing agency based on testing current sealant formulations within a 12-month period.
1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C1021.
 2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C920, and where applicable, to other standard test methods.
 3. Test other joint sealants for compliance with requirements indicated by referencing standard specifications and test methods.

D. Lab Tests: Submit samples of materials that will be in contact or affect joint sealants to joint sealant manufacturers for tests as follows:

1. Adhesion Testing: Before installing elastomeric sealants, test their adhesion to protect joint substrates according to the method in ASTM C794 to determine if primer or other specific joint preparation techniques are required.
2. Compatibility Testing: Before installing elastomeric sealants, determine compatibility when in contact with glazing and gasket materials.
3. Stain Testing: Perform testing per ASTM C1248 on interior and exterior sealants to determine if sealants or primers will stain adjacent surfaces. No sealant work is to start until results of these tests have been submitted to the Contracting Officer Representative (COR) and the COR has given written approval to proceed with the work.

1.4 CERTIFICATION:

A. Contractor is to submit to the COR written certification that joints are of the proper size and design, that the materials supplied are compatible with adjacent materials and backing, that the materials will properly perform to provide permanent watertight, airtight or vapor tight seals (as applicable), and that materials supplied meet specified performance requirements.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.
- C. Installer qualifications.
- D. Contractor certification.
- E. Manufacturer's installation instructions for each product used.
- F. Cured samples of exposed sealants for each color.
- G. Manufacturer's Literature and Data:
 1. Primers
 2. Sealing compound, each type, including compatibility when different sealants are in contact with each other.

H. Manufacturer warranty.

1.6 PROJECT CONDITIONS:

A. Environmental Limitations:

1. Do not proceed with installation of joint sealants under following conditions:

a. When ambient and substrate temperature conditions are outside limits permitted by joint sealant manufacturer or are below 4.4 degrees C (40 degrees F).

b. When joint substrates are wet.

B. Joint-Width Conditions:

1. Do not proceed with installation of joint sealants where joint widths are less than those allowed by joint sealant manufacturer for applications indicated.

C. Joint-Substrate Conditions:

1. Do not proceed with installation of joint sealants until contaminants capable of interfering with adhesion are removed from joint substrates.

1.7 DELIVERY, HANDLING, AND STORAGE:

A. Deliver materials in manufacturers' original unopened containers, with brand names, date of manufacture, shelf life, and material designation clearly marked thereon.

B. Carefully handle and store to prevent inclusion of foreign materials.

C. Do not subject to sustained temperatures exceeding 32 degrees C (90 degrees F) or less than 5 degrees C (40 degrees F).

1.8 DEFINITIONS:

A. Definitions of terms in accordance with ASTM C717 and as specified.

B. Backing Rod: A type of sealant backing.

C. Bond Breakers: A type of sealant backing.

D. Filler: A sealant backing used behind a back-up rod.

1.9 WARRANTY:

A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".

B. Manufacturer Warranty: Manufacturer shall warranty their sealant for a minimum of five (5) years from the date of installation and final acceptance by the Government. Submit manufacturer warranty.

1.10 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. ASTM International (ASTM):
 - C509-06Elastomeric Cellular Preformed Gasket and Sealing Material
 - C612-14Mineral Fiber Block and Board Thermal Insulation
 - C717-14aStandard Terminology of Building Seals and Sealants
 - C734-06 (R2012)Test Method for Low-Temperature Flexibility of Latex Sealants after Artificial Weathering
 - C794-10Test Method for Adhesion-in-Peel of Elastomeric Joint Sealants
 - C919-12.Use of Sealants in Acoustical Applications.
 - C920-14aElastomeric Joint Sealants.
 - C1021-08 (R2014)Laboratories Engaged in Testing of Building Sealants
 - C1193-13Standard Guide for Use of Joint Sealants.
 - C1248-08 (R2012)Test Method for Staining of Porous Substrate by Joint Sealants
 - C1330-02 (R2013)Cylindrical Sealant Backing for Use with Cold Liquid Applied Sealants
 - C1521-13Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints
 - D217-10Test Methods for Cone Penetration of Lubricating Grease
 - D1056-14Specification for Flexible Cellular Materials—Sponge or Expanded Rubber
 - E84-09Surface Burning Characteristics of Building Materials
- C. Sealant, Waterproofing and Restoration Institute (SWRI).
The Professionals' Guide
- D. Environmental Protection Agency (EPA):
 - 40 CFR 59 (2014)National Volatile Organic Compound Emission Standards for Consumer and Commercial Products

PART 2 - PRODUCTS

2.1 SEALANTS:

A. Exterior Sealants:

1. Vertical surfaces, provide non-staining ASTM C920, Type S or M, Grade NS, Class 25, Use NT.
 - a. Basis of Design: Emseal Colorseal
 - b. Product Description: factory-applied, low-modulus silicone with an open-cell polyurethane foam infused with a water-based, non-drying acrylic dispersion. The external-colored silicone facing is factory applied while the foam is partially precompressed to a width greater than maximum anticipated joint extension and is cured before final compression.
2. Horizontal surfaces, provide ASTM C920, Type S or M, Grade P, Class 25, Use T.
3. Provide location(s) of exterior sealant as follows:
 - a. Joints formed where frames and subsills of windows, doors, louvers, and vents adjoin masonry, concrete, or metal frames. Provide sealant at exterior surfaces of exterior wall penetrations.
 - b. Metal to metal.
 - c. Masonry to masonry or stone.
 - d. Cast stone to cast stone.
 - e. Masonry expansion and control joints.
 - d. Masonry joints where shelf angles occur.
 - e. Voids where items penetrate exterior walls.
 - f. Metal reglets, where flashing is inserted into masonry joints, and where flashing is penetrated by coping dowels.

B. Floor Joint Sealant:

1. ASTM C920, Type S or M, Grade P, Class 25, Use T.
2. Provide location(s) of floor joint sealant as follows.
 - a. Seats of metal thresholds exterior doors.
 - b. Control and expansion joints in floors, slabs.

C. Interior Sealants:

1. VOC Content of Interior Sealants: Sealants and sealant primers used inside the weatherproofing system are to comply with the following

- limits for VOC content when calculated according to 40 CFR 59, (EPA Method 24):
- a. Architectural Sealants: 250 g/L.
 - b. Sealant Primers for Nonporous Substrates: 250 g/L.
 - c. Sealant Primers for Porous Substrates: 775 g/L.
2. Vertical and Horizontal Surfaces: ASTM C920, Type S or M, Grade NS, Class 25, Use NT.
3. Provide location(s) of interior sealant as follows:
- a. Typical narrow joint 6 mm, (1/4 inch) or less at walls and adjacent components.
 - b. Perimeter of doors, windows, access panels which adjoin concrete or masonry surfaces.
 - c. Interior surfaces of exterior wall penetrations.
 - d. Joints at masonry walls and columns, piers, concrete walls or exterior walls.
 - e. Exposed isolation joints at top of full height walls.
 - f. Joints between bathtubs and ceramic tile; joints between shower receptors and ceramic tile; joints formed where nonplanar tile surfaces meet.

D. Acoustical Sealant:

1. Conforming to ASTM C919; flame spread of 25 or less; and a smoke developed rating of 50 or less when tested in accordance with ASTM E84. Acoustical sealant have a consistency of 250 to 310 when tested in accordance with ASTM D217; remain flexible and adhesive after 500 hours of accelerated weathering as specified in ASTM C734; and be non-staining.
2. Provide location(s) of acoustical sealant as follows:
 - a. Exposed acoustical joint at sound rated partitions.
 - b. Concealed acoustic joints at sound rated partitions.

2.2 COLOR:

- A. Sealants used with exposed masonry are to match color of mortar joints.
- B. Sealants used with unpainted concrete are to match color of adjacent concrete.

- C. Color of sealants for other locations to be light gray or aluminum, unless otherwise indicated in construction documents.

2.3 JOINT SEALANT BACKING:

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C1330, of type indicated below and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
 - 1. Type C: Closed-cell material with a surface skin.
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D1056 or synthetic rubber (ASTM C509), nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 32 degrees C (minus 26 degrees F). Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

2.4 FILLER:

- A. Mineral fiberboard: ASTM C612, Class 1.
- B. Thickness same as joint width.
- C. Depth to fill void completely behind back-up rod.

2.5 PRIMER:

- A. As recommended by manufacturer of caulking or sealant material.
- B. Stain free type.

2.6 CLEANERS-NON POROUS SURFACES:

- A. Chemical cleaners compatible with sealant and acceptable to manufacturer of sealants and sealant backing material. Cleaners to be free of oily residues and other substances capable of staining or harming joint substrates and adjacent non-porous surfaces and formulated to promote adhesion of sealant and substrates.

PART 3 - EXECUTION

3.1 INSPECTION:

- A. Inspect substrate surface for bond breaker contamination and unsound materials at adherent faces of sealant.
- B. Coordinate for repair and resolution of unsound substrate materials.
- C. Inspect for uniform joint widths and that dimensions are within tolerance established by sealant manufacturer.

3.2 PREPARATIONS:

- A. Prepare joints in accordance with manufacturer's instructions and SWRI (The Professionals' Guide).
- B. Clean surfaces of joint to receive caulking or sealants leaving joint dry to the touch, free from frost, moisture, grease, oil, wax, lacquer paint, or other foreign matter that would tend to destroy or impair adhesion.
 - 1. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants.
 - 2. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Porous joint surfaces include but are not limited to the following:
 - a. Concrete.
 - b. Masonry.
 - 3. Remove laitance and form-release agents from concrete.
 - 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous surfaces include but are not limited to the following:
 - a. Metal.
 - b. Glass.
- C. Do not cut or damage joint edges.
- D. Apply non-staining masking tape to face of surfaces adjacent to joints before applying primers, caulking, or sealing compounds.
 - 1. Do not leave gaps between ends of sealant backings.
 - 2. Do not stretch, twist, puncture, or tear sealant backings.
 - 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.

E. Apply primer to sides of joints wherever required by compound manufacturer's printed instructions or as indicated by pre-construction joint sealant substrate test.

1. Apply primer prior to installation of back-up rod or bond breaker tape.
2. Use brush or other approved means that will reach all parts of joints. Avoid application to or spillage onto adjacent substrate surfaces.

3.3 BACKING INSTALLATION:

- A. Install backing material, to form joints enclosed on three sides as required for specified depth of sealant.
- B. Where deep joints occur, install filler to fill space behind the backing rod and position the rod at proper depth.
- C. Cut fillers installed by others to proper depth for installation of backing rod and sealants.
- D. Install backing rod, without puncturing the material, to a uniform depth, within plus or minus 3 mm (1/8 inch) for sealant depths specified.
- E. Where space for backing rod does not exist, install bond breaker tape strip at bottom (or back) of joint so sealant bonds only to two opposing surfaces.

3.4 SEALANT DEPTHS AND GEOMETRY:

- A. At widths up to 6 mm (1/4 inch), sealant depth equal to width.
- B. At widths over 6 mm (1/4 inch), sealant depth 1/2 of width up to 13 mm (1/2 inch) maximum depth at center of joint with sealant thickness at center of joint approximately 1/2 of depth at adhesion surface.

3.5 INSTALLATION:

- A. General:
 1. Apply sealants and caulking only when ambient temperature is between 5 degrees C and 38 degrees C (40 degrees and 100 degrees F).
 2. Do not install polysulfide base sealants where sealant may be exposed to fumes from bituminous materials, or where water vapor in continuous contact with cementitious materials may be present.
 3. Do not install sealant type listed by manufacture as not suitable for use in locations specified.

4. Apply caulking and sealing compound in accordance with manufacturer's printed instructions.
 5. Avoid dropping or smearing compound on adjacent surfaces.
 6. Fill joints solidly with compound and finish compound smooth.
 7. Tool exposed joints to form smooth and uniform beds, with slightly concave surface conforming to joint configuration per Figure 5A in ASTM C1193 unless shown or specified otherwise in construction documents. Remove masking tape immediately after tooling of sealant and before sealant face starts to "skin" over. Remove any excess sealant from adjacent surfaces of joint, leaving the working in a clean finished condition.
 8. Finish paving or floor joints flush unless joint is otherwise detailed.
 9. Apply compounds with nozzle size to fit joint width.
 10. Test sealants for compatibility with each other and substrate. Use only compatible sealant. Submit test reports.
 11. Replace sealant which is damaged during construction process.
- B. For application of sealants, follow requirements of ASTM C1193 unless specified otherwise. Take all necessary steps to prevent three-sided adhesion of sealants.
- C. Interior Sealants: Where gypsum board partitions are of sound rated, fire rated, or smoke barrier construction, follow requirements of ASTM C919 only to seal all cut-outs and intersections with the adjoining construction unless specified otherwise.
1. Apply a 6 mm (1/4 inch) minimum bead of sealant each side of runners (tracks), including those used at partition intersections with dissimilar wall construction.
 2. Coordinate with application of gypsum board to install sealant immediately prior to application of gypsum board.
 3. Partition intersections: Seal edges of face layer of gypsum board abutting intersecting partitions, before taping and finishing or application of veneer plaster-joint reinforcing.
 4. Openings: Apply a 6 mm (1/4 inch) bead of sealant around all cutouts to seal openings of electrical boxes, ducts, pipes and similar penetrations. To seal electrical boxes, seal sides and backs.

5. Control Joints: Before control joints are installed, apply sealant in back of control joint to reduce flanking path for sound through control joint.

3.6 CLEANING:

- A. Fresh compound accidentally smeared on adjoining surfaces: Scrape off immediately and rub clean with a solvent as recommended by manufacturer of the adjacent material or if not otherwise indicated by the caulking or sealant manufacturer.
- B. Leave adjacent surfaces in a clean and unstained condition.

- - - E N D - - -

SECTION 07 95 13
EXPANSION JOINT COVER ASSEMBLIES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Prefabricated floor, wall, and ceiling building expansion joint assemblies.
 - a. Preformed elastomeric sealant joint at interior floor and wall control joints.
 - b. Exterior wall joints.

1.2 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this Section.
- B. American Society of Civil Engineers (ASCE):
1. ASCE/SEI 7-10 - Minimum Design Loads For Buildings and Other Structures.
- C. ASTM International (ASTM):
1. A36/A36M-14 - Structural Steel.
 2. A240/A240M-15b - Chromium and Chromium-Nickel Stainless Steel Plate, Sheet and Strip for Pressure Vessels and for General Applications.
 3. A283/A283M-13 - Low and Intermediate Tensile Strength Carbon Steel Plates.
 4. A786/A786M-05(2009) - Hot-Rolled Carbon, Low-Alloy, High-Strength Low-Alloy, and Alloy Steel Floor Plates.
 5. B36/B36M-13 - Brass, Plate, Sheet, Strip, and Rolled Bar.
 6. B121/B121M-11 - Leaded Brass Plate, Sheet, Strip and Rolled Bar.
 7. B209-14 - Aluminum and Aluminum-Alloy Sheet and Plate.
 8. B209M-14 - Aluminum and Aluminum-Alloy Sheet and Plate (Metric).
 9. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
 10. B221M 13 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric).
 11. B455-10 - Copper-Zinc-Lead Alloy (Leaded-Brass) Extruded Shapes.
 12. C864-05(2011) - Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers.

13. D1187/D1187M-97(2011)e1 - Asphalt-Base Emulsions for Use as Protective Coatings for Metal.
14. E1399/E1399M-97(2013)e1 - Standard Test Method for Cyclic Movement and Measuring the Minimum and Maximum Joint Widths of Architectural Joint Systems.
15. E1966-15 - Standard Test Method for Fire-Resistive Joint Systems.
- D. National Association of Architectural Metal Manufacturers (NAAMM):
 1. AMP 500-06 - Metal Finishes Manual.
- E. UL LLC (UL):
 1. 2079-15 - Standard for Tests for Fire Resistance of Building Joint Systems.

1.3 PREINSTALLATION MEETINGS

- A. Conduct preinstallation meeting at project site minimum 30 days before beginning Work of this Section.
 1. Required Participants:
 - a. Contracting Officer's Representative.
 - b. Contractor.
 - c. Installer.
 2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
 - a. Installation schedule.
 - b. Installation sequence.
 - c. Preparatory work.
 - d. Protection before, during, and after installation.
 - e. Installation.
 - f. Terminations.
 - g. Transitions and connections to other work.
 - h. Other items affecting successful completion.
 3. Document and distribute meeting minutes to participants to record decisions affecting installation.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 1. Include large-scale details indicating profiles of each type of expansion joint cover, splice joints between joint sections,

- transitions to other assemblies, terminations, anchorages, fasteners, and relationship to adjoining work and finishes.
2. Show size, configuration, and fabrication and installation details.
 3. Include composite drawings showing work specified in other Sections coordinated with expansion joints.
- C. Manufacturer's Literature and Data:
1. Description of each product specified.
 2. Show movement capability of each cover assembly // and suitability of material used in exterior seals for ultraviolet exposure //.
 3. Description of materials and finishes.
 4. Installation instructions.
- D. Samples: Submit 300 mm (12 inch) long samples.
1. Each type and color of metal finish for each required thickness and alloy.
 2. Each type and color of flexible seal.
- E. Sustainable Construction Submittals:
1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.
 2. Low Pollutant-Emitting Materials:
 - a. Identify volatile organic compound types and quantities.
- F. Qualifications: Substantiate qualifications comply with specifications.
1. Installer with project experience list .
- G. Operation and Maintenance Data:
1. Care instructions for each exposed finish product.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications:
1. Regularly installs specified products.
 2. Installed specified products with satisfactory service on five similar installations for minimum five years.
 - a. Project Experience List: Provide contact names and addresses for completed projects.

1.6 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, and manufacture date.

- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.

1.8 FIELD CONDITIONS

- A. Field Measurements: Verify field conditions affecting expansion joint cover assembly fabrication and installation. Show field measurements on Submittal Drawings.
 - 1. Coordinate field measurement and fabrication schedule to avoid delay.

1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Provide joint cover assemblies that permit unrestrained movement of joint without disengagement of cover, and, where applicable, maintain moisture, watertight and fire-rated protection.
- B. Provide templates to related trades for location of support and anchorage items.

2.2 SYSTEM PERFORMANCE

- A. Design expansion joint cover assemblies complying with specified performance.
- B. Joint Movement: ASTM E1399.
 - 1. Nominal Joint Width: Refer to Drawings.
 - 2. Minimum Movement Capability: 25 percent.
 - 3. Movement Type: Thermal and wind and seismic.
- C. Floor Joints: Live loads, including rolling loads.
 - 1. Load Resistance: ASCE/SEI 7; Design criteria as indicated on Drawings.
 - 2. Maximum Deflection: 1/360 of span, maximum.

2.3 MATERIALS

- A. Aluminum:
 - 1. Extruded: ASTM B221M (ASTM B221), alloy 6063-T5, 6063-T6, or 6061-T6.
 - 2. Plate and Sheet: ASTM B209M (ASTM B209), alloy 6061-T6.
- B. Elastomeric Seals:
 - 1. Flexible extruded polyvinyl chloride, meeting a Shore A hardness of 75 with UV stabilizer. Manufacturer's standard colors.
- C. Thermoplastic Rubber:
 - 1. ASTM C864.
 - 2. Dense Neoprene or other material standard with expansion joint manufacturers having the same physical properties.
- D. Compression Seals: Pre-compressed secondary sealant using preformed expanding foam sealant; open-cell polyurethane foam impregnated with polymer-modified acrylic adhesive. Acceptable Product: Emseal 2-Inch expansion joint, fire-rated. Color: To be selected from manufacturers full range.

2.4 PRODUCTS - GENERAL

- A. Provide each product from one manufacturer.
 - 1. Provide ceiling and wall expansion joint cover assemblies design matching floor to wall and floor to floor expansion joint cover design.
 - 2. Provide expansion joint cover assembly designs, profiles, materials and configuration indicated, as required to accommodate joint size variations in adjacent surfaces, and anticipated movement.
- B. Sustainable Construction Requirements:
 - 1. Aluminum Recycled Content: 80 percent total recycled content, minimum.
 - 2. Low Pollutant-Emitting Materials: Maximum VOC content by weight.
 - a. Non-Flooring Adhesives and Sealants.

2.5 FABRICATION

- A. Fabricate Expansion Joint Cover Assemblies:
 - 1. As complete assembly ready for installation.
 - 2. In longest practicable lengths to minimize number of end joints.
 - 3. With factory mitered corners where joint changes directions or abuts other materials.

- a. With closure materials and transition pieces, tee-joints, corners, curbs, cross-connections and other assemblies.
4. Compression Seals: Fabricate from expanding foam as secondary seal and elastomeric sealant to sizes and profiles shown.
- B. Interior Wall Joint Cover Assemblies:
 1. Frame: Metal, surface mounted, concealed fastening to wall on one sides of joint.
 2. Joint Design: Match adjacent floor to floor design.
- C. Extruded Thermoplastic Rubber Joint Assemblies:
 1. Frames: Aluminum, both sides of joint.
 2. Primary Seal: Flexible rubber on exposed face after frame installation with factory welded watertight miters and transitions.
 - a. Anchor spaced at ends and not over 600 mm (24 inches).
 - 1) Variable movement extruded rubber primary seal designed to remain in aluminum frame, throughout movement of joint.
 - b. Flush mounted seal minimum 3 mm (0.12 inch) thick with dual movement grooves designed for plus or minus 50 percent, movement of joint width.
- D. Ceiling Assemblies:
 1. Flexible Insert: Variable movement semi-rigid vinyl locked into frame.
 - a. Face Style: Flush or accordion, as shown, to span joint width without sagging.

2.6 FINISHES

- A. Aluminum Anodized Finish: NAAMM AMP 500.
 1. Clear Anodized Finish: AA-C22A41; Class I Architectural, 0.018 mm (0.7 mil) thick.

2.7 ACCESSORIES

- A. General: Manufacturer's standard anchors, fasteners, set screws, spaces, protective coating, and filler materials, adhesive and other accessories required for installation.
- B. Adhesives: Low pollutant-emitting, water based type recommended by adhered product manufacturer for each application.
- C. Fasteners: Type and size recommended by expansion joint cover assembly manufacturer.
 1. Fasteners for Aluminum: Stainless steel.

2. Other Applications: Galvanized steel or stainless steel.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
 1. Provide items embedded in concrete and masonry in time for building into work without delaying work.
- B. Protect existing construction and completed work from damage.
- C. Apply barrier coating to aluminum surfaces in contact with dissimilar metals and cementitious materials to minimum 0.7 mm (30 mils) dry film thickness.

3.2 INSTALLATION

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Install anchorage devices and fasteners for securing expansion joint assemblies to in-place construction where anchors are not embedded in concrete and masonry.
 1. Secure with metal fasteners, type and size to suit application.
- C. Perform cutting, drilling and fitting required for installation of expansion joint cover assemblies.
- D. Install joint cover assemblies aligned and positioned in correct relationship to expansion joint opening and adjoining finished surfaces measured from established lines and levels.
 1. Allow for thermal expansion and contraction of metal to avoid buckling.
 2. Accommodate joint opening size at time of installation.
- E. Locate wall, and ceiling covers in continuous contact with adjacent surfaces. Secure with required accessories.
- F. Locate anchors at interval recommended by manufacturer, but minimum 75 mm (3 inches) from each end, and, maximum 600 mm (24 inches) on centers.

- G. Maintain continuity of expansion joint cover assemblies with end joints held to a minimum and metal members aligned mechanically using splice joints.
- H. Cut and fit ends to accommodate thermal expansion and contraction of metal to avoid buckling of frames and cover plates.
- I. Apply sealant where required to prevent water and air infiltration.
- J. Preformed Elastomeric Sealant Joint:
 - 1. Locate joint directly over joints in wall and floor substrates.
 - 2. Fasten full length to substrate using construction adhesive.
 - 3. Install flush or slightly below finish material.

3.3 CLEANING

- A. Remove excess adhesive before adhesive sets.
- B. Clean exposed metal surfaces. Remove contaminants and stains.

3.4 PROTECTION

- A. Cover floor joints with plywood where wheel traffic occurs before Substantial completion.
- B. Remove protective covering when adjacent work areas are completed. Clean exposed surfaces in compliance with manufacture's printed instructions.

- - E N D - -

SECTION 081113

HOLLOW METAL DOORS AND FRAMES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

1. Standard and custom hollow metal doors and frames.
2. Steel sidelight, borrowed lite and transom frames.
3. Louvers installed in hollow metal doors.
4. Light frames and glazing installed in hollow metal doors.

B. Related Sections:

1. Division 01 Section "General Conditions".
2. Division 04 Section "Unit Masonry" for embedding anchors for hollow metal work into masonry construction.
3. Division 08 Section "Flush Wood Doors".
4. Division 08 Section "Glazing" for glass view panels in hollow metal doors.
5. Division 08 Section "Door Hardware".
6. Division 09 Sections "Exterior Painting" and "Interior Painting" for field painting hollow metal doors and frames.

C. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.

1. ANSI/SDI A250.8 - Recommended Specifications for Standard Steel Doors and Frames.
2. ANSI/SDI A250.4 - Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames, Frames Anchors and Hardware Reinforcing.
3. ANSI/SDI A250.6 - Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames.
4. ANSI/SDI A250.10 - Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames.
5. ANSI/SDI A250.11 - Recommended Erection Instructions for Steel Frames.

6. ASTM A1008 - Standard Specification for Steel Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability.
7. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
8. ASTM A924 - Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process.
9. ASTM C 1363 - Standard Test Method for Thermal Performance of Building Assemblies by Means of a Hot Box Apparatus.
10. ANSI/BHMA A156.115 - Hardware Preparation in Steel Doors and Frames.
11. ANSI/SDI 122 - Installation and Troubleshooting Guide for Standard Steel Doors and Frames.
12. ANSI/NFPA 80 - Standard for Fire Doors and Fire Windows; National Fire Protection Association.
13. ANSI/NFPA 105: Standard for the Installation of Smoke Door Assemblies.
14. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; National Fire Protection Association.
15. UL 10C - Positive Pressure Fire Tests of Door Assemblies.
16. UL 1784 - Standard for Air Leakage Tests of Door Assemblies.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated. Include construction details, material descriptions, core descriptions, hardware reinforcements, profiles, anchors, fire-resistance rating, and finishes.
- B. Door hardware supplier is to furnish templates, template reference number and/or physical hardware to the steel door and frame supplier in order to prepare the doors and frames to receive the finish hardware items.
- C. Shop Drawings: Include the following:
 1. Elevations of each door design.
 2. Details of doors, including vertical and horizontal edge details and metal thicknesses.
 3. Frame details for each frame type, including dimensioned profiles and metal thicknesses.
 4. Locations of reinforcement and preparations for hardware.
 5. Details of anchorages, joints, field splices, and connections.
 6. Details of accessories.
 7. Details of moldings, removable stops, and glazing.
 8. Details of conduit and preparations for power, signal, and control systems.
- D. Samples for Verification:

1. Samples are only required by request of the architect and for manufacturers that are not current members of the Steel Door Institute.

1.4 QUALITY ASSURANCE

- A. Source Limitations: Obtain hollow metal doors and frames through one source from a single manufacturer wherever possible.
- B. Quality Standard: In addition to requirements specified, furnish SDI-Certified manufacturer products that comply with ANSI/SDI A250.8, latest edition, "Recommended Specifications for Standard Steel Doors and Frames".
- C. Fire-Rated Door Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, based on testing at positive pressure according to UL10C (neutral pressure at 40" above sill) or UL 10C.
 1. Oversize Fire-Rated Door Assemblies Construction: For units exceeding sizes of tested assemblies, attach construction label certifying doors are built to standard construction requirements for tested and labeled fire rated door assemblies except for size.
 2. Temperature-Rise Limit: Where indicated and at vertical exit enclosures (stairwell openings) and exit passageways, provide doors that have a maximum transmitted temperature end point of not more than 450 deg F (250 deg C) above ambient after 30 minutes of standard fire-test exposure.
 3. Smoke Control Door Assemblies: Comply with NFPA 105.
 - a. Smoke "S" Label: Doors to bear "S" label, and include smoke and draft control gasketing applied to frame and on meeting stiles of pair doors.
- D. Fire-Rated, Borrowed-Light Frame Assemblies: Assemblies complying with NFPA 80 that are listed and labeled, by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated, based on testing according to NFPA 257. Provide labeled glazing material.
- E. Pre-Submittal Conference: Conduct conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier, Installer, and Contractor to review proper methods and procedures for installing hollow metal doors and frames and to verify installation of electrical knockout boxes and conduit at frames with electrified or access control hardware.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver hollow metal work palletized, wrapped, or crated to provide protection during transit and Project site storage. Do not use non-vented plastic.

- B. Deliver welded frames with two removable spreader bars across bottom of frames, tack welded to jambs and mullions.
- C. Store hollow metal work under cover at Project site. Place in stacks of five units maximum in a vertical position with heads up, spaced by blocking, on minimum 4-inch high wood blocking. Do not store in a manner that traps excess humidity.
 - 1. Provide minimum 1/4-inch space between each stacked door to permit air circulation. Door and frames to be stacked in a vertical upright position.

1.6 PROJECT CONDITIONS

- A. Field Measurements: Verify actual dimensions of openings by field measurements before fabrication.

1.7 COORDINATION

- A. Coordinate installation of anchorages for hollow metal frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors. Deliver such items to Project site in time for installation.
- B. Building Information Modeling (BIM) Support: Utilize designated BIM software tools and obtain training needed to successfully participate in the Project BIM processes. All technical disciplines are responsible for the product data integration and data reliability of their Work into the coordinated BIM applications.

1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace doors that fail in materials or workmanship within specified warranty period.
- B. Warranty includes installation and finishing that may be required due to repair or replacement of defective doors.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide steel doors and frames from a SDI Certified manufacturer:
 - 1. CECO Door Products (C).
 - 2. Curries Company (CU).
 - 3. Pioneer Industries (PI).
 - 4. Steelcraft (S).

2.2 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.
- C. Frame Anchors: ASTM A 653/A 653M, Commercial Steel (CS), Commercial Steel (CS), Type B; with minimum G60 (Z180) or A60 (ZF180) metallic coating.

2.3 HOLLOW METAL FRAMES

- A. General: Comply with ANSI/SDI A250.8 and with details indicated for type and profile.
- B. Interior Frames: Fabricated from cold-rolled steel sheet that complies with ASTM A 1008/A 1008M.
 - 1. Fabricate frames with mitered or coped corners. Profile as indicated on drawings.
 - 2. Frames: Minimum 16 gauge (0.053-inch -1.3-mm) thick steel sheet.
 - 3. Manufacturers Basis of Design:
 - a. Curries Company (CU) - C CM Series.
 - b. Curries Company (CU) - M Series.
- C. Fire rated frames: Fabricate frames in accordance with NFPA 80, listed and labeled by a qualified testing agency, for fire-protection ratings indicated.
- D. Hardware Reinforcement: Fabricate according to ANSI/SDI A250.6 Table 4 with reinforcement plates from same material as frames.

2.4 FRAME ANCHORS

- A. Jamb Anchors:
 - 1. Masonry Type: Adjustable strap-and-stirrup or T-shaped anchors to suit frame size, formed from A60 metallic coated material, not less than 0.042 inch thick, with corrugated or perforated straps not less than 2 inches wide by 10 inches long; or wire anchors not less than 0.177 inch thick.
 - 2. Stud Wall Type: Designed to engage stud and not less than 0.042 inch thick.
 - 3. Compression Type for Drywall Slip-on (Knock-Down) Frames: Adjustable compression anchors.
- B. Floor Anchors: Floor anchors to be provided at each jamb, formed from A60 metallic coated material, not less than 0.042 inches thick.

- C. Mortar Guards: Formed from same material as frames, not less than 0.016 inches thick.

2.5 ACCESSORIES

- A. Mullions and Transom Bars: Join to adjacent members by welding or rigid mechanical anchors.
- B. Grout Guards: Formed from same material as frames, not less than 0.016 inches thick.

2.6 FABRICATION

- A. Fabricate hollow metal work to be rigid and free of defects, warp, or buckle. Accurately form metal to required sizes and profiles, with minimum radius for thickness of metal. Where practical, fit and assemble units in manufacturer's plant. When shipping limitations so dictate, frames for large openings are to be fabricated in sections for splicing or splining in the field by others.
- B. Tolerances: Fabricate hollow metal work to tolerances indicated in ANSI/SDI A250.8.
- C. Hollow Metal Frames:
 - 1. Shipping Limitations: Where frames are fabricated in sections due to shipping or handling limitations, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
 - 2. Welded Frames: Weld flush face joints continuously; grind, fill, dress, and make smooth, flush, and invisible.
 - a. Welded frames are to be provided with two steel spreaders temporarily attached to the bottom of both jambs to serve as a brace during shipping and handling. Spreader bars are for bracing only and are not to be used to size the frame opening.
 - 3. High Frequency Hinge Reinforcement: Provide high frequency hinge reinforcements at door openings 48-inches and wider with mortise butt type hinges at top hinge locations.
 - 4. Continuous Hinge Reinforcement: Provide welded continuous 12 gauge straps for continuous hinges specified in hardware sets in Division 08 Section "Door Hardware".
 - 5. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated for removable stops, provide security screws at exterior locations.
 - 6. Mortar Guards: Provide guard boxes at back of hardware mortises in frames at all hinges and strike preps regardless of grouting requirements.
 - 7. Floor Anchors: Weld anchors to bottom of jambs and mullions with at least four spot welds per anchor.
 - 8. Jamb Anchors: Provide number and spacing of anchors as follows:

- a. Masonry Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Two anchors per jamb up to 60 inches high.
 - 2) Three anchors per jamb from 60 to 90 inches high.
 - 3) Four anchors per jamb from 90 to 120 inches high.
 - 4) Four anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 120 inches high.
 - b. Stud Wall Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Three anchors per jamb up to 60 inches high.
 - 2) Four anchors per jamb from 60 to 90 inches high.
 - 3) Five anchors per jamb from 90 to 96 inches high.
 - 4) Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 96 inches high.
 - 5) Two anchors per head for frames above 42 inches wide and mounted in metal stud partitions.
 9. Door Silencers: Except on weatherstripped or gasketed doors, drill stops to receive door silencers. Silencers to be supplied by frame manufacturer regardless if specified in Division 08 Section "Door Hardware".
 10. Bituminous Coating: Where frames are fully grouted with an approved Portland Cement based grout or mortar, coat inside of frame throat with a water based bituminous or asphaltic emulsion coating to a minimum thickness of 3 mils DFT, tested in accordance with UL 10C and applied to the frame under a 3rd party independent follow-up service procedure.
- D. Hardware Preparation: Factory prepare hollow metal work to receive template mortised hardware; include cutouts, reinforcement, mortising, drilling, and tapping according to the Door Hardware Schedule and templates furnished as specified in Division 08 Section "Door Hardware."
1. Locate hardware as indicated, or if not indicated, according to ANSI/SDI A250.8.
 2. Reinforce doors and frames to receive non-template, mortised and surface mounted door hardware.
 3. Comply with applicable requirements in ANSI/SDI A250.6 and ANSI/DHI A115 Series specifications for preparation of hollow metal work for hardware.
 4. Coordinate locations of conduit and wiring boxes for electrical connections with Division 26 Sections.

2.7 STEEL FINISHES

- A. Prime Finishes: Doors and frames to be cleaned, and chemically treated to insure maximum finish paint adhesion. Surfaces of the door and frame

exposed to view to receive a factory applied coat of rust inhibiting shop primer.

1. Shop Primer: Manufacturer's standard, fast-curing, lead and chromate free primer complying with ANSI/SDI A250.10 acceptance criteria; recommended by primer manufacturer for substrate; and compatible with substrate and field-applied coatings.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. General Contractor to verify the accuracy of dimensions given to the steel door and frame manufacturer for existing openings or existing frames (strike height, hinge spacing, hinge back set, etc.).
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Remove welded in shipping spreaders installed at factory. Restore exposed finish by grinding, filling, and dressing, as required to make repaired area smooth, flush, and invisible on exposed faces.
- B. Prior to installation, adjust and securely brace welded hollow metal frames for square, level, twist, and plumb condition.
- C. Tolerances shall comply with SDI-117 "Manufacturing Tolerances Standard Steel Doors and Frames."
- D. Drill and tap doors and frames to receive non-template, mortised, and surface-mounted door hardware.

3.3 INSTALLATION

- A. General: Install hollow metal work plumb, rigid, properly aligned, and securely fastened in place; comply with Drawings and manufacturer's written instructions.
- B. Hollow Metal Frames: Install hollow metal frames of size and profile indicated. Comply with ANSI/SDI A250.11 and NFPA 80 at fire rated openings.
 1. Set frames accurately in position, plumbed, leveled, aligned, and braced securely until permanent anchors are set. After wall construction is complete and frames properly set and secured,

remove temporary braces, leaving surfaces smooth and undamaged. Shim as necessary to comply with installation tolerances.

2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with post-installed expansion anchors.
3. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with mortar.
4. Grout Requirements: Do not grout head of frames unless reinforcing has been installed in head of frame. Do not grout vertical or horizontal closed mullion members.

- C. Field Glazing: Comply with installation requirements in Division 08 Section "Glazing" and with hollow metal manufacturer's written instructions.

3.4 ADJUSTING AND CLEANING

- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including hollow metal work that is warped, bowed, or otherwise unacceptable.
- B. Remove grout and other bonding material from hollow metal work immediately after installation.
- C. Prime-Coat and Painted Finish Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat, or painted finishes, and apply touchup of compatible air drying, rust-inhibitive primer, zinc rich primer (exterior and galvanized openings) or finish paint.

3.5 FIELD QUALITY CONTROL

- A. Field Inspection (Punch Report): Reference Division 01 Sections "Closeout Procedures". Produce project punch report for each installed door opening indicating compliance with approved submittals and verification hardware is properly installed, operating and adjusted. Include list of items to be completed and corrected, indicating the reasons or deficiencies causing the Work to be incomplete or rejected.
 1. Organization of List: Include separate Door Opening and Deficiencies and Corrective Action Lists organized by Mark, Opening Remarks and Comments, and related Opening Images and Video Recordings.

END OF SECTION 081113

**SECTION 08 14 00
INTERIOR WOOD DOORS**

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Interior flush wood doors transparent finish.

1.2 RELATED REQUIREMENTS

- A. Paints and Coatings and Composite Wood and Agrifiber VOC Limits:
Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Door Hardware including hardware location (height): Section 08 71 00,
DOOR HARDWARE.
- C. Installation of Doors and Hardware: Section 08 11 13, HOLLOW METAL
DOORS AND FRAMES Section 08 71 00, DOOR HARDWARE.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. American National Standards Institute/Window and Door Manufacturers
Association (ANSI/WDMA):
1. I.S. 1A-13 - Architectural Wood Flush Doors.
 2. I.S. 6A-13 - Interior Architectural Stile and Rails Doors.
- C. ASTM International (ASTM):
1. E90-09 - Laboratory Measurements of Airborne Sound Transmission Loss
of Building Partitions and Elements.
- D. Window and Door Manufacturers Association (WDMA):
1. TM 7-14 - Cycle-Slam Test.
 2. TM 8-14 - Hinge Loading Test.
 3. TM 10-14 - Screw Holding Capacity.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA,
AND SAMPLES.
- B. Submittal Drawings:
1. Show size, configuration, and fabrication and installation details.
 2. Include details of glazing .
 3. Indicate project specific requirements not included in
Manufacturer's Literature and Data submittal.
- C. Manufacturer's Literature and Data:

1. Description of each product.

D. Samples:

1. Corner section of flush veneered door 300 mm (12 inches) square, showing details of construction, labeled to show grade and type number and conformance to specified standard.
2. Veneer sample 200 mm by 275 mm (8 inch by 11 inch) showing specified wood species sanded to receive a transparent finish. Factory finish veneer sample where the prefinished option is accepted.

E. Sustainable Construction Submittals:

1. Low Pollutant-Emitting Materials:

- a. Show volatile organic compound types and quantities.

F. Test Reports: Indicate products comply with specifications.

1. Screw Holding Capacity Test.
2. Cycle-Slam Test.
3. Hinge-Loading Test.

G. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

1.5 QUALITY ASSURANCE

A. Manufacturer Qualifications:

1. Regularly and presently manufactures specified products.
2. Manufactures specified products with satisfactory service on five similar installations for minimum five years.

1.6 DELIVERY

A. Deliver products in manufacturer's original sealed packaging.

1. Minimum 0.15 mm (6 mil) polyethylene bags or cardboard packaging to remain unbroken during delivery and storage.

B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, and manufacture date.

1. Identify door opening corresponding to Door Schedule.

C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.7 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight conditioned facility.
 - 1. Store doors according to ANSI/WDMA I.S. 1A.
- B. Protect products from damage during handling and construction operations.

1.8 FIELD CONDITIONS

- A. Environment:
 - 1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
 - 2. Work Area Ambient Temperature Range: 21 to 27 degrees C (70 to 80 degrees F) continuously, beginning 48 hours before installation.
 - 3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.
 - a. Comply with door manufacturer's instructions for relative humidity.

1.9 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant interior factory finished flush wood doors against material and manufacturing defects.
 - 1. Warranty Period: Lifetime of original installation.

PART 2 - PRODUCTS

2.1 PRODUCTS - GENERAL

- A. Provide each product from one manufacturer.
- B. Sustainable Construction Requirements:
 - 1. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Paints and coatings.
 - b. Composite wood and agrifiber.

2.2 FLUSH WOOD DOORS

- A. General:
 - 1. ANSI/WDMA I.S. 1A, Extra Heavy Duty.
 - 2. Adhesive: Type II.

3. Core: Structural composite lumber, except when mineral core is required for fire rating.
4. Thickness: 44 mm (1-3/4 inches) unless otherwise shown or specified.
5. Finish: Refer to Finish Legend.

B. Faces:

1. ANSI/WDMA I.S. 1A.
2. One species throughout project unless scheduled or otherwise shown.
3. Transparent Finished Faces: Premium Grade. rotary cut, white birch.
 - a. A Grade face veneer.
 - b. Match face veneers for doors for uniform effect of color and grain at joints.
 - c. Door Edges: Same species as door face veneer, except maple is acceptable for stile face veneer on birch doors.
4. Factory sand doors for finishing.

C. Wood For Stops, Louvers, Muntins and Moldings For Flush Doors Required to Have Transparent Finish:

1. Solid wood of same species as face veneer..
2. Glazing:
 - a. On non-fire-rated doors, use applied wood stops nailed tightly on room side and attached on opposite side with flathead, countersunk wood screws, spaced approximately 125 mm (5 inches) on center.

D. Sound Rated Doors:

1. Fabricated as specified for flush wood doors with additional construction requirements to comply with specified sound transmission class (STC).
2. STC Rating of door assembly in place when tested according to ASTM E90 by independent acoustical testing laboratory minimum 35.

2.3 FABRICATION

- A. Factory machine interior wood doors to receive hardware, bevels, undercuts, cutouts, accessories and fitting for frame.
 1. Factory fit fire rated doors according to NFPA 80.
- B. Rout doors for hardware using templates and location heights specified in Section 08 71 00, DOOR HARDWARE.

- C. Factory fit doors to frame, bevel lock edge of doors 3 mm (1/8 inch) for each 50 mm (2 inches) of door thickness undercut where shown .
- D. Clearances between Doors and Frames and Floors:
 - a. Other Door Bottoms: Maximum 3 mm (1/8 inch) clearance at the jambs, heads, and meeting stiles, and a 19 mm (3/4 inch) clearance at bottom, except as otherwise specified.
 - 2. Door Jambs, Heads, and Meeting Stiles: Maximum 3 mm (1/8 inch).
- E. Provide cutouts for glazed openings.
- F. Finish surfaces, including both faces, top and bottom and edges of the doors smooth to touch.
- G. Identify each door on top edge.
 - 1. Mark with stamp, brand or other indelible mark, giving manufacturer's name, door's trade name, construction of door, date of manufacture and quality.
 - 2. Mark door or provide separate certification including name of inspection organization.
 - 3. Identify door manufacturing standard, including glue type.
 - 4. Identify veneer and quality certification.
 - 5. Identification of preservative treatment for stile and rail doors.

2.4 FINISHES

- A. Factory Transparent Finish:
 - 1. Factory finish flush wood doors.
 - a. ANSI/WDMA I.S. 1A Section F-3 Finish System Descriptions for System 5, Conversion Varnish or System 7, Catalyzed Vinyl.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
 - 1. Verify door frames are properly anchored.
 - 2. Verify door frames are plumb, square, in plane, and within tolerances for door installation.
- B. Protect existing construction and completed work from damage.

3.2 INSTALLATION

- A. Install products according to manufacturer's instructions and approved submittal drawings .

1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

3.3 PROTECTION

- A. After installation, place shipping container over door and tape in place.
 1. Do not apply tape to door faces and edges.
- B. Provide protective covering over exposed hardware in addition to covering door.
- C. Maintain covering in good condition until removal is directed by Contracting Officer's Representative.

- - E N D - -

SECTION 08 31 13
ACCESS DOORS AND FRAMES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Access doors and panels installed in walls and ceilings.

1.2 RELATED REQUIREMENTS

- A. Field Painting: Section 09 91 00, PAINTING.
- B. Access Doors for Plumbing Valves: Section 21 40 00, PLUMBING FIXTURES.
- C. Locations of Access Doors for Ductwork Cleanouts: Section 23 31 00, HVAC DUCTS AND CASINGS.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. American Welding Society (AWS):
 1. D1.3/D1.3M-08 - Structural Welding Code - Sheet Steel.
- C. ASTM International (ASTM):
 1. A653/A653M-15 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Sip Process.
 2. A1008/A1008M-15 - Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Baked Hardenable.
 3. A666-15 - Annealed or Cold-Worked Austenitic Stainless Steel sheet, Strip, Plate, and Flat Bar.
 4. E119-15 - Fire Test of Building Construction and Materials.
- D. National Fire Protection Association (NFPA):
 1. 80-16 - Fire Doors and Other Opening Protectives.
 2. 251-12 - Fire Tests of Door Assemblies.
- E. National Association of Architectural Metal Manufacturers (NAAMM):
 1. AMP 500-06 - Metal Finishes Manual.
- F. UL LLC (UL):
 1. Listed - Online Certifications Directory.
 2. 10B-08 - Standard for Fire Tests of Door Assemblies.
 3. 263-11 - Fire Tests of Building Construction and Materials.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 - 1. Show size, configuration, and fabrication and installation details.
- C. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Installation instructions.
- D. Sustainable Construction Submittals:
 - 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.

1.5 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.6 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage during handling and construction operations.

1.7 FIELD CONDITIONS

- A. Field Measurements: Verify field conditions affecting access door fabrication and installation. Show field measurements on Submittal Drawings.
 - 1. Coordinate field measurement and fabrication schedule to avoid delay.

1.8 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Steel Sheet: ASTM A1008/A1008M.
- B. Galvanized Steel: ASTM A 653/A 653M.

2.2 PRODUCTS - GENERAL

- A. Basis of Design: Nystrom
- B. Provide each product from one manufacturer.
- C. Sustainable Construction Requirements:
 - 1. Steel Access Doors Recycled Content: 30 percent total recycled content, minimum.

2.3 ACCESS DOORS, FLUSH PANEL, NON-RATED

- A. Door Panel:
 - 1. 1.9 mm (0.07 inch) thick steel.
 - 2. Reinforce to maintain flat surface.
- B. Frame:
 - 1. 1.5 mm (0.06 inch) thick steel sheet, depth and configuration to suit material and construction type where installed.
 - 2. Frame Flange: Provide at units installed in concrete, masonry, and gypsum board.
 - 3. Exposed Joints in Flange: Weld and grind smooth.
- C. Hinge:
 - 1. Concealed spring hinge, 175 degrees of opening.
 - 2. Removable hinge pin to allow removal of door panel from frame.
- D. Lock:
 - 1. Flush, screwdriver-operated cam lock.

2.4 FABRICATION - GENERAL

- A. Size: Minimum 600 mm (24 inches) square door unless otherwise shown or required to suit opening in suspension system of ceiling.
- B. Component Fabrication: Straight, square, flat and in same plane where required.
 - 1. Exposed Edges: Slightly rounded, without burrs, snags and sharp edges.
 - 2. Exposed Welds: Continuous, ground smooth.

3. Welding: AWS D1.3/D1.3M.

- C. Locks and Non-Continuous Hinges: Provide in numbers required to maintain alignment of door panel with frame. For fire-rated doors, provide hinges and locks as required by fire test.
- D. Anchoring: Make provisions in frame for anchoring to adjacent construction. Provide anchors in size, number and location on four sides to secure access door to substrate.

2.5 FINISHES

A. Steel Paint Finish:

- 1. Powder-Coat Finish: Manufacturer's standard two-coat finish system consisting of the following:
 - a. One coat primer.
 - b. One coat thermosetting topcoat.
 - c. Dry-film Thickness: 0.05 mm (2 mils) minimum.
 - d. Color: To be selected.

2.6 ACCESSORIES

- A. Fasteners: Type and size recommended by access door manufacturer, to suit application.
 - 1. Other Access Doors: Stainless steel fasteners.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
 - 1. Verify access door locations and sizes provide required maintenance access to installed building services components.
- B. Protect existing construction and completed work from damage.

3.2 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.

- B. Install access doors and panels permitting access to service valves, traps, dampers, cleanouts, and other mechanical, electrical and conveyor control items concealed in walls and partitions, and concealed above gypsum board and plaster ceilings.
- C. Install fire-rated doors in fire-rated partitions and ceilings.

3.3 ACCESS DOOR AND FRAME INSTALLATION

- A. Wall Installations: Install access doors in openings with sides vertical.
- B. Ceiling Installations: Install access doors parallel to ceiling suspension grid or room partitions.
- C. Frames without Flanges: Install frame flush with surrounding finish surfaces.
- D. Frames with Flanges: Overlap opening, with face uniformly spaced from finish surface.
- E. Secure frames to adjacent construction with fasteners.
- F. Install type, size and quantity of anchoring device suitable for material surrounding opening to maintain alignment, and resist displacement, during normal use of access door.
- G. Field Painting Primed Access Doors: Comply with the requirements of Section 09 91 00, PAINTING.

3.4 ADJUSTMENT

- A. Adjust hardware so door panel opens freely.
- B. Adjust door when closed so door panel is centered in frame.

- - E N D - -

SECTION 08 41 13
ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Aluminum-framed entrances and storefronts .

1.2 RELATED REQUIREMENTS

- A. Glass and Glazing: Section 08 80 00, GLAZING.
B. Hardware: Section 08 71 00, DOOR HARDWARE.
C. Automatic Door Actuators: Section 08 71 13, AUTOMATIC DOOR OPERATORS.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
B. American Architectural Manufacturers Associations (AAMA):
1. 2603-15 - Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions and Panels.
 2. 2604-13 - Performance Requirements and Test Procedures for High Performance Organic Coatings on Architectural Extrusions and Panels.
 3. 2605-13 - Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels.
- C. American Welding Society (AWS):
1. D1.2/D1.2M-14 - Structural Welding Code - Aluminum.
- D. ASTM International (ASTM):
1. A240/A240M-15b - Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications.
 2. B209-14 - Aluminum and Aluminum-Alloy Sheet and Plate.
 3. B209M-14 - Aluminum and Aluminum-Alloy Sheet and Plate (Metric).
 4. B221-14 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
 5. B221M 13 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric).
 6. D1187/D1187M-97(2011)e1 - Asphalt-Base Emulsions for Use as Protective Coatings for Metal.
 7. E283-04(2012) - Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen.

8. E330/E330M-14 -Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference.
9. E331-00(2009) - Water Penetration of Exterior Windows, Curtain Walls, and Doors by Uniform Static Air Pressure Difference.
10. E1886-13a - Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Missiles and Exposed to Cyclic Pressure Differentials.
11. E1996-14a - Performance of Exterior Windows, Curtain Walls, Doors, and impact Protective Systems Impacted by Windborne Debris in Hurricanes.
12. F468-15 - Nonferrous Bolts, Hex Cap Screws, and Studs for General Use.
13. F593-13a - Stainless Steel Bolts, Hex Cap Screws, and Studs.
- E. National Association of Architectural Metal Manufacturers (NAAMM):
 1. AMP 500-06 - Metal Finishes Manual.
- F. National Fenestration Rating Council (NFRC):
 1. 500-14(E1A0) - Determining Fenestration Product Condensation Resistance Values.
- G. U.S. Veterans Administration (VA):
 1. PSDSDD - Physical Security Design Standards Data Definitions.
 2. Physical Security Design Manual for VA Facilities (VAPSDG); Mission Critical Facilities

1.4 PREINSTALLATION MEETINGS

- A. Conduct preinstallation meeting at project site minimum 30 days before beginning Work of this section.
 1. Required Participants:
 - a. Contracting Officer's Representative.
 - b. Architect/Engineer.
 - c. Contractor.
 - d. Installer.
 - e. Manufacturer's field representative.
 2. Meeting Agenda: Distribute agenda to participants minimum 3 days before meeting.
 - a. Installation schedule.
 - b. Installation sequence.

- c. Preparatory work.
 - d. Protection before, during, and after installation.
 - e. Installation.
 - f. Terminations.
 - g. Transitions and connections to other work.
 - h. Other items affecting successful completion.
3. Document and distribute meeting minutes to participants to record decisions affecting installation.

1.5 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings: Minimum 1 to 2 (half size) scale.
 1. Show size, configuration, and fabrication and installation details.
 2. Show anchorage and reinforcement.
 3. Show interface and relationship to adjacent work, including thermal, air, and water barrier continuity.
- C. Manufacturer's Literature and Data:
 1. Description of each product.
 2. Doors, each type.
 3. Entrance and Storefront construction.
 4. Installation instructions.
 5. Warranty.
- D. Samples:
 1. Door Corner Section: Minimum 450 mm x 450 mm (18 x 18 inches) for each specified door type, showing head rail and hinge stile, door closer reinforcement, internal reinforcement and insulation in flush panel door .
 2. Aluminum Anodized Finish: wo sample extrusions minimum 150 mm (6 inches) long for each specified color in sets of three showing maximum color range.
 3. Aluminum Paint Finish: wo sample extrusions minimum 150 mm (6 inches) long for each specified color.
- E. Sustainable Construction Submittals:
 1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.

- F. Test reports: Certify each product complies products comply with specifications.
- G. Certificates: Certify each product complies products comply with specifications.
 - 1. Certify anodized finish thickness.
- H. Qualifications: Substantiate qualifications comply with specifications.
 - 1. Manufacturer with project experience list .
 - 2. Installer with project experience list .
 - 3. Welders and welding procedures.
- I. Delegated Design Drawings and Calculations: Signed and sealed by responsible design professional.
 - 1. Show location and magnitude of loads applied to building structural frame.
 - 2. Identify deviations from details shown on drawings.
- J. Operation and Maintenance Data:
 - 1. Care instructions for each exposed finish product.

1.6 QUALITY ASSURANCE

- A. Manufacturer Qualifications:
 - 1. Regularly manufactures specified products.
 - 2. Manufactured specified products with satisfactory service on five similar installations for minimum five years.
 - a. Project Experience List: Provide contact names and addresses for completed projects.
- B. Installer Qualifications: Product manufacturer. Manufacturer authorized representative.
 - 1. Regularly installs specified products.
 - 2. Installed specified products with satisfactory service on five similar installations for minimum five years.
 - a. Project Experience List: Provide contact names and addresses for completed projects.
- C. Welders and Welding Procedures Qualifications: AWS D1.2/D1.2M.

1.7 DELIVERY, STORAGE AND HANDLING

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.

- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.
- D. Store products indoors in dry, weathertight conditioned facility.
- E. Protect products from damage during handling and construction operations.

1.8 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."
- B. Manufacturer's Warranty: Warrant painted finish against material and manufacturing defects.
 - 1. Warranty Period: 20 years.

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

- A. Delegated Design: Prepare submittal documents including design calculations and drawings signed and sealed by registered design professional, licensed in state where work is located.
 - 1. Minor deviations to details shown on drawings to accommodate manufacturer's standard products may be accepted by Contracting Officer's Representative when deviations do not affect design concept and specified performance.
- B. Design aluminum framed entrances and storefronts complying with specified performance:
 - 1. Wind and Seismic Load Resistance: ASCE/SEI 7; Design criteria as indicated on Drawings when tested according to ASTM E330/E330M.
 - a. Wind Load: 1.4 _____ kPa (30 _____ psf) positive and negative, minimum.
 - b. Maximum Deflection: 1/175 of span, maximum with minimum 1.65 safety factor.
 - 2. Thermal Movement: Accommodate ambient temperature range of 67 degrees C (120 degrees F).
 - 3. Blast Resistance:
 - a. Mission Critical Protected Facilities: VA PSDSDD W1 design threat level located at standoff distance.
 - 1) Standoff Distance: Minimum 15 m (50 feet); maximum VA PSDSDD GP2.

- b. Failure: Glass must fail first.
- 4. Windborne-Debris Impact Resistance: Pass ASTM E1886.
 - a. Openings within 9144 mm (30 feet) of Grade: ASTM E1996 large missile test.
 - b. Other Openings: ASTM 1996 small missile test.
- 5. Condensation Resistance: NFRC 500.
 - a. Fixed Framing: 45 CRF, minimum.
- 6. Water Resistance: ASTM E331; No uncontrolled penetration at 380 Pa (8 psf), minimum, pressure differential.
- 7. Fixed Framing Air Infiltration Resistance: ASTM E283; 0.30 L/s/sq. m (0.06 cfm/sf), maximum at 300 Pa (6.24 psf), minimum, pressure differential.
- 8. Entrance Doors Air Infiltration Resistance: ASTM E283; maximum allowable at 75 Pa (1.57 psf), minimum, pressure differential.
 - a. Single Doors: 2.5 L/s/sq. m (0.5 cfm/sf).
 - b. Paired Doors: 6 L/s/sq. m (1.2 cfm/sf).

2.2 MATERIALS

- A. Aluminum:
 - 1. Sheet Metal: ASTM B209M (ASTM B209), minimum 1.6 mm (0.063 inch) thick.
 - 2. Extrusions: ASTM B221M (ASTM B221).
 - a. Framing: Minimum 3 mm (0.125 inch) wall thickness.
 - b. Glazing Beads, Moldings, and Trim: Minimum 1.25 mm (0.050 inch) thick.
 - 3. Alloy 6063 temper T5 for doors, door frames, fixed glass sidelights storefronts and transoms .
 - 4. Alloy 6061 temper T6 for guide tracks for sliding doors and other extruded structural members.
 - 5. Color Anodized Aluminum: Provide aluminum alloy required to produce specified color.
- B. Stainless Steel: ASTM A240/A240M; Type 302 or Type 304.
- C. Thermal Break: Manufacturer standard low conductive material retarding heat flow in the framework, where insulating glass is scheduled.

2.3 PRODUCTS - GENERAL

- A. Provide aluminum framed entrances and storefronts from one manufacturer and from one production run .

- B. Provide aluminum entrances, storefront, curtain wall systems from same manufacturer.
- C. Sustainable Construction Requirements:
 - 1. Aluminum Recycled Content: 50 percent total recycled content, minimum.

2.4 FRAMES

- A. Framing Members: Extruded aluminum, thermally broken .
- B. Stops: Provide integral fixed stops and glass rebates and snap-on removable stops.
- C. Provide concealed screws, bolts and other fasteners.
- D. Secure cover boxes to frames in back of lock strike cutouts.

2.5 STILE AND RAIL DOORS

- A. Basis of Design: YKK 35H by YKK AP America
- B. Stiles and Rails: Extruded aluminum, thermally broken .
 - 1. Thickness: 45 mm (1-3/4 inch).
 - 2. Stiles and Head Rails: 90 mm (3-1/2 inches) wide.
 - 3. Bottom Rails: 250 mm (10 inches) wide.
- C. Single-Acting Doors:
 - 1. Bevel: 3 mm (1/8 inch) at lock, hinge, and meeting stile edges.
 - 2. Clearances: 2 mm (1/16 inch) at hinge stiles, 3 mm (1/8 inch) at lock stiles and top rails, and 5 mm (3/16 inch) at floors and thresholds.
- D. Glass Rebates: Integral with stiles and rails.
- E. Glazing Beads: Extruded aluminum, 1.3 mm (0.050 inch) thick. Integral with stiles and rails or applied type, snap-fit secured.
- F. Stile and Rail Joints: Welded or interlocking dovetail joints between stiles and rails.
 - 1. Clamp door together through top and bottom rails with 9 mm (3/8 inch) primed steel tie rod extending into stiles, and having self-locking nut and washer at both ends.
 - 2. Reinforce stiles and rails to prevent door distortion when tie rods are tightened.
 - 3. Provide compensating spring-type washer under each nut for stress relief.
 - 4. Construct joints to remain rigid and tight when door is operated.

- G. Weather-stripping: Removable, woven pile type (silicone-treated) weather-stripping attached to aluminum or vinyl holder.
1. Make slots for applying weather-stripping integral with doors and door frame stops.
 2. Apply continuous weather-stripping to heads, jambs, bottom, and meeting stiles of doors and frames so doors swing freely and close positively.

2.6 FABRICATION

- A. Form metal parts and fit and assemble joints, except joints designed to accommodate movement. Seal joints to resist air infiltration and water penetration.
- B. Welding:
1. Make welds without distorting and discoloring exposed surfaces.
 2. Clean and dress welds. Remove welding flux and weld spatter.
- C. Prepare and reinforce doors and frames for hardware and accessories.
1. Coordinate preparation with specified hardware. See Section 08 71 00, DOOR HARDWARE.
 2. Fabricate reinforcement from stainless steel plates.
 - a. Hinge and pivot reinforcing: Minimum 4.5 mm (0.179 inch) thick.
 - b. Lock Face, Flush Bolts, Concealed Holders, Concealed and Surface Mounted Closers Reinforcing: Minimum 2.6 mm (0.104 inch) thick.
 - c. Other Surface Mounted Hardware Reinforcing: Minimum 1.5 mm (0.059 inch) thick.
 3. Where concealed hardware is specified, provide space, cutouts, and reinforcement for installation and secure fastening.
- D. Factory assemble doors.

2.7 FINISHES

- A. Aluminum Anodized Finish: NAAMM AMP 500.
1. Color Anodized Finish: AA-C22A42 or AA-C22A44; Class I Architectural, 0.018 mm (0.7 mil) thick. Color and finish to be selected from manufacturers full range.
- B. Aluminum Paint finish:
1. Fluorocarbon Finish: AAMA 2605; 70 percent fluoropolymer resin, 2-coat system.

2.8 ACCESSORIES

- A. Dielectric Tape: Plastic, non-absorptive, with pressure sensitive adhesive; 0.18 to 0.25 mm (7 to 10 mils) thick.
- B. Barrier Coating: ASTM D1187/D1187M.
- C. Welding Materials: AWS D1.2/D1.2M, type to suit application.
- D. Fasteners:
 - 1. Aluminum: ASTM F468, Alloy 2024.
 - 2. Stainless Steel: ASTM F593, Alloy Groups 1, 2 and 3.
- E. Anchors: Aluminum or stainless steel; type to suit application.
- F. Galvanizing Repair Paint: MPI No. 18.
- G. Touch-Up Paint: Match shop finish.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
 - 1. Coordinate floor closer installation recessed into concrete slabs.
 - 2. Coordinate anchor installation built into masonry and concrete.
- B. Protect existing construction and completed work from damage.
- C. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
- D. Apply dielectric tape or barrier coating to aluminum surfaces in contact with dissimilar metals and cementitious materials to minimum 0.7 mm (30 mils) dry film thickness.

3.2 INSTALLATION - GENERAL

- A. Install products according to manufacturer's instructions and approved submittal drawings .
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Install aluminum framed entrances and storefronts plumb and true, in alignment and to lines shown on drawings.
- C. Anchor frames to adjoining construction at heads, jambs and sills.
- D. Provide concealed aluminum clips to connect adjoining frame sections.
- E. Install door hardware and hang doors. See Section 08 71 00, DOOR HARDWARE.

- F. Install door operators. See Section 08 71 13, AUTOMATIC DOOR OPERATORS.
- G. Adjust doors and hardware uniform clearances and proper operation.
- H. Touch up damaged factory finishes.
 - 1. Repair galvanized surfaces with galvanized repair paint.
 - 2. Repair painted surfaces with touch up primer.
- I. Tolerances:
 - 1. Variation from Plumb, Level, Warp, and Bow: Maximum 3 mm in 3 m (1/8 inch in 10 feet).
 - 2. Variation from Plane: Maximum 3 mm in 3.65 m (1/8 inch in 12 feet); 6 mm (1/4 inch) over total length.
 - 3. Variation from Alignment: Maximum 1.5 mm (1/16 inch) in-line offset and maximum 3 mm (1/8 inch) corner offset.
 - 4. Variation from Square: Maximum 3 mm (1/8 inch) diagonal measurement differential.

3.3 PROTECTION, CLEANING AND REPAIRING

- A. Clean exposed aluminum and glass surfaces. Remove contaminants and stains.
- B. Protect aluminum-framed entrances and storefronts from construction operations.
- C. Remove protective materials immediately before acceptance.
- D. Repair damage.

- - - E N D - - -

SECTION 084229.23

SLIDING AUTOMATIC ENTRANCES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes exterior, sliding, power-operated automatic entrances.

1.2 PREINSTALLATION MEETINGS

- A. Preinstallation Conference: Conduct conference at Project site.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For sliding automatic entrances.
 - 1. Include plans, elevations, sections, hardware mounting heights, and attachment details.
 - 2. Include diagrams for power, signal, and control wiring.
 - 3. Indicate locations of activation and safety devices.
 - 4. Include hardware schedule and indicate hardware types, functions, quantities, and locations.
- C. Samples: For each type of exposed finish required.
- D. Delegated-Design Submittal: For automatic entrances.

1.4 INFORMATIONAL SUBMITTALS

- A. Product certificates.
- B. Product test reports.
- C. Field quality-control reports.
- D. Sample warranties.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation and maintenance of units required for this Project and who employs a Certified Inspector.
- B. Certified Inspector Qualifications: Certified by AAADM.

1.7 WARRANTY

- A. Special Warranty: Manufacturer agrees to repair or replace components of automatic entrances that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: Two years from date of Substantial Completion.
- B. Special Finish Warranty: Manufacturer agrees to repair or replace components on which finishes fail in materials or workmanship within specified warranty period.
 - 1. Deterioration includes, but is not limited to, the following:
 - a. Color fading more than 5 Hunter units when tested according to ASTM D 2244.
 - b. Chalking in excess of a No. 8 rating when tested according to ASTM D 4214.
 - c. Cracking, checking, peeling, or failure of paint to adhere to bare metal.
 - 2. Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 AUTOMATIC ENTRANCE ASSEMBLIES

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Power-Operated Door Standard: BHMA A156.10.

2.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Engage a qualified professional engineer, as defined in Section 014000 "Quality Requirements," to design automatic entrances.
- B. Structural Performance: Automatic entrances shall withstand the effects of gravity loads and the following loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.

1. Seismic Loads:.
 2. Wind Loads: 125 exposure B.
- C. Windborne-Debris Impact Resistance: Pass missile-impact and cyclic-pressure tests according to ASTM E 1996 for Wind Zone.
- D. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes.
1. Temperature Change: 120 deg F (67 deg C), ambient; 180 deg F (100 deg C), material surfaces.
- E. Air Infiltration: Maximum air leakage through fixed glazing and framing areas of 1.25 cfm/sq. ft. (6.4 L/s x sq. m) <Insert value> of fixed entrance-system area when tested according to ASTM E 283 at a minimum static-air-pressure difference of 1.57 lbf/sq. ft. (75 Pa) 6.24 lbf/sq. ft. (300 Pa).

2.3 SLIDING AUTOMATIC ENTRANCES

- A. General: Provide manufacturer's standard automatic entrances, including doors, sidelites, framing, headers, carrier assemblies, roller tracks, door operators, controls, and accessories required for a complete installation.
- B. All-Glass Sliding Automatic Entrance:
1. Biparting-Sliding Units:
 - a. Basis of Design: SL500 by ASSA Abloy
 2. Configuration: Biparting-sliding doors with two sliding leaves, transom, and pocketed sidelites on each side.
 - a. Traffic Pattern: Two way.
 - b. Emergency Breakaway Capability: Only Sliding leaves.
 - c. Mounting: Between jambs Surface.
 3. Operator Features:
 - a. Power opening and closing.
 - b. Drive System: Chain.
 - c. Adjustable opening and closing speeds.
 - d. Adjustable hold-open time between zero and 30 seconds.
 - e. Obstruction recycle.
 - f. On-off/hold-open switch to control electric power to operator.
 4. Sliding-Door Carrier Assemblies and Overhead Roller Tracks: Carrier assembly that allows vertical adjustment; consisting of nylon- or delrin-covered, ball-bearing-center steel wheels operating on a continuous roller track, or ball-bearing-center steel wheels operating on a nylon- or delrin-covered, continuous

roller track. Support doors from carrier assembly by cantilever and pivot assembly.

- a. Rollers: Minimum of two ball-bearing roller wheels and two antirise rollers for each active leaf.
5. Sliding-Door Threshold: Threshold members and bottom-guide-track system with stainless-steel, ball-bearing-center roller wheels.
 - a. Configuration: Saddle-type threshold across door opening and surface-mounted recessed guide-track system at sidelites.
 6. Controls: Activation and safety devices as indicated on Drawings and according to BHMA standards.
 - a. Activation Device: Push-plate switch on each side of door to activate door operator.
 - b. Safety Device: Two photoelectric beams mounted in sidelite jambs on each side of door to detect pedestrians in presence zone and to prevent door from closing.
 - c. Sidelite Safety Device: Presence sensor, mounted above each sidelite on side of door opening through which doors travel, to detect obstructions and to prevent door from opening.
 7. Finish: Finish framing, door(s), and header with high-performance organic finish (two-coat fluoropolymer).
 - a. Color: As selected by Architect from full range of industry colors and color densities.

2.4 ENTRANCE COMPONENTS

- A. Framing Members: Extruded aluminum, minimum 0.125 inch (3.2 mm) thick and reinforced as required to support imposed loads.
 1. Nominal Size: As indicated on Drawings.
 2. Extruded Glazing Stops and Applied Trim: Minimum 0.062-inch (1.6-mm) wall thickness.
- B. Stile and Rail Doors: 1-3/4-inch- (45-mm-) thick, glazed doors with minimum 0.125-inch- (3.2-mm-) thick, extruded-aluminum tubular stile and rail members. Mechanically fasten corners with reinforcing brackets that are welded, or incorporate concealed tie-rods that span full length of top and bottom rails.
 1. Glazing Stops and Gaskets: Snap-on, extruded-aluminum stops and preformed gaskets.
 2. Stile Design: Medium stile, 3-1/2-inch (90-mm) nominal width Wide stile, more than 4-inch (100-mm) nominal width.
 3. Rail Design: 10-inch (254-mm) nominal height.
 4. Muntin Bars: Horizontal tubular rail member for each door; match stile design and finish.

- C. Sidelite and Transom: 1-3/4-inch- (45-mm-) deep sidelite(s) and transom with minimum 0.125-inch- (3.2-mm-) thick, extruded-aluminum tubular stile and rail members matching door design.
 - 1. Glazing Stops and Gaskets: Same materials and design as for stile and rail door.
 - 2. Glazing Stops and Gaskets: Snap-on, extruded-aluminum stops and preformed gaskets.
 - 3. Muntin Bars: Horizontal tubular rail members for each sidelite; match stile design.

- D. Headers: Fabricated from minimum 0.125-inch- (3.2-mm-) thick extruded aluminum and extending full width of automatic entrance units to conceal door operators and controls. Provide hinged or removable access panels for service and adjustment of door operators and controls. Secure panels to prevent unauthorized access.
 - 1. Mounting: Surface mounted Concealed, with one side of header flush with framing.

- E. Signage: As required by cited BHMA standard.
 - 1. Application Process: Decals Silk-screened Door manufacturer's standard process.

2.5 MATERIALS

- A. Aluminum: Alloy and temper recommended by manufacturer for type of use and finish indicated.
 - 1. Extrusions: ASTM B 221 (ASTM B 221M).
 - 2. Sheet: ASTM B 209 (ASTM B 209M).

- B. Steel Reinforcement: Reinforcement with corrosion-resistant primer complying with SSPC-PS Guide No. 12.00 applied immediately after surface preparation and pretreatment. Use surface preparation methods according to recommendations in SSPC-SP COM and prepare surfaces according to applicable SSPC standard.

- C. Stainless-Steel Bars: ASTM A 276/A 276M or ASTM A 666, type 316.

- D. Stainless-Steel Tubing: ASTM A 554, Grade MT 304 Grade MT 316.

- E. Expanded Aluminum Mesh: Expanded Expanded and flattened aluminum sheet according to the geometry of ASTM F 1267.

- F. Glazing: As specified in Section 088000 "Glazing."

- G. Sealants and Joint Fillers: As specified in Section 079200 "Joint Sealants."

- H. Nonmetallic, Shrinkage-Resistant Grout: Premixed, nonmetallic, noncorrosive, nonstaining grout; complying with ASTM C 1107/C 1107M; of consistency suitable for application.
- I. Bituminous Coating: Cold-applied asphalt emulsion complying with ASTM D 1187/D 1187M.
- J. Fasteners and Accessories: Corrosion-resistant, nonstaining, nonbleeding fasteners and accessories compatible with adjacent materials.

2.6 DOOR OPERATORS AND CONTROLS

- A. General: Provide operators and controls, which include activation and safety devices, according to BHMA standards, for condition of exposure, and for long-term, maintenance-free operation under normal traffic load for type of occupancy indicated.
- B. Door Operators: Provide door operators of size recommended by manufacturer for door size, weight, and movement.
 - 1. Door Operator Performance: Door operators shall open and close doors and maintain them in fully closed position when subjected to Project's design wind loads.
 - 2. Electromechanical Operators: Concealed, self-contained, overhead units powered by fractional-horsepower, permanent-magnet dc motor; with closing speed controlled mechanically by gear train and dynamically by braking action of electric motor; with solid-state microprocessor controller; complying with UL 325; and with manual operation with power off.
- C. Motion Sensors: Self-contained, K-band-frequency, microwave-scanner units; fully enclosed by their plastic housings; adjustable to provide detection-field sizes and functions required by BHMA A156.10.
 - 1. Provide capability for switching between bi- and unidirectional detection.
 - 2. For one-way traffic, sensor on egress side shall not be active when doors are fully closed.
- D. Presence Sensors: Self-contained, active-infrared scanner units; adjustable to provide detection-field sizes and functions required by BHMA A156.10. Sensors shall remain active at all times.
- E. Photoelectric Beams: Pulsed infrared, sender-receiver assembly for recessed mounting. Beams shall not be active when doors are fully closed.
- F. Push-Plate Switch: Momentary-contact door-control switch with flat push-plate actuator, with contrasting-colored, engraved message.
 - 1. Configuration: Square push plate with 4-by-4-inch (100-by-100-mm) junction box.

- a. Mounting: Semiflush in wall Surface mounted on wall.
 2. Push-Plate Material: Stainless steel.
 3. Message: International symbol of accessibility and "Push to Open."
- G. Electrical Interlocks: Unless units are equipped with self-protecting devices or circuits, provide electrical interlocks to prevent activation of operator when door is locked, latched, or bolted.

2.7 HARDWARE

- A. General: Provide units in sizes and types recommended by automatic entrance and hardware manufacturers for entrances and uses indicated. Finish exposed parts to match door finish unless otherwise indicated.
- B. Breakaway Device for Power-Operated Doors: Device that allows door to swing out in direction of egress to full 90 degrees from any operating position. Interrupt powered operation of door operator while in breakaway mode.
- C. Deadlocks: Deadbolt operated by exterior cylinder and interior thumb turn, with minimum 1-inch- (25-mm-) long throw bolt; BHMA A156.5, Grade 1.
1. Cylinders: BHMA A156.5, Grade 1, six-pin mortise type.
 - a. Keying: Integrate into building master key system.
 - b. Keys: Three for each cylinder.
 2. Two-Point Locking for Stile and Rail Sliding Doors: Mechanism in stile of active door leaf that automatically extends second lockbolt into overhead carrier assembly threshold.
 3. Lock/Unlock Indicator: Lock position indicators integrated with locking system. Stile is mounted on secure side of door. Visual display of lock position as follows: "OPEN" in black letters when unlocked, and "LOCKED" in red letters when locked.
 4. Armored Strike: Reinforced security strike plate.
- D. Weather Stripping/Bottom Seal: Replaceable components.
1. Sliding Type: AAMA 701/702, made of wool, polypropylene, or nylon woven pile with nylon-fabric or aluminum-strip backing.

2.8 FABRICATION

- A. General: Factory fabricate automatic entrance components to designs, sizes, and thicknesses indicated and to comply with indicated standards.
- B. Framing: Provide automatic entrances as prefabricated assemblies. Complete fabrication, assembly, finishing, hardware application, and other work before shipment to Project site.

1. Provide components with concealed fasteners and anchor and connection devices.
 2. Fabricate components with accurately fitted joints, with ends coped or mitered to produce hairline joints free of burrs and distortion.
 3. Fabricate exterior components to drain water passing joints, condensation occurring within framing members, and moisture migrating within system to exterior.
 4. Provide anchorage and alignment brackets for concealed support of assembly from building structure.
 5. Allow for thermal expansion of exterior units.
- C. Doors: Factory fabricated and assembled in profiles indicated. Reinforce as required to support imposed loads and for installing hardware.
- D. Door Operators: Factory fabricated and installed in headers, including adjusting and testing.
- E. Glazing: Fabricate framing with minimum glazing edge clearances for thickness and type of glazing indicated, according to GANA's "Glazing Manual."
- F. Hardware: Factory install hardware to greatest extent possible; remove only as required for final finishing operation and for delivery to and installation at Project site. Cut, drill, and tap for factory-installed hardware before applying finishes.
1. Provide sliding-type weather stripping, mortised into door, at perimeter of doors.
- G. Controls:
1. General: Factory install activation and safety devices in doors and headers as required by BHMA A156.10 for type of door and direction of travel.

2.9 ALUMINUM FINISHES

- A. High-Performance Organic Finish: Two-coat fluoropolymer finish complying with AAMA 2604 AAMA 2605 and containing not less than 50 70 percent PVDF resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
1. Color and Gloss: As selected by Architect from manufacturer's full range.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install automatic entrances according to manufacturer's written instructions and cited BHMA A156.10 for direction of pedestrian travel, including signage, controls, wiring, and connection to the building's power supply.
1. Do not install damaged components. Fit frame joints to produce hairline joints free of burrs and distortion. Rigidly secure nonmovement joints. Seal joints watertight.
 2. Where aluminum will contact dissimilar metals, protect against galvanic action by painting contact surfaces with primer or by applying sealant or tape recommended by manufacturer for this purpose.
 3. Where aluminum will contact concrete or masonry, protect against corrosion by painting contact surfaces with bituminous coating.
- B. Entrances: Install automatic entrances plumb and true in alignment with established lines and grades without warp or rack of framing members and doors. Anchor securely in place.
1. Install surface-mounted hardware using concealed fasteners to greatest extent possible.
 2. Set headers, carrier assemblies, tracks, operating brackets, and guides level and true to location with anchorage for permanent support.
 3. Install components to drain water passing joints, condensation occurring within framing members, and moisture migrating within system to exterior.
 4. Level recesses for recessed thresholds using nonshrink grout.
- C. Door Operators: Connect door operators to electrical power distribution system.
- D. Access-Control Devices: Connect access-control devices to access-control system, as specified in Section 281300 "Access Control Software and Database Management."
- E. Controls: Install and adjust activation and safety devices according to manufacturer's written instructions and cited BHMA standard for direction of pedestrian travel. Connect control wiring according to Section 260519 "Low-Voltage Electrical Power Conductors and Cables."
- F. Glazing: Install glazing as specified in Section 088000 "Glazing."
- G. Sealants: Comply with requirements specified in Section 079200 "Joint Sealants" to provide weathertight installation.
1. Set thresholds, bottom-guide-track system, framing members and flashings in full sealant bed.
 2. Seal perimeter of framing members with sealant.

- H. Signage: Apply signage on both sides of each door as required by cited BHMA standard for direction of pedestrian travel.
- I. Wiring within Automatic Entrance Enclosures: Bundle, lace, and train conductors to terminal points with no excess and without exceeding manufacturer's written limitations on bending radii. Provide and use lacing bars and distribution spools.

3.2 FIELD QUALITY CONTROL

- A. Certified Inspector: Owner will engage Engage a Certified Inspector to test and inspect components, assemblies, and installations, including connections.
- B. Perform the following tests and inspections with the assistance of a factory-authorized service representative:
 - 1. Test and inspect each automatic entrance, using AAADM inspection forms, to determine compliance of installed systems with applicable BHMA standards.
- C. Automatic entrances will be considered defective if they do not pass tests and inspections.
- D. Prepare test and inspection reports.

3.3 ADJUSTING

- A. Adjust hardware, moving parts, door operators, and controls to function smoothly, and lubricate as recommended by manufacturer; comply with requirements of applicable BHMA standards.
- B. Readjust door operators and controls after repeated operation of completed installation equivalent to three days' use by normal traffic (100 to 300 cycles).

3.4 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain automatic entrances.

END OF SECTION 084229.23

SECTION 08 45 23

TRANSLUCENT SKYLIGHT

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes the insulated translucent sandwich panel skylight system and accessories as shown and specified. Work includes providing and installing:
 - 1. 2-3/4 inch factory prefabricated structural insulated translucent sandwich panels
 - 2. Aluminum installation system
 - 3. Aluminum flashing attached to skylights
- B. Related Sections:
 - 1. Structural Steel Section 052100
 - 2. Roofing: Section 074100
 - 3. Flashing and Sheet Metal: Section 076200
 - 4. Sealants: Section 079200

1.2 SUBMITTALS

- A. Submit manufacturer's product data. Include construction details, material descriptions, profiles and finishes of skylight components.
- B. Submit shop drawings. Include elevations and details.
- C. Submit manufacturer's color charts showing the full range of colors available for factory-finished aluminum.
 - 1. When requested, submit samples for each exposed finish required, in same thickness and material indicated for the work and in size indicated below. If finishes involve normal color variations, include sample sets consisting of two or more units showing the full range of variations expected.
 - a. Sandwich panels: 14" x 28" units
 - b. Factory finished aluminum: 5" long sections
- D. Submit Installer Certificate, signed by installer, certifying compliance with project qualification requirements.
- E. Submit product reports from a qualified independent testing agency indicating each type and class of panel system complies with the project performance requirements, based on comprehensive testing of current products. Previously completed reports will be acceptable if for current manufacturer and indicative of products used on this project.

- 1. Reports required are:

- a. International Building Code Evaluation Report
- b. Flame Spread and Smoke Developed (UL 723) - Submit UL Card
- c. Burn Extent (ASTM D 635)
- d. Color Difference (ASTM D 2244)
- e. Impact Strength (UL 972)
- f. Bond Tensile Strength (ASTM C 297 after aging by ASTM D 1037)
- g. Bond Shear Strength (ASTM D 1002)
- h. Beam Bending Strength (ASTM E 72)
- i. Fall Through Resistance (ASTM E 661)
- j. Insulation U-Factor (NFRC 100)
- k. NFRC System U-Factor Certification (NFRC 700)
- l. Solar Heat Gain Coefficient (NFRC or Calculations)
- m. Condensation Resistance Factor (AAMA 1503)
- n. Air Leakage (ASTM E 283)
- o. Structural Performance (ASTM E 330)
- p. Water Penetration (ASTM E 331)
- q. Class A Roof Covering Burning Brand (ASTM E 108)
- r. UL Listed Class A Roof System (UL 790) (Optional) - Submit UL Card

1.3 QUALITY ASSURANCE

A. Manufacturer's Qualifications

1. Material and products shall be manufactured by a company continuously and regularly employed in the manufacture of specified materials for a period of at least ten consecutive years and which can show evidence of those materials being satisfactorily used on at least six projects of similar size, scope and location. At least three of the projects shall have been in successful use for ten years or longer.
2. Panel system must be listed by an ANSI accredited Evaluation Service, which requires quality control inspections and fire, structural and water infiltration testing of sandwich panel systems by an accredited agency.
3. Quality control inspections shall be conducted at least once each year and shall include manufacturing facilities, sandwich panel components and production sandwich panels for conformance with AC177 "Translucent Fiberglass Reinforced Plastic (FRP) Faced Panel Wall, Roof and Skylight Systems" as issued by the ICC-ES.

- B. Installer's Qualifications: Installation shall be by an experienced installer, which has been in the business of installing specified skylight systems for at least two consecutive years and can show evidence of satisfactory completion of projects of similar size, scope and type.

1.4 PERFORMANCE REQUIREMENTS

- A. The manufacturer shall be responsible for the configuration and fabrication of the complete skylight panel system.

4. When requested, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
5. Standard skylight system shall have less than 0.01 cfm/ft² air leakage by ASTM E 283 at 6.24 PSF (50 mph) and no water penetration by ASTM E 331 at 15 PSF; and structural testing by ASTM E 330.
6. Structural Loads; Provide skylight system capable of handling the following loads:
 - a. Live Load: 25 PSF
 - b. Snow Load: 25 PSF; Drift Load: 0 PSF
 - c. Wind Load: 25 PSF

1.5 DELIVERY STORAGE AND HANDLING

- A. Deliver panel system, components and materials in manufacturer's standard protective packaging.
- B. Store panels on the long edge; several inches above the ground, blocked and under cover in accordance with manufacturer's storage and handling instructions.

1.6 WARRANTY

- A. Submit manufacturer's and installer's written warranty agreeing to repair or replace panel system work, which fails in materials or workmanship within one year of the date of delivery. Failure of materials or workmanship shall include leakage, excessive deflection, deterioration of finish on metal in excess of normal weathering, defects in accessories, insulated translucent sandwich panels and other components of the work.
- B. Extended Warranty: 5 years

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. The basis for this specification is for products manufactured by Kalwall Corporation. Other manufacturers may bid this project provided they comply with all of the performance requirements of this specification and submit evidence thereof. Listing other manufacturers' names in this specification does not constitute approval of their products or relieve them of compliance with all the performance requirements contained herein.
- B. Kalwall Corporation, Tel: (800) 258-9777 - Fax: (603) 627-7905 - Email: info@kalwall.com.

2.2 PANEL COMPONENTS

- A. Face Sheets

1. Translucent faces: Manufactured from glass fiber reinforced thermoset resins, formulated specifically for architectural use.
 - a. Thermoplastic (e.g. polycarbonate, acrylic) faces are not acceptable.
 - b. Face sheets shall not deform, deflect or drip when subjected to fire or flame.
 2. Interior face sheets:
 - a. Flame spread: Underwriters Laboratories (UL) listed, which requires periodic unannounced retesting, with flame spread rating no greater than 50 and smoke developed no greater than 250 when tested in accordance with UL 723.
 - b. Burn extent by ASTM D 635 shall be no greater than 1".
 3. Exterior face sheets:
 - a. Color stability: Full thickness of the exterior face sheet shall not change color more than 3 CIE Units DELTA E by ASTM D 2244. Color stability shall be unaffected by abrasion or scratching.
 - b. Strength: Exterior face sheet shall be uniform in strength, impenetrable by hand held pencil and repel an impact minimum of 70 ft. lbs. without fracture or tear when impacted by a 3-1/4" diameter, 5 lb. free-falling ball per UL 972.
 4. Appearance:
 - a. Exterior face sheets: Smooth, .070" thick and crystal in color, Type A.
 - b. Interior face sheets: Smooth, .045" thick and white in color, Type A.
 - c. Face sheets shall not vary more than $\pm 10\%$ in thickness and be uniform in color.
- B. Grid Core
1. Standard aluminum I-beam grid core shall be of 6063-T6 or 6005-T5 alloy and temper with provisions for mechanical interlocking of muntin-mullion and perimeter. Width of I-beam shall be no less than 7/16".
- C. Laminate Adhesive
1. Heat and pressure resin type adhesive engineered for structural sandwich panel use, with minimum 25-years field use. Adhesive shall pass testing requirements specified by the International Code Council "Acceptance Criteria for Sandwich Panel Adhesives".
 2. Minimum tensile strength of 750 PSI when the panel assembly is tested by ASTM C 297 after two exposures to six cycles each of the aging conditions prescribed by ASTM D 1037.
 3. Minimum shear strength of the panel adhesive by ASTM D 1002 after exposure to four separate conditions:

- a. 50% Relative Humidity at 68° F: 540 PSI
- b. 182° F: 100 PSI
- c. Accelerated Aging by ASTM D 1037 at room temperature: 800 PSI
- d. Accelerated Aging by ASTM D 1037 at 182° F: 250 PSI

2.3 PANEL CONSTRUCTION

- A. Provide sandwich panels of flat fiberglass reinforced translucent face sheets laminated to a grid core of mechanically interlocking I-beams. The adhesive bonding line shall be straight, cover the entire width of the I-beam and have a neat, sharp edge.
 1. Thickness: 2-3/4"
 2. Light transmission: 37%
 3. Solar heat gain coefficient.44.
 4. Panel U-factor by NFRC certified laboratory: 2-3/4" thermally broken grid.53.
 5. Grid pattern: Nominal size 8" x 20"; pattern shoji.
- B. Standard panels shall deflect no more than 1.9" at 30 PSF in 10' 0" span without a supporting frame by ASTM E 72.
- C. Standard panels shall withstand 1200° F fire for minimum one hour without collapse or exterior flaming.
- D. Skylight System:
 1. Skylight system shall pass Class A Roof Burning Brand Test By ASTM E 108.
- E. Skylight System shall meet the fall through requirements of OSHA 1910.23 as demonstrated by testing in accordance with ASTM E 661, thereby not requiring supplemental screens or railings.

2.4 BATTENS AND PERIMETER CLOSURE SYSTEM

- A. Closure system:
 1. Extruded aluminum 6063-T6 and 6063-T5 alloy, S Lines Perimeter frame.
 2. Skylight perimeter closures at curbs shall be factory sealed to panels.
- B. Sealing tape: Manufacturer's standard, pre-applied to closure system at the factory under controlled conditions.
- C. Fasteners: 300 series stainless steel screws for aluminum closures, excluding final fasteners to the building.
- D. Finish:
 1. Manufacturer's factory applied finish, which meets the performance requirements of AAMA 2604. Color to be selected from manufacturer's full range.

D. Minimum pitch 3/8: 12 per skylight panel requirements

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Installer shall examine substrates, supporting structure and installation conditions.
- B. Do not proceed with panel installation until unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Metal Protection:

- 1. Where aluminum will contact dissimilar metals, protect against galvanic action by painting contact surfaces with primer or by applying sealant or tape recommended by manufacturer for this purpose.
- 2. Where aluminum will contact concrete, masonry or pressure treated wood, protect against corrosion by painting contact surfaces with bituminous paint or method recommended by manufacturer.

3.3 INSTALLATION

A. Install the skylight system in accordance with the manufacturer's suggested installation recommendations and approved shop drawings.

- 1. Anchor component parts securely in place by permanent mechanical attachment system.
- 2. Accommodate thermal and mechanical movements.
- 3. Set perimeter framing in a full bed of sealant compound, or with joint fillers or gaskets to provide weather-tight construction.

B. Install joint sealants at perimeter joints and within the panel system in accordance with manufacturer's installation instructions.

3.4 FIELD QUALITY CONTROL

- A. Water Test: Installer to test skylights according to procedures in AAMA 501.2.
- B. Repair or replace work that does not pass testing or that is damaged by testing and retest work.

3.5 CLEANING

- A. Clean the skylight system interior and exterior, immediately after installation.
- B. Refer to manufacturer's written recommendations.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

END OF SECTION 08 45 23

TRANSLUCENT SKYLIGHT
084523-7

SECTION 087100
DOOR HARDWARE

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes commercial door hardware for the following:

1. Swinging doors.
2. Other doors to the extent indicated.

- B. Door hardware includes, but is not necessarily limited to, the following:

1. Mechanical door hardware.
2. Electromechanical door hardware.
3. Cylinders specified for doors in other sections.

- C. Related Sections:

1. Division 08 Section "Hollow Metal Doors and Frames".
2. Division 08 Section "Flush Wood Doors".
3. Division 08 Section "Automatic Entrances".

- D. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.

1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
2. ICC/IBC - International Building Code.
3. NFPA 70 - National Electrical Code.
4. NFPA 80 - Fire Doors and Windows.
5. NFPA 101 - Life Safety Code.
6. NFPA 105 - Installation of Smoke Door Assemblies.
7. State Building Codes, Local Amendments.

- E. Standards: All hardware specified herein shall comply with the following industry standards as applicable. Any undated reference to a standard shall be interpreted as referring to the latest edition of that standard:

1. ANSI/BHMA Certified Product Standards - A156 Series.
2. UL10C - Positive Pressure Fire Tests of Door Assemblies.
3. ANSI/UL 294 - Access Control System Units.
4. UL 305 - Panic Hardware.
5. ANSI/UL 437- Key Locks.

1.3 SUBMITTALS

- A. Product Data: Manufacturer's product data sheets including installation details, material descriptions, dimensions of individual components and profiles, operational descriptions and finishes.
- B. Door Hardware Schedule: Prepared by or under the supervision of supplier, detailing fabrication and assembly of door hardware, as well as procedures and diagrams. Coordinate the final Door Hardware Schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
 1. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule."
 2. Organization: Organize the Door Hardware Schedule into door hardware sets indicating complete designations of every item required for each door or opening. Organize door hardware sets in same order as in the Door Hardware Sets at the end of Part 3. Submittals that do not follow the same format and order as the Door Hardware Sets will be rejected and subject to resubmission.
 3. Content: Include the following information:
 - a. Type, style, function, size, label, hand, and finish of each door hardware item.
 - b. Manufacturer of each item.
 - c. Fastenings and other pertinent information.
 - d. Location of door hardware set, cross-referenced to Drawings, both on floor plans and in door and frame schedule.
 - e. Explanation of abbreviations, symbols, and codes contained in schedule.
 - f. Mounting locations for door hardware.
 - g. Door and frame sizes and materials.
 - h. Warranty information for each product.
 4. Submittal Sequence: Submit the final Door Hardware Schedule at earliest possible date, particularly where approval of the Door Hardware Schedule must precede fabrication of other work that is critical in the Project construction schedule. Include Product Data, Samples, Shop Drawings of other work affected by door hardware, and other information essential to the coordinated review of the Door Hardware Schedule.

- C. Shop Drawings: Details of electrified access control hardware indicating the following:
1. Wiring Diagrams: Upon receipt of approved schedules, submit detailed system wiring diagrams for power, signaling, monitoring, communication, and control of the access control system electrified hardware. Differentiate between manufacturer-installed and field-installed wiring. Include the following:
 - a. Elevation diagram of each unique access controlled opening showing location and interconnection of major system components with respect to their placement in the respective door openings.
 - b. Complete (risers, point-to-point) access control system block wiring diagrams.
 - c. Wiring instructions for each electronic component scheduled herein.
 2. Electrical Coordination: Coordinate with related sections the voltages and wiring details required at electrically controlled and operated hardware openings.
- D. Keying Schedule: After a keying meeting with the owner has taken place prepare a separate keying schedule detailing final instructions. Submit the keying schedule in electronic format. Include keying system explanation, door numbers, key set symbols, hardware set numbers and special instructions. Owner must approve submitted keying schedule prior to the ordering of permanent cylinders/cores.
- E. Informational Submittals:
1. Product Test Reports: Indicating compliance with cycle testing requirements, based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified independent testing agency.
- F. Operating and Maintenance Manuals: Provide manufacturers operating and maintenance manuals for each item comprising the complete door hardware installation in quantity as required in Division 01, Closeout Procedures.

1.4 QUALITY ASSURANCE

- A. Manufacturers Qualifications: Engage qualified manufacturers with a minimum 5 years of documented experience in producing hardware and equipment similar to that indicated for this Project and that have a proven record of successful in-service performance.
- B. Certified Products: Where specified, products must maintain a current listing in the Builders Hardware Manufacturers Association (BHMA) Certified Products Directory (CPD).

- C. **Installer Qualifications:** A minimum 3 years documented experience installing both standard and electrified door hardware similar in material, design, and extent to that indicated for this Project and whose work has resulted in construction with a record of successful in-service performance.
- D. **Door Hardware Supplier Qualifications:** Experienced commercial door hardware distributors with a minimum 5 years documented experience supplying both mechanical and electromechanical hardware installations comparable in material, design, and extent to that indicated for this Project. Supplier recognized as a factory direct distributor by the manufacturers of the primary materials with a warehousing facility in Project's vicinity. Supplier to have on staff a certified Architectural Hardware Consultant (AHC) available during the course of the Work to consult with Contractor, Architect, and Owner concerning both standard and electromechanical door hardware and keying.
- E. **Source Limitations:** Obtain each type and variety of door hardware specified in this section from a single source unless otherwise indicated.
1. Electrified modifications or enhancements made to a source manufacturer's product line by a secondary or third party source will not be accepted.
 2. Provide electromechanical door hardware from the same manufacturer as mechanical door hardware, unless otherwise indicated.
- F. Each unit to bear third party permanent label demonstrating compliance with the referenced standards.
- G. **Keying Conference:** Conduct conference to comply with requirements in Division 01 Section "Project Meetings." Keying conference to incorporate the following criteria into the final keying schedule document:
1. Function of building, purpose of each area and degree of security required.
 2. Plans for existing and future key system expansion.
 3. Requirements for key control storage and software.
 4. Installation of permanent keys, cylinder cores and software.
 5. Address and requirements for delivery of keys.
- H. **Pre-Submittal Conference:** Conduct coordination conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier(s), Installer(s), and Contractor(s) to review proper methods and the procedures for receiving, handling, and installing door hardware.
1. Prior to installation of door hardware, conduct a project specific training meeting to instruct the installing contractors'

personnel on the proper installation and adjustment of their respective products. Product training to be attended by installers of door hardware (including electromechanical hardware) for aluminum, hollow metal and wood doors. Training will include the use of installation manuals, hardware schedules, templates and physical product samples as required.

2. Inspect and discuss electrical roughing-in, power supply connections, and other preparatory work performed by other trades.
3. Review sequence of operation narratives for each unique access controlled opening.
4. Review and finalize construction schedule and verify availability of materials.
5. Review the required inspecting, testing, commissioning, and demonstration procedures

- I. At completion of installation, provide written documentation that components were applied to manufacturer's instructions and recommendations and according to approved schedule.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up and shelving for door hardware delivered to Project site. Do not store electronic access control hardware, software or accessories at Project site without prior authorization.
- B. Tag each item or package separately with identification related to the final Door Hardware Schedule, and include basic installation instructions with each item or package.
- C. Deliver, as applicable, permanent keys, cylinders, cores, access control credentials, software and related accessories directly to Owner via registered mail or overnight package service. Instructions for delivery to the Owner shall be established at the "Keying Conference".

1.6 COORDINATION

- A. Templates: Obtain and distribute to the parties involved templates for doors, frames, and other work specified to be factory prepared for installing standard and electrified hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing hardware to comply with indicated requirements.
- B. Door and Frame Preparation: Doors and corresponding frames are to be prepared, reinforced and pre-wired (if applicable) to receive the installation of the specified electrified, monitoring, signaling and access control system hardware without additional in-field modifications.

1.7 WARRANTY

- A. General Warranty: Reference Division 01, General Requirements. Special warranties specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.
- B. Warranty Period: Written warranty, executed by manufacturer(s), agreeing to repair or replace components of standard and electrified door hardware that fails in materials or workmanship within specified warranty period after final acceptance by the Owner. Failures include, but are not limited to, the following:
 - 1. Structural failures including excessive deflection, cracking, or breakage.
 - 2. Faulty operation of the hardware.
 - 3. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 4. Electrical component defects and failures within the systems operation.
- C. Standard Warranty Period: One year from date of Substantial Completion, unless otherwise indicated.
- D. Special Warranty Periods:
 - 1. Ten years for mortise locks and latches.
 - 2. Five years for exit hardware.
 - 3. Twenty five years for manual overhead door closer bodies.
 - 4. Two years for electromechanical door hardware, unless noted otherwise.

1.8 MAINTENANCE SERVICE

- A. Maintenance Tools and Instructions: Furnish a complete set of specialized tools and maintenance instructions as needed for Owner's continued adjustment, maintenance, and removal and replacement of door hardware.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in Door Hardware Sets and each referenced section that products are to be supplied under.

- B. Designations: Requirements for quantity, item, size, finish or color, grade, function, and other distinctive qualities of each type of door hardware are indicated in the Door Hardware Sets at the end of Part 3. Products are identified by using door hardware designations, as follows:
1. Named Manufacturer's Products: Product designation and manufacturer are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in the Door Hardware Schedule.
- C. Substitutions: Requests for substitution and product approval for inclusive mechanical and electromechanical door hardware in compliance with the specifications must be submitted in writing and in accordance with the procedures and time frames outlined in Division 01, Substitution Procedures. Approval of requests is at the discretion of the architect, owner, and their designated consultants.

2.2 HANGING DEVICES

- A. Hinges: ANSI/BHMA A156.1 certified butt hinges with number of hinge knuckles and other options as specified in the Door Hardware Sets.
1. Quantity: Provide the following hinge quantity:
 - a. Two Hinges: For doors with heights up to 60 inches.
 - b. Three Hinges: For doors with heights 61 to 90 inches.
 - c. Four Hinges: For doors with heights 91 to 120 inches.
 - d. For doors with heights more than 120 inches, provide 4 hinges, plus 1 hinge for every 30 inches of door height greater than 120 inches.
 2. Hinge Size: Provide the following, unless otherwise indicated, with hinge widths sized for door thickness and clearances required:
 - a. Widths up to 3'0": 4-1/2" standard or heavy weight as specified.
 - b. Sizes from 3'1" to 4'0": 5" standard or heavy weight as specified.
 3. Hinge Weight and Base Material: Unless otherwise indicated, provide the following:
 - a. Exterior Doors: Heavy weight, non-ferrous, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate standard weight.
 - b. Interior Doors: Standard weight, steel, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate heavy weight.

4. Hinge Options: Comply with the following:
 - a. Non-removable Pins: With the exception of electric through wire hinges, provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for the all out-swinging lockable doors.

5. Manufacturers:
 - a. Hager Companies (HA).
 - b. McKinney Products; ASSA ABLOY Architectural Door Accessories (MK).
 - c. Stanley Hardware (ST).

- B. Continuous Geared Hinges: ANSI/BHMA A156.26 Grade 1-600 certified continuous geared hinge. with minimum 0.120-inch thick extruded 6060 T6 aluminum alloy hinge leaves and a minimum overall width of 4 inches. Hinges are non-handed, reversible and fabricated to template screw locations. Factory trim hinges to suit door height and prepare for electrical cut-outs.

1. Manufacturers:
 - a. Hager Companies (HA).
 - b. Pemko Products; ASSA ABLOY Architectural Door Accessories (PE).
 - c. Stanley Hardware (ST).

2.3 CYLINDERS AND KEYING

- A. General: Cylinder manufacturer to have minimum (10) years experience designing secured master key systems and have on record a published security keying system policy.

1. Manufacturers:
 - a. Match Existing, Field Verify.

- B. Cylinder Types: Original manufacturer cylinders able to supply the following cylinder formats and types:

1. Threaded mortise cylinders with rings and cams to suit hardware application.
2. Rim cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.
3. Bored or cylindrical lock cylinders with tailpieces as required to suit locks.
4. Tubular deadlocks and other auxiliary locks.
5. Mortise and rim cylinder collars to be solid and recessed to allow the cylinder face to be flush and be free spinning with matching finishes.

6. Keyway: Match Facility Standard.
- C. Interchangeable Cores: Provide small format interchangeable cores as specified, core insert, removable by use of a special key; usable with other manufacturers' cylinders.
 - D. Keying System: Each type of lock and cylinders to be factory keyed.
 1. Supplier shall conduct a "Keying Conference" to define and document keying system instructions and requirements.
 2. Furnish factory cut, nickel-silver large bow permanently inscribed with a visual key control number as directed by Owner.
 3. Existing System: Field verify and key cylinders to match Owner's existing system.
 - E. Key Quantity: Provide the following minimum number of keys:
 1. Change Keys per Cylinder: Two (2)
 2. Master Keys (per Master Key Level/Group): Five (5).
 3. Construction Keys (where required): Ten (10).
 - F. Construction Keying: Provide construction master keyed cylinders.
 - G. Key Registration List (Bitting List):
 1. Provide keying transcript list to Owner's representative in the proper format for importing into key control software.
 2. Provide transcript list in writing or electronic file as directed by the Owner.
- 2.4 MECHANICAL LOCKS AND LATCHING DEVICES
- A. Mortise Locksets, Grade 1 (Heavy Duty): ANSI/BHMA A156.13, Series 1000, Operational Grade 1 Certified Products Directory (CPD) listed. Locksets are to be manufactured with a corrosion resistant steel case and be field-reversible for handing without disassembly of the lock body.
 1. Manufacturers:
 - a. Corbin Russwin Hardware (RU) - ML2000 Series.
 - b. dormakaba Best (BE) - 45H Series.
 - c. Sargent Manufacturing (SA) - 8200 Series.
 - d. Yale Commercial(YA) - 8800FL Series.

2.5 LOCK AND LATCH STRIKES

- A. Strikes: Provide manufacturer's standard strike with strike box for each latch or lock bolt, with curved lip extended to protect frame,

finished to match door hardware set, unless otherwise indicated, and as follows:

1. Flat-Lip Strikes: For locks with three-piece antifriction latchbolts, as recommended by manufacturer.
2. Extra-Long-Lip Strikes: For locks used on frames with applied wood casing trim.
3. Aluminum-Frame Strike Box: Provide manufacturer's special strike box fabricated for aluminum framing.
4. Double-lipped strikes: For locks at double acting doors. Furnish with retractable stop for rescue hardware applications.

B. Standards: Comply with the following:

1. Strikes for Mortise Locks and Latches: BHMA A156.13.
2. Strikes for Bored Locks and Latches: BHMA A156.2.
3. Strikes for Auxiliary Deadlocks: BHMA A156.36.
4. Dustproof Strikes: BHMA A156.16.

2.6 CONVENTIONAL EXIT DEVICES

A. General Requirements: All exit devices specified herein shall meet or exceed the following criteria:

1. At doors not requiring a fire rating, provide devices complying with NFPA 101 and listed and labeled for "Panic Hardware" according to UL305. Provide proper fasteners as required by manufacturer including sex nuts and bolts at openings specified in the Hardware Sets.
2. Where exit devices are required on fire rated doors, provide devices complying with NFPA 80 and with UL labeling indicating "Fire Exit Hardware". Provide devices with the proper fasteners for installation as tested and listed by UL. Consult manufacturer's catalog and template book for specific requirements.
3. Except on fire rated doors, provide exit devices with hex key dogging device to hold the pushbar and latch in a retracted position. Provide optional keyed cylinder dogging on devices where specified in Hardware Sets.
4. Devices must fit flat against the door face with no gap that permits unauthorized dogging of the push bar. The addition of filler strips is required in any case where the door light extends behind the device as in a full glass configuration.
5. Lever Operating Trim: Where exit devices require lever trim, furnish manufacturer's heavy duty escutcheon trim with threaded studs for thru-bolts.

- a. Lock Trim Design: As indicated in Hardware Sets, provide finishes and designs to match that of the specified locksets.
 - b. Where function of exit device requires a cylinder, provide a cylinder (Rim or Mortise) as specified in Hardware Sets.
6. Vertical Rod Exit Devices: Where surface or concealed vertical rod exit devices are used at interior openings, provide as less bottom rod (LBR) unless otherwise indicated. Provide dust proof strikes where thermal pins are required to project into the floor.
 7. Narrow Stile Applications: At doors constructed with narrow stiles, or as specified in Hardware Sets, provide devices designed for maximum 2" wide stiles.
 8. Dummy Push Bar: Nonfunctioning push bar matching functional push bar.
 9. Rail Sizing: Provide exit device rails factory sized for proper door width application.
 10. Through Bolt Installation: For exit devices and trim as indicated in Door Hardware Sets.
- B. Conventional Push Rail Exit Devices (Heavy Duty): ANSI/BHMA A156.3, Grade 1 Certified Products Directory (CPD) listed panic and fire exit hardware devices furnished in the functions specified in the Hardware Sets. Exit device latch to be stainless steel, pullman type, with deadlock feature.
1. Manufacturers:
 - a. Corbin Russwin Hardware (RU) - ED4000 / ED5000 Series.
 - b. Detex (DE) - Advantex.
 - c. Sargent Manufacturing (SA) - 80 Series.
 - d. Von Duprin (VD) - 35A/98 XP Series.
 - e. Yale (YA) - 7000 Series.

2.7 DOOR CLOSERS

- A. All door closers specified herein shall meet or exceed the following criteria:
1. General: Door closers to be from one manufacturer, matching in design and style, with the same type door preparations and templates regardless of application or spring size. Closers to be non-handed with full sized covers.
 2. Standards: Closers to comply with UL-10C for Positive Pressure Fire Test and be U.L. listed for use of fire rated doors.

3. Size of Units: Comply with manufacturer's written recommendations for sizing of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Where closers are indicated for doors required to be accessible to the Americans with Disabilities Act, provide units complying with ANSI ICC/A117.1.
 4. Closer Arms: Provide heavy duty, forged steel closer arms unless otherwise indicated in Hardware Sets.
 5. Closers shall not be installed on exterior or corridor side of doors; where possible install closers on door for optimum aesthetics.
 6. Closer Accessories: Provide door closer accessories including custom templates, special mounting brackets, spacers and drop plates as required for proper installation. Provide through-bolt and security type fasteners as specified in the hardware sets.
- B. Door Closers, Surface Mounted (Commercial Duty): ANSI/BHMA 156.4, Grade 1 Certified Products Directory (CPD) listed surface mounted, institutional grade door closers with complete spring power adjustment, sizes 1 thru 6; and fully operational adjustable according to door size, frequency of use, and opening force. Closers to be rack and pinion type, one piece cast iron or aluminum alloy body construction, with adjustable backcheck, closing sweep, and latch speed control valves. Provide non-handed units standard.
1. Manufacturers:
 - a. Corbin Russwin Hardware (RU) - DC6000 Series.
 - b. dormakaba Stanley (ST) - CLD-4551 Series.
 - c. LCN Closers (LC) - 1450 Series.
 - d. Norton Door Controls (NO) - 8500 Series.
 - e. Sargent Manufacturing (SA) - 1431 Series.
 - f. Yale Commercial(YA) - 3500 Series.

2.8 SURFACE MOUNTED CLOSER HOLDERS

- A. Electromagnetic Door Holders: Certified ANSI A156.15 electromagnetic door holder/releases with a minimum 20 to 40 pounds holding power and single coil construction able to accommodate.12VDC, 24VAC, 24VDC and 120VAC. Coils to be independently wound, employing an integral fuse and armatures to include a positive release button.
1. Manufacturers:
 - a. Rixson (RF) - 980/990 Series.
 - b. Sargent Manufacturing (SA) - 1560 Series.

2.9 ARCHITECTURAL TRIM

A. Door Protective Trim

1. General: Door protective trim units to be of type and design as specified below or in the Hardware Sets.
2. Size: Fabricate protection plates (kick, armor, or mop) not more than 2" less than door width (LDW) on stop side of single doors and 1" LDW on stop side of pairs of doors, and not more than 1" less than door width on pull side. Coordinate and provide proper width and height as required where conflicting hardware dictates. Height to be as specified in the Hardware Sets.
3. Where plates are applied to fire rated doors with the top of the plate more than 16" above the bottom of the door, provide plates complying with NFPA 80. Consult manufacturer's catalog and template book for specific requirements for size and applications.
4. Protection Plates: ANSI/BHMA A156.6 certified protection plates (kick, armor, or mop), fabricated from the following:
 - a. Stainless Steel: 300 grade, 050-inch thick.
5. Options and fasteners: Provide manufacturer's designated fastener type as specified in the Hardware Sets. Provide countersunk screw holes.
6. Manufacturers:
 - a. Hiawatha, Inc. (HI).
 - b. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
 - c. Trimco (TC).

2.10 DOOR STOPS AND HOLDERS

- A. General: Door stops and holders to be of type and design as specified below or in the Hardware Sets.
- B. Door Stops and Bumpers: ANSI/BHMA A156.16, Grade 1 certified door stops and wall bumpers. Provide wall bumpers, either convex or concave types with anchorage as indicated, unless floor or other types of door stops are specified in Hardware Sets. Do not mount floor stops where they will impede traffic. Where floor or wall bumpers are not appropriate, provide overhead type stops and holders.
 1. Manufacturers:
 - a. Hiawatha, Inc. (HI).

- b. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
- c. Trimco (TC).

2.11 ARCHITECTURAL SEALS

- A. General: Thresholds, weatherstripping, and gasket seals to be of type and design as specified below or in the Hardware Sets. Provide continuous weatherstrip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated. At exterior applications provide non-corrosive fasteners and elsewhere where indicated.
- B. Smoke Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke control ratings indicated, based on testing according to UL 1784.
 - 1. Provide smoke labeled perimeter gasketing at all smoke labeled openings.
- C. Fire Labeled Gasketing: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to UL-10C.
 - 1. Provide intumescent seals as indicated to meet UL10C Standard for Positive Pressure Fire Tests of Door Assemblies, and NPFA 252, Standard Methods of Fire Tests of Door Assemblies.
- D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated.
- E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.
- F. Manufacturers:
 - 1. National Guard Products (NG).
 - 2. Pemko Products; ASSA ABLOY Architectural Door Accessories (PE).
 - 3. Reese Enterprises, Inc. (RE).

2.12 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates generally prepared for machine, wood, and sheet metal screws. Provide screws according to manufacturers recognized installation standards for application intended.

2.13 FINISHES

- A. Standard: Designations used in the Hardware Sets and elsewhere indicate hardware finishes complying with ANSI/BHMA A156.18, including coordination with traditional U.S. finishes indicated by certain manufacturers for their products.
- B. Provide quality of finish, including thickness of plating or coating (if any), composition, hardness, and other qualities complying with manufacturer's standards, but in no case less than specified by referenced standards for the applicable units of hardware
- C. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine scheduled openings, with Installer present, for compliance with requirements for installation tolerances, labeled fire door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Notify architect of any discrepancies or conflicts between the door schedule, door types, drawings and scheduled hardware. Proceed only after such discrepancies or conflicts have been resolved in writing.

3.2 PREPARATION

- A. Hollow Metal Doors and Frames: Comply with ANSI/DHI A115 series.
- B. Wood Doors: Comply with ANSI/DHI A115-W series.

3.3 INSTALLATION

- A. Install each item of mechanical and electromechanical hardware and access control equipment to comply with manufacturer's written instructions and according to specifications.
 - 1. Installers are to be trained and certified by the manufacturer on the proper installation and adjustment of fire, life safety, and security products including: hanging devices; locking devices; closing devices; and seals.
- B. Mounting Heights: Mount door hardware units at heights indicated in following applicable publications, unless specifically indicated or required to comply with governing regulations:

1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
 3. Where indicated to comply with accessibility requirements, comply with ANSI A117.1 "Accessibility Guidelines for Buildings and Facilities."
 4. Provide blocking in drywall partitions where wall stops or other wall mounted hardware is located.
- C. Retrofitting: Install door hardware to comply with manufacturer's published templates and written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9 Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.
- D. Thresholds: Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- E. Storage: Provide a secure lock up for hardware delivered to the project but not yet installed. Control the handling and installation of hardware items so that the completion of the work will not be delayed by hardware losses before and after installation.
- 3.4 FIELD QUALITY CONTROL
- A. Field Inspection (Punch Report): Reference Division 01 Sections "Closeout Procedures". Produce project punch report for each installed door opening indicating compliance with approved submittals and verification hardware is properly installed, operating and adjusted. Include list of items to be completed and corrected, indicating the reasons or deficiencies causing the Work to be incomplete or rejected.
1. Organization of List: Include separate Door Opening and Deficiencies and Corrective Action Lists organized by Mark, Opening Remarks and Comments, and related Opening Images and Video Recordings.
- 3.5 ADJUSTING
- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

3.6 CLEANING AND PROTECTION

- A. Protect all hardware stored on construction site in a covered and dry place. Protect exposed hardware installed on doors during the construction phase. Install any and all hardware at the latest possible time frame.
- B. Clean adjacent surfaces soiled by door hardware installation.
- C. Clean operating items as necessary to restore proper finish. Provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of owner occupancy.

3.7 DEMONSTRATION

- A. Instruct Owner's maintenance personnel to adjust, operate, and maintain mechanical and electromechanical door hardware.

3.8 DOOR HARDWARE SETS

- A. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.
 - 1. Quantities listed are for each pair of doors, or for each single door.
 - 2. The supplier is responsible for handing and sizing all products.
 - 3. Where multiple options for a piece of hardware are given in a single line item, the supplier shall provide the appropriate application for the opening.
 - 4. At existing openings with new hardware the supplier shall field inspect existing conditions prior to the submittal stage to verify the specified hardware will work as required. Provide alternate solutions and proposals as needed.

Hardware Sets

Set: 1.0

Doors: 106A, 106B

1 Continuous Hinge (A31031G)	CFM (height) HD1		PE
1 Rim Exit Device, Storeroom	16 72 8804 ETL	US32D	SA
2 Interchangeable Core (E09241)	Core as required to match existing system.	26	
1 Surface Closer (C02021-PT4G)	CPS8501 M	689	NO
1 Kick Plate (J102)	K1050 10" CSK	US32D	RO
1 Threshold (J36100)	2009APK		PE
1 Rain Guard (R0Y976)	346C		PE
1 Gasketing (R3E164)	303AS (HEAD/JAMBS)		PE
1 Sweep (R3D534)	345AV		PE

Notes:

*Waiver may be required to comply with Buy American Act.

Set: 2.0

Doors: 110

6 Hinge (A8111)	T4A3786 x USA	US26D	MK
2 Exit Device (Type 2, 08)	72 NB8713 ETL	US32D	SA
2 Interchangeable Core (E09241)	Core as required to match existing system.	26	
2 Surface Closer (C02021-PT4G)	CPS8501 M	689	NO
2 Kick Plate (J102)	K1050 10" CSK	US32D	RO
2 Magnetic Holder (C00011)	998	689	RF ⚡
1 Adhesive Gasketing (R0Y154)	S88BL		PE
1 Astragal	S772BL LAR		PE

Notes: • Electronic Operation: Magnetic hold opens hold door in pocket. Activation of fire alarm or lose of power closes and latches door. Trims are left in unlocked position during business hours.

*Waiver may be required to comply with Buy American Act.

Set: 3.0

Doors: E1, E2

3 Hinge (A8112)	TA2714 x USA	US26D	MK
1 Storeroom Lock (F07)	72 8204 LNL	US26D	SA
1 Interchangeable Core (E09241)	Core as required to match existing system.	26	
1 Kick Plate (J102)	K1050 10" CSK	US32D	RO

1 Door Stop (L02251 / L02121)*	403/470	US26D	RO
1 Adhesive Gasketing (R0Y154)	S88BL		PE

Notes:

*Waiver may be required to comply with Buy American Act.

Set: 4.0

Doors: [102A](#), [102B](#)

3 Hinge (A8112)	TA2714 x USA	US26D	MK
1 Storeroom Lock (F07)	72 8204 LNL	US26D	SA
1 Interchangeable Core (E09241)	Core as required to match existing system.	26	
1 Surface Closer (C02011 / C02021)	R / PR8501 M	689	NO
1 Kick Plate (J102)	K1050 10" CSK	US32D	RO
1 Door Stop (L02251 / L02121)*	403/470	US26D	RO
1 Adhesive Gasketing (R0Y154)	S88BL		PE

Notes:

*Waiver may be required to comply with Buy American Act.

Set: 5.0

Doors: [107](#), [108](#)

3 Hinge (A8112)	TA2714 x USA	US26D	MK
1 Storeroom Lock (F07)	72 8204 LNL	US26D	SA
1 Interchangeable Core (E09241)	Core as required to match existing system.	26	
1 Surface Closer (C02021-PT4G)	CPS8501 M	689	NO
1 Kick Plate (J102)	K1050 10" CSK	US32D	RO
1 Adhesive Gasketing (R0Y154)	S88BL		PE

Notes:

*Waiver may be required to comply with Buy American Act.

Set: 6.0

Doors: [T101A](#), [T101B](#)

1 Continuous Hinge (A31031G)	CFM (height) HD1		PE
1 Threshold (J36100)T101A only	2009APK		PE
1 Rain Guard(R0Y976)T101A only	346C		PE
1 Gasketing (R3E164)	303AS (HEAD/JAMBS)		PE
1 Sweep (R3D534)	345AV		PE

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

END OF SECTION 087100

SECTION 08 71 13
AUTOMATIC DOOR OPERATORS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Automatic operators for swinging and sliding doors.

1.2 RELATED REQUIREMENTS

- A. Aluminum Frames Entrance Work: Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.
- B. Door Hardware: Section 08 71 00, DOOR HARDWARE.
- C. Access Control Devices: Division 28, ELECTRONIC SAFETY AND SECURITY.
- D. Electric General Wiring, Connections and Equipment Requirements: Division 26, ELECTRICAL.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
 - 1. B209-14 - Aluminum and Aluminum-Alloy Sheet and Plate.
 - 2. A1008/A1008M-15 - Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Baked Hardenable.
- C. Builders Hardware Manufacturers Association (BHMA):
 - 1. BHMA A156.10-11 - Power Operated Pedestrian Doors.
- D. National Fire Protection Association (NFPA):
 - 1. 101-15 - Life Safety Code.
- E. Underwriters Laboratories (UL):
 - 1. 325-13 - Standard for Doors, Drapery, Gate, Louver, and Window Operators and Systems.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submittal Drawings:
 - 1. Show size, configuration, and fabrication and installation details.
- C. Manufacturer's Literature and Data:
 - 1. Description of each product.
 - 2. Installation instructions.

3. Warranty.

D. Sustainable Construction Submittals:

1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.

E. Test reports: Certify each product complies with specifications.

F. Qualifications: Substantiate qualifications comply with specifications.

1. Manufacturer.

2. Installer with project experience list.

G. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

2. Start-up, maintenance, troubleshooting, emergency, and shut-down instructions for each operational product.

1.5 QUALITY ASSURANCE

A. Manufacturer's Qualifications:

1. Regularly manufactures specified products.

2. Manufactured specified products with satisfactory service on five similar installations for minimum five years.

a. Provide contact names and addresses for completed projects when requested by Contracting Officer's Representative.

B. Installer's Qualifications: Experienced installer, approved by the manufacturer.

1.6 WARRANTY

A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

B. Manufacturer's Warranty: Warrant automatic door operators against material and manufacturing defects.

1. Warranty Period: Two years.

PART 2 - PRODUCTS

2.1 SYSTEM PERFORMANCE

A. Comply with requirements of BHMA A156.10. Unless otherwise indicated on Drawings, provide operators that move doors from fully closed to fully opened position in five seconds maximum time interval, when speed adjustment is at maximum setting.

B. Equipment: Conforming to UL 325. Provide key operated power disconnect wall switch for each door installation.

- C. Electrical Wiring, Connections and Equipment: Motors, starters, controls, associated devices, and interconnecting wiring required for installation. Equipment and wiring as specified in Division 26, ELECTRICAL.

2.2 PRODUCTS - GENERAL

- A. Basis of Design: ASSA/Abloy/Besam SW 200
B. Provide door operators from one manufacturer.
C. Provide one type of operator throughout project.

2.3 SWING DOOR OPERATORS

- A. General:
1. Type: Institutional type.
 2. Size: As recommended by manufacturer for door weight and sizes.
- B. Function:
1. Provide operators, enclosed in housing, permitting opening of door by energizing motor and stopped by electrically reducing Voltage and stalling motor against mechanical stop.
 2. Door to close by means of spring energy, and closing force controlled by gear system and motor being used as dynamic brake without power, or controlled by hydraulic closer in electro-hydraulic operators.
 3. Opening and Closing Speeds: Field adjustable.
 4. Operators with checking mechanism providing cushioning action at last part of door travel, in both opening and closing cycle.
 5. Operators capable of recycling doors instantaneously to full open position from any point in closing cycle when control switch is activated.
 6. When automatic power is interrupted or shut-off, permit doors to easily open manually without damage to automatic operator system.
- C. Connect hardware with drive arm attached to door with pin linkage rotating in a self-lubricating bearing. Prevent doors from pivoting on shaft of operator.
- D. Operator Housing:
1. ASTM B209, Type 6063-T5 aluminum alloy, 112 mm (4-1/2 inches) wide by 140 mm (5.5 inches) high by 3.2 mm (0.125 inch) thick, aluminum extrusions with enclosed end caps for application to 100 mm (4 inches) and larger frame systems.

E. Power Operator:

1. Completely assembled and sealed unit including gear drive transmission, mechanical spring and bearings, located in aluminum case and filled with special lubricant for extreme temperature conditions. Rubber mounted units with provisions for easy maintenance and replacement, without removing door from pivots or frame.

F. Motors:

1. Provide with interlock to prevent operation when doors are electrically locked from opening.

G. Electrical Control:

1. Self-contained electrical control unit, including necessary transformers, relays, rectifiers, and other electronic components for proper operation and switching of power operator.
2. Connecting Harnesses: Interlocking plugs.

H. Accessories:

1. Metal mounting supports, brackets and other accessories necessary for installation of operators at head of door frames.

I. Microprocessor Controls:

1. Multi-function microprocessor control providing adjustable hold open time (1-30 seconds) with fully adjustable opening speed, LED indications for sensor input signals and operator status and power assist close options. Control capable of receiving activation signals from any device with normally open dry contact output.
2. Hold doors held open by low Voltage applied to the continuous duty motor.
3. Controls:
 - a. Adjustable safety circuit that monitors door operation and stops opening direction of door if obstruction is sensed.
 - b. Recycle feature that reopens door if obstruction is sensed at any point during closing cycle.
 - c. Standard three position key switch with functions for ON, OFF, and HOLD OPEN, mounted on operator enclosure, door frame, or wall, as indicated on drawings.

2.4 SLIDING DOOR OPERATORS

A. Operator Function:

1. Electric motor pulling door from closed to open position, stopping door by electrically reducing Voltage and stalling door against mechanical stop.
 2. Opening and Closing Speeds: Field adjustable.
 3. System permitting manual control of door in event of power failure.
- B. Power Operator:
1. Completely assembled and sealed electromechanical operating unit including 95 W (1/8 hp.) DC shunt-wound permanent magnet motor with sealed bearings, located in aluminum case and filled with special lubricant for extreme temperature conditions. Rubber mount units with provisions for easy maintenance and replacement, without removing door from pivots or frame.
 2. Opening and Closing Cycle: Field adjustable.
- C. Operator Housing:
1. ASTM B209, Type 6063-T5 aluminum alloy, 150 mm (6 inches) wide by 200 mm (8 inches) high by 3.2 mm (0.125 inch) thick, aluminum extrusions with enclosed end caps for application to 100 mm (4 inches) and larger frame systems.

2.5 SLIDING DOOR UNITS

- A. Provide door panels in compliance with NFPA 101, allowing "breakout" to full open position to provide instant egress at any point in door's movement.
1. Door Panels: ASTM A1008/A1008M, steel sheet, Type B, cold-rolled, reinforce frame structure, minimum 1.1-mm (0.043 inch) thick steel shapes.
- B. Sliding Door Hardware Guide Rollers, Door Carrier:
1. Rollers: Steel or plastic rollers with sealed bearings with each door having two support rollers and one anti-rise roller.
 - a. Vertical Adjustment: Minimum 9 mm (0.35 inch) with positive mechanical locks.
 - b. Include two urethane covered oil impregnated bearing bottom rollers attached with 5 mm (3/16 inch) thick formed steel guide brackets at each door.
 - c. Door Carriers: For each door carrier supporting door leaf, include vertical steel reinforcing member to prevent sagging when door is swung under breakaway conditions.

1) Carbon Steel Brackets And Fittings: Corrosion resistant.

C. Locking Hardware:

1. Locking hardware at interior doors not requiring physical security is not required.
2. Doors with flush concealed vertical rod panic hardware integrated into doors where physical security is required and free egress is required at all times.
3. Doors with manufacturers' standard hookbolt lock (keyed both sides) where physical security is required and free egress is not required at all times.
 - a. At doors with access control devices specified in Division 28 - ELECTRONIC SAFETY AND SECURITY, provide doors with electronic deadbolt locking to prevent doors from manually sliding open.

D. Door Closers: Breakout or swing-out panels with door closers concealed in top rail of door.

2.6 POWER UNITS

- A. Self-contained, electric operated and independent of door operator.
1. Capacity and size of power circuits according to automatic door operator manufacturer's specifications and Division 26 - ELECTRICAL.

2.7 DOOR CONTROLS

- A. Control Devices: BHMA A156.10; control opening and closing functions.
- B. Open doors when control device is actuated; hold doors in open positions; then, close doors after a set time period, unless safety device or reactivated control interrupts operation.
- C. Manual Controls:
1. Push Plate Wall Switch: Recessed type, stainless steel push plate minimum 100 mm by 100 mm (4 inch by 4 inch), with 13 mm (1/2 inch) high letters "To Operate Door-Push" engraved on face of plate.
- D. Motion Detector:
1. Mounting: Surface or concealed.
 2. Detection Area: 1500 mm (60 inches) deep and 1500 mm (60 inches) across, plus or minus 150 mm (6 inches).
 3. Response Time: 25 milliseconds, maximum.
 4. Control Power: 24 Volt DC.
 5. Design units to be unaffected by cleaning material, solvents, dust, dirt and outdoor weather conditions.

2.8 SAFETY DEVICES

- A. Sliding Doors:
 - 1. Two photoelectric beams mounted at heights of 600 mm (24 inches) and 1200 mm (48 inches) in door frame.
 - 2. Overhead safety presence sensors at door head on both sides of opening.
 - 3. Recycle doors to full open position when beams are interrupted.
 - 4. Motion detector mounted on both sides of door for detection of traffic in both direction.
- B. Swing Doors: Install presence sensor on pull side of door to detect any person standing in door swing path and prevent door from opening.
 - 1. Time delay Switches: Adjustable between 3 to 60 seconds and control closing cycle of doors.
- C. Install decal signs with "In" or "Do Not Enter" on both faces of each door where shown.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
 - 1. Verify door opening is correctly sized and within acceptable tolerances.
- B. Protect existing construction and completed work from damage.

3.2 INSTALLATION

- A. Install products according to manufacturer's instructions and approved submittal drawings.
 - 1. When manufacturer's instructions deviate from specifications, submit proposed resolution for Contracting Officer's Representative consideration.
- B. Coordinate door installation with other related work.
- C. Install manual controls and power disconnect switches recessed or semi-flush mounted in partitions.
- D. Secure operator components to adjacent construction with suitable fastenings.
- E. Conceal conduits, piping, and electric equipment, in finish work.
- F. Install power units in locations shown.

1. Where units are mounted on walls, provide metal supports or shelves for units.
 2. Ensure equipment, including time delay switches, are accessible for maintenance and adjustment.
- G. Ensure operators are adjusted and function properly for type of expected traffic.
- H. Synchronize each leaf of pair doors to open and close simultaneously. Permit each door leaf to be opened manually, independent of other door leaf.
- I. Install controls at positions shown and ensuring convenience for expected traffic.
- J. Push Plate Wall Switches Mounting Height: 1000 mm (40 inches) maximum, unless otherwise approved by Contracting Officer's Representative.

3.3 DEMONSTRATION AND TRAINING

- A. Instruct VA personnel in proper automatic door operator operation and maintenance.
1. Trainer: Manufacturer approved instructor.
 2. Training Time: 2 hours minimum.
- B. Coordinate instruction to VA personnel with VA Contracting Officer's Representative.
- - E N D - -

SECTION 08 80 00
GLAZING

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies the following:
1. Glass.
 2. Glazing materials and accessories for both factory and field glazed assemblies.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Factory glazed by manufacturer in following units:
1. Sound resistant doors: Section 08 11 13, HOLLOW METAL DOORS AND FRAMES, and Section 08 14 00, WOOD DOORS.
 2. Mirrors: Section 10 28 00, TOILET, BATH, AND LAUNDRY ACCESSORIES.
 3. Entrances and Storefronts: Section 08 41 13, ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS.
 4. Glazed Curtain Walls: Section 08 44 13, GLAZED ALUMINUM CURTAIN WALLS.
 5. Access Control Systems: Section 28 13 11, PHYSICAL ACCESS CONTROL SYSTEMS.
 6. Intrusion Detection: Section 28 16 11, INTRUSION DETECTION SYSTEM.
 7. Junction and Switch Boxes: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.

1.3 LABELS:

- A. Temporary labels:
1. Provide temporary label on each light of glass and plastic material identifying manufacturer or brand and glass type, quality and nominal thickness.
 2. Label in accordance with NFRC label requirements.
 3. Temporary labels are to remain intact until glass and plastic material is approved by Contracting Officer Representative (COR).
- B. Permanent labels:
1. Locate in corner for each pane.
 2. Label in accordance with ANSI Z97.1 and SGCC label requirements.

- a. Tempered glass.
 - b. Laminated glass or have certificate for panes without permanent label.
 - c. Organic coated glass.
3. Bullet resistance glass or plastic assemblies:
- a. Bullet resistance glass or plastic assemblies in accordance with UL 752 requirements for power rating specified.
 - b. Identify each security glazing permanently with glazing manufacturer's name, date of manufacture, product number, and DOS Code number inconspicuously located in lower corner on protective side and visible after glazing is framed.
 - c. The "attack (threat) side" is to be identified in bold lettering on each side of glazing with removable label.
4. Fire rated glazing assemblies: Mark in accordance with IBC.

1.4 PERFORMANCE REQUIREMENTS:

- A. General: Design glazing system consistent with guidance and practices presented in the GANA Glazing Manual, GANA Laminated Glazing Manual, and GANA Sealant Manual, as applicable to project. Installed glazing is to withstand applied loads, thermal stresses, thermal movements, building movements, permitted tolerances, and combinations of these conditions without failure, including loss or glass breakage attributable to defective manufacture, fabrication, or installation; failure of sealants or gaskets to remain watertight and airtight; deterioration of glazing materials; unsafe engagement of the framing system; deflections beyond specified limits; or other defects in construction.
- B. Glazing Unit Design: Design glass, including engineering analysis meeting requirements of authorities having jurisdiction. Thicknesses listed are minimum. Coordinate thicknesses with framing system manufacturers.
1. Design glass in accordance with ASTM E1300, and for conditions beyond the scope of ASTM E1300, by a properly substantiated structural analysis.
 2. Design Wind Pressures: As indicated on construction documents In accordance with ASCE 7 In accordance with applicable code .

3. Wind Design Data: As indicated on construction documents In accordance with ASCE 7 In accordance with applicable code .
 4. Maximum Lateral Deflection: For glass supported on all four edges, limit center-of-glass deflection at design wind pressure to not more than the structural capacity of the glazing unit, the threshold at which frame engagement is no longer safely assured, $1/100$ times the short-side length, or 19 mm (0.75 inch) , whichever is less.
- C. Ballistic- and Blast- resistant glass assemblies:
1. For blast-resistant and ballistic-resistant units comply with requirements in UFC 4-010-01, Physical Security Design Manual for VA Facilities, and project-specific criteria provided by VA.
 2. Spall Resistance: Laminated glazing is not permitted to produce spall to interior (protected side) when impacted with scheduled ballistics.
 3. Tolerances:
 - a. Outside dimensions: Overall outside dimensions (height and width) of laminated security glazing is to maintain tolerance of ± 3 mm (± 0.12 inch).
 - b. Warpage: Out-of-flat (warpage or bowing) condition of laminates is not to exceed 2.5 mm per lineal meter (0.10 inch per 3.3 lineal foot). The condition, if present, is to be localized to extent not greater than 0.75 mm (0.03 inch) for any 0.3 meter (0.98 feet) section.
- D. Windborne-Debris-Impact Resistance: Comply with enhanced-protection testing requirements in ASTM E1996 for project wind zone when tested according to ASTM E1886, based upon testing of specimens not less than the size required for project and utilizing installation method identical to that specified for project.
1. Project Wind Zone: Wind Zone 1 Wind Zone 2 Wind Zone 3 Wind Zone 4 .
- E. Building Enclosure Vapor Retarder and Air Barrier:
1. Utilize the inner pane of multiple pane sealed units for the continuity of the air barrier and vapor retarder seal.

2. Maintain a continuous air barrier and vapor retarder throughout the glazed assembly from glass pane to heel bead of glazing sealant.

1.5 SUBMITTALS:

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.
- C. Manufacturer's Certificates:
 1. Certificate stating that fire-protection and fire-resistive glazing units meet code requirements for fire-resistance-rated assembly and applicable safety glazing requirements.
 2. Certificate on solar heat gain coefficient when value is specified.
 3. Certificate on "R" value when value is specified.
 4. Certificate test reports confirming compliance with specified bullet resistive rating.
- D. Manufacturer Warranty.
- E. Manufacturer's Literature and Data:
 1. Glass, each kind required.
 2. Insulating glass units.
 3. Elastic compound for metal sash glazing.
 4. Glazing cushion.
 5. Sealing compound.
- F. Samples:
 1. Size: 305 mm by 305 mm (12 inches by 12 inches).
 2. Tinted glass.
- G. Preconstruction Adhesion and Compatibility Test Report: Submit glazing sealant manufacturer's test report indicating glazing sealants were tested for adhesion to glass and glazing channel substrates and for compatibility with glass and other glazing materials.

1.6 DELIVERY, STORAGE AND HANDLING:

- A. Delivery: Schedule delivery to coincide with glazing schedules so minimum handling of crates is required. Do not open crates except as required for inspection for shipping damage.
- B. Storage: Store cases according to printed instructions on case, in areas least subject to traffic or falling objects. Keep storage area clean and dry.
- C. Handling: Unpack cases following printed instructions on case. Stack individual windows on edge leaned slightly against upright supports with separators between each.
- D. Protect laminated security glazing units against face and edge damage during entire sequence of fabrication, handling, and delivery to installation location. Provide protective covering on exposed faces of glazing plastics, and mark inside as "INTERIOR FACE" or "PROTECTED FACE":
 - 1. Treat security glazing as fragile merchandise, and packaged and shipped in export wood cases with width end in upright position and blocked together in a mass. Storage and handling to comply with manufacturer's directions and as required to prevent edge damage or other damage to glazing resulting from effects of moisture, condensation, temperature changes, direct exposure to sun, other environmental conditions, and contact with chemical solvents.
 - 2. Protect sealed-air-space insulating glazing units from exposure to abnormal pressure changes, as could result from substantial changes in altitude during delivery by air freight. Provide temporary breather tubes which do not nullify applicable warranties on hermetic seals.
 - 3. Temporary protections: The glass front and polycarbonate back of glazing are to be temporarily protected with compatible, peelable, heat-resistant film which will be peeled for inspections and re-applied and finally removed after doors and windows are installed at destination. Since many adhesives will attack polycarbonate, the film used on exposed polycarbonate surfaces is to be approved and applied by manufacturer.
 - 4. Edge protection: To cushion and protect glass clad, and polycarbonate edges from contamination or foreign matter, the four (4) edges are to be sealed the depth of glazing with continuous

standard-thickness thermoplastic rubber tape. Alternatively, continuous channel shaped extrusion of thermoplastic rubber are to be used, with flanges extending into face sides of glazing.

5. Protect "Constant Temperature" units including every unit where glass sheet is directly laminated to or directly sealed with metal-tube type spacer bar to polycarbonate sheet, from exposures to ambient temperatures outside the range of 16 to 24 degrees C (60 to 75 degrees F), during the fabricating, handling, shipping, storing, installation, and subsequent protection of glazing.

1.7 PROJECT CONDITIONS:

Field Measurements: Field measure openings before ordering tempered glass products to assure for proper fit of field measured products.

1.8 WARRANTY:

- A. Construction Warranty: Comply with the FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their glazing from the date of installation and final acceptance by the Government as follows. Submit manufacturer warranty.
 1. Bullet resistive plastic material to remain visibly clear without discoloration for 10 years.
 2. Insulating glass units to remain sealed for ten (10) years.
 3. Laminated glass units to remain laminated for five (5) years.
 4. Polycarbonate to remain clear and ultraviolet light stabilized for five (5) years.
 5. Insulating plastic to not have more than 6 percent decrease in light transmission and be ultraviolet light stabilized for ten (10) years.

1.9 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. American Architectural Manufacturers Association (AAMA):
 - 800Test Methods for Sealants
 - 810.1-77Expanded Cellular Glazing Tape
- C. American National Standards Institute (ANSI):
 - Z97.1-14Safety Glazing Material Used in Building -
Safety Performance Specifications and Methods
of Test

- D. American Society of Civil Engineers (ASCE):
7-10Wind Load Provisions
- E. ASTM International (ASTM):
C542-05 (R2011)Lock-Strip Gaskets
C716-06Installing Lock-Strip Gaskets and Infill
Glazing Materials
C794-10Adhesion-in-Peel of Elastomeric Joint Sealants
C864-05 (R2011)Dense Elastomeric Compression Seal Gaskets,
Setting Blocks, and Spacers
C920-14aElastomeric Joint Sealants
C964-07 (R2012)Standard Guide for Lock-Strip Gasket Glazing
C1036-11 (R2012)Flat Glass
C1048-12Heat-Treated Flat Glass-Kind HS, Kind FT Coated
and Uncoated Glass.
C1172-14Laminated Architectural Flat Glass
C1349-10Standard Specification for Architectural Flat
Glass Clad Polycarbonate
C1376-10Pyrolytic and Vacuum Deposition Coatings on
Flat Glass
D635-10Rate of Burning and/or Extent and Time of
Burning of Self-Supporting Plastic in a
Horizontal Position
D4802-10Poly (Methyl Methacrylate) Acrylic Plastic
Sheet
E84-14Surface Burning Characteristics of Building
Materials
E119-14Standard Test Methods for Fire Test of Building
Construction and Material
E1300-12aLoad Resistance of Glass in Buildings
E1886-13aStandard Test Method for Performance of
Exterior Windows, Curtain Walls, Doors, and
Impact Protective Systems Impacted by
Missile(s) and Exposed to Cyclic Pressure
Differentials
E1996-14aStandard Specification for Performance of
Exterior Windows, Curtain Walls, Doors, and

- Impact Protective Systems Impacted by Windborne
Debris in Hurricanes
- E2141-12Test Methods for Assessing the Durability of
Absorptive Electrochromic Coatings on Sealed
Insulating Glass Units
- E2190-10Insulating Glass Unit
- E2240-06Test Method for Assessing the Current-Voltage
Cycling Stability at 90 Degree C (194 Degree F)
of Absorptive Electrochromic Coatings on Sealed
Insulating Glass Units
- F1233-08Standard Test Method for Security Glazing
Materials and Systems
- F1642-12Test Method for Glazing and Glazing Systems
Subject to Airblast Loadings
- E. Code of Federal Regulations (CFR):
- 16 CFR 1201-10Safety Standard for Architectural Glazing
Materials
- F. Glass Association of North America (GANA):
- 2010 EditionGANA Glazing Manual
- 2008 EditionGANA Sealant Manual
- 2009 EditionGANA Laminated Glazing Reference Manual
- 2010 EditionGANA Protective Glazing Reference Manual
- G. International Code Council (ICC):
- IBCInternational Building Code
- H. Insulating Glass Certification Council (IGCC)
- I. Insulating Glass Manufacturer Alliance (IGMA):
- TB-3001-13Guidelines for Sloped Glazing
- TM-3000North American Glazing Guidelines for Sealed
Insulating Glass Units for Commercial and
Residential Use
- J. Intertek Testing Services - Warnock Hersey (ITS-WHI)
- K. National Fire Protection Association (NFPA):
- 80-16Fire Doors and Windows
- 252-12Fire Tests of Door Assemblies
- 257-12Standard on Fire Test for Window and Glass
Block Assemblies
- L. National Fenestration Rating Council (NFRC)

- M. Safety Glazing Certification Council (SGCC) 2012:
Certified Products Directory (Issued Semi-Annually).
- N. Underwriters Laboratories, Inc. (UL):
 - 9-08 (R2009)Fire Tests of Window Assemblies
 - 263-14Fire Tests of Building Construction and
Materials
 - 752-11Bullet-Resisting Equipment.
- O. Unified Facilities Criteria (UFC):
 - 4-010-01-03 (R2007)DOD Minimum Antiterrorism Standards for
Buildings
 - Physical Security Design Manual for VA Facilities (VAPSDG); Mission
Critical Facilities
 - Architectural Design Manual for VA Facilities (VASDM)
- Q. Environmental Protection Agency (EPA):
 - 40 CFR 59 (2014)National Volatile Organic Compound Emission
Standards for Consumer and Commercial Products

PART 2 - PRODUCT

2.1 GLASS:

- A. Provide minimum thickness stated and as additionally required to meet performance requirements.
 - 1. Provide minimum 6 mm (1/4 inch) thick glass units unless otherwise indicated.
- B. Obtain glass units from single source from single manufacturer for each glass type.
- C. Clear Glass:
 - 1. ASTM C1036, Type I, Class 1, Quality q3 .
- E. Tinted Heat reflective and low emissivity coated glass:
 - 1. ASTM C1036, Type I, Class 2, Quality q3.

2.2 HEAT-TREATED GLASS:

- A. Roller Wave Limits for Heat-Treated Glass: Orient all roller wave distortion parallel to bottom surface of glazing, and provide units complying with the following limitations:

1. Measurement Parallel to Line: Maximum peak to valley 0.203 mm (0.008 inch).
2. Measurement Perpendicular to Line: Maximum 0.0254 mm (0.001 inch).
3. Bow/Warp: Maximum 50 percent of bow and warp allowed by ASTM C1048.

B. Clear Heat Strengthened Glass:

1. ASTM C1048, Kind HS, Condition A, Type I, Class 1, Quality q3.

C. Clear Tempered Glass:

1. ASTM C1048, Kind FT, Condition A, Type I, Class 1, Quality q3.

D. Tinted Tempered Glass.

1. ASTM C1048, Kind FT, Condition A, Type I, Class 2, Quality q3.

2.3 COATED GLASS:

A. Ceramic Coated Vision Glass:

1. ASTM C1048, Kind HS or FT, Condition C, Type I, Quality q3 with ceramic coating applied by silk-screen process.
2. Pattern as indicated in construction documents.

2.4 LAMINATED GLASS:

- A. Laminated Glass: ASTM C1172. Two or more lites of glass bonded with polyvinyl butyral, ionomeric polymer, or cast-in-place and cured-transparent-resin interlayer complying with interlayer manufacturer's written instructions.
- B. Interlayer: Use min. 0.75 mm (0.030 inch) thick interlayer for vertical glazing unless otherwise indicated in construction documents scheduled .
- C. Interlayer: Use 1.5 mm (0.060 inch) thick interlayer for:
 1. Horizontal or sloped glazing.
 2. Acoustical glazing.
 3. Assemblies requiring heat strengthened or fully tempered glass.
- D. Interlayer: Use 2.28 mm (0.090 inch) thick interlayer where required to meet performance requirements.
- E. Interlayer Color: Clear, unless otherwise indicated in construction documents .

2.5 INSULATING GLASS UNITS:

- A. Provide factory fabricated, hermetically sealed glass unit consisting of two panes of glass separated by a dehydrated air space and comply with ASTM E2190.
- B. Assemble units using glass types specified in Insulating Glass Schedule.

2.6 FIRE PROTECTION AND FIRE RESISTANCE GLAZING:

- A. Fire-Protection-Rated Glazing: Glazing units tested for use in fire door assemblies or fire windows, UL, ITS-WHI or equivalent listed and labeled by testing agency in accordance with IBC, for fire-protection ratings as indicated on construction documents scheduled, based upon positive-pressure testing per NFPA 257 or UL 9, and complying with NFPA 80.
 - 1. Hose-Stream Test: Units must comply, except units having fire-protection rating of 60 and 90 minutes.
 - 2. Temperature Rise Limitation: Units over 0.065 sq. m (100 sq. in.) must comply with 232 deg. C (450 deg. F) limitation.
 - 3. Labeling: Permanently label fire-protection-rated glazing units in accordance with IBC.
 - 4. Safety Glazing: Comply with 16 CFR 1201, Category II.

2.7 GLAZING ACCESSORIES:

- A. As required to supplement the accessories provided with the items to be glazed and to provide a complete installation. Ferrous metal accessories exposed in the finished work are to have a finish that will not corrode or stain while in service. Fire rated glazing to be installed with glazing accessories in accordance with the manufacturer's installation instructions.
- B. Setting Blocks: ASTM C864:
 - 1. Silicone type.
 - 2. Channel shape; having 6 mm (1/4 inch) internal depth.
 - 3. Shore A hardness of 80 to 90 Durometer.
 - 4. Block lengths: 50 mm (2 inches) except 100 to 150 mm (4 to 6 inches) for insulating glass.
 - 5. Block width: Approximately 1.6 mm (1/16 inch) less than the full width of the rabbet.

6. Block thickness: Minimum 4.8 mm (3/16 inch). Thickness sized for rabbet depth as required.
- C. Spacers: ASTM C864:
1. Channel shape having a 6 mm (1/4 inch) internal depth.
 2. Flanges not less 2.4 mm (3/32 inch) thick and web 3 mm (1/8 inch) thick.
 3. Lengths: 25 to 76 mm (1 to 3 inches).
 4. Shore A hardness of 40 to 50 Durometer.
- D. Glazing Tapes:
1. Semi-solid polymeric based closed cell material exhibiting pressure-sensitive adhesion and withstanding exposure to sunlight, moisture, heat, cold, and aging.
 2. Shape, size and degree of softness and strength suitable for use in glazing application to prevent water infiltration.
 3. Complying with AAMA 800 for the following types:
 - a. AAMA 810.1, Type 1, for glazing applications in which tape acts as the primary sealant.
 - b. AAMA 810.1, Type 2, for glazing applications in which tape is used in combination with a full bead of liquid sealant.
- E. Glazing Gaskets: ASTM C864:
1. Firm dense wedge shape for locking in sash.
 2. Soft, closed cell with locking key for sash key.
 3. Flanges may terminate above the glazing-beads or terminate flush with top of beads.
- F. Lock-Strip Glazing Gaskets: ASTM C542, shape, size, and mounting as indicated.
- G. Glazing Sealants: ASTM C920, silicone neutral cure:
1. Type S.
 2. Class 25 or 50 as recommended by manufacturer for application.
 3. Grade NS.
 4. Shore A hardness of 25 to 30 Durometer.
 5. VOC Content: For sealants used inside the weatherproofing system, not more than 250 g/L or less when calculating according to 40 CFR 59, (EPA Method 24).
- H. Structural Sealant: ASTM C920, silicone acetoxo cure:

1. Type S.
2. Class 25.
3. Grade NS.
4. Shore a hardness of 25 to 30 Durometer.

I. Color:

1. Color of glazing compounds, gaskets, and sealants used for aluminum color frames to match color of the finished aluminum and be nonstaining.
2. Color of other glazing compounds, gaskets, and sealants which will be exposed in the finished work and unpainted are to be black, gray, or neutral color.

PART 3 - EXECUTION

3.1 EXAMINATION:

- A. Verification of Conditions:
 1. Examine openings for glass and glazing units; determine they are proper size; plumb; square; and level before installation is started.
 2. Verify that glazing openings conform with details, dimensions and tolerances indicated on manufacturer is approved shop drawings.
- B. Review for conditions which may adversely affect glass and glazing unit installation, prior to commencement of installation. Do not proceed with installation until unsatisfactory conditions have been corrected.
- C. Verify that wash down of adjacent masonry is completed prior to erection of glass and glazing units.

3.2 PREPARATION:

- A. For sealant glazing, prepare glazing surfaces in accordance with GANA Sealant Manual.
- B. Determine glazing unit size and edge clearances by measuring the actual unit to receive the glazing.
- C. Shop fabricate and cut glass with smooth, straight edges of full size required by openings to provide GANA recommended edge clearances.
- D. Verify that components used are compatible.
- E. Clean and dry glazing surfaces.
- F. Prime surfaces scheduled to receive sealants, as determined by preconstruction sealant-substrate testing.

3.3 INSTALLATION - GENERAL:

- A. Install in accordance with GANA Glazing Manual, GANA Sealant Manual, IGMA TB-3001, and IGMA TM-3000 unless specified otherwise.
- B. Glaze in accordance with recommendations of glazing and framing manufacturers, and as required to meet the Performance Test Requirements specified in other applicable sections of specifications.
- C. Set glazing without bending, twisting, or forcing of units.
- D. Do not allow glass to rest on or contact any framing member.
- E. Glaze doors and operable sash, in a securely fixed or closed and locked position, until sealant, glazing compound, or putty has thoroughly set.
- F. Tempered Glass: Install with roller distortions in horizontal position unless otherwise directed.
- G. Laminated Glass:
 - 1. Tape edges to seal interlayer and protect from glazing sealants.
 - 2. Do not use putty or glazing compounds.
- H. Insulating Glass Units:
 - 1. Glaze in compliance with glass manufacturer's written instructions.
 - 2. When glazing gaskets are used, they are to be of sufficient size and depth to cover glass seal or metal channel frame completely.
 - 3. Do not use putty or glazing compounds.
 - 4. Do not grind, nip, cut, or otherwise alter edges and corners of fused glass units after shipping from factory.
 - 5. Install with tape or gunnable sealant in wood sash.
- I. Fire Protective and Fire Resistance Glass:
 - 1. Wire Glass: Glaze in accordance with NFPA 80.
 - 2. Other fire protective and fire resistant glass: Glaze in accordance with manufacturer's installation instructions and NFPA 80.

1.

3.5 INSTALLATION - WET/DRY METHOD (PREFORMED TAPE AND SEALANT)

- A. Cut glazing tape to length and set against permanent stops, 5 mm (3/16 inch) below sight line. Seal corners by butting tape and dabbing with butyl sealant.
- B. Apply heel bead of butyl sealant along intersection of permanent stop with frame ensuring full perimeter seal between glass and frame to complete the continuity of the air and vapor seal.

- C. Place setting blocks at 1/4 1/3 points with edge block no more than 152 mm (6 inches) from corners.
- D. Rest glazing on setting blocks and push against tape and heel bead of sealant with sufficient pressure to achieve full contact at perimeter of pane or glass unit.
- E. Install removable stops, with spacer strips inserted between glazing and applied stops, 6 mm (1/4 inch) below sight line. Place glazing tape on glazing pane or unit with tape flush with sight line.
- F. Fill gap between glazing and stop with sealant to depth equal to bite of frame on glazing, but not more than 9 mm (3/8 inch) below sight line. Sealant type is to be compatible with glazing tape.
- G. Apply cap bead of sealant along void between the stop and the glazing, to uniform line, flush with sight line. Tool or wipe sealant surface smooth.

3.6 INSTALLATION - WET METHOD (SEALANT AND SEALANT) :

- A. Place setting blocks at 1/4 1/3 points and install glazing pane or unit.
- B. Install removable stops with glazing centered in space by inserting spacer shims both sides at 600 mm (24 inch) intervals, 6 mm (1/4 inch) below sight line.
- C. Fill gaps between glazing and stops with sealant to depth of bite on glazing, but not more than 9 mm (3/8 inch) below sight line to ensure full contact with glazing and continue the air and vapor seal.
- D. Apply sealant to uniform line, flush with sight line. Tool or wipe sealant surface smooth.

3.7 INSTALLATION - INTERIOR WET/DRY METHOD (TAPE AND SEALANT) :

- A. Cut glazing tape to length and install against permanent stops, projecting 1.6 mm (1/16 inch) above sight line.
- B. Place setting blocks at 1/4 1/3 points with edge block no more than 150 mm (6 inches) from corners.
- C. Rest glazing on setting blocks and push against tape to ensure full contact at perimeter of pane or unit.
- D. Install removable stops, spacer shims inserted between glazing and applied stops at 600 mm (24 inch) intervals, 6 mm (1/4 inch) below sight line.

- E. Fill gaps between pane and applied stop with sealant to depth equal to bite on glazing, to uniform and level line. Sealant type is to be compatible with glazing tape.
- F. Trim protruding tape edge.

3.8 INSTALLATION - INTERIOR WET METHOD (COMPOUND AND COMPOUND) :

- A. Install glazing resting on setting blocks. Install applied stop and center pane by use of spacer shims at 600 mm (24 inch) centers, kept 6 mm (1/4 inch) below sight line.
- B. Locate and secure glazing pane using glazers' spring wire clips.
- C. Fill gaps between glazing and stops with glazing compound until flush with sight line. Tool surface to straight line.

3.9 REPLACEMENT AND CLEANING:

- A. Clean new glass surfaces removing temporary labels, paint spots, and defacement after approval by COR.
- B. Replace cracked, broken, and imperfect glass, or glass which has been installed improperly.
- C. Leave glass, putty, and other setting material in clean, whole, and acceptable condition.

3.10 PROTECTION:

- A. Protect finished surfaces from damage during erection, and after completion of work. Strippable plastic coatings on colored anodized finish are not acceptable.

3.11 MONOLITHIC GLASS SCHEDULE:

- A. Glass Type : Clear fully tempered float glass.
 - 1. Unit Thickness: 6 mm (0.23 inch) .
 - 2. Safety glazing label required.

3.12 LAMINATED GLASS SCHEDULE:

- A. Glass Type : Clear laminated glass with two (2) lites of fully tempered float glass.
 - 1. Minimum Thickness of Each Glass Lite: 3 mm (0.12 inch).
 - 2. Interlayer Thickness: 1.52 mm (0.060 inch).
 - 3. Safety glazing label required.
 - 4. Application: Interior glazing of units unless otherwise scheduled.
- B. Glass Type : Clear laminated glass with two (2) lites of fully tempered float glass.

1. Minimum Thickness of Each Glass Lite: 4 mm (0.16 inch).
 2. Interlayer Thickness: 1.52 mm (0.060 inch).
 3. Safety glazing label required.
- E. Glass Type LG# : Tinted laminated glass with two (2) lites of fully tempered float glass with outer ply tinted and inner lite clear.
1. Unit Thickness: 6 mm (0.23 inch) .
 2. Minimum Thickness of Each Glass Lite: 3 mm (0.12 inch) 4 mm (0.16 inch) 5 mm (0.19 inch) 6 mm (0.23 inch) .
 3. Tint Color: To be selected .
 4. Interlayer Thickness: 0.76 mm (0.030 inch) 1.52 mm (0.060 inch) 2.29 mm (0.090 inch) .
 5. Visible Light Transmittance: percent minimum.
 6. Solar Heat Gain Coefficient: maximum.
 7. Safety glazing label required.
 8. Windborne debris-resistant glazing unit required.

3.13 INSULATING GLASS SCHEDULE:

- B. Glass Type IG# : Low-E-coated, clear insulating glass.
1. Overall Unit Thickness: 25 mm (1 inch) .
 2. Minimum Thickness of Each Glass Lite: 3 mm (0.12 inch) 4 mm (0.16 inch) 5 mm (0.19 inch) 6 mm (0.23 inch) .
 3. Outdoor Lite: Annealed float glass, except heat-strengthened float glass where required, and fully tempered float glass where indicated.
 4. Interspace Content: Air Argon .
 5. Indoor Lite: Fully tempered float glass.
 6. Low-E Coating: Sputtered on second Sputtered on third surface.
 7. Visible Light Transmittance: 68 percent minimum.
 8. Solar Heat Gain Coefficient: 0.38 maximum.
 9. Safety glazing label required.

3.18 INSULATING LAMINATED GLASS SCHEDULE (FORCE PROTECTION AND PHYSICAL SAFETY):

- B. Glass Type IL# : Low-E-coated, clear insulating laminated glass.
1. Minimum Overall Unit Thickness: 25 mm (1 inch).

2. Outdoor Lite: Clear annealed float glass, except heat-strengthened float glass where required, and fully tempered float glass where indicated.
 - a. Minimum Thickness of Outdoor Lite: 6 mm (0.23 inch).
3. Interspace Content: Air or Argon.
4. Indoor Lite: Clear laminated glass with two lites of annealed float glass, except heat-strengthened float glass where required, and fully tempered float glass where indicated.
 - a. Minimum Thickness of Each Glass Lite: 3 mm (0.12 inch).
 - b. Minimum Interlayer Thickness: 0.76 mm (0.030 inch).
5. Low-E Coating: Sputtered on second surface.
6. Visible Light Transmittance: percent minimum.
7. Solar Heat Gain Coefficient: maximum.
8. Safety glazing label required.
9. Windborne debris-resistant glazing unit required.

3.14 FIRE-PROTECTIVE AND FIRE-RESISTANCE GLAZING SCHEDULE:

- A Glass Type FR# : Fire-protection-rated laminated ceramic glazing.
1. Thickness: .
 2. Rating: 60- and 90- minute.
 3. Application: Fire-protection-rated door and window assemblies.

3.15- GLAZING SCHEDULE:

A. IGU-1: Laminated, Silicone-coated, insulating spandrel glass.

1. Basis-of-Design Product: Viracon.
2. Coating Color: As selected by Architect from manufacturer's full range.
3. Outdoor Lite: fully tempered float glass.
4. Interspace Content: Air.
5. Indoor Lite: Clear laminated glass with two plies of fully tempered float glass.
 - a. Minimum Thickness of Each Glass Ply: 3 mm.
 - b. Interlayer Thickness: 0.030 inch (0.76 mm).
6. Coating Location: Fourth surface.
7. Overall Unit Thickness: 1 1/4 inch.

B. IGU-2: Low-E-coated, clear insulating laminated glass.

1. Basis-of-Design Product: Viracon.

2. Overall Unit Thickness: 1 1/4 inch.
3. Minimum Thickness of Outdoor Lite: 3 mm.
4. Outdoor Lite: Fully tempered float glass.
5. Interspace Content: Air.
6. Indoor Lite: Clear laminated glass with two plies of fully tempered float glass.
 - a. Minimum Thickness of Each Glass Ply: 3 mm.
 - b. Interlayer Thickness: 0.030 inch (0.76 mm).
7. Low-E Coating: Pyrolytic on second surface.

C. G-4: Tempered Clear

1. Clear fully tempered float glass.
2. Minimum Thickness: 6 mm.
3. Safety glazing required.

D. G-5: Fire-Rate Glass, 60 and 90 minutes

1. Fire-Protection-Rated Tempered Glass: 6-mm thickness, fire-protection-rated tempered glass; and complying with 16 CFR 1201, Category II.
2. Basis of Design: Pilkington

- - - E N D - - -

SECTION 09 05 16
SUBSURFACE PREPARATION FOR FLOOR FINISHES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies subsurface preparation requirements for areas to receive the installation of applied and resinous flooring. This section includes removal of existing floor coverings, testing concrete for moisture and pH, remedial floor coating for concrete floor slabs having unsatisfactory moisture or pH conditions, floor leveling and repair as required.

1.2 RELATED WORK

- A. Section 07 92 00, JOINT SEALANTS.
- B. Section 09 65 16, RESILIENT SHEET FLOORING Section 09 65 19, RESILIENT TILE FLOORING Section 09 68 00, CARPETING

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA and TEST DATA.
- B. Written approval confirming product compatibility with subfloor material manufacturer and the flooring manufacturer
- C. Product Data:
 - 1. Moisture remediation system
 - 2. Underlayment Primer
 - 3. Cementitious Self-Leveling Underlayment
 - 4. Cementitious Trowel-Applied Underlayment (Not suitable for resinous floor finishes)
- D. Test Data:
 - 1. Moisture test and pH results performed by a qualified independent testing agency or warranty holding manufacturer's technical representative.

1.4 DELIVERY AND STORAGE

- A. Deliver materials in containers with labels legible and intact and grade-seals unbroken.
- B. Store material to prevent damage or contamination.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.
- B. American Society for Testing and Materials (ASTM):

D638-10 (2010)	Test Method for Tensile Properties of Plastics
D4259-88 (2012)	Standard Practice for Abrading Concrete to alter the surface profile of the concrete and to remove foreign materials and weak surface laitance.
C109/C109M -12 (2012)	Standard Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or [50-mm] Cube Specimens) Modified Air Cure Only
D7234-12 (2012)	Standard Test Method for Pull-Off Adhesion Strength of Coatings on Concrete Using Portable Pull-Off Adhesion Testers.
E96/E96M - 12 (2012)	Standard Test Methods for Water Vapor Transmission of Materials
F710-11 (2011)	Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring
F1869-11 (2011)	Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
F2170-11 (2011)	Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes
C348-08 (2008)	Standard Test Method for Flexural Strength of Hydraulic-Cement Mortars
C191-13 (2013)	Standard Test Method for Time of Setting of Hydraulic Cement by Vicat Needle

PART 2 - PRODUCTS

2.1 MOISTURE REMEDIATION COATING

- A. System Descriptions:
1. High-solids, epoxy system designed to suppress excess moisture in concrete prior to an overlayment. For use under resinous products, VCT, tile and carpet where issues caused by moisture vapor are a concern.

- B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up.
- C. System Components: Verify specific requirements as systems vary by manufacturer. Verify build up layers and installation method. Verify compatibility with substrate. Use manufacturer's standard components, compatible with each other and as follows:
 - 1. Liquid applied coating:
 - a. Resin: epoxy.
 - b. Formulation Description: Multiple component high solids.
 - c. Application: Per manufacturer's written installation requirements.
 - d. Thickness: minimum 10 mils
- D. Material Vapor Permeance: Application shall achieve a permeance rating of less than 0.1 perm in accordance with ASTM E96/E96M.
- E. Maximum RH requirement: 100% testing in accordance with ASTM F2170.

2.2

Property	Test	Value
Tensile Strength	ASTM D638	4,400 psi
Volatile Organic Compound Limits (V.O.C.)	SCAMD Rule 1113	25 grams per liter
Permeance	ASTM E96	0.1 perms
Tensile Modulus	ASTM D638	1.9X10 ⁵ psi
Percent Elongation	ASTM D638	12%
Cure Rate	Per manufacture's Data	4 hours Tack free with 24hr recoat window
Bond Strength	ASTM D7234	100% bond to concrete failure

CEMENTITIOUS SELF-LEVELING UNDERLAYMENT

- A. System Descriptions:
 - 1. High performance self-leveling underlayment resurfacer. Single component, self-leveling, cementitious material designed for easy application as an underlayment for all types of flooring materials. It is used for substrate repair and leveling.

- B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up. Gypsum-based products are unacceptable.
- C. System Characteristics:
1. Wearing Surface: smooth
 2. Thickness: Per architectural drawings, ranging from feathered edge to 1", per application. Applications greater than 1" require additional 3/8" aggregate to mix or as recommended by manufacturer.
- D. Underlayment shall be calcium aluminate cement-based, containing Portland cement. Gypsum-based products are unacceptable.
- E. Compressive Strength: Minimum 4100 psi in 28 days in accordance with ASTM C109/C109M.
- F. Flexural Strength: Minimum 1000 psi in 28 days in accordance with ASTM C348
- G. Dry Time: Underlayment shall receive the application of moisture insensitive tile in 6 hours, floor coverings in 16 hours, and resinous flooring in 3-7 days. H. Primer: compatible and as recommended by manufacturer for use over intended substrate
- I. System Components: Manufacturer's standard components that are compatible with each other and as follows:
1. Primer:
 - a. Resin: copolymer
 - b. Formulation Description: single component ready to use.
 - c. Application Method: Squeegee and medium nap roller.
All puddles shall be removed, and material shall be allowed to dry, 1-2 hours at 70F/21C.
 - d. Number of Coats: (1) one.
 2. Grout Resurfacing Base:
 - a. Formulation Description: Single component, cementitious self-leveling high-early and high-ultimate strength grout.
 - b. Application Method: colloidal mix pump, cam rake, spike roll.
 - 1) Thickness of Coats: Per architectural scope, 1" lifts.
 - 2) Number of Coats: More than one if needed.
 - c. Aggregates: for applications greater than 1inch, require additional 3/8" aggregate to mix.

2.3	Property	Test	Value
	Compressive Strength	ASTM C109/C109M	2,200 psi @ 24 hrs 3,000 psi @ 7 days
	Initial set time Final Set time	ASTM C191	30-45 min. 1 to 1.5 hours
	Bond Strength	ASTM D7234	100% bond to concrete failure

CEMENTITIOUS TROWEL-APPLIED UNDERLAYMENT (NOT SUITABLE FOR RESINOUS FLOOR FINISHES)

- A. Underlayment shall be calcium aluminate cement-based, containing Portland cement. Gypsum-based products are unacceptable.
- B. Compressive Strength: Minimum 4000 psi in 28 days
- C. Trowel-applied underlayment shall not contain silica quartz (sand).
- D. Dry Time: Underlayment shall receive the application of floor covering in 15-20 minutes.

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS

- A. Maintain ambient temperature of work areas at not less than 16 degree C (60 degrees F), without interruption, for not less than 24 hours before testing and not less than three days after testing.
- B. Maintain higher temperatures for a longer period of time where required by manufacturer's recommendation.
- C. Do not install materials when the temperatures of the substrate or materials are not within 60-85 degrees F/ 16-30 degrees C.

3.2 SURFACE PREPARATION

- A. Existing concrete slabs with existing floor coverings:
 - 1. Conduct visual observation of existing floor covering for adhesion, water damage, alkaline deposits, and other defects.
 - 2. Remove existing floor covering and adhesives. Comply with local, state and federal regulations and the RFCI Recommended Work Practices for Removal of Resilient Floor Coverings, as applicable to the floor covering being removed.
- B. Concrete shall meet the requirements of ASTM F710 and be sound, solid, clean, and free of all oil, grease, dirt, curing compounds, and any substance that might act as a bond-breaker before application. As

required prepare slab by mechanical methods. No chemicals or solvents shall be used.

- C. General: Prepare and clean substrates according to flooring manufacturer's written instructions for substrate indicated.
- D. Prepare concrete substrates per ASTM D4259 as follows:
 - 1. Dry abrasive blasting.
 - 2. Wet abrasive blasting.
 - 3. Vacuum-assisted abrasive blasting.
 - 4. Centrifugal-shot abrasive blasting.
 - 5. Comply with manufacturer's written instructions.
- E. Repair damaged and deteriorated concrete according to flooring manufacturer's written recommendations.
- F. Verify that concrete substrates are dry.
- G. Perform anhydrous calcium chloride test, ASTM F 1869. Proceed with application only after substrates have maximum moisture-vapor-emission rate of per flooring manufacturer's formal and project specific written recommendation.
- H. Perform in situ probe test, ASTM F2170. Proceed with application only after substrates do not exceed a maximum potential equilibrium relative humidity per flooring manufacturer's formal and project specific written recommendation.
- I. Provide a written report showing test placement and results.
- J. Prepare joints in accordance with Section 07 92 00, JOINT SEALANTS and material manufacturer's instructions.
- K. Alkalinity: Measure surface pH in accordance with procedures provided in ASTM F710 or as outlined by qualified testing agency or flooring manufacturer's technical representative.
- L. Tolerances: Subsurface shall meet the flatness and levelness tolerance specified on drawings or recommended by the floor finish manufacturer. Tolerance shall also not to exceed 1/4" deviation in 10'. As required, install underlayment to achieve required tolerance.
- M. Other Subsurface: For all other subsurface conditions, such as wood or metal, contact the floor finish or underlayment manufacturer, as appropriate, for proper preparation practices.

3.3 MOISTURE REMEDIATION COATING:

- A. Where results of relative humidity testing (ASTM F2170) exceed the requirements of the specified flooring manufacturer, apply remedial coating as specified to correct excessive moisture condition.
- B. Prior to remedial floor coating installation mechanically prepare the concrete surface to provide a concrete surface profile in accordance with ASTM D4259.
- C. Mix and apply moisture remediation coating in accordance with manufacturer's instructions.

3.4 CEMENTITIOUS UNDERLAYMENT:

- A. Install cementitious self-leveling underlayment as required to correct surface defects, floor flatness or levelness corrections to meet the tolerance requirements as or detailed on drawings, address non-moving cracks or joints, provide a smooth surface for the installation of floor covering, or meet elevation requirements detailed on drawings.
- B. Mix and apply in accordance with manufacturer's instructions.

3.5 PROTECTION

- A. Prior to the installation of the finish flooring, the surface of the underlayment should be protected from abuse by other trades by the use of plywood, tempered hardwood, or other suitable protection course

3.6 FIELD QUALITY CONTROL

- A. Where specified, field sampling of products shall be conducted by a qualified, independent testing facility.

- - - E N D - - -

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS
04-01-15

SECTION 09 06 00
SCHEDULE FOR FINISHES

VAMC: Lebanon VAMC

Location:

Project no. and Name: VLEB-010 New Entryway for Building 17

Submission: BID DOCUMENTS

Date: 10-24-2022

**SECTION 09 06 00
SCHEDULE FOR FINISHES**

PART I - GENERAL

1.1 DESCRIPTION

This section contains a coordinated system in which requirements for materials specified in other sections shown are identified by abbreviated material names and finish codes in the room finish schedule or shown for other locations.

1.2 MANUFACTURERS

Manufacturer's trade names and numbers used herein are only to identify colors, finishes, textures and patterns. Products of other manufacturer's equivalent to colors, finishes, textures and patterns of manufacturers listed that meet requirements of technical specifications will be acceptable upon approval in writing by contracting officer for finish requirements.

1.3 SUBMITALS

Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES—provide quadruplicate samples for color approval of materials and finishes specified in this section.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in text by basic designation only.
- B. MASTER PAINTING INSTITUTE: (MPI)
2001Architectural Painting Specification Manual

PART 2- PRODUCTS

2.1 LIST OF INTERIOR FINISH MATERIALS

The materials listed on drawings **A-131** of the drawing set which accompany this specification form a part of the contract.

--- E N D---

SECTION 09 22 16
NON-STRUCTURAL METAL FRAMING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies steel studs wall systems, shaft wall systems, ceiling suspended or furred framing, wall furring, fasteners, and accessories for the screw attachment of gypsum board, or other building boards.

1.2 RELATED WORK

- A. Load bearing framing: Section 05 40 00, COLD-FORMED METAL FRAMING.
- B. Support for wall mounted items: Section 05 50 00, METAL FABRICATIONS.
- C. Ceiling suspension systems for acoustical tile or panels and lay in gypsum board panels: Section 09 51 00, ACOUSTICAL CEILINGS Section 09 29 00, GYPSUM BOARD.

1.3 TERMINOLOGY

- A. Description of terms shall be in accordance with ASTM C754, ASTM C11, ASTM C841 and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by beams, trusses, or bar joists. In interstitial spaces with walk-on floors the underside of the walk-on floor is the underside of structure overhead.
- C. Thickness of steel specified is the minimum bare (uncoated) steel thickness.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Studs, runners and accessories.
 - 2. Hanger inserts.
 - 3. Channels (Rolled steel).
 - 4. Furring channels.
 - 5. Screws, clips and other fasteners.
- C. Shop Drawings:
 - 1. Typical ceiling suspension system.

2. Typical metal stud and furring construction system including details around openings and corner details.

D. Test Results: Fire rating test designation, each fire rating required for each assembly.

1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE

In accordance with the requirements of ASTM C754.

1.6 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society For Testing And Materials (ASTM)

A641-09Zinc-Coated (Galvanized) Carbon Steel Wire

A653/653M-11Specification for Steel Sheet, Zinc Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by Hot-Dip Process.

C11-10Terminology Relating to Gypsum and Related Building Materials and Systems

C635-07Manufacture, Performance, and Testing of Metal Suspension System for Acoustical Tile and Lay-in Panel Ceilings

C636-08Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels

C645-09Non-Structural Steel Framing Members

C754-11Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products

C841-03 (R2008)Installation of Interior Lathing and Furring

C954-10Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness

E580-11Application of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Requiring Moderate Seismic Restraint.

PART 2 - PRODUCTS

2.1 PROTECTIVE COATING

Galvanize steel studs, runners (track), rigid (hat section) furring channels, "Z" shaped furring channels, and resilient furring channels, with coating designation of G40 or equivalent.

2.2 STEEL STUDS AND RUNNERS (TRACK)

- A. ASTM C645, modified for thickness specified and sizes as shown.
 - 1. Use C 645 steel, 0.75 mm (0.0296-inch) minimum base-metal (30 mil).
 - 2. Runners same thickness as studs.
 - 3. Exception: Members that can show certified third party testing with gypsum board in accordance with ICC ES AC86 (Approved May 2012) need not meet the minimum thickness limitation or minimum section properties set forth in ASTM C 645. The submission of an evaluation report is acceptable to show conformance to this requirement. Use C 645 steel, 0.48mm (0.019 inch) minimum base-metal (19 mil).
- B. Provide not less than two cutouts in web of each stud, approximately 300 mm (12 inches) from each end, and intermediate cutouts on approximately 600 mm (24-inch) centers.
- C. Doubled studs for openings and studs for supporting concrete backer-board.
- D. Studs 3600 mm (12 feet) or less in length shall be in one piece.
- E. Shaft Wall Framing:
 - 1. Conform to rated wall construction.
 - 2. C-H Studs or C-T Studs.

2.3 FURRING CHANNELS

- A. Rigid furring channels (hat shape): ASTM C645.
- B. Resilient furring channels:
 - 1. Not less than 0.45 mm (0.0179-inch) thick bare metal.
 - 2. Semi-hat shape, only one flange for anchorage with channel web leg slotted on anchorage side, channel web leg on other side stiffens fastener surface but shall not contact anchorage surface other channel leg is attached to.
- C. "Z" Furring Channels:
 - 1. Not less than 0.45 mm (0.0179-inch)-thick base metal, with 32 mm (1-1/4 inch) and 19 mm (3/4-inch) flanges.
 - 2. Web furring depth to suit thickness of insulation.

- D. Rolled Steel Channels: ASTM C754, cold rolled; or, ASTM C841, cold rolled.

2.4 FASTENERS, CLIPS, AND OTHER METAL ACCESSORIES

- A. ASTM C754, except as otherwise specified.
- B. For fire rated construction: Type and size same as used in fire rating test.
- C. Fasteners for steel studs thicker than 0.84 mm (0.033-inch) thick. Use ASTM C954 steel drill screws of size and type recommended by the manufacturer of the material being fastened.
- D. Clips: ASTM C841 (paragraph 6.11), manufacturer's standard items. Clips used in lieu of tie wire shall have holding power equivalent to that provided by the tie wire for the specific application.
- E. Concrete ceiling hanger inserts (anchorage for hanger wire and hanger straps): Steel, zinc-coated (galvanized), manufacturers standard items, designed to support twice the hanger loads imposed and the type of hanger used.
- F. Tie Wire and Hanger Wire:
 - 1. ASTM A641, soft temper, Class 1 coating.
 - 2. Gage (diameter) as specified in ASTM C754 or ASTM C841.
- G. Attachments for Wall Furring:
 - 1. Manufacturers standard items fabricated from zinc-coated (galvanized) steel sheet.
 - 2. For concrete or masonry walls: Metal slots with adjustable inserts or adjustable wall furring brackets. Spacers may be fabricated from 1 mm (0.0396-inch) thick galvanized steel with corrugated edges.
- H. Power Actuated Fasteners: Type and size as recommended by the manufacturer of the material being fastened.

2.5 SUSPENDED CEILING SYSTEM FOR GYPSUM BOARD (OPTION)

- A. Conform to ASTM C635, heavy duty, with not less than 35 mm (1-3/8 inch) wide knurled capped flange face designed for screw attachment of gypsum board.
- B. Wall track channel with 35 mm (1-3/8 inch) wide flange.

PART 3 - EXECUTION

3.1 INSTALLATION CRITERIA

- A. Where fire rated construction is required for walls, partitions, columns, beams and floor-ceiling assemblies, the construction shall be same as that used in fire rating test.
- B. Construction requirements for fire rated assemblies and materials shall be as shown and specified, the provisions of the Scope paragraph (1.2) of ASTM C754 and ASTM C841 regarding details of construction shall not apply.

3.2 INSTALLING STUDS

- A. Install studs in accordance with ASTM C754, except as otherwise shown or specified.
- B. Space studs not more than 610 mm (24 inches) on center.
- C. Cut studs 6 mm to 9 mm (1/4 to 3/8-inch) less than floor to underside of structure overhead when extended to underside of structure overhead.
- D. Where studs are shown to terminate above suspended ceilings, provide bracing as shown or extend studs to underside of structure overhead.
- E. Extend studs to underside of structure overhead for fire, rated partitions, smoke partitions, shafts, and sound rated partitions and insulated exterior wall furring.
- F. At existing plaster ceilings and where shown, studs may terminate at ceiling as shown.
- G. Openings:
 - 1. Frame jambs of openings in stud partitions and furring with two studs placed back to back or as shown.
 - 2. Fasten back to back studs together with 9 mm (3/8-inch) long Type S pan head screws at not less than 600 mm (two feet) on center, staggered along webs.
 - 3. Studs fastened flange to flange shall have splice plates on both sides approximately 50 X 75 mm (2 by 3 inches) screwed to each stud with two screws in each stud. Locate splice plates at 600 mm (24 inches) on center between runner tracks.
- H. Fastening Studs:
 - 1. Fasten studs located adjacent to partition intersections, corners and studs at jambs of openings to flange of runner tracks with two screws through each end of each stud and flange of runner.

2. Do not fasten studs to top runner track when studs extend to underside of structure overhead.

I. Chase Wall Partitions:

1. Locate cross braces for chase wall partitions to permit the installation of pipes, conduits, carriers and similar items.
2. Use studs or runners as cross bracing not less than 63 mm (2-1/2 inches wide).

J. Form building seismic or expansion joints with double studs back to back spaced 75 mm (three inches) apart plus the width of the seismic or expansion joint.

K. Form control joint, with double studs spaced 13 mm (1/2-inch) apart.

3.3 INSTALLING WALL FURRING FOR FINISH APPLIED TO ONE SIDE ONLY

A. In accordance with ASTM C754, or ASTM C841 except as otherwise specified or shown.

B. Wall furring-Stud System:

1. Framed with 63 mm (2-1/2 inch) or narrower studs, 600 mm (24 inches) on center.
2. Brace as specified in ASTM C754 for Wall Furring-Stud System or brace with sections or runners or studs placed horizontally at not less than three foot vertical intervals on side without finish.
3. Securely fasten braces to each stud with two Type S pan head screws at each bearing.

C. Direct attachment to masonry or concrete; rigid channels or "Z" channels:

1. Install rigid (hat section) furring channels at 600 mm (24 inches) on center, horizontally or vertically.
2. Install "Z" furring channels vertically spaced not more than 600 mm (24 inches) on center.
3. At corners where rigid furring channels are positioned horizontally, provide mitered joints in furring channels.
4. Ends of spliced furring channels shall be nested not less than 200 mm (8 inches).
5. Fasten furring channels to walls with power-actuated drive pins or hardened steel concrete nails. Where channels are spliced, provide two fasteners in each flange.
6. Locate furring channels at interior and exterior corners in accordance with wall finish material manufacturers printed erection

instructions. Locate "Z" channels within 100 mm (4 inches) of corner.

- D. Installing Wall Furring-Bracket System: Space furring channels not more than 400 mm (16 inches) on center.

3.4 INSTALLING SUPPORTS REQUIRED BY OTHER TRADES

- A. Provide for attachment and support of electrical outlets, plumbing, laboratory or heating fixtures, recessed type plumbing fixture accessories, access panel frames, wall bumpers, wood seats, toilet stall partitions, dressing booth partitions, urinal screens, chalkboards, tackboards, wall-hung casework, handrail brackets, recessed fire extinguisher cabinets and other items like auto door buttons and auto door operators supported by stud construction.
- B. Provide additional studs where required. Install metal backing plates, or special metal shapes as required, securely fastened to metal studs.

3.6 INSTALLING FURRED AND SUSPENDED CEILINGS

- A. Install furred and suspended ceilings or soffits in accordance with ASTM C754 or ASTM C841 except as otherwise specified or shown for screw attached gypsum board ceilings and for plaster ceilings or soffits.
1. Space framing at 400 mm (16-inch) centers for metal lath anchorage.
 2. Space framing at 600 mm (24-inch) centers for gypsum board anchorage.
- B. Where bar joists or beams are more than 1200 mm (48 inches) apart, provide intermediate hangers so that spacing between supports does not exceed 1200 mm (48 inches). Use clips, bolts, or wire ties for direct attachment to steel framing.
- EC. Existing concrete construction exposed or concrete on steel decking:
1. Use power actuated fasteners either eye pin, threaded studs or drive pins for type of hanger attachment required.
 2. Install fasteners at approximate mid height of concrete beams or joists. Do not install in bottom of beams or joists.
- D. Steel decking without concrete topping:
1. Do not fasten to steel decking 0.76 mm (0.0299-inch) or thinner.
 2. Toggle bolt to decking 0.9 mm (0.0359-inch) or thicker only where anchorage to steel framing is not possible.
- E. Installing suspended ceiling system for gypsum board (ASTM C635 Option):

1. Install only for ceilings to receive screw attached gypsum board.
2. Install in accordance with ASTM C636.
 - a. Install main runners spaced 1200 mm (48 inches) on center.
 - b. Install 1200 mm (four foot) tees not over 600 mm (24 inches) on center; locate for edge support of gypsum board.
 - c. Install wall track channel at perimeter.

F. Installing Ceiling Bracing System:

1. Construct bracing of 38 mm (1-1/2 inch) channels for lengths up to 2400 mm (8 feet) and 50 mm (2 inch) channels for lengths over 2400 mm (8 feet) with ends bent to form surfaces for anchorage to carrying channels and over head construction. Lap channels not less than 600 mm (2 feet) at midpoint back to back. Screw or bolt lap together with two fasteners.
2. Install bracing at an approximate 45 degree angle to carrying channels and structure overhead; secure as specified to structure overhead with two fasteners and to carrying channels with two fasteners or wire ties.
3. Brace suspended ceiling or soffit framing in seismic areas in accordance with ASTM E580.

3.7 TOLERANCES

- A. Fastening surface for application of subsequent materials shall not vary more than 3 mm (1/8-inch) from the layout line.
- B. Plumb and align vertical members within 3 mm (1/8-inch.)
- C. Level or align ceilings within 3 mm (1/8-inch.)

- - - E N D - - -

SECTION 09 29 00
GYPSUM BOARD

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies installation and finishing of gypsum board.

1.2 RELATED WORK

- A. Installation of steel framing members for walls, partitions, furring, and ceilings: and Section 09 22 16, NON-STRUCTURAL METAL FRAMING.
- B. Sound deadening board: Section 07 21 13, THERMAL INSULATION.
- C. Acoustical Sealants: Section 07 92 00, JOINT SEALANTS.

- D. Lay in gypsum board ceiling panels: Section 09 51 00, ACOUSTICAL CEILING.

1.3 TERMINOLOGY

- A. Definitions and description of terms shall be in accordance with ASTM C11, C840, and as specified.
- B. Underside of Structure Overhead: In spaces where steel trusses or bar joists are shown, the underside of structure overhead shall be the underside of the floor or roof construction supported by the trusses or bar joists.
- C. "Yoked": Gypsum board cut out for opening with no joint at the opening (along door jamb or above the door).

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Cornerbead and edge trim.
 - 2. Finishing materials.
 - 3. Laminating adhesive.
 - 4. Gypsum board, each type.
- C. Shop Drawings:
 - 1. Typical gypsum board installation, showing corner details, edge trim details and the like.

2. Typical sound rated assembly, showing treatment at perimeter of partitions and penetrations at gypsum board.
3. Typical shaft wall assembly.
3. Typical fire rated assembly and column fireproofing, indicating details of construction same as that used in fire rating test.

D. Samples:

1. Cornerbead.
2. Edge trim.
3. Control joints.

E. Test Results:

1. Fire rating test, each fire rating required for each assembly.
2. Sound rating test.

F. Certificates: Certify that gypsum board types, gypsum backing board types, cementitious backer units, and joint treating materials do not contain asbestos material.

1.5 DELIVERY, IDENTIFICATION, HANDLING AND STORAGE

In accordance with the requirements of ASTM C840.

1.6 ENVIRONMENTAL CONDITIONS

In accordance with the requirements of ASTM C840.

1.7 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing And Materials (ASTM):

- C11-15Terminology Relating to Gypsum and Related Building Materials and Systems
- C475-15Joint Compound and Joint Tape for Finishing Gypsum Board
- C840-13Application and Finishing of Gypsum Board
- C919-12Sealants in Acoustical Applications
- C954-15Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Stud from 0.033 in. (0.84mm) to 0.112 in. (2.84mm) in thickness

- C1002-14Steel Self-Piercing Tapping Screws for the
Application of Gypsum Panel Products or Metal
Plaster Bases to Wood Studs or Steel Studs
- C1047-14Accessories for Gypsum Wallboard and Gypsum
Veneer Base
- C1177-13Glass Mat Gypsum Substrate for Use as Sheathing
- C1658-13Glass Mat Gypsum Panels
- C1396-14Gypsum Board
- C. Underwriters Laboratories Inc. (UL):
Latest EditionFire Resistance Directory
- D. Inchcape Testing Services (ITS):
Latest EditionsCertification Listings

PART 2 - PRODUCTS

2.1 GYPSUM BOARD

- A. Gypsum Board: ASTM C1396, Type X, 16 mm (5/8 inch) thick unless shown otherwise.
- B. Coreboard or Shaft Wall Liner Panels.
 - 1. ASTM C1396, Type X.
 - 2. Coreboard for shaft walls 300, 400, 600 mm (12, 16, or 24 inches) wide by required lengths 25 mm (one inch) thick with paper faces treated to resist moisture.
- B. Paper facings shall contain 100 percent post-consumer recycled paper content.

2.2 ACCESSORIES

- A. ASTM C1047, except form of 0.39 mm (0.015 inch) thick zinc coated steel sheet or rigid PVC plastic.
- B. Flanges not less than 22 mm (7/8 inch) wide with punchouts or deformations as required to provide compound bond.

2.4 FASTENERS

- A. ASTM C1002 and ASTM C840, except as otherwise specified.
- B. ASTM C954, for steel studs thicker than 0.04 mm (0.33 inch).
- C. Select screws of size and type recommended by the manufacturer of the material being fastened.

- D. For fire rated construction, type and size same as used in fire rating test.
- E. Clips: Zinc-coated (galvanized) steel; gypsum board manufacturer's standard items.

2.5 FINISHING MATERIALS AND LAMINATING ADHESIVE

ASTM C475 and ASTM C840. Free of antifreeze, vinyl adhesives, preservatives, biocides and other VOC. Adhesive shall contain a maximum VOC content of 50 g/l.

PART 3 - EXECUTION

3.1 GYPSUM BOARD HEIGHTS

- A. Extend all layers of gypsum board from floor to underside of structure overhead on following partitions and furring:
 - 1. Two sides of partitions:
 - a. Fire rated partitions.
 - b. Sound rated partitions.
 - c. Full height partitions shown (FHP).
 - d. Corridor partitions.
 - 2. One side of partitions or furring:
 - a. Inside of exterior wall furring or stud construction.
 - b. Room side of room without suspended ceilings.
 - c. Furring for pipes and duct shafts, except where fire rated shaft wall construction is shown.
 - 3. Extend all layers of gypsum board construction used for fireproofing of columns from floor to underside of structure overhead, unless shown otherwise.
- B. In locations other than those specified, extend gypsum board from floor to heights as follows:
 - 1. Not less than 100 mm (4 inches) above suspended acoustical ceilings.
 - 2. At ceiling of suspended gypsum board ceilings.

3.2 INSTALLING GYPSUM BOARD

- A. Coordinate installation of gypsum board with other trades and related work.

- B. Install gypsum board in accordance with ASTM C840, except as otherwise specified.
- C. Moisture and Mold-Resistant Assemblies: Provide and install moisture and mold-resistant glass mat gypsum wallboard products with moisture-resistant surfaces complying with ASTM C1658 where shown and in locations which might be subject to moisture exposure during construction.
- D. Use gypsum boards in maximum practical lengths to minimize number of end joints.
- E. Bring gypsum board into contact, but do not force into place.
- F. Ceilings:
 - 1. For single-ply construction, use perpendicular application.
 - 2. For two-ply assemblies:
 - a. Use perpendicular application.
 - b. Apply face ply of gypsum board so that joints of face ply do not occur at joints of base ply with joints over framing members.
- G. Walls (Except Shaft Walls):
 - 1. When gypsum board is installed parallel to framing members, space fasteners 300 mm (12 inches) on center in field of the board, and 200 mm (8 inches) on center along edges.
 - 2. When gypsum board is installed perpendicular to framing members, space fasteners 300 mm (12 inches) on center in field and along edges.
 - 3. Stagger screws on abutting edges or ends.
 - 4. For single-ply construction, apply gypsum board with long dimension either parallel or perpendicular to framing members as required to minimize number of joints except gypsum board shall be applied vertically over "Z" furring channels.
 - 5. For two-ply gypsum board assemblies, apply base ply of gypsum board to assure minimum number of joints in face layer. Apply face ply of wallboard to base ply so that joints of face ply do not occur at joints of base ply with joints over framing members.

6. No offset in exposed face of walls and partitions will be permitted because of single-ply and two-ply or three-ply application requirements.
 7. Installing Two Layer Assembly Over Sound Deadening Board:
 - a. Apply face layer of wallboard vertically with joints staggered from joints in sound deadening board over framing members.
 - b. Fasten face layer with screw, of sufficient length to secure to framing, spaced 300 mm (12 inches) on center around perimeter, and 400 mm (16 inches) on center in the field.
 8. Control Joints ASTM C840 and as follows:
 - a. Locate at both side jambs of openings if gypsum board is not "yoked". Use one system throughout.
 - b. Not required for wall lengths less than 9000 mm (30 feet).
 - c. Extend control joints the full height of the wall or length of soffit/ceiling membrane.
- H. Acoustical or Sound Rated Partitions, Fire and Smoke Partitions:
1. Cut gypsum board for a space approximately 3 mm to 6 mm (1/8 to 1/4 inch) wide around partition perimeter.
 2. Coordinate for application of caulking or sealants to space prior to taping and finishing.
 3. For sound rated partitions, use sealing compound (ASTM C919) to fill the annular spaces between all receptacle boxes and the partition finish material through which the boxes protrude to seal all holes and/or openings on the back and sides of the boxes. STC minimum values as shown.
- I. Electrical and Telecommunications Boxes:
1. Seal annular spaces between electrical and telecommunications receptacle boxes and gypsum board partitions.
- J. Accessories:
1. Set accessories plumb, level and true to line, neatly mitered at corners and intersections, and securely attach to supporting surfaces as specified.

2. Install in one piece, without the limits of the longest commercially available lengths.
3. Corner Beads:
 - a. Install at all vertical and horizontal external corners and where shown.
 - b. Use screws only. Do not use crimping tool.
4. Edge Trim (casings Beads):
 - a. At both sides of expansion and control joints unless shown otherwise.
 - b. Where gypsum board terminates against dissimilar materials and at perimeter of openings, except where covered by flanges, casings or permanently built-in equipment.
 - c. Where gypsum board surfaces of non-load bearing assemblies abut load bearing members.
 - d. Where shown.

3.4 CAVITY SHAFT WALL

- A. Coordinate assembly with Section 09 22 16, NON-STRUCTURAL METAL FRAMING, for erection of framing and gypsum board.
- B. Conform to UL Design indicated in the schedule.
- C. Gypsum Board:
 1. One hour wall with one layer on finish side of wall: Apply face layer of gypsum board vertically. Attach to studs with screws of sufficient length to secure to framing, spaced 300 mm (12 inches) on center in field and along edges.

3.3 FINISHING OF GYPSUM BOARD

- A. Finish joints, edges, corners, and fastener heads in accordance with ASTM C840. Use Level 4 finish for all finished areas open to public view.
- B. Before proceeding with installation of finishing materials, assure the following:
 1. Gypsum board is fastened and held close to framing or furring.
 2. Fastening heads in gypsum board are slightly below surface in dimple formed by driving tool.

C. Finish joints, fasteners, and all openings, including openings around penetrations, on that part of the gypsum board extending above suspended ceilings to seal surface of non decorated fire rated and sound rated gypsum board construction. After the installation of hanger rods, hanger wires, supports, equipment, conduits, piping and similar work, seal remaining openings and maintain the integrity of the fire rated and sound rated construction. Sanding is not required of non decorated surfaces.

3.4 REPAIRS

- A. After taping and finishing has been completed, and before decoration, repair all damaged and defective work, including nondecorated surfaces.
- B. Patch holes or openings 13 mm (1/2 inch) or less in diameter, or equivalent size, with a setting type finishing compound or patching plaster.
- C. Repair holes or openings over 13 mm (1/2 inch) diameter, or equivalent size, with 16 mm (5/8 inch) thick gypsum board secured in such a manner as to provide solid substrate equivalent to undamaged surface.
- D. Tape and refinish scratched, abraded or damaged finish surfaces including cracks and joints in non decorated surface to provide smoke tight construction fire protection equivalent to the fire rated construction and STC equivalent to the sound rated construction.

- - - E N D - - -

SECTION 09 51 00
ACOUSTIC CEILINGS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the contract apply to this section. This includes General and Supplementary Conditions of Division 01 (1) Specification Sections.

1.2 SUMMARY

- A. Section includes acoustic panels and suspension systems for ceilings
- B. Related Sections
 - 1. Section 09 20 00 (09250) - Gypsum Board, Framing & Accessories
 - 2. Division 23 (15) - Heating, Ventilating and Air Conditioning (HVAC)
 - 3. Division 26 (16) - Electrical

1.3 REFERENCES

- A. ASTM A641 - *Specification for Steel Sheet, Zinc-Coated (galvanized) Carbon Steel Wire*
- B. ASTM A653 - *Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galv-annealed) by the Hot-Dip Process*
- C. ASTM C423 - *Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method*
- D. ASTM C635 - *Standard Specification for Metal Suspension Systems for Acoustic Tile and Lay-in Panel Ceilings*
- E. ASTM C636 - *Recommended Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings*
- F. ASTM E84 - *Test Method for Surface Burning Characteristics of Building Materials*
- G. ASTM E580 - *Practice for Application of Ceiling Suspension Systems for Acoustic Tile and Lay-in Panels in Areas Requiring Seismic Restraint*
- H. ASTM E795 - *Practice for Mounting Test Specimens During Sound Absorption Tests*
- I. ASTM E1111 - *Test Method for Measuring Interzone Attenuation of Ceiling Systems*
- J. ASTM E1264 - *Classification for Acoustic Ceiling Products*
- K. ASTM E1414 - *Test Method for Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum*
- L. ASTM E1477 - *Standard Test Method for Luminous Reflectance Factor of Acoustical Materials by Use of Integrating Sphere Reflectometer*
- M. CAN/ULC-S102 - *Method of Test for Surface Burning Characteristics of Building Materials and Assemblies*
- N. ISO 14644 - *Classification of Air Cleanliness*
- O. ISO 14024 *Environmental Labels and Declarations - Type I Environmental Labeling - Principles and Procedures*
- P. ISO 14025 - *Environmental Labels and Declarations -- Type III Environmental Declarations -- Principles and Procedures*

- Q. CISCA (Ceilings & Interior Systems Construction Association) - *Ceilings Systems Handbook*
- R. CISCA (Ceilings & Interior Systems Construction Association) - *Acoustical Ceilings - Use and Practice*
- S. CISCA (Ceilings & Interior Systems Construction Association) - *Guidelines For Seismic Restraint Direct Hung Suspended Ceiling Assemblies*
- T. Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers Version 1.2
 - a. California Dept. of Public Health CDPH/EHLB/Standard Method v1.2, 2017
- U. Health Product Declaration Standard v2.0 - hpdcollaborative.org

1.4 SUBMITTALS

- A. Product Data
 - 1. Submit manufacturer's published technical information for each product indicated
- B. Shop Drawings
 - 1. Submit reflected ceiling plans drawn to scale prescribed by Architect
 - a. Include coordinated penetrations and ceiling-mounted items
 - b. Include any necessary details or drawings from the manufacturer regarding recommended installation
- C. Samples
 - 1. Submit 6" x 6" manufacturer's sample of each panel indicated
 - 2. Submit representative manufacturer's sample of each suspension member indicated
- D. Certifications
 - 1. Provide manufacturer's written certification that products submitted meet or exceed all specified requirements
 - 2. Provide laboratory reports that certify compliance with specified tests
 - 3. Provide third party verified life cycle information with published environmental product declaration (EPD)
 - a. Per ISO 14025 *Environmental Labels and Declarations - Type III Environmental Declarations - Principles and Procedures*

1.5 QUALITY ASSURANCE

- A. Source Limitations
 - 1. Acoustic Ceiling Panel and Suspension System
 - a. Obtain each type through one source from a single manufacturer
- B. Installer Qualifications
 - 1. Must be experienced in the installation of systems similar to those specified herein
- C. Surface Burning Characteristics
 - 1. ASTM E1264
 - a. Class A
 - 2. ASTM E84 [United States]
 - a. Flame spread of 25 or less
 - b. Smoke developed of 50 or less
 - 3. CAN/ULC-S102 [Canada]
 - a. Flame spread of 25 or less

b. Smoke developed of 50 or less

1.6 DELIVERY, STORAGE AND HANDLING

- A. Delivery of acoustic ceiling products will be in the original unopened packages with the manufacturer's label intact
- B. Handling and storage should be in accordance with the manufacturer's Safety Data Sheets (SDS)
- C. Individual panels should be handled carefully to avoid damage

1.7 PROJECT CONDITIONS

- A. Environmental Limitations
 - 1. Install acoustic panels only in conditions that are within the manufacturer's published limits for temperature and humidity

1.8 COORDINATION

- A. Coordinate the installation of the acoustic ceiling system with any and all trades whose work is impacted by that installation

1.9 EXTRA MATERIALS

- A. Provide extra materials in the manufacturer's unopened packaging, with the manufacturer's label intact, as detailed below
 - 1. Acoustic Panels - Minimum 5% of each type installed
 - 2. Suspension System Components - Minimum 5% of each type installed

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. CertainTeed Ceilings

2.2 ACOUSTIC CEILING UNITS

- A. Acoustical Ceiling Panel
 - 1. Basis of Design: Symphony *f*
 - 2. Physical Characteristics
 - a. Type: XII (per ASTM E1264)
 - b. Form: 2 (per ASTM E1264)
 - c. Pattern: E (per ASTM E1264)
 - d. Size:
 - 1) 2 feet x 6 feet.
 - e. Thickness:
 - 1) Imperial
 - 1. 1 - inch
 - f. Edges: Reveal for 15/16" grid
 - g. Finished Surface: Laminated painted fiberglass mat
 - h. Finished Surface Color: White
 - i. Optional Panel Backing: Foil
 - j. Core Composition: Fiberglass
 - k. Recycled Content: 29-35%
 - 1) 1" Trim

- 2) 1" Reveal, Narrow Reveal
 1. 0% (pre-consumer)
 2. 29% (post-consumer)
3. Performance Criteria
 - a. Noise Reduction Coefficient (NRC) per ASTM C423 (E-400 mounting)
 - 1) 1.00 [1-1/2"]
 - 2) 0.95 [1", 1-1/2" foil back]
 - 3) 0.90 [3/4"]
 - b. Articulation Class (AC) per ASTM E1111
 - 1) 190 [3/4"]
 - 2) 200 [1"]
 - 3) 210 [1-1/2"]
 - c. Light Reflectance (LR) per ASTM E1477
 - 1) 0.90
 - d. Ceiling Attenuation Class (CAC) per ASTM C1414
 - 1) 24 [2'x2'x1" w/ optional foil backing]
 - 2) 25 [2'x4'x1" w/ optional foil backing]
 - 3) 25 [1-1/2" panels with optional foil backing]
 - e. Clean Room Classification
 - 1) Class 4 per ISO 14644
 1. Independently certified
 - f. Surface Washability per ASTM D 4828
 - 1) Tested to 1000 cycles
 1. Tested with chemical sanitizers in their manufacturer's recommended dilution (contact CertainTeed for details)
 - g. Humidity Resistance
 - 1) Warranted to withstand relative humidity of up to 95% at 104°F without sagging, warping or delaminating for 10-years
 - h. Flame Spread Classification per ASTM E84, CAN/ULC-S102: Class A
4. Independent Certifications [requires third-party documentation]
 - a. VOC content
 - 1) Third-party certification of compliance
 1. Per California Dept. of Public Health
CDPH/EHLB/Standard Method v1.2, 2017
 - b. Recycled content
 - 1) Third-party verified Type I Environmental Label
 1. Per ISO 14024 *Environmental Labels and Declarations - Type I Environmental Labeling - Principles and Procedures*
 - c. Environmental Product Declaration
 - 1) Third-party verified Type III Environmental Product Declaration
 1. Per ISO 14025 - *Environmental Labels and Declarations - Type III Environmental Declarations -- Principles and Procedures*
 - d. Health Product Declaration
 - 1) Per Health Product Declaration Standard v2.0
 1. hpd-collaborative.org

2.3 SUSPENSION SYSTEM

- A. Manufacturer: CertainTeed Ceilings
- B. For information pertaining to specific suspension system offerings, reference CertainTeed Ceilings' library of Suspension System 3-Part Specifications

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Ascertain acceptability of substrates and building conditions under which the ceiling system is to be installed. Do not proceed with the installation until any and all unacceptable conditions have been rectified.

3.2 PREPARATION

- A. Unless otherwise directed by the reflected ceiling plan, measure the space in which the ceiling system is to be installed and establish a layout that balances border widths at opposite ends of the ceiling.
- B. When possible, coordinate the ceiling system layout to avoid the use of less than half width panels at the perimeter.

3.3 INSTALLATION

- A. Install the ceiling system in accordance with the following:
 - 1. Manufacturer's printed instructions
 - a. Available online at www.certainteed.com/commercial-ceilings
 - 2. ASTM C636
 - 3. Ceilings & Interior Systems Construction Association (CISCA) recommendations
 - 4. Applicable local code requirements
 - 5. Approved shop drawings

3.4 MAINTENANCE

- A. Replace any and all damaged ceiling system components
- B. Clean any and all exposed surfaces in accordance with the manufacturer's printed instructions

END OF SECTION

SECTION 09 54 26
ACOUSTIC WALL PANELS

PART 1 GENERAL

1.1 SUMMARY

A. Section includes:

1. Sound absorptive panels

B. Related sections

1. Section 095100 - Acoustical Ceiling

2. Section 092116 - Gypsum Board Assemblies

1.3 SUBMITTALS

A. Comply with Section 013300 - Submittal Procedures

B. Product Data: Manufacturer's technical data and installation instructions for each type of wall panel required.

C. Certifications: Certified test reports showing compliance with performance requirements specified.

D. Samples: Submit a minimum of three (3) samples of each panel type and finish type required. Include samples that show the range of variation expected in grain, texture and color.

E. Shop Drawings: Submit shop drawings, including details, for all walls. Coordinate wall panel layout, installation and suspension system components. Show overall layout with dimensions and details of penetrations and intersections with other materials or building components.

F. Submit operation and maintenance data for installed products. Include precautions relating to harmful cleaning materials and methods that would affect the service life of the panels.

1.4 QUALITY ASSURANCE

A. Single Source Responsibility: Provide acoustic panels from a single manufacturer with at least 5 years of prior experience fabricating projects of similar size and complexity.

B. Installer: Installation shall be done by qualified carpenters with at least 2 years experience in the installation of architectural woodwork or acoustical wall material. Installers must receive training on handling, cutting, machining and field finishing the specified product prior to receiving materials on site.

-
- C. Fire Performance Characteristics: Class A as tested by an independent accredited testing facility. Tests: ASTM E84. Flame spread: 25 or less. Smoke developed: 450 or less as specified by state or local codes.
 - D. Coordination of Work: Installing contractor shall organize and conduct a pre-installation survey of temperature, humidity and construction elements attaching, penetrating or concealed behind the acoustic wall panels.

1.5 REFERENCES

A. Test Methods:

1. ASTM C423 Sound absorption and sound absorption coefficients by the reverberation room method performed by an independent testing agency
2. ASTM E84 Standard test method for surface burning characteristics of building materials
3. ASTM D1037 Linear expansion with change in moisture content

1.6 DELIVERY, STORAGE AND HANDLING

- A. Deliver panels to the project in original, unopened packages. Inspect containers for visible damage and report any questionable condition to the shipper and manufacturer immediately.
- B. Store products in a fully enclosed, clean, dry space out of direct sunlight and protected from damage with temperature controlled between 50 and 86 degrees F.
- C. Handle products carefully to avoid damaging panel surfaces or chipping edges. Report any damage immediately. Installation of damaged panels is not covered by the manufacturer's warranty.

1.7 PROJECT CONDITIONS

- A. Do not install acoustic panels until space is enclosed and weather-proofed, wet work is completely dry and ambient temperature and humidity conditions are maintained at the levels indicated for the project when occupied for its intended use.
- B. Permit panels to reach room temperature, 50 to 86 degrees F, and stabilized moisture content of 25% to 55% RH for at least 72 hours before installation per AWI standards. Building should be enclosed and HVAC systems functioning in continuous operation with relative humidity maintained between 25 and 55 percent.

1.8 WARRANTY

- A. Provide manufacturer's standard one-year written product warranty per Section 01770 - Closeout Procedures

-
- B. Manufacturer's warranty is limited to decorative or acoustical materials only. Other components used in the set up are excluded. Refer to the appropriate provisions in the related specification section.

1.9 MAINTENANCE

- A. **Maintenance Instructions:** Provide manufacturer's standard maintenance and cleaning instructions for finishes provided.

PART 2 - PRODUCTS

2.1 MANUFACTURER

- A. Provide SoundPly® panels manufactured by Navy Island Inc., 275 Marie Avenue E, St. Paul, MN 55118, Ph. (651) 451-4454, email sales@navyisland.com

2.2 MATERIALS

- A. SOUNDPLY® Latus LRM Wall Panels for Interior Installation: Latus WP-LRM-19 (3/4") or Latus WP-LRM-25 (1") or Latus WP-LRM-38 (1 1/2") or Latus WP-LRM-51 (2") thick acoustical panels as follows: Real wood veneer laminated to a fiberglass reinforced polymer or a UV printed/painted surface applied to an MDF skin. Surface skin thickness shall not be less than 1.5mm (0.060"). The core of the panels shall be comprised of a Class A mineral wool.
- B. Panel Edge Treatment: Panels will be edge banded with the matching materials and finish to match the panel face.
- C. Panel Weight: WP-LRM-19 = 1.4 lbs./ft², WP-LRM-25 = 1.8 lbs./ft², WP-LRM-38 = 2.2 lbs./ft², WP-LRM-51 = 2.6 lbs./ft².
- D. Panel Sizes: Refer to Finish Legend.
- E. Panel thickness: Refer to Finish Legend.
- F. Flame Resistance: Latus LR Panels have a Class 1(A) rating based on ASTM E84 standard test method for surface burning characteristics in building materials. Depending on the use and the type of veneer selected, Latus Panels can be used in Class A environments (IBC Chapter 8 Section 803).
- G. Perforations: Panels will be furnished with perforated faces consisting of 0.5mm (0.02") diameter holes in an offset pattern. The perforations must be clean without rounded edges or grain pull out between perforations. A minimum of 99.5% of the perforations must be acoustically functional, providing unobstructed passage into the core. Perforations must maintain consistent diameter through the face material and backer with no tapering or roughness.

-
- H. Acoustic Performance: To generate the standing sound waves required for resistive absorption, each panel must have a solid acoustically reflective back surface that extends the panel's full length and width. Each panel must achieve a minimum NRC test value as stated without any cavity space or back loading.
- I. Panel Stability: Linear contraction or expansion to not exceed 0.4% maximum variation in width or height per ASTM D1037.
- J. Finish for Veneer Faced Panels: Select
1. Species as selected by the architect.
 2. Cut: plain sliced.
 3. Matching veneer leaves: book match.
 4. Matching between panels: *natural sequence*.
 5. Finishes shall be applied in the shop: *clear*.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Inspect installation area and conditions under which work is to be performed for compliance with all manufacturer's environmental requirements. All wet work in the installation area must be complete, cured and dry prior to installation. Do not proceed until all unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Installation must be done by qualified carpenters with 2 years experience in the installation of architectural woodwork or acoustic systems. The firm must demonstrate successful experience installing materials of similar type and quality of those required for this project. The use of proper carpentry tools and techniques will be required for the installation.
- B. Comply with manufacturer's instruction and recommendations for hanging panels.
- C. Confirm all field dimensions are coordinated with shop drawings.

3.3 ADJUSTING AND CLEANING

- A. Clean soiled surfaces of panels per manufacturer's instructions.
- B. Remove and replace damaged or discolored materials not in compliance with manufacturer's tolerances.

VA Project No. 595-668
AE Works Project No. VLEB-010

Lebanon VAMC
New Entryway for Building 17
BID DOCUMENTS

END OF SECTION

SECTION 09 65 13
RESILIENT BASE AND ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Resilient base (RB) adhered to interior walls and partitions.

1.2 RELATED REQUIREMENTS

- A. Sheet Flooring Integral Base: Section 09 65 16, RESILIENT SHEET FLOORING.

1.3 APPLICABLE PUBLICATIONS

- A. Comply with references to extent specified in this section.
- B. ASTM International (ASTM):
1. F1344-15 - Rubber Floor Tile.
 2. F1859-14 - Rubber Sheet Floor Covering without Backing.
 3. F1860-14 - Rubber Sheet Floor Covering with Backing.
 4. F1861-08(2012)e1 - Resilient Wall Base.
 5. D4259-88(2012) - Abrading Concrete.
- C. Federal Specifications (Fed. Spec.):
1. RR-T-650E - Treads, Metallic and Non-Metallic, Skid-Resistant.
- D. International Concrete Repair Institute (ICRI):
1. 310.2R-13 - Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays.

1.4 SUBMITTALS

- A. Submittal Procedures: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
1. Description of each product.
 2. Adhesives and primers indicating manufacturer's recommendation for each application.
 3. Installation instructions.
- C. Samples:
1. Resilient Base: 150 mm (6 inches) long, each type and color.

D. Sustainable Construction Submittals:

1. Recycled Content: Identify post-consumer and pre-consumer recycled content percentage by weight.
2. Low Pollutant-Emitting Materials:
 - a. Show volatile organic compound types and quantities.

E. Operation and Maintenance Data:

1. Care instructions for each exposed finish product.

1.5 DELIVERY

- A. Deliver products in manufacturer's original sealed packaging.
- B. Mark packaging, legibly. Indicate manufacturer's name or brand, type, color, production run number, and manufacture date.
- C. Before installation, return or dispose of products within distorted, damaged, or opened packaging.

1.6 STORAGE AND HANDLING

- A. Store products indoors in dry, weathertight facility.
- B. Protect products from damage when handling and during construction operations.

1.7 FIELD CONDITIONS

- A. Environment:
 1. Product Temperature: Minimum 21 degrees C (70 degrees F) for minimum 48 hours before installation.
 2. Work Area Ambient Temperature Range: 21 to 27 degrees C (70 to 80 degrees F) continuously, beginning 48 hours before installation.
 3. Install products when building is permanently enclosed and when wet construction is completed, dried, and cured.

1.8 WARRANTY

- A. Construction Warranty: FAR clause 52.246-21, "Warranty of Construction."

PART 2 - PRODUCTS

2.1 PRODUCTS

- A. Basis of Design: Refer to Finish Legend.

B. Provide each product from one manufacturer and from one production run.

C. Sustainable Construction Requirements:

1. Sheet Rubber Flooring Recycled Content: 90 percent total recycled content, minimum.
2. Low Pollutant-Emitting Materials: Comply with VOC limits specified in Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS for the following products:
 - a. Flooring Adhesives and Sealants.

2.2 RESILIENT BASE

- A. Resilient Base: 3 mm (1/8 inch) thick, 100 mm (4 inches) high.
1. Type: Rubber; use one type throughout.
 2. ASTM F1861, Type TP thermoplastic rubber or Type TV thermoplastic vinyl, Group 2 - layered.
- B. Applications:
1. Carpet Flooring Locations: Style A - Straight.
 2. Other Locations: Style B - Cove.

2.3 PRIMER (FOR CONCRETE FLOORS)

- A. Primer: Type recommended by adhesive manufacturer.

2.4 LEVELING COMPOUND (FOR CONCRETE FLOORS)

- A. Leveling Compound: Provide products mixed with latex or polyvinyl acetate resins.

2.5 ADHESIVES

- A. Adhesives: Low pollutant-emitting, water based type recommended by adhered product manufacturer for each application.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine and verify substrate suitability for product installation.
- B. Protect existing construction and completed work from damage.
- C. Remove existing base to permit new installation.
 1. Dispose of removed materials.
- D. Correct substrate deficiencies.
 1. Fill cracks, pits, and depressions with leveling compound.

2. Remove protrusions; grind high spots.
 3. Apply leveling compound to achieve 3 mm (1/8 inch) in 3 m (10 feet) maximum surface variation.
- E. Clean substrates. Remove contaminants capable of affecting subsequently installed product's performance.
1. Mechanically clean concrete floor substrate according to ASTM D4259.
 2. Surface Profile: ICRI Guideline No. 310.2R.
- F. Allow substrate to dry and cure.
- G. Perform flooring manufacturer's recommended bond, substrate moisture content, and pH tests.

3.2 INSTALLATION GENERAL

- A. Install products according to manufacturer's instructions.
1. When instructions deviate from specifications, submit proposed resolution for Contracting Officer consideration.

3.3 RESILIENT BASE INSTALLATION

- A. Applications:
1. Install resilient base in rooms scheduled on Drawings.
 2. Extend resilient base into closets, alcoves, and cabinet knee spaces, and around columns within scheduled room.
- B. Lay out resilient base with minimum number of joints.
1. Length: 600 mm (24 inches) minimum, each piece.
 2. Locate joints 150 mm (6 inches) minimum from corners and intersection of adjacent materials.
- C. Installation:
1. Apply adhesive uniformly for full contact between resilient base and substrate.
 2. Set resilient base with hairline butted joints aligned along top edge.
- D. Factory form corners and end stops.
1. V-groove back of outside corner.
 2. V-groove face of inside corner and notch cove for miter joint.
- E. Roll resilient base ensuring complete adhesion.

3.4 CLEANING

- A. Remove excess adhesive before adhesive sets.

- B. Clean exposed resilient base, surfaces. Remove contaminants and stains.
 - 1. Clean with mild detergent. Leave surfaces free of detergent residue.
- C. Polish exposed resilient base to gloss sheen.

3.5 PROTECTION

- A. Protect products from construction traffic and operations.
 - 1. Maintain protection until directed by Contracting Officer's Representative.
- B. Replace damaged products and re-clean.
 - 1. Damaged Products include cut, gouged, scraped, torn, and unbonded products.

- - E N D - -

SECTION 09 65 19
RESILIENT TILE FLOORING

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies the installation of luxury vinyl tile, and accessories required for a complete installation.

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.
- C. Subfloor Testing and Preparation: Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.
- D. Removal of Existing Construction Containing Asbestos:
Section 02 82 13.19, ASBESTOS FLOOR TILE AND MASTIC ABATEMENT.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals as described below:
1. Volatile organic compounds per volume as described in PART 2 - PRODUCTS.
 2. Postconsumer and preconsumer recycled content as described in PART 2 - PRODUCTS.
- C. Manufacturer's Literature and Data:
1. Description of each product.
 2. Resilient material manufacturer's recommendations for adhesives, underlayment, primers, and polish.
 3. Application, installation and maintenance instructions.
- D. Samples:
1. Tile: Each type, color, thickness and finish.
 2. Edge Strips: Each type, color, thickness and finish.
 3. Feature Strips: Each type, color, thickness and finish.
- E. Shop Drawings:

1. Layout of patterns as shown on the construction documents.
2. Edge strip locations showing types and detail cross sections.

F. Test Reports:

1. Abrasion resistance: Depth of wear for each tile type and color and volume loss of tile, certified by independent laboratory. Tested per ASTM F510/F510M.
2. Moisture and pH test results as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

1.4 DELIVERY:

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Materials from containers which have been distorted, damaged or opened prior to installation are not acceptable.

1.5 STORAGE:

- A. Store materials in a clean, dry, enclosed space off the ground, protected from harmful weather conditions and at temperature and humidity conditions recommended by the manufacturer. Protect adhesives from freezing. Store flooring, adhesives, and accessories in the spaces where they will be installed for at least 48 hours before beginning installation.

1.6 QUALITY ASSURANCE:

- A. Installer Qualifications: A company specializing in installation with minimum three (3) years' experience and employs experienced flooring installers who have retained, and currently hold, an INSTALL Certification, or a certification from a comparable certification program.
 1. Installers to be certified by INSTALL or a comparable certification program with the following minimum criteria:
 - a. US Department of Labor approved four (4) year apprenticeship program, 160 hours a year.
 - b. Career long training.
 - c. Manufacturer endorsed training.
 - d. Fundamental journeyman skills certification.

B. Furnish product type materials from the same production run.

1.7 WARRANTY:

A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

1.8 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. ASTM International (ASTM):
- D2047-11Test Method for Static Coefficient of Friction of Polish-Coated Flooring Surfaces as Measured by the James Machine
 - D2240-05 (R2010)Test Method for Rubber Property—Durometer Hardness
 - D4078-02 (R2008)Water Emulsion Floor Finish
 - E648-14cCritical Radiant Flux of Floor Covering Systems Using a Radiant Energy Source
 - E662-14Specific Optical Density of Smoke Generated by Solid Materials
 - E1155/E1155M-14Determining Floor Flatness and Floor Levelness Numbers
 - F510/F510M-14Resistance to Abrasion of Resilient Floor Coverings Using an Abrader with a Grit Feed Method
 - F710-11Preparing Concrete Floors to Receive Resilient Flooring
 - F925-13Test Method for Resistance to Chemicals of Resilient Flooring
 - F1344-12 (R2013)Rubber Floor Tile
 - F1700-13aSolid Vinyl Floor Tile
 - F1869-11Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride

F2170-11Test Method for Determining Relative Humidity
in Concrete Floor Slabs Using in Situ Probes

F2195-13Linoleum Floor Tile

C. Code of Federal Regulation (CFR):

40 CFR 59Determination of Volatile Matter Content, Water
Content, Density Volume Solids, and Weight
Solids of Surface Coating

D. International Standards and Training Alliance (INSTALL):

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS:

- A. Provide adhesives, underlayment, primers, and polish recommended by resilient floor material manufacturer.
- B. Critical Radiant Flux: 0.45 watts per sq. cm or more, Class I, per ASTM E648.
- C. Smoke Density: Less than 450 per ASTM E662.
- D. Slip Resistance - Not less than 0.5 when tested with ASTM D2047.

2.2 LUXURY VINYL TILE:

- A. ASTM F1700, Class III, Printed Film Vinyl Tile, Type A.
- B. Thickness: 12 mil (1/8 inch).
- C. Size:.
- D. Provide products with recycled content with not less than 30 percent.
- E. Chemical Resistance: ASTM F925; pass.

2.3 ADHESIVES:

- A. Provide water resistant type adhesive for flooring, base and accessories as recommended by the manufacturer to suit substrate conditions. VOC content to be less than the 50 grams/L when calculated according to 40 CFR 59 (EPA Method 24). Submit manufacturer's descriptive data, documentation stating physical characteristics, and mildew and germicidal characteristics.

2.4 PRIMER FOR CONCRETE SUBFLOORS:

- A. Provide in accordance with Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

2.5 LEVELING COMPOUND FOR CONCRETE FLOORS:

- A. Provide cementitious products with latex or polyvinyl acetate resins in the mix in accordance with Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

2.6 POLISH AND CLEANERS:

- A. Cleaners: As recommended in writing by floor tile manufacturer.
- B. Polish: ASTM D4078.

2.7 MOULDING:

- A. Provide tapered mouldings of vinyl and types as indicated on the construction documents for both edges and transitions of flooring materials specified. Provide vertical lip on moulding of maximum 6 mm (1/4 inch). Provide bevel change in level between 6 and 13 mm (1/4 and 1/2 inch) with a slope no greater than 1:2.
- B. Fasteners for Aluminum Mouldings: Stainless steel of type required for substrate condition.

PART 3 - EXECUTION

3.1 ENVIRONMENTAL REQUIREMENTS:

- A. Maintain flooring materials and areas to receive resilient flooring at a temperature above 20 degrees C (68 degrees F) for three (3) days before application, during application and two (2) days after application, unless otherwise directly by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature of 13 degrees C (55 degrees F) thereafter. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.
- B. Do not install flooring until building is permanently enclosed and wet construction in or near areas to receive tile materials is complete, dry and cured.

3.2 SUBFLOOR TESTING AND PREPARATION:

- A. Prepare and test surfaces to receive resilient tile and adhesive as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.
 - 1. Remove existing resilient floor and existing adhesive.

B. Prepare concrete substrates in accordance with ASTM F710.

C. Perform work regarding removal of flooring and adhesive containing asbestos as specified in Section 02 82 13.19, ASBESTOS FLOOR TILE AND MASTIC ABATEMENT.

3.3 INSTALLATION:

A. Install in accordance with manufacturer's instructions for application and installation unless specified otherwise.

B. Mix tile from at least two containers. An apparent line either of shades or pattern variance is not acceptable.

C. Tile Layout:

1. If layout is not shown on construction documents, lay tile symmetrically about center of room or space with joints aligned.
2. Vary edge width as necessary to maintain full size tiles in the field, no edge tile to be less than 1/2 the field tile size, except where irregular shaped rooms make it impossible.
3. Place tile pattern in the same direction; do not alternate tiles unless specifically indicated in the construction documents to the contrary.

D. Application:

1. Adhere floor tile to flooring substrates using a full spread of adhesive applied to substrate to produce a completed installation without open cracks, voids, raising and puckering at joints, telegraphing of adhesive spreader marks, and other surface imperfections.
2. Scribe, cut, and fit floor tiles to butt neatly and tightly to vertical surfaces and permanent fixtures including built-in furniture, cabinets, pipes, outlets, and door frames.
3. Extend floor tiles into toe spaces, door reveals, closets, and similar openings. Extend floor tiles to center of door openings.
4. Roll tile floor with a minimum 45 kg (100 pound) roller.

E. Seal joints at pipes with sealants in accordance with Section 07 92 00, JOINT SEALANTS.

F. Installation of Edge Strips:

1. Locate edge strips under center line of doors unless otherwise shown on construction documents.
2. Set resilient edge strips in adhesive. Anchor metal edge strips with anchors and screws.
3. Where tile edge is exposed, butt edge strip to touch along tile edge.
4. Where thin set ceramic tile abuts resilient tile, set edge strip against floor file and against the ceramic tile edge.

3.4 CLEANING AND PROTECTION:

- A. Clean adhesive marks on exposed surfaces during the application of resilient materials before the adhesive sets. Exposed adhesive is not acceptable.
- B. Keep traffic off resilient material for a minimum 72 hours after installation.
- C. Clean flooring as recommended in accordance with manufacturer's printed maintenance instructions and within the recommended time frame. As required by the manufacturer, apply the recommended number of coats and type of polish and/or finish in accordance with manufacturer's written instructions.
- D. When construction traffic occurs over tile, cover resilient materials with reinforced kraft paper properly secured and maintained until removal is directed by COR. At entrances and where wheeled vehicles or carts are used, cover tile with plywood, hardboard, or particle board over paper, secured and maintained until removal is directed by COR.
- E. When protective materials are removed and immediately prior to acceptance, replace damaged tile and mouldings, re-clean resilient materials.

3.5 LOCATION:

- A. Unless otherwise indicated in construction documents, install tile flooring, under areas where casework, laboratory and pharmacy furniture and other equipment occur.
- B. Extend tile flooring for room into adjacent closets and alcoves.

- - - E N D - - -

SECTION 09 66 16
TERRAZZO FLOOR TILE

PART 1 - GENERAL

1.1 DESCRIPTION:

- A. This section specifies requirements for terrazzo tile with grouted joints and terrazzo stair treads and base..
- B. Basis of Design: Terrazzio

1.2 RELATED WORK:

- A. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE CONSTRUCTION REQUIREMENTS.
- B. Concrete Floors: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- C. Color, Size, Thickness, Finish and Type: Refer to Finish Legend.
- D. Subfloor Testing and Preparation: Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

1.3 QUALITY ASSURANCE:

- A. Approval by Contracting Officer Representative (COR) is required of products or service, or proposed manufacturer, suppliers and installers, and will be based upon submission by Contractor of certification that:
 - 1. Manufacturer has manufactured terrazzo tile as one of his principal products for a minimum of three (3) years. Submit list of not less than five (5) installations. List is to include name of project, and owner and location of project. Submit manufacturer's qualifications.
 - 2. Installer has installed terrazzo tile for a minimum of three (3) years. Submit installer's qualifications.

1.4 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals, as described below:
 - 1. Postconsumer and preconsumer recycled content as specified in PART 2 - PRODUCTS.
 - 2. For flooring adhesive installation containing volatile organic compounds, provide documentation indicating applicable volatile organic compounds per volume as specified in PART 2 - PRODUCTS.

- C. Flooring Manufacturer's Literature and Data: Printed pre-installation and installation instructions for conditions indicated.
- D. Certificates: Indicating materials conform to specified requirements. Indicating flooring manufacturer's approval of underlayment, substrate preparation, adhesive finishes and cleaners.
- E. Samples: Terrazzo Tile each color, size, finish, and type to be used.
- F. Manufacturer's qualifications including list of installations.
- G. Installer's qualifications.
- H. Moisture and pH test results as per Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.
- I. Manufacturer's warranty.

1.5 DELIVERY:

- A. Deliver materials to job in manufacturer's original unopened containers, free of damage, with manufacturer's brand name marked thereon.

1.6 STORAGE:

- A. Store materials in a protected area. That is kept dry and has a temperature not lower than 18 degrees C (65 degrees F) or higher than 27 degrees C (80 degrees F).

1.7 PROJECT CONDITIONS:

- A. Do not install tiles until all other work that could cause damage to the finish flooring has been completed. Acclimate tiles and maintain spaces where tile is to be installed to a temperature of not less than 21 degrees C (70 degrees F) for at least 48 hours before, during and after the installation of tiles. A minimum temperature of 13 degrees C (55 degrees F) is to be maintained thereafter.

1.8 WARRANTY:

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

1.9 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. ASTM International (ASTM):
C97/C97M-09Test Methods for Absorption and Bulk Specific Gravity of Dimension Stone

- C109/C109M-13Compressive Strength of Hydraulic Cement Mortars
- C501-84 (R2009)Test Method for Relative Resistance to Wear of Unglazed Ceramic Tile by the Taber Abraser
- E84-14Test Method for Surface Burning Characteristics of Building Materials
- E90-09Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Element
- E413-10Classification for Rating Sound Insulation
- E492-09Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine
- E648-14cCritical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source
- E989-06Standard Classification for Determination of Impact Insulation Class
- F1869-11Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
- F2170-11Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in Situ Probes
- C. Code of Federal Regulation (CFR):
 - 40 CFR 59Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- D. Tile Council of North America (TCNA):
 - DCOF AcuTest-2012Dynamic Coefficient of Friction Test

PART 2 - PRODUCTS

2.1 TERRAZZO TILE:

- A. Provide terrazzo tile that is of color, size, thickness, finish and type as specified in Finish Legend. Tiles are to consist of marble chips embedded in a flexible rigid thermoset resin matrix. Provide marble chips graded to 16 6 mm (5/8 1/4 inch) maximum size. Provide granite chips that are manufacturer's standard gradation. Provide tile with the following properties.

1. Recycled Content of Terrazzo Products: Post-consumer content plus one-half of preconsumer content not less than 30 percent.

TERRAZZO TILE PROPERTIES		
PROPERTY	TEST METHOD	VALUE
Compressive strength	ASTM C109/C109M	20 MPa (3000 psi) minimum
Water Absorption	ASTM C97/C97M	0.7 percent maximum
Abrasive Wear	ASTM C501	Index 28
Coefficient of Friction	TCNA DCOF AcuTest	0.42 when wet
Flame Spread	ASTM E84	Class A
Critical Radiant Flux	ASTM E648	Class I

2.2 ADHESIVE:

A. Provide terrazzo tile manufacturer's standard product or a product recommended by the terrazzo tile manufacturer.

1. Adhesive to have a VOC content of 70 g/L or less when calculated according to 40 CFR 59, (EPA Method 24).

2.3 TERRAZZO BASE:

A. Provide terrazzo base matching the requirements of terrazzo tile and being a manufacturer's standard product. Color, size, thickness, finish and type as specified in Finish Legend.

2.4 METAL EDGE STRIPS AND STAIR NOSING:

A. Stainless steel 304 brushed finish, butt-type, 38 mm (1-1/2 inches) wide with thickness to set top surface flush with top of tile and with bevel at exposed edge. Edge strips to have countersunk holes, within 12 mm (1/2 inch) of each end and spaced at no more than 203 mm (8 inches) on center for securement.

PART 3 - EXECUTION

3.1 GENERAL:

- A. Provide terrazzo tile flooring and base on floor surfaces and walls where shown on the construction documents. After becoming familiar with details of the work, verify dimensions in the field, and advise the COR of any discrepancy before performing the work.

3.2 SUBFLOOR TESTING AND PREPARATION:

- A. Prepare and test surfaces to receive terrazzo floor tile and adhesive as specified in Section 09 05 16, SUBSURFACE PREPARATION FOR FLOOR FINISHES.

3.3 INSTALLATION:

- A. Install tile in accordance with the tile manufacturers approved installation instructions, except as specified herein. Lay design symmetrical about center lines of rooms. Joints are to be maximum 0.79 mm (1/32 inch) and in true alignment. Cut tile to fit snugly at pipes and other fixed vertical surfaces. Seal joints at pipes with silicone. Remove spots or smears of adhesive immediately. Make entire surfaces of finished tile floors smooth, straight, and free from bleeding adhesive, buckles, waves or projecting tile edges upon completion.
- B. Metal Edge Strips: Secure strips with No. 10 aluminum alloy, counter sunk flathead machine screws with expansion sleeves. Provide metal edge strips, in one (1) piece, at any exposed edges of tile.
- C. Terrazzo Base: Continuous and adhesively applied. Joints are to be tight and formed in same manner as floor tile.
- D. Grouting and Pointing Joints:
 - A. Follow the mixing and installation instructions contained in the product packaging, data sheets and how to install instructions for the grouting product that will be utilized.
 - B. Joining edges of Terrazzo, Metazzo and all Metal Trim Edges shall be filled with Unsanded Grout matching the Terrazzo binding resin color. All excess grout to be removed during application of the grout.
 - C. Joints shall be packed full and free of all voids and pits. (Tool or rake as specified).

- D. Excess grout shall be cleaned from the surface as the work progresses, while grout is fresh and before it hardens.
- E. The day after installation grout film or haze shall be removed using a neutral Ph detergent solution. Epoxy grout haze should be removed the same day as indicated in the printed product instructions. No acids should be used for cleaning tile work.

3.4 CLEANING:

- A. Upon completion and after adhesive has cured, clean flooring in accordance with manufacturer's recommendations.

3.5 PROTECTION:

- A. From the time of laying until acceptance, protect the flooring from damage. Replace damaged, loose, broken, or curled tiles. Except as necessary to install new tile, keep all traffic off new tile for at least 24 hours after installation.

- - - E N D - - -

SECTION 09 91 00
PAINTING

PART 1 - GENERAL

1.1 DESCRIPTION:

A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the construction documents and/or specified herein, including, but not limited to, the following:

1. Prime coats which may be applied in shop under other sections.
2. Prime painting unprimed surfaces to be painted under this Section.
3. Painting items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
4. Painting ferrous metal (except stainless steel) exposed to view.
5. Painting galvanized ferrous metals exposed to view.
6. Painting interior concrete block exposed to view.
7. Painting gypsum drywall exposed to view.
8. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
9. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
10. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers lighting fixtures, and the like, which are exposed to view through these items.
11. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
12. Painting of any surface not specifically mentioned to be painted herein or on construction documents, but for which painting is obviously necessary to complete the job, or work which comes within the intent of these specifications, is to be included as though specified.

1.2 RELATED WORK:

- A. Activity Hazard Analysis: Section 01 35 26, SAFETY REQUIREMENTS.
- B. Sustainable Design Requirements: Section 01 81 13, SUSTAINABLE DESIGN REQUIREMENTS.
- C. Shop prime painting of steel and ferrous metals: Division 05 - METALS, Division 08 - OPENINGS; Division 10 - SPECIALTIES; Division 11 - EQUIPMENT; Division 12 - FURNISHINGS; Division 13 - SPECIAL CONSTRUCTION;; Division 21 - FIRE SUPPRESSION; Division 22 - PLUMBING; Division 23 - HEATING; VENTILATION AND AIR-CONDITIONING; and Division 26 - ELECTRICAL; Division 27 sections.
- D. Type of Finish, Color, and Gloss Level of Finish Coat: Refer to Finish Legend.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Sustainable Design Submittals as described below:
 - 1. Volatile organic compounds per volume as specified in PART 2 - PRODUCTS.
- C. Painter qualifications.
- D. Manufacturer's Literature and Data:
 - 1. Before work is started, or sample panels are prepared, submit manufacturer's literature and technical data, the current Master Painters Institute (MPI) "Approved Product List" indicating brand label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use subsequent MPI "Approved Product List", however, only one (1) list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI "Approved Product List" where applicable is acceptable.
- E. Sample Panels:
 - 1. After painters' materials have been approved and before work is started submit sample panels showing each type of finish and color specified.
 - 2. Panels to Show Color: Composition board, 100 x 250 mm (4 x 10 inch).
 - 3. Attach labels to panel stating the following:

- a. Federal Specification Number or manufacturers name and product number of paints used.
 - b. Specification code number specified in Section 09 06 00, SCHEDULE FOR FINISHES.
 - c. Product type and color.
 - d. Name of project.
5. Strips showing not less than 50 mm (2 inch) wide strips of undercoats and 100 mm (4 inch) wide strip of finish coat.
- F. Sample of identity markers if used.
- G. Manufacturers' Certificates indicating compliance with specified requirements:
1. Manufacturer's paint substituted for Federal Specification paints meets or exceeds performance of paint specified.
 2. High temperature aluminum paint.
 3. Epoxy coating.

1.4 DELIVERY AND STORAGE:

- A. Deliver materials to site in manufacturer's sealed container marked to show following:
1. Name of manufacturer.
 2. Product type.
 3. Batch number.
 4. Instructions for use.
 5. Safety precautions.
- B. In addition to manufacturer's label, provide a label legibly printed as following:
1. Federal Specification Number, where applicable, and name of material.
 2. Surface upon which material is to be applied.
 3. Specify Coat Types: Prime; body; finish; etc.
- C. Maintain space for storage, and handling of painting materials and equipment in a ventilated, neat and orderly condition to prevent spontaneous combustion from occurring or igniting adjacent items.
- D. Store materials at site at least 24 hours before using, at a temperature between 7 and 30 degrees C (45 and 85 degrees F).

1.5 QUALITY ASSURANCE:

- A. Qualification of Painters: Use only qualified journeyman painters for the mixing and application of paint on exposed surfaces. Submit evidence that key personnel have successfully performed surface preparation and

application of coating on a minimum of three (3) similar projects within the past three (3) years.

- B. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier coats over incompatible primers or remove and re-prime as required. Notify the Contracting Officer Representative (COR) in writing of any anticipated problems using the coating systems as specified with substrates primed by others.

1.6 REGULATORY REQUIREMENTS:

- A. Paint materials are to conform to the restrictions of the local Environmental and Toxic Control jurisdiction.
1. Volatile Organic Compounds (VOC) Emissions Requirements: Field-applied paints and coatings that are inside the waterproofing system to not exceed limits of authorities having jurisdiction.
 2. Lead-Base Paint:
 - a. Comply with Section 410 of the Lead-Based Paint Poisoning Prevention Act, as amended, and with implementing regulations promulgated by Secretary of Housing and Urban Development.
 - b. Regulations concerning prohibition against use of lead-based paint in federal and federally assisted construction, or rehabilitation of residential structures are set forth in Subpart F, Title 24, Code of Federal Regulations, Department of Housing and Urban Development.
 - c. Do not use coatings having a lead content over 0.06 percent by weight of non-volatile content.
 - d. For lead-paint removal, see Section 02 83 33.13, LEAD-BASED PAINT REMOVAL AND DISPOSAL.
 3. Asbestos: Provide materials that do not contain asbestos.
 4. Chromate, Cadmium, Mercury, and Silica: Provide materials that do not contain zinc-chromate, strontium-chromate, Cadmium, mercury or mercury compounds or free crystalline silica.
 5. Human Carcinogens: Provide materials that do not contain any of the ACGIH-BKLT and ACGHI-DOC confirmed or suspected human carcinogens.

6. Use high performance acrylic paints in place of alkyd paints.

1.7 SAFETY AND HEALTH

- A. Apply paint materials using safety methods and equipment in accordance with the following:
 - 1. Comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis (AHA) as specified in Section 01 35 26, SAFETY REQUIREMENTS. The AHA is to include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.
- B. Safety Methods Used During Paint Application: Comply with the requirements of SSPC PA Guide 10.
- C. Toxic Materials: To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:
 - 1. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.
 - 2. 29 CFR 1910.1000.
 - 3. ACHIH-BKLT and ACGHI-DOC, threshold limit values.

1.8 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. American Conference of Governmental Industrial Hygienists (ACGIH):
 - ACGIH TLV-BKLT-2012Threshold Limit Values (TLV) for Chemical Substances and Physical Agents and Biological Exposure Indices (BEIs)
 - ACGIH TLV-DOC-2012Documentation of Threshold Limit Values and Biological Exposure Indices, (Seventh Edition)
- C. ASME International (ASME):
 - A13.1-07(R2013)Scheme for the Identification of Piping Systems
- D. Code of Federal Regulation (CFR):
 - 40 CFR 59Determination of Volatile Matter Content, Water Content, Density Volume Solids, and Weight Solids of Surface Coating
- E. Commercial Item Description (CID):
 - A-A-1272APlaster Gypsum (Spackling Compound)
- F. Federal Specifications (Fed Spec):

TT-P-1411APaint, Copolymer-Resin, Cementitious (For
Waterproofing Concrete and Masonry Walls) (CEP)

G. Master Painters Institute (MPI):

- 1Aluminum Paint
- 4Interior/ Exterior Latex Block Filler
- 5Exterior Alkyd Wood Primer
- 7Exterior Oil Wood Primer
- 8Exterior Alkyd, Flat MPI Gloss Level 1
- 9Exterior Alkyd Enamel MPI Gloss Level 6
- 10Exterior Latex, Flat
- 11Exterior Latex, Semi-Gloss
- 18Organic Zinc Rich Primer
- 22Aluminum Paint, High Heat (up to 590% - 1100F)
- 27Exterior / Interior Alkyd Floor Enamel, Gloss
- 31Polyurethane, Moisture Cured, Clear Gloss
- 36Knot Sealer
- 43Interior Satin Latex, MPI Gloss Level 4
- 44Interior Low Sheen Latex, MPI Gloss Level 2
- 45Interior Primer Sealer
- 46Interior Enamel Undercoat
- 47Interior Alkyd, Semi-Gloss, MPI Gloss Level 5
- 48Interior Alkyd, Gloss, MPI Gloss Level 6
- 50Interior Latex Primer Sealer
- 51Interior Alkyd, Eggshell, MPI Gloss Level 3
- 52Interior Latex, MPI Gloss Level 3
- 53Interior Latex, Flat, MPI Gloss Level 1
- 54Interior Latex, Semi-Gloss, MPI Gloss Level 5
- 59Interior/Exterior Alkyd Porch & Floor Enamel, Low
Gloss
- 60Interior/Exterior Latex Porch & Floor Paint, Low
Gloss
- 66Interior Alkyd Fire Retardant, Clear Top-Coat (ULC
Approved)
- 67Interior Latex Fire Retardant, Top-Coat (ULC
Approved)
- 68Interior/ Exterior Latex Porch & Floor Paint,
Gloss

- 71Polyurethane, Moisture Cured, Clear, Flat
- 77Epoxy Cold Cured, Gloss
- 79Marine Alkyd Metal Primer
- 90Interior Wood Stain, Semi-Transparent
- 91Wood Filler Paste
- 94Exterior Alkyd, Semi-Gloss
- 95Fast Drying Metal Primer
- 98High Build Epoxy Coating
- 101Epoxy Anti-Corrosive Metal Primer
- 108High Build Epoxy Coating, Low Gloss
- 114Interior Latex, Gloss
- 119Exterior Latex, High Gloss (acrylic)
- 134Galvanized Water Based Primer
- 135Non-Cementitious Galvanized Primer
- 138Interior High Performance Latex, MPI Gloss Level 2
- 139Interior High Performance Latex, MPI Gloss Level 3
- 140Interior High Performance Latex, MPI Gloss Level 4
- 141Interior High Performance Latex (SG) MPI Gloss
Level 5
- 163Exterior Water Based Semi-Gloss Light Industrial
Coating, MPI Gloss Level 5

G. Society for Protective Coatings (SSPC):

- SSPC SP 1-82 (R2004)Solvent Cleaning
- SSPC SP 2-82 (R2004)Hand Tool Cleaning
- SSPC SP 3-28 (R2004)Power Tool Cleaning
- SSPC SP 10/NACE No.2 ...Near-White Blast Cleaning
- SSPC PA Guide 10Guide to Safety and Health Requirements

H. Maple Flooring Manufacturer's Association (MFMA):

I. U.S. National Archives and Records Administration (NARA):

- 29 CFR 1910.1000Air Contaminants

J. Underwriter's Laboratory (UL)

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Conform to the coating specifications and standards referenced in PART 3.
Submit manufacturer's technical data sheets for specified coatings and solvents.

2.2 PAINT PROPERTIES:

- A. Use ready-mixed (including colors), except two component epoxies, polyurethanes, polyesters, paints having metallic powders packaged separately and paints requiring specified additives.
- B. Where no requirements are given in the referenced specifications for primers, use primers with pigment and vehicle, compatible with substrate and finish coats specified.
- C. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer, and use only to recommended limits.
- D. VOC Content: For field applications that are inside the weatherproofing system, paints and coating to comply with VOC content limits of authorities having jurisdiction and the following VOC content limits:
 - 1. Flat Paints and Coatings: 50 g/L.
 - 2. Non-flat Paints and Coatings: 150 g/L.
 - 3. Dry-Fog Coatings: 400 g/L.
 - 4. Primers, Sealers, and Undercoaters: 200 g/L.
 - 5. Anticorrosive and Antirust Paints applied to Ferrous Metals: 250 g/L.
 - 6. Zinc-Rich Industrial Maintenance Primers: 340 g/L.
 - 7. Pretreatment Wash Primers: 420 g/L.
- E. VOC test method for paints and coatings is to be in accordance with 40 CFR 59 (EPA Method 24). Part 60, Appendix A with the exempt compounds' content determined by Method 303 (Determination of Exempt Compounds) in the South Coast Air Quality Management District's (SCAQMD) "Laboratory Methods of Analysis for Enforcement Samples" manual.

2.3 PLASTIC TAPE:

- A. Pigmented vinyl plastic film in colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES or specified.
- B. Pressure sensitive adhesive back.
- C. Snap on coil plastic markers.
- D. Widths as shown on construction documents.

2.4 Biobased Content

- A. Paint products shall comply with following bio-based standards for biobased materials:

Material Type	Percent by Weight
Interior Paint	20 percent biobased material
Interior Paint- Oil Based and Solvent Alkyd	67 percent biobased material
Exterior Paint	20 percent biobased material
Wood & Concrete Stain	39 percent biobased content
Polyurethane Coatings	25 percent biobased content
Water Tank Coatings	59 percent biobased content
Wood & Concrete Sealer- Membrane Concrete Sealers	11 percent biobased content
Wood & Concrete Sealer- Penetrating Liquid	79 percent biobased content

B. The minimum-content standards are based on the weight (not the volume) of the material.

PART 3 - EXECUTION

3.1 JOB CONDITIONS:

- A. Safety: Observe required safety regulations and manufacturer's warning and instructions for storage, handling and application of painting materials.
 - 1. Take necessary precautions to protect personnel and property from hazards due to falls, injuries, toxic fumes, fire, explosion, or other harm.
 - 2. Deposit soiled cleaning rags and waste materials in metal containers approved for that purpose. Dispose of such items off the site at end of each day's work.
- B. Atmospheric and Surface Conditions:
 - 1. Do not apply coating when air or substrate conditions are:
 - a. Less than 3 degrees C (5 degrees F) above dew point.
 - b. Below 10 degrees C (50 degrees F) or over 35 degrees C (95 degrees F), unless specifically pre-approved by the COR and the product manufacturer. Under no circumstances are application conditions to exceed manufacturer recommendations.
 - c. When the relative humidity exceeds 85 percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
 - 2. Maintain interior temperatures until paint dries hard.
 - 3. Do no exterior painting when it is windy and dusty.

4. Do not paint in direct sunlight or on surfaces that the sun will warm.
5. Apply only on clean, dry and frost free surfaces except as follows:
 - a. Apply water thinned acrylic and cementitious paints to damp (not wet) surfaces only when allowed by manufacturer's printed instructions.
 - b. Concrete and masonry when permitted by manufacturer's recommendations, dampen surfaces to which water thinned acrylic and cementitious paints are applied with a fine mist of water on hot dry days to prevent excessive suction and to cool surface.
6. Varnishing:
 - a. Apply in clean areas and in still air.
 - b. Before varnishing vacuum and dust area.
 - c. Immediately before varnishing wipe down surfaces with a tack rag.

3.2 INSPECTION:

- A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

3.3 GENERAL WORKMANSHIP REQUIREMENTS:

- A. Application may be by brush or roller. Spray application only upon acceptance from the COR in writing.
- B. Furnish to the COR a painting schedule indicating when the respective coats of paint for the various areas and surfaces will be completed. This schedule is to be kept current as the job progresses.
- C. Protect work at all times. Protect all adjacent work and materials by suitable covering or other method during progress of work. Upon completion of the work, remove all paint and varnish spots from floors, glass and other surfaces. Remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and leave work in a clean condition.
- D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.
- E. When indicated to be painted, remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.

- F. Materials are to be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.
- G. Apply materials with a coverage to hide substrate completely. When color, stain, dirt or undercoats show through final coat of paint, the surface is to be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Government.
- H. All coats are to be dry to manufacturer's recommendations before applying succeeding coats.
- I. All suction spots or "hot spots" in plaster after the application of the first coat are to be touched up before applying the second coat.
- J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.

3.4 SURFACE PREPARATION:

A. General:

1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work. Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished are to be completely dry, clean and smooth.
2. See other sections of specifications for specified surface conditions and prime coat.
3. Perform preparation and cleaning procedures in strict accordance with the paint manufacturer's instructions and as herein specified, for each particular substrate condition.
4. Clean surfaces before applying paint or surface treatments with materials and methods compatible with substrate and specified finish. Remove any residue remaining from cleaning agents used. Do not use solvents, acid, or steam on concrete and masonry. Schedule the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.
5. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:

- a. Concrete: 12 percent.
 - b. Fiber-Cement Board: 12 percent.
 - c. Masonry (Clay and CMU's): 12 percent.
 - d. Wood: 15 percent.
 - e. Gypsum Board: 12 percent.
 - f. Plaster: 12 percent.
- B. Ferrous Metals:
1. Remove oil, grease, soil, drawing and cutting compounds, flux and other detrimental foreign matter in accordance with SSPC-SP 1 (Solvent Cleaning).
 2. Remove loose mill scale, rust, and paint, by hand or power tool cleaning, as defined in SSPC-SP 2 (Hand Tool Cleaning) and SSPC-SP 3 (Power Tool Cleaning). Where high temperature aluminum paint is used, prepare surface in accordance with paint manufacturer's instructions.
 3. Fill dents, holes and similar voids and depressions in flat exposed surfaces of hollow steel doors and frames, access panels, roll-up steel doors and similar items specified to have semi-gloss or gloss finish with TT-F-322D (Filler, Two-Component Type, For Dents, Small Holes and Blow-Holes). Finish flush with adjacent surfaces.
 - a. Fill flat head countersunk screws used for permanent anchors.
 - b. Do not fill screws of item intended for removal such as glazing beads.
 4. Spot prime abraded and damaged areas in shop prime coat which expose bare metal with same type of paint used for prime coat. Feather edge of spot prime to produce smooth finish coat.
 5. Spot prime abraded and damaged areas which expose bare metal of factory finished items with paint as recommended by manufacturer of item.
- C. Zinc-Coated (Galvanized) Metal, Aluminum, Copper and Copper Alloys Surfaces Specified Painted:
1. Clean surfaces to remove grease, oil and other deterrents to paint adhesion in accordance with SSPC-SP 1 (Solvent Cleaning).
 2. Spot coat abraded and damaged areas of zinc-coating which expose base metal on hot-dip zinc-coated items with MPI 18 (Organic Zinc Rich Coating). Prime or spot prime with MPI 134 (Waterborne Galvanized Primer) or MPI 135 (Non-Cementitious Galvanized Primer) depending on finish coat compatibility.
- F. Gypsum Plaster and Gypsum Board:

1. Remove efflorescence, loose and chalking plaster or finishing materials.
2. Remove dust, dirt, and other deterrents to paint adhesion.
3. Fill holes, cracks, and other depressions with CID-A-A-1272A finished flush with adjacent surface, with texture to match texture of adjacent surface. Patch holes over 25 mm (1-inch) in diameter as specified in Section for plaster or gypsum board.

3.5 PAINT PREPARATION:

- A. Thoroughly mix painting materials to ensure uniformity of color, complete dispersion of pigment and uniform composition.
- B. Do not thin unless necessary for application and when finish paint is used for body and prime coats. Use materials and quantities for thinning as specified in manufacturer's printed instructions.
- C. Remove paint skins, then strain paint through commercial paint strainer to remove lumps and other particles.
- D. Mix two (2) component and two (2) part paint and those requiring additives in such a manner as to uniformly blend as specified in manufacturer's printed instructions unless specified otherwise.
- E. For tinting required to produce exact shades specified, use color pigment recommended by the paint manufacturer.

3.6 APPLICATION:

- A. Start of surface preparation or painting will be construed as acceptance of the surface as satisfactory for the application of materials.
- B. Unless otherwise specified, apply paint in three (3) coats; prime, body, and finish. When two (2) coats applied to prime coat are the same, first coat applied over primer is body coat and second coat is finish coat.
- C. Apply each coat evenly and cover substrate completely.
- D. Allow not less than 48 hours between application of succeeding coats, except as allowed by manufacturer's printed instructions, and approved by COR.
- E. Apply by brush or roller. Spray application for new or existing occupied spaces only upon approval by acceptance from COR in writing.
 1. Apply painting materials specifically required by manufacturer to be applied by spraying.
 2. In new construction and in existing occupied spaces, where paint is applied by spray, mask or enclose with polyethylene, or similar air

tight material with edges and seams continuously sealed including items specified in "Building and Structural Work Field Painting"; "Work not Painted"; motors, controls, telephone, and electrical equipment, fronts of sterilizes and other recessed equipment and similar prefinished items.

- F. Do not paint in closed position operable items such as access doors and panels, window sashes, overhead doors, and similar items except overhead roll-up doors and shutters.

3.7 PRIME PAINTING:

- A. After surface preparation, prime surfaces before application of body and finish coats, except as otherwise specified.
- B. Spot prime and apply body coat to damaged and abraded painted surfaces before applying succeeding coats.
- C. Additional field applied prime coats over shop or factory applied prime coats are not required except for exterior exposed steel apply an additional prime coat.
- D. Prime rabbets for stop and face glazing of wood, and for face glazing of steel.
- E. Wood and Wood Particleboard:
 - 1. Use same kind of primer specified for exposed face surface.
 - a. Interior wood except for transparent finish: MPI 45 (Interior Primer Sealer) or MPI 46 (Interior Enamel Undercoat), thinned if recommended by manufacturer.
- F. Metals: Canopy steel and lintels, :
 - 1. Steel and iron: Use MPI 101 (Cold Curing Epoxy Primer) where MPI 77 (Epoxy Cold Cured, Gloss MPI 98 (High Build Epoxy Coating) .
 - 2. Zinc-coated steel and iron: MPI 134 (Waterborne Galvanized Primer) .
 - 3. Aluminum scheduled to be painted: MPI 95 (Fast Drying Metal Primer).
- G. Gypsum Board and Hardboard:
 - 1. Surfaces scheduled to have MPI 53 (Interior Latex, Flat), MPI Gloss Level 1 MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) finish: Use MPI 10 MPI 53 (Interior Latex, MPI Gloss Level 3) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) respectively.

2. Primer: MPI 50 (Interior Latex Primer Sealer) except use MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) in shower and bathrooms.
3. Surfaces scheduled to receive vinyl coated fabric wall covering: MPI 46 (Interior Enamel Undercoat).

3.8 EXTERIOR FINISHES:

- A. Apply following finish coats where specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. Steel and Ferrous Metal: Hollow metal doors and frames
 1. Two (2) coats of MPI 9 (Exterior Alkyd Enamel) on exposed surfaces, except on surfaces over 94 degrees C (201 degrees F).
- C. Canopy Steel and Lintels:
 1. Pigmented Polyurethane over Epoxy Primer System MPI EXT 5.3L:
 - a. Prime Coat: Primer, epoxy, anti-corrosive, for metal, MPI #108.
 - 1) SW: Macropoxy 646 Fast Cure Epoxy, B58-600 series.
 - b. Intermediate Coat: Polyurethane, two component, pigmented, semi-gloss matching topcoat.
 - c. Topcoat: Polyurethane, two component, pigmented, semi-gloss (MPI Gloss Level 5), MPI #174.
 - 1) SW: Acrolon 218 HS Polyurethane Semi-Gloss, B65-650 series
- D. Concrete Masonry Units:
 1. General:
 - a. Where specified in Section 09 06 00, SCHEDULE FOR FINISHES or shown.
 - b. Mix as specified in manufacturer's printed directions.
 - c. Do not mix more paint than can be used within four (4) hours after mixing. Discard paint that has started to set.
 - d. Dampen warm surfaces above 24 degrees C (75 degrees F) with fine mist of water before application of paint. Do not leave free water on surface.
 - e. Cure paint with a fine mist of water as specified in manufacturer's printed instructions.

2. Use two (2) coats of TT-P-1411 (Paint, Co-polymer-Resin, Cementitious), unless specified otherwise.

3.9 INTERIOR FINISHES:

- A. Apply following finish coats over prime coats in spaces or on surfaces specified in Finish Legend.
- B. Metal Work:
 1. Apply to exposed surfaces.
 2. Omit body and finish coats on surfaces concealed after installation except electrical conduit containing conductors over 600 volts.
 3. Ferrous Metal, Galvanized Metal, and Other Metals Scheduled:
 - a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) unless specified otherwise.
 - b. Two (2) coats of MPI 48 (Interior Alkyd Gloss) MPI 51 (Interior Alkyd, Eggshell).
 - c. Machinery: One (1) coat MPI 9 (Exterior Alkyd Enamel).
 - d. Asphalt Coated Metal: One (1) coat MPI 1 (Aluminum Paint).
- C. Gypsum Board:
 1. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 139 (Interior High Performance Latex, MPI Gloss level 3).
 2. Two (2) coats of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2).
 3. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) or MPI 114 (Interior Latex, Gloss).
 4. One (1) coat of MPI 45 (Interior Primer Sealer) MPI 46 (Interior Enamel Undercoat) plus one (1) coat of MPI 48 (Interior Alkyd Gloss).
- G. Cement Board: One (1) coat of MPI 138 (Interior High Performance Latex, MPI Gloss Level 2) MPI 139 (Interior High Performance Latex, MPI Gloss Level 3) MPI 140 (Interior High Performance Latex MPI Gloss Level 4) MPI 141 (Interior High Performance Latex, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss).
- H. Miscellaneous:
 1. Apply where specified in Section 09 06 00, SCHEDULE FOR FINISHES.

2. MPI 1 (Aluminum Paint): Two (2) coats of aluminum paint.

3.10 PAINT COLOR:

- A. Color and gloss of finish coats is specified in Section 09 06 00, SCHEDULE FOR FINISHES.
- B. For additional requirements regarding color see Articles, "REFINISHING EXISTING PAINTED SURFACE" and "MECHANICAL AND ELECTRICAL FIELD PAINTING SCHEDULE".
- C. Coat Colors:
 - 1. Color of priming coat: Lighter than body coat.
 - 2. Color of body coat: Lighter than finish coat.
 - 3. Color prime and body coats to not show through the finish coat and to mask surface imperfections or contrasts.
- D. Painting, Caulking, Closures, and Fillers Adjacent to Casework:
 - 1. Paint to match color of casework where casework has a paint finish.
 - 2. Paint to match color of wall where casework is stainless steel, plastic laminate, or varnished wood.

3.11 MECHANICAL AND ELECTRICAL WORK FIELD PAINTING SCHEDULE:

- A. Field painting of mechanical and electrical consists of cleaning, touching-up abraded shop prime coats, and applying prime, body and finish coats to materials and equipment if not factory finished in space scheduled to be finished.
- B. In spaces not scheduled to be finish painted in Section 09 06 00, SCHEDULE FOR FINISHES paint as specified below.
- C. Paint various systems specified in Division 02 - EXISTING CONDITIONS, Division 21 - FIRE SUPPRESSION, Division 22 - PLUMBING, Division 23 - HEATING, VENTILATION AND AIR-CONDITIONING, Division 26 - ELECTRICAL, and Division 27 - COMMUNICATIONS.
- D. Paint after tests have been completed.
- E. Omit prime coat from factory prime-coated items.
- F. Finish painting of mechanical and electrical equipment is not required when located in interstitial spaces, above suspended ceilings, in concealed areas such as pipe and electric closets, shafts and furred spaces except on electrical conduit containing feeders 600 volts or more.
- G. Omit field painting of items specified in "BUILDING AND STRUCTURAL WORK FIELD PAINTING"; "Building and Structural Work not Painted".
- H. Color:

1. Paint items having no color specified in Section 09 06 00, SCHEDULE FOR FINISHES to match surrounding surfaces.
 2. Paint colors as specified in Section 09 06 00, SCHEDULE FOR FINISHES except for following:
 - a. Gray: Heating, ventilating, air conditioning and refrigeration equipment (except as required to match surrounding surfaces), and water equipment.
 - b. Federal Safety Red: Exposed fire protection piping hydrants, post indicators, electrical conduits containing fire alarm control wiring, and fire alarm equipment.
 - c. Federal Safety Orange: Entire lengths of electrical conduits containing feeders 600 volts or more.
- I. Apply paint systems on properly prepared and primed surface as follows:
1. Interior Locations:
 - a. Apply two (2) coats of MPI 47 (Interior Alkyd, Semi-Gloss) to following items:
 - 1) Metal under 94 degrees C (201 degrees F) of items such as bare piping, fittings, hangers and supports.
 - 2) Equipment and systems such as hinged covers and frames for control cabinets and boxes, cast-iron radiators, electric conduits and panel boards.
 - 3) Heating, ventilating, air conditioning, plumbing equipment, and machinery having shop prime coat and not factory finished.
 - b. Apply one (1) coat of MPI 50 (Interior Latex Primer Sealer) and one (1) coat of MPI 53 (Interior Latex, Flat, MPI Gloss Level 1) MPI 44 (Interior Low Sheen Latex) MPI 52 (Interior Latex, MPI Gloss Level 3) MPI 43 (Interior Satin Latex) MPI 54 (Interior Latex, Semi-Gloss, MPI Gloss Level 5) MPI 114 (Interior Latex, Gloss) on finish of insulation on boiler breeching and uptakes inside boiler house, drums, drumheads, oil heaters, feed water heaters, tanks and piping.
 - c. Apply two (2) coats of MPI 22 (High Heat Resistant Coating) to ferrous metal surface over 94 degrees K (290 degrees F) of following items:
 - 1) Steam line flanges, bare pipe, fittings, valves, hangers and supports over 94 degrees K (290 degrees F).
 - 2) Engine generator exhaust piping and muffler.

e. Paint electrical conduits containing cables rated 600 volts or more using two (2) coats of MPI 9 (Exterior Alkyd Enamel) in the Federal Safety Orange color in exposed and concealed spaces full length of conduit.

2. Other exposed locations:

a. Metal surfaces, except aluminum, of cooling towers exposed to view, including connected pipes, rails, and ladders: Two (2) coats of MPI 1 (Aluminum Paint).

b. Cloth jackets of insulation of ducts and pipes in connection with plumbing, air conditioning, ventilating refrigeration and heating systems: One (1) coat of MPI 50 (Interior Latex Primer Sealer) and one (1) coat of MPI 10 (Exterior Latex, Flat).

3.12 BUILDING AND STRUCTURAL WORK FIELD PAINTING:

A. Painting and finishing of interior work except as specified here-in-after.

1. Painting and finishing of new and existing work including colors and gloss of finish selected is specified in Finish Schedule, Section 09 06 00, SCHEDULE FOR FINISHES.

2. Painting of disturbed, damaged and repaired or patched surfaces when entire space is not scheduled for complete repainting or refinishing.

3. Painting of ferrous metal and galvanized metal.

4. Painting of wood with fire retardant paint.

5. Identity painting and safety painting.

B. Building and Structural Work not Painted:

1. Prefinished items:

a. Casework, doors, elevator entrances and cabs, metal panels, wall covering, and similar items specified factory finished under other sections.

b. Factory finished equipment and pre-engineered metal building components such as metal roof and wall panels.

2. Finished surfaces:

a. Hardware except ferrous metal.

b. Anodized aluminum, stainless steel, chromium plating, copper, and brass, except as otherwise specified.

c. Signs, fixtures, and other similar items integrally finished.

3. Concealed surfaces:

- a. Inside dumbwaiter, elevator and duct shafts, interstitial spaces, pipe basements, crawl spaces, pipe tunnels, above ceilings, attics, except as otherwise specified.
 - b. Inside walls or other spaces behind access doors or panels.
 - c. Surfaces concealed behind permanently installed casework and equipment.
4. Moving and operating parts:
 - a. Shafts, chains, gears, mechanical and electrical operators, linkages, and sprinkler heads, and sensing devices.
 - b. Tracks for overhead or coiling doors, shutters, and grilles.
 5. Labels:
 - a. Code required label, such as Underwriters Laboratories Inc., Intertek Testing Service or Factory Mutual Research Corporation.
 - b. Identification plates, instruction plates, performance rating, and nomenclature.
 6. Galvanized metal:
 - a. Gas Storage Racks.
 - b. Except where specifically specified to be painted.
 7. Metal safety treads and nosings.
 8. Gaskets.
 9. Structural steel encased in concrete, masonry, or other enclosure.
 10. Structural steel to receive sprayed-on fire proofing.
 11. Ceilings, walls, columns in interstitial spaces.
 12. Ceilings, walls, and columns in pipe basements.

3.13 IDENTITY PAINTING SCHEDULE:

- A. Identify designated service in new buildings or projects with extensive remodeling in accordance with ASME A13.1, unless specified otherwise, on exposed piping, piping above removable ceilings, piping in accessible pipe spaces, interstitial spaces, and piping behind access panels. For existing spaces where work is minor match existing.
 1. Legend may be identified using snap-on coil plastic markers or by paint stencil applications.
 2. Apply legends adjacent to changes in direction, on branches, where pipes pass through walls or floors, adjacent to operating accessories such as valves, regulators, strainers and cleanouts a minimum of 12.2 M

(40 feet) apart on straight runs of piping. Identification next to plumbing fixtures is not required.

3. Locate Legends clearly visible from operating position.
4. Use arrow to indicate direction of flow using black stencil paint.
5. Identify pipe contents with sufficient additional details such as temperature, pressure, and contents to identify possible hazard. Insert working pressure shown on construction documents where asterisk appears for High, Medium, and Low Pressure designations as follows:
 - a. High Pressure - 414 kPa (60 psig) and above.
 - b. Medium Pressure - 104 to 413 kPa (15 to 59 psig).
 - c. Low Pressure - 103 kPa (14 psig) and below.
 - d. Add Fuel oil grade numbers.
6. Legend name in full or in abbreviated form as follows:

PIPING	COLOR OF EXPOSED PIPING	COLOR OF BACKGROUND	COLOR OF LETTERS	LEGEND ABBREVIATIONS
Blow-off		Green	White	Blow-off
Boiler Feedwater		Green	White	Blr Feed
A/C Condenser Water Supply		Green	White	A/C Cond Wtr Sup
A/C Condenser Water Return		Green	White	A/C Cond Wtr Ret
Chilled Water Supply		Green	White	Ch. Wtr Sup
Chilled Water Return		Green	White	Ch. Wtr Ret
Shop Compressed Air		Blue	White	Shop Air
Air-Instrument Controls		Green	White	Air-Inst Cont
Drain Line		Green	White	Drain
Emergency Shower		Green	White	Emg Shower
High Pressure Steam		Green	White	H.P. _____*
High Pressure Condensate Return		Green	White	H.P. Ret _____*
Medium Pressure Steam		Green	White	M. P. Stm _____*
Medium Pressure Condensate Return		Green	White	M.P. Ret _____*
Low Pressure Steam		Green	White	L.P. Stm _____*
Low Pressure Condensate Return		Green	White	L.P. Ret _____*
High Temperature Water				

Supply		Green	White	H. Temp Wtr Sup
High Temperature Water				
Return		Green	White	H. Temp Wtr Ret
Hot Water Heating Supply		Green	White	H. W. Htg Sup
Hot Water Heating Return		Green	White	H. W. Htg Ret
Gravity Condensate Return		Green	White	Gravity Cond Ret
Pumped Condensate Return		Green	White	Pumped Cond Ret
Vacuum Condensate Return		Green	White	Vac Cond Ret
Fuel Oil - Grade	Brown		White	Fuel Oil-Grade
(Diesel Fuel included under Fuel Oil)				
Boiler Water Sampling		Green	White	Sample
Chemical Feed		Green	White	Chem Feed
Continuous Blow-Down		Green	White	Cont. B D
Pumped Condensate		Green	White	Pump Cond
Pump Recirculating		Green	White	Pump-Recirc.
Vent Line		Green	White	Vent
Alkali		Orange	Black	Alk
Bleach		Orange	Black	Bleach
Detergent		Yellow	Black	Det
Liquid Supply		Yellow	Black	Liq Sup
Reuse Water		Yellow	Black	Reuse Wtr
Cold Water (Domestic)	White	Green	White	C.W. Dom
Hot Water (Domestic)				
Supply	White	Yellow	Black	H.W. Dom
Return	White	Yellow	Black	H.W. Dom Ret
Tempered Water	White	Yellow	Black	Temp. Wtr
Ice Water				
Supply	White	Green	White	Ice Wtr
Return	White	Green	White	Ice Wtr Ret
Reagent Grade Water		Green	White	RG
Reverse Osmosis		Green	White	RO
Sanitary Waste		Green	White	San Waste
Sanitary Vent		Green	White	San Vent
Storm Drainage		Green	White	St Drain
Pump Drainage		Green	White	Pump Disch
Chemical Resistant Pipe				
Waste		Orange	Black	Acid Waste
Vent		Orange	Black	Acid Vent
Atmospheric Vent		Green	White	ATV
Silver Recovery		Green	White	Silver Rec
Oral Evacuation		Green	White	Oral Evac
Fuel Gas		Yellow	Black	Gas

Fire Protection Water

Sprinkler	Red	Red	White	Auto Spr
Standpipe	Red	Red	White	Stand
Sprinkler	Red	Red	White	Drain

7. Electrical Conduits containing feeders over 600 volts, paint legends using 50 mm (2 inch) high black numbers and letters, showing the voltage class rating. Provide legends where conduits pass through walls and floors and at maximum 6096 mm (20 foot) intervals in between. Use labels with yellow background with black border and words Danger High Voltage Class, 5000 15000 25000.

8. See Sections for methods of identification, legends, and abbreviations of the following:

- a. Laboratory gas and vacuum lines: Section 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES / Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES.
- b. Medical Gases and vacuum lines: Section 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES
- c. Conduits containing high voltage feeders over 600 volts:
Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS /
Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS /
Section 28 05 33, RACEWAYS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY.

B. Fire and Smoke Partitions:

- 1. Identify partitions above ceilings on both sides of partitions except within shafts in letters not less than 64 mm (2 1/2 inches) high.
- 2. Stenciled message: "SMOKE BARRIER" or, "FIRE BARRIER" as applicable.
- 3. Locate not more than 6096 mm (20 feet) on center on corridor sides of partitions, and with a least one (1) message per room on room side of partition.
- 4. Use semi-gloss paint of color that contrasts with color of substrate.

C. Identify columns in pipe basements and interstitial space:

- 1. Apply stenciled number and letters to correspond with grid numbering and lettering indicated on construction documents.
- 2. Paint numbers and letters 101 mm (4 inches) high, locate 45 mm (18 inches) below overhead structural slab.

3. Color:

- a. Use black on concrete columns.
- b. Use white or contrasting color on steel columns.

3.14 PROTECTION CLEAN UP, AND TOUCH-UP:

- A. Protect work from paint droppings and spattering by use of masking, drop cloths, removal of items or by other approved methods.
- B. Upon completion, clean paint from hardware, glass and other surfaces and items not required to be painted of paint drops or smears.
- C. Before final inspection, touch-up or refinished in a manner to produce solid even color and finish texture, free from defects in work which was damaged or discolored.

- - - E N D - - -

SECTION 10 14 00
SIGNAGE

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies interior signage for room numbers, directional signs exterior signage, code required signs and temporary signs.

1.2 RELATED WORK

- A. Electrical Work: Division 26, ELECTRICAL.
B. Lighted EXIT signs for egress purposes are specified under Division 26, ELECTRICAL.
C. Structural Steel Supports: Section 05 12 00, STRUCTURAL STEEL FRAMING.

1.3 QUALITY ASSURANCE

- A. Manufacturer's Qualifications: Provide signage that is the product of one manufacturer, who has provided signage as specified for a minimum of three (3) years. Submit manufacturer's qualifications.
B. Installer's Qualifications: Minimum three (3) years' experience in the installation of signage of the type as specified in this Section. Submit installer's qualifications.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 00, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
B. Interior Sign Samples: Sign panels and frames, with letters and symbols, for each sign type.
1. Sign Panel, 203 x 254 mm (8 x 10 inches), with letters.
2. Color samples of each color, 152 x 152 mm (6 x 6 inches. Show anticipated range of color and texture.
3. Sample of typeface, arrow and symbols in a typical full size layout.
C. Manufacturer's Literature:
1. Showing the methods and procedures proposed for the anchorage of the signage system to each surface type.
2. Manufacturer's printed specifications and maintenance instructions.
D. Sign Location Plan, showing location, type and total number of signs required.
E. Shop Drawings: Scaled for manufacture and fabrication of sign types. Identify materials, show joints, welds, anchorage, accessory items, mounting and finishes.

- H. Full size layout patterns for dimensional letters.
- I. Manufacturer's qualifications.
- J. Installer's qualifications.

1.5 DELIVERY AND STORAGE

- A. Deliver materials to job in manufacturer's original sealed containers with brand name marked thereon. Protect materials from damage.
- B. Package to prevent damage or deterioration during shipment, handling, storage and installation. Maintain protective covering in place and in good repair until removal is necessary.
- C. Deliver signs only when the site and mounting services are ready for installation work to proceed.
- D. Store products in dry condition inside enclosed facilities.

1.6 WARRANTY

- A. Construction Warranty: Comply with FAR clause 52.246-21, "Warranty of Construction".

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Architectural Manufacturers Association (AAMA):
 - 611-14Anodized Architectural Aluminum
 - 2603-13Voluntary Specification, Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions and Panels
- C. American National Standards Institute (ANSI):
 - A117.1-09Accessible and Usable Buildings and Facilities
- D. ASTM International (ASTM):
 - A36/A36M-14Carbon Structural Steel
 - A240/A240M-15Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
 - A666-10Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar
 - A1011/A1011M-14Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-

Strength Low-Alloy with Improved Formability,
and Ultra-High Strength

- B36/B36M-13Brass Plate, Sheet, Strip, and Rolled Bar
- B152/B152M-13Copper Sheet, Strip, Plate, and Rolled Bar
- B209-14Aluminum and Aluminum-Alloy Sheet and Plate
- B209M-14Aluminum and Aluminum-Alloy Sheet and Plate
(Metric)
- B221-14Aluminum and Aluminum-Alloy Extruded Bars,
Rods, Wire, Shapes, and Tubes
- B221M-13Aluminum and Aluminum-Alloy Extruded Bars,
Rods, Wire, Shapes, and Tubes (Metric)
- C1036-11 (R2012)Flat Glass
- C1048-12Heat-Treated Flat Glass-Kind HS, Kind FT Coated
and Uncoated Glass
- C1349-10Architectural Flat Glass Clad Polycarbonate
- D1003-13Test Method for Haze and Luminous Transmittance
of Transparent Plastics
- D4802-10Poly(Methyl Methacrylate) Acrylic Plastic Sheet
- D. Code of Federal Regulation (CFR):
 - 40 CFR 59Determination of Volatile Matter Content, Water
Content, Density Volume Solids, and Weight
Solids of Surface Coating
- E. Federal Specifications (Fed Spec):
 - MIL-PRF-8184FPlastic Sheet, Acrylic, Modified.
 - MIL-P-46144CPlastic Sheet, Polycarbonate
- F. National Fire Protection Association (NFPA):
 - 70-14National Electrical Code

PART 2 - PRODUCTS

2.1 SIGNAGE GENERAL

- A. Provide signs of type, size and design shown on the construction documents.
- B. Provide signs complete with lettering, framing and related components for a complete installation.
- C. Provide graphics items as completed units produced by a single manufacturer, including necessary mounting accessories, fittings and fastenings.

- D. Do not scale construction documents for dimensions. Verify dimensions and coordinate with field conditions. Notify Contracting Officer Representative (COR) of discrepancies or changes needed to satisfy the requirements of the construction documents.

2.3 INTERIOR SIGN MATERIALS

- A. Aluminum:
1. Sheet and Plate: ASTM B209M (B209).
 2. Extrusions and Tubing: ASTM B221M (B221).
- B. Cast Acrylic Sheet: MIL-PRF-8184F; Type II, class 1, Water white non-glare optically clear. Matt finish water white clear acrylic shall not be acceptable.
- C. Polycarbonate: MIL-P-46144C; Type I, class 1.
- D. Vinyl: Premium grade 0.1 mm (0.004 inch) thick machine cut, having a pressure sensitive adhesive and integral colors.
- E. Adhesives:
1. Adhesives for Field Application: Mildew-resistant, nonstaining adhesive for use with specific type of panels, sheets, or assemblies; and for substrate application; as recommended in writing by signage manufacturer.
 2. Adhesives to have VOC content of 50 g/L or less when calculated according to 40 CFR 59, (EPA Method 24).
- F. Typography: Comply with VA Signage Design Guide.
1. Type Style: Helvetica Medium and Helvetica Medium Condensed. Initial caps or all caps, as indicated on Drawing A151.
 2. Arrow: Comply with graphic standards in construction documents.
 3. Letter spacing: Comply with graphic standards in construction documents.
 4. Letter spacing: Comply with graphic standards in construction documents.
 5. Provide text, arrows, and symbols in size, colors, typefaces and letter spacing shown in construction documents. Text shall be a true, clean, accurate reproduction of typeface(s). Text shown in construction documents is for layout purposes only; final text for signs is listed in on Drawing A151.

2.4 EXTERIOR SIGN MATERIALS

- A. Aluminum Sheet and Plate: ASTM B209M (B209).

- B. Aluminum Extrusions: ASTM B221M (B221).
- C. Brass Sheet (Yellow Brass): ASTM B36/B36M.
- D. Bronze Plate: ASTM B36/B36M.
- E. Copper Sheet: ASTM B152/B152M.
- F. Steel Products: Structural steel products that conform to ASTM A36/A36M. Sheet and strip steel products that conform to ASTM A1011/A1011M.
- G. Stainless Steel Sheet: ASTM A240/A240M, stretcher leveled standard of flatness.
- H. Acrylic Sheet: ASTM D4802; category as standard with manufacturer for each sign. Provide type UVF.
- I. Fiberglass Sheet: Multiple laminations of glass fiber reinforced polyester resin with UV light stabilized, colorfast, nonfading, weather and stain resistant, colored polyester gel coat with manufacturer's standard finish.
- J. Polycarbonate Sheet: ASTM C1349, Appendix X1, Type II (coated, mar resistant, UV stabilized polycarbonate) with coating on both sides.
- K. Finish:
 - 1. Aluminum Finishes:
 - a. Clear Anodic Finish: AAMA 611.
 - b. Color Anodic Finish: AAMA 611.
 - c. Baked Enamel or Powder Coat Finish: AAMA 2603 with a minimum dry film thickness of 0.04 mm (1.5 mils).

2.5 INTERIOR SIGN TYPES

- A. Conform to the VA Signage Design Guide.
- B. Provide insert and frame component system.
- C. Component System Signs:
 - 1. Provide interior sign system as follows:
 - a. Interchangeable system that allows for changes of graphic components of the installed sign, without changing sign in its entirety.
 - b. Provide sign system comprised of following primary components:
 - 1) Rail Back: Horizontal rails, spaced to allow for uniform, modular sizing of sign types.

- 2) Rail Insert: Mount to back of Copy Panels to allow for attachment to Rail Back.
 - 3) Copy Panels: Fabricate of ABS phopolymer acrylic materials to allow for different graphic needs.
 - 4) End Caps: Interlock to Rail Back to enclose and secure changeable Copy Panels.
 - 5) Joiners and Accent Joiners: To connect separate Rail Backs together.
 - 6) Top Accent Bars: To provide decorative trim cap that encloses the top of sign.
- c. Provide rail back, rail insert and end caps in anodized extruded aluminum.
 - d. Provide signs in system that are convertible in the field to allow for enlargement from one (1) size to another in height and width through use of joiners or accent joiners, which connect rail back panels together blindly, providing a butt joint between copy panels. Connect accent joiners to rail backs with a visible 3 mm (1/8") horizontal rib, flush to the adjacent copy insert surfaces.
 - e. Provide sign configurations as indicated on construction documents that vary in width from 228 mm (9 inches) to 2032 mm (80 inches), and have height dimensions of 50 mm (2 inches), 76 mm (3 inches), 152 mm (6 inches), 228 mm (9 inches) and 305 mm (12 inches). Height that can be increased beyond 305 mm (12 inches), by repeating height module in full or in part.
2. Provide rail back functions as internal structural member of sign. Fabricate of 6063T5-extruded aluminum, anodized black.
 - a. Fabricate to accept an extruded aluminum or plastic insert on either side, depending upon sign type.
 - b. Provide components that are convertible in field to allow for connection to other rail back panels.
 - c. Provide mounting devices including wall mounting for screw-on applications , wall mounting with pressure sensitive tape and other mounting devices as needed.
 3. Provide rail insert functions as mounting device for copy panels on to the rail back. The rail insert mounts to the back of the copy

- panel with adhesive suitable for attaching particular copy insert material.
- a. Provide copy panels that slide or snap into the horizontal rail back.
4. Provide copy panels that accept various forms of copy and graphics, and attach to the rail back with the rail insert. Provide copy panels fabricated of ABS plastic with integral color or an acrylic lacquer finish.
- a. Provide copy panels that are interchangeable by sliding horizontally from either side of sign, and to other signs in system of equal or greater width or height.
 - b. Provide materials that are cleanable without use of special chemicals or cleaning solutions.
 - c. Copy Panel Materials.
 - 1) ABS Inserts: 2.3 mm (.090 inches) extruded ABS plastic core with .07 mm (.003 inches) acrylic cap bonded during extrusion/texturing process.
 - a) Pressure bonded to extruded rail insert with adhesive.
 - b) Background Color: Integral or painted in acrylic lacquer.
 - c) Finished: Texture pattern.
 - 2) Acrylic - 2 mm (.080 inches) non-glare acrylic.
 - a) Pressure bonded to extruded rail insert using adhesive.
 - b) Background Color: Painted in acrylic lacquer or acrylic enamel.
 - 3) Extruded 6063T5 aluminum with a black anodized finish insert holder with integral rail insert for connection with structural back panel to hold 0.76 mm (.030 inches) textured polycarbonate insert and a sliding tile which mounts in the inset holder and slides horizontally.
5. End Caps: Extruded using 6063T5 aluminum with a black anodized finish. End caps interlock with rail back with clips to form an integral unit, enclosing and securing the changeable copy panels, without requiring tools for assembly.
- a. Interchangeable to each end of sign and to other signs in signage system of equal height.
 - b. Provide mechanical fasteners that can be added to the end caps that will secure it to rail back to make sign tamper resistant.

6. Joiners: Extruded using 6063T5 aluminum with a black anodized finish. Rail joiners connect rail backs together blindly, providing a butt joint between copy inserts.
7. Accent Joiners: Extruded using 6063T5 aluminum with a mirror polished finish. Connect joiner and rail backs together with a visible 3 mm (.125 inches) horizontal rib, flush to the adjacent copy panel surfaces.
8. Top Accent Rail: Extruded rail using 6063T5 aluminum with a mirror polished finish that provides a 3.2 mm (.125 inches) high decorative trim cap. Cap butts flush to adjacent copy panel and encloses top of rail back and copy panel.
9. Typography:
 - a. Vinyl First Surface Copy (non-tactile): Applied vinyl copy.
 - b. Subsurface Copy Inserts: Textured 1 mm (.030 inches) clear polycarbonate face with subsurface applied vinyl copy.
 - 1) Spray face back with paint and laminated to extruded aluminum carrier insert.
 - c. Integral Tactile Copy Inserts: Phenolic photopolymer etched with 2.3 mm (.0937 inches) raised copy.
 - d. Silk-screened First Surface Copy (non-tactile): Injection molded or extruded ABS plastic insert with first surface applied enamel silk-screened copy.

D. Tactile Sign:

1. Tactile sign made from a material that provides for letters, numbers and Braille to be integral with sign. Photopolymer etched metal, sandblasted phenolic or embossed material. Do not apply letters, numbers and Braille with adhesive.
2. Numbers, letters and Braille to be raised 0.8 mm (1/32 inches) from the background surface. The draft of the letters, numbers and Braille to be tapered, vertical and clean.
3. Braille Dots: Conform with ANSI A117.1 for Braille position and layout; (a) Dot base diameter: 1.5 mm (.059 inches) (b) Inter-dot spacing: 2.3 mm (.090 inches) (c) Horizontal separation between cells: 6.0 mm (.241 inches) (d) Vertical separation between cells: 10.0 mm (.395 inches)

4. Paint assembly specified color. After painting, apply white or other specified color to surface of the numbers and letters. Apply protective clear coat sealant to entire sign.
 5. Finish: Eggshell, 11 to 19 degree on a 60 degree glossmeter.
- E. Provide cork or felt on bottom or mounting bracket when sign is mounted on counter or desk.
- F. For ceiling mounted signs, provide mounting hardware on the sign that allows for sign disconnection, removal, reinstallation, and reconnection.
- G. Dimensional Letters:
1. Provide dimensional letters that are mill or laser cut acrylic in size and thickness indicated in construction documents.
 2. Provide draft of letters perpendicular to letters face.
 3. Fabricate letters with square corners, such as where a letter stem and bar intersect.
 4. Paint letters with acrylic polyurethane.

2.6 FABRICATION

- A. Design interior signage components to allow for expansion and contraction for a minimum material temperature range of 38 degrees C (100 degrees F), without causing buckling, excessive opening of joints or over stressing of adhesives, welds and fasteners.
- B. Form work to required shapes and sizes, with true curve lines and angles. Provide necessary rebates, lugs and brackets for assembly of units. Provide concealed fasteners wherever possible.
- C. Shop fabricate so far as practicable. Fasten joints flush to conceal reinforcement, or weld joints, where thickness or section permits.
- D. Level and assemble contract surfaces of connected members so joints will be tight and practically unnoticeable, without applying filling compound.
- E. Signs: Fabricate with fine, even texture to be flat and sound.
1. Maintain lines and miters sharp, arises unbroken, profiles accurate and ornament true to pattern.
 2. Plane surfaces to be smooth, flat and without oil-canning, free of rack and twist.
 3. Maximum variation from plane of surface plus or minus 0.3 mm (0.015 inches). Restore texture to filed or cut areas.

- F. Finish extruded members to be free from extrusion marks. Fabricate square turns, sharp corners, and true curves.
- G. Finish hollow signs with matching material on all faces, tops, bottoms and ends. Mitere edge joints to give appearance of solid material.
- H. Do not manufacture signs until final sign message schedule and location review has been completed by the COR and forwarded to contractor.
- I. Drill holes for bolts and screws. Mill smooth exposed ends and edges with corners slightly rounded.
- J. Form joints exposed to weather to exclude water.
- K. Movable Parts, Including Hardware: Cleaned and adjusted to operate as designed without binding or deformation of members. Center doors and covers in opening or frame.
 - 1. Align contact surfaces fit tight and even without forcing or warping components.
- L. Pre-assemble items in shop to minimize field splicing and assembly. Disassemble units only as necessary for shipping and handling limitations. Clearly mark units for re-assembly and coordinated installation.
- M. Prime painted surfaces as required. Apply finish coating of paint for complete coverage with no light or thin applications allowing substrate or primer to show.
 - 1. Finish surface smooth, free of scratches, gouges, drips, bubbles, thickness variations, foreign matter and other imperfections.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Locate signs as shown on Drawing A151.
- B. Conform to the VA Signage Design Guide for installation requirements.
- C. At each sign location there are no utility lines behind each sign location that will be affected by installation of signs.
 - 1. Correct and repair damage done to utilities during installation of signs at no additional cost to Government.
- D. Provide inserts and anchoring devices which must be set in concrete or other material for installation of signs. Submit setting drawings, templates, instructions and directions for installation of anchorage devices, which may involve other trades.
- E. Refer to Sign Message Schedule for mounting method. Mount signs in proper alignment, level and plumb according to the Sign Location Plan

and the dimensions given on elevation and Sign Location Plans. When exact position, angle, height or location is not clear, contact COR for resolution.

- F. When signs are installed on glass, provide blank glass back to be placed on opposite side of glass exactly behind sign being installed. Provide blank glass back that is the same size as sign being installed.
- G. Touch up exposed fasteners and connecting hardware to match color and finish of surrounding surface.
- H. At completion of sign installation, clean exposed sign surfaces. Clean and repair adjoining or adjacent surfaces that became soiled or damaged as a result of installation of signs.

- - - END - - -

SECTION 10 26 00
WALL AND DOOR PROTECTION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies wall guards, handrail/wall guard combinations, corner guards and door/door frame protectors and sheet wall protection.

1.2 RELATED WORK

- A. Structural Steel Corner Guards: Section 05 50 00, METAL FABRICATIONS.
- B. Armor plates and kick plates not specified in this section: Section 08 71 00, DOOR HARDWARE.
- C. Color and texture of aluminum and resilient material: Section 09 06 00, SCHEDULE FOR FINISHES.

1.3 QUALITY ASSURANCE

- A. Manufacturer's Qualifications: Manufacturer with a minimum of three (3) years' experience in providing items of type specified.
 - 1. Obtain wall and door protection from single manufacturer.
- B. Installer's Qualifications: Installers are to have a minimum of three (3) years' experience in the installation of units required for this project.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings: Show design and installation details.
- C. Manufacturer's Literature and Data:
 - 1. Handrail/Wall Guard Combinations.
 - 2. Wall Guards.
 - 3. Corner Guards.
 - 4. Door/Door Frame Protectors.
 - 5. Sheet wall protection.
- D. Test Report: Showing that resilient material complies with specified fire and safety code requirements.
- E. Manufacturer's qualifications.
- F. Installer's qualifications.
- G. Manufacturer's warranty.

1.5 DELIVERY AND STORAGE

- A. Deliver materials to the site in original sealed packages or containers marked with the name and brand, or trademark of the manufacturer.
- B. Protect from damage from handling and construction operations before, during and after installation.
- C. Store in a dry environment of approximately 21 degrees C (70 degrees F) for at least 48 hours prior to installation.

1.6 WARRANTY

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their wall and door protection for a minimum of five (5) years from date of installation and final acceptance by the Government. Submit manufacturer warranty.

1.7 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
- B. ASTM International (ASTM):
 - A240/A240M-14Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and For General Applications
 - B221-14Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes
 - B221M-13Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Shapes, and Tubes (Metric)
 - D256-10Impact Resistance of Plastics
 - D635-10Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position
 - E84-14Surface Burning Characteristics of Building Materials
- C. Aluminum Association (AA):
 - DAF 45-09Designation System for Aluminum Finishes
- D. American Architectural Manufacturers Association (AAMA):
 - 611-14Anodized Architectural Aluminum
- E. Code of Federal Regulation (CFR):

- 40 CFR 59Determination of Volatile Matter Content, Water
Content, Density Volume Solids, and Weight
Solids of Surface Coating
- F. The National Association of Architectural Metal Manufacturers (NAAMM):
AMP 500-06Metal Finishes Manual
- G. National Fire Protection Association (NFPA):
80-13Standard for Fire Doors and Windows
- H. SAE International (SAE):
J 1545-05 (R2014)Instrumental Color Difference Measurement for
Exterior Finishes.
- I. Underwriters Laboratories Inc. (UL):
Annual IssueBuilding Materials Directory

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Stainless Steel: A240/A240M, Type 304.
- B. Aluminum Extruded: ASTM B221M (B221), Alloy 6063, Temper T5 or T6.
- C. Resilient Material:
1. Provide resilient material consisting of high impact resistant extruded acrylic vinyl, polyvinyl chloride, or injection molded thermal plastic conforming to the following:
 - a. Minimum impact resistance of 960.8 N-m/m (18 ft.-lbs./sq. inch) when tested in accordance with ASTM D256 (Izod impact, ft.-lbs. per inch notched).
 - b. Class 1 fire rating when tested in accordance with ASTM E84, having a maximum flame spread of 25 and a smoke developed rating of 450 or less.
 - c. Rated self-extinguishing when tested in accordance with ASTM D635.
 - d. Provide material labeled and tested by Underwriters Laboratories or other approved independent testing laboratory.
 - e. Provide resilient material for protection on fire rated doors and frames assemblies that is listed by the testing laboratory performing the tests.
 - f. Provide resilient material installed on fire rated wood/steel door and frame assemblies that have been tested on similar type

- assemblies. Test results of material tested on any other combination of door and frame assembly are not acceptable.
- g. Provide integral color with colored components matched in accordance with SAE J 1545 to within plus or minus 1.0 on the CIE-LCH scales.

2.2 CORNER GUARDS

- A. Resilient, Shock-Absorbing Corner Guards: Flush mounted type.
1. Snap-on corner guard formed from resilient material, minimum 1.98 mm (0.078-inch) thick, free floating on a continuous 1.52 mm (0.060-inch) thick extruded aluminum retainer. Retainer used for flush mounted type to act as a stop for adjacent wall finish material. Provide appropriate mounting hardware, cushions and base plates as required.
 2. Profile: Minimum 50 mm (2 inch) long leg and 6 mm (1/4 inch)
 3. Height: As indicated on drawings.
 4. Retainer Clips: Provide manufacturer's standard impact-absorbing clips.
 5. Provide factory fabricated end closure caps at top and bottom of surface mounted corner guards.
 6. Flush mounted corner guards installed on any fire rated wall to be installed in a manner that maintains the fire rating of the wall. Provide fire test of proposed corner guard system to verify compliance.
 - a. Where insulating materials are an integral part of the corner guard system, provide insulating materials furnished by the manufacturer of the corner guard system.

2.3 WALL GUARDS AND HANDRAILS

- A. Resilient Wall Guards and Handrails/Crash Rail:
1. Handrail/Crash rail Combination:
 - a. Snap-on covers of resilient material, minimum 2 mm (0.078-inch) thick.
 - b. Free-floating on a continuous, extruded aluminum retainer, minimum 1.82 mm (0.072-inch) thick.
 - c. Anchor to wall at maximum 762 mm (30 inches) on center.
 - d. Basis of Design: Model HRB-10CN by CS Acrovyn
 2. Wall Guards:

- a. Snap-on covers of resilient material, minimum 2.54 mm (0.100-inch) thick. Free-floated over a continuous extruded aluminum retainer, minimum 2.03 mm (0.080-inch) thick anchored to wall at maximum 610 mm (24 inches) on center.
3. Provide handrails and wall guards with prefabricated end closure caps, inside and outside corners, concealed splices, cushions, mounting hardware and other accessories as required. End caps and corners to be field adjustable to assure close alignment with handrails and wall guards. Screw or bolt closure caps to aluminum retainer in a concealed manner.

2.4 DOOR AND DOOR FRAME PROTECTION

- A. Fabricate door and door frame protection items from vinyl acrylic or polyvinyl chloride resilient material, minimum 1.52 mm (0.060-inch) thick, for doors and 0.89 mm (0.035-inch) thick for door frames.
- B. Provide adhesive as recommended by resilient material manufacturer.

2.5 HIGH IMPACT SHEET WALL PROTECTION

- A. Provide sheet wall covering consisting of high impact rigid acrylic vinyl or polyvinyl chloride resilient material.
- B. Panel sizes to be as indicated on drawings.
- C. Submit fire rating and extinguishing test results for resilient material.
- D. Submit statements attesting that the items comply with specified fire and safety code requirements.
- E. Wall covering thickness to be .060 (1.52mm)
- F. Provide adhesive as recommended by the wall covering manufacturer. Provide adhesive with VOC content of 250 g/L or less when calculated according to 40 CFR 59, (EPA Method 24).

2.6 FASTENERS AND ANCHORS

- A. Provide fasteners and anchors as required for each specific type of installation.
- B. Where type, size, spacing or method of fastening is not shown or specified in construction documents, submit shop drawings showing proposed installation details.

2.7 FINISH

- B. Aluminum: In accordance with AA DAF-45.

1. Exposed aluminum: AAMA 611 AA-M12C22A31 chemically etched medium matte, with clear anodic coating, Class II Architectural, .01 mm (0.4 mil) thick.
2. Concealed aluminum: Mill finish as fabricated, uniform in color and free from surface blemishes.
- C. Stainless Steel: In accordance with NAAMM AMP 500 finish Number 4.
- D. Resilient Material: Embossed textures and color in accordance with SAE J1545.

PART 3 - INSTALLATION

3.1 RESILIENT CORNER GUARDS

- A. Install corner guards on walls in accordance with manufacturer's instructions.

3.2 STAINLESS STEEL CORNER GUARDS

- A. Mount guards on external corners of interior walls, partitions and columns as shown on construction documents.
- B. Where corner guards are installed on gypsum board, clean surface and anchor guards with a neoprene solvent-type contact adhesive specifically manufactured for use on gypsum board construction. Remove excess adhesive from around edge of guard and allow curing undisturbed for 24 hours.

3.3 RESILIENT WALL GUARD HANDRAIL COMBINATION

- A. Secure guards to walls with mounting cushions brackets and fasteners in accordance with manufacturer's details and instructions.

3.4 DOOR, DOOR FRAME PROTECTION AND HIGH IMPACT WALL COVERING

- A. Surfaces to receive protection to be clean, smooth and free of obstructions.
- B. Install protectors after frames are in place but preceding installation of doors in accordance with approved shop drawings and manufacturer's specific instructions.
- C. Apply with adhesive in controlled environment according to manufacturer's recommendations.
- D. Protection installed on fire rated doors and frames to be installed according to NFPA 80 and installation procedures listed in UL Building Materials Directory; or, equal listing by other approved independent testing laboratory establishing the procedures.

- - - E N D - - -

SECTION 10 44 13
FIRE EXTINGUISHER CABINETS

PART 1 - GENERAL

1.1 DESCRIPTION

This section covers recessed fire extinguisher cabinets.

1.2 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Fire extinguisher cabinet including installation instruction and rough opening required.

1.3 APPLICATION PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Testing and Materials (ASTM):
 - D4802-15Poly (Methyl Methacrylate) Acrylic Plastic Sheet

PART 2 - PRODUCTS

2.1 FIRE EXTINGUISHER CABINET

Recessed type with flat trim of size and design shown.

2.2 FABRICATION

- A. Form body of cabinet from 0.9 mm (0.0359 inch) thick sheet steel.
- B. Fabricate door and trim from 1.2 mm (0.0478 inch) thick sheet steel with all face joints fully welded and ground smooth.
 - 1. Glaze doors with 6 mm (1/4 inch) thick ASTM D4802, clear acrylic sheet, Category B-1, Finish 1.
 - 2. Design doors to open 180 degrees.
 - 3. Provide continuous hinge, pull handle, and adjustable roller catch.

2.3 FINISH

- A. Finish interior of cabinet body with baked-on semigloss white enamel.
- B. Finish door, frame with manufacturer's standard baked-on prime coat suitable for field painting.

PART 3 - EXECUTION

- A. Install fire extinguisher cabinets in prepared openings and secure in accordance with manufacturer's instructions.
- B. Install cabinet so that the extinguisher height within meets the requirements of NFPA 10

- - - E N D - - -

SECTION 10 74 13

EXTERIOR CLOCKS

PART 1 GENERAL

1.1 SUMMARY

A. This section includes:

1. Tower Clock Components
2. Remote Control System

B. Related Sections

1. Division 26 - Electrical: All raceways, junction boxes, and conduit wire required for a complete operational clock system

1.2 PERFORMANCE REQUIREMENTS

Structural Performance: Design, fabricate and install exterior clocks to withstand loads from gravity, wind, seismic and structural movement, including thermally induced movement, according to ASCE/SEI 7 and to resist without failure, other conditions of in-service use, including exposure to weather.

1.3 SUBMITTALS

A. Product Data

1. Provide manufacturer's data sheets for all clock equipment and related devices
2. Include material descriptions, hardware, fittings and mounting accessories

B. Shop Drawings

1. Show materials, fabrication, full dimensions on clock components, face/hand/digit, case, mounting heights, blocking requirements, finish details, clearances and installation details
2. Provide coordination with electrical to include:
 - a) Wiring diagrams
 - b) Location of master clock controller
 - c) Responsibility of electrical contractor
 - d) Responsibility of clock installer

C. Operation & Maintenance Data

1. Provide instruction manual for master clock controller
2. Provide complete Operation and Maintenance manuals as per close-out requirements

D. Samples, if requested

1. Translucent dial material, 6" square
2. Dial digit, full size, in required finish
3. Metal for dial overlay, if applicable, in required finish, 6" digit
4. Hand, 12" minimum, in required finish and fabrication
5. Color chip samples of finishes

1.4 QUALITY ASSURANCE

A. Manufacturer Qualifications: company specializing in manufacturing products specified in this section with no less than 10 years of documented experience

B. Installer Qualifications: Company specializing in performing the work of this section and approved by clock manufacturer

1.5 PROJECT CONDITIONS

A. Field Measurements: Verify actual locations of walls and other construction contiguous with exterior clocks by field measurements before fabrication and indicate on shop drawings

B. Environmental Limitations: Do not deliver or install exterior clocks until wet work on facades and inside tower is complete and dry

C. Weather Limitations: Proceed with installation only when existing and forecasted weather conditions permit installation of exterior clocks to be performed w/o damage to components or hazardous to installer

1.6 WARRANTY

A. Manufacturer's standard warranty for repair or replacement of components which fail in materials or workmanship within specified warranty period to include structural failures, faulty hardware operation, and deterioration of metals, finishes, and other materials beyond normal weathering

B. Provide standard three-year warranty for clock and controller.

PART 2 PRODUCTS

2.1 MANUFACTURERS

A. National Time & Signal. Series 300, Model 360

2.2 EXTERIOR CLOCKS

A. Furnish complete clock system consisting of fully enclosed, case clock, and 1 remote fully automatic control system

B. Tower Clock Components

1. Clock Case:

- a) As selected by Architect, fabricated all-aluminum, .063" min thickness, fully-enclosed case, nominal size 60 inch diameter, built with an additional 1-1/2 mounting flange to lip-over rough opening (to be 1/4" larger (min) than case size).
- b) Finish: Painted with exterior sign-grade acrylic enamel paint. Interior of case shall be painted/powder coated white for optimum reflectivity.
- c) Case shall be serviceable either through the front or entirely through the back. If through the back, there shall be enough room accommodate complete access for removal of all parts, including the dial. If through the front, there must be provisions for easy crane/bucket truck access.
- d) Case shall contain IP 66 minimum rated LED modules and power supply, in color temperature 5000k. LED modules and power supplies shall be of a brand found in national sign supply distributors for ease of eventual replacement. LED spacing shall be laid-out to provide even illumination with no hot or dark spots.
- e) Case shall provide adequate water egress, and ventilation
- f) Clock crystal, in sizes 1/8" minimum thickness, tempered glass.

2. Clock Dial:
 - a) Number style: Analog numbers
 - b) Material
 1. Flat .177 thick translucent white sign-grade (UV Protected) polycarbonate
 2. Specify numbers:
 - a. ¼" thick plate aluminum numbers, powder coated and through-bolted to polycarbonate
 3. Full metal dial overlay, backed with flat .177 thick translucent white sign-grade (UV Protected) polycarbonate
 - c) Clock dial shall be free to expand/contract with temperature, secured within a retainer to allow for such movement
3. Clock Hands:
 - a) Fabricated .063 aluminum, balanced and rated for weather & exposure
 - b) Illuminated, halo-lit: Fabricated .063 aluminum or #4 brushed stainless steel with 1-1/2" returns, fully enclosed translucent white polycarbonate backs with IP 66 rated LED's
 - c) Finish: Architectural grade powder coated color
4. Clock Movement:
 - a) Shall be rated by movement manufacturer for dial size
 - b) 24v powered
 - c) Rings and brushes for power transmission to clock hands in the case of illuminated skeletal type of clocks
5. Fasteners:
 - a) All fasteners to be of Stainless Steel throughout clock case
 - b) All fasteners to be hidden from ground view
6. Automatic Master Clock controller:
 - a) Internal quartz time-base
 - b) 7-year lithium battery back-up memory
 - c) Available GPS synchronization
 - d) Automatically reset the display clock(s) after power outages and Daylight Saving
 - e) Programmable Daylight-Saving parameters
 - f) 2-line LCD display
 - g) 24v bi-polar output impulse
 - h) Mounted in a NEMA wall-mounted enclosure, furnished with a 7' cord and UL Listed 120v/24v AC Class 2 50VA plug-in transformer

PART 3 EXECUTION

3.1 EXAMINATION

- A. Inspect substrates, supporting items and conditions to ensure they are ready to receive the clocks prior to installation.
- B. Examine areas and conditions with installer present for compliance with requirements for supporting members, blocking, inserts, installation tolerances, clearances, lighting and other conditions affecting exterior clocks installation or operations
- C. Proceed with installation if conditions meet requirements

3.2 INSTALLATION

- A. Install each item at locations indicated on drawings, as detailed and in accordance with manufacture's written instructions and recommendations. Provide accessories necessary for complete installation
- B. Install exterior clocks after other finishing operations, including masonry cleaning, have been completed
- C. Install exterior clocks securely connected to supports, and in proper relation to adjacent construction. Use mounting methods of types described and in compliance with approved shop drawings and fabricators written instructions
- D. Anchoring to in-place constructions: Use anchors, fasteners, fittings, hardware and installation accessories for securing exterior clocks to the clock tower structure, properly transferring load to in-place construction
- E. Install master clock controller in a convenient, accessible, secure, dry location
- F. Connect clocks to master clock controller and electrical system in accordance with approved shop drawings
- G. Seal all perimeter openings with glazing sealant or caulking
- H. Test and calibrate entire clock system, verify GPS signal strength and accuracy with NIST

3.3 DEMONSTRATION AND TRAINING

- A. Demonstrate functionality of clock system, operation and maintenance of exterior clocks and master clock controller to Owner's designated representative

END OF SECTION

**SECTION 12 32 00
MANUFACTURED WOOD CASEWORK**

PART 1 - GENERAL

1.1 DESCRIPTION:

A. This section specifies plastic laminate casework as detailed on the construction documents, including related components and accessories required to form integral units. Wood casework items shown on the construction documents, but not specified below are to be included as part of the work under this section, and applicable portions of the specification are to apply to these items.

1.2 RELATED WORK:

- B. Sealants: Section 07 92 00, JOINT SEALANTS.
- C. Color of Casework Finish: Section 09 06 00, SCHEDULE OF FINISHES.
- D. Resilient Base: Section 09 65 13, RESILIENT BASE AND ACCESSORIES.
- E. Backing Plates for Wall Mounted Casework: Section 09 22 16, NON-STRUCTURAL METAL FRAMING.
- F. Countertop Construction and Materials and Items Installed in Countertops: Section 12 36 00, COUNTERTOPS.

1.3 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Locks for doors and drawers.
 - 2. Adhesive cements.
 - 3. Casework hardware.
- C. Samples:
 - 1. Plastic laminate.
- D. Shop Drawings (1/2 full size):
 - 1. Each casework type, showing details of construction, including materials, hardware and accessories.
 - 2. Fastenings and method of installation.
- E. Certification:
 - 1. Manufacturer's qualifications specified.
 - 2. Installer's qualifications specified.

1.4 QUALITY ASSURANCE:

- A. Approval by COR is required of manufacturer and installer based upon certification of qualifications specified.
- B. Manufacturer's qualifications:
 - 1. Manufacturer is regularly engaged in design and manufacture of modular plastic laminate casework, casework components and accessories of scope and type similar to indicated requirements for a period of not less than five (5) years.
 - 2. Manufacturer has successfully completed at least three (3) projects of scope and type similar to indicated requirements.
 - 3. Submit manufacturer's qualifications and list of projects, including owner contact information.
- C. Installer Qualifications:
 - 1. Installer has completed at least three (3) projects in last five (5) years in which these products were installed.
 - 2. Submit installer qualifications.

1.5 WARRANTY:

- A. Construction Warranty: Comply with FAR clause 52.246-21 "Warranty of Construction".
- B. Manufacturer Warranty: Manufacturer shall warranty their wood casework for a minimum of five (5) years from date of installation and final acceptance by the Government. Submit manufacturer warranty.

1.6 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. ASTM International (ASTM):
 - A240/A240M-14Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
 - A1008/A1008M-13Steel, Sheet, Cold-Rolled, Carbon, Structural, High Strength Low Alloy
 - C1036-11E1 (R2012)Flat Glass
- C. Builders Hardware Manufacturers Association (BHMA):
 - A156.1-13Butts and Hinges
 - A156.9-10Cabinet Hardware
 - A156.5-14Auxiliary Locks and Associated Products

- A156.11-14Cabinet Locks
- D. Composite Panel Association (CPA):
 - A208.1-09Particleboard
 - A208.2-09Medium Density Fiberboard (MDF) for Interior Applications
- E. U.S. Department of Commerce Product Standards (Prod. Std):
 - PS 1-09Construction and Industrial Plywood
- F. Hardwood, Plywood and Veneer Association (HPVA):
 - HP-1-09Hardwood and Decorative Plywood
- G. Architectural Woodwork Institute (AWI):
 - Architectural Woodwork Standards, Edition 2 Certification Program - 2014
- H. American Society of Mechanical Engineers (ASME):
 - A112.18.1-12Plumbing Fixture Fittings
- I. National Electrical Manufacturers Association (NEMA):
 - LD 3-05High Pressure Decorative Laminates
- J. Underwriters Laboratories Inc. (UL):
 - 437-08 (R2013)Key Locks
- K. Scientific Equipment and Furniture Association (SEFA):
 - 2.3-10Installation of Scientific Laboratory Furniture and Equipment

PART 2 - PRODUCTS

2.1 PLASTIC LAMINATE:

- A. NEMA LD 3.
- B. Exposed decorative surfaces, both sides of cabinet doors, and for items having plastic laminate finish. Type HPL.
- C. Cabinet Interiors Including Shelving: Both of following options to comply with NEMA LD 3 as a minimum.
 - 1. Plastic laminate clad plywood or particleboard, MDF (excluding shelves).
 - 2. Thermafoil.
- D. Backing sheet on bottom of plastic laminate covered wood tops. Backer Type BKL.
- E. Post Forming Fabrication, Decorative Surface: Post forming Type HGP.

2.2 PLYWOOD, SOFTWOOD:

- A. Prod. Std. PS1, five (5) ply construction from 13 mm to 28 mm (1/2 inch to 1-1/8 inch) thickness, and seven (7) ply for 31 mm (1 1/4 inch) thickness.

2.3 MEDIUM DENSITY FIBERBOARD (MDF):

- A. Fully waterproof bond conforming to CPA A208.1 and CPA A208.2.

2.4 HARDWARE:

A. Cabinet Locks:

1. Provide where locks are indicated on construction documents.
2. Locked pair of hinged door over 915 mm (36 inches) high:
 - a. ANSI/BHMA A156.5, key one side.
 - b. On active leaf use three (3) point locking device, consisting of two (2) steel rods and lever controlled cam at lock, to operate by lever having lock cylinder housed therein.
 - c. On inactive leaf provide dummy lever of same design.
 - d. Provide keeper holes for locking device rods and cam.
3. Door and Drawer: ANSI/BHMA A156.11 cam locks. Provide one (1) type for each condition as follows:
 - a. Drawer and Hinged Door up to 915 mm (36 inches) high: E07261.
 - b. Drawer and Hinged Door: Pin-tumbler, cylinder type lock with not less than four (4) pins or a UL 437 rated wafer lock with brass working parts and case.
 - c. Sliding Door: E07161.
4. Key locks differently for each type casework and master key for each service, for Exam and Patient rooms.
 - a. Key drug locker inner door different from outer door.
 - b. Furnish two (2) keys per lock.
 - c. Furnish six (6) master keys per service or Nursing Unit.
5. Marking of Locks and Keys:
 - a. Name of manufacturer, or trademark which can readily be identified legibly marked on each lock and key change number marked on exposed face of lock.
 - b. Key change numbers stamped on keys.
 - c. Key change numbers to provide sufficient information for manufacturer to replace key.

B. Hinged Doors:

1. Provide doors 915 mm (36 inches) and more in height with three (3) hinges and doors less than 915 mm (36 inches) in height is to have two (2) hinges. Each door is to close against two (2) rubber bumpers.
 2. Concealed Hinges: BHMA A156.9, Type B01602, 135 degrees of opening, self-closing.
 4. Fasteners: Provide full thread wood screws to fasten hinge leaves to door and cabinet frame. Finish screws to match finish of hinges.
- C. Door Catches:
1. Magnetic type, fabricated with metal housing.
 2. Provide one (1) catch for cabinet doors 1220 mm (48 inches) high and under, and two (2) for doors over 1220 mm (48 inches) high.
- D. Drawer and Door Pulls:
1. Doors and drawers to have flush pulls, fabricated of either chromium-plated brass, chromium plated steel, stainless steel, or anodized aluminum. Drawer and door pulls to be of a design that can be operated with a force of 22.2 N (5 pounds) or less, with one (1) hand and not require tight grasping, pinching or twisting of the wrist.
- E. Drawer Slides:
1. Full extension steel slides with nylon ball-bearing rollers.
 2. Slides to have positive stop.
 3. Equip drawers with rubber bumpers.
- F. Shelf Standards (Except For Fixed Shelves):
1. Bright zinc-plated steel for recessed mounting with screws, 16 mm (5/8 inch) wide by 5 mm (3/16 inch) high providing 13 mm (1/2 inch) adjustment, complete with shelf supports.

2.5 MANUFACTURED PRODUCTS:

- A. When two (2) or more units are required, use products of one (1) manufacturer.
- B. Manufacturer of casework assemblies is to assume complete responsibility for the final assembled unit.
- C. Provide products of a single manufacturer for parts which are alike.

2.6 FABRICATION:

- A. Casework to be of the flush overlay design and, except as otherwise specified, be of Premium Grade construction and of component thickness in conformance with AWI Quality Standards.
- B. Fabricate casework of plastic laminated covered plywood or particleboard factory finished wood veneer as follows:
 - 1. Where shown, doors drawers shelves all semi-concealed surfaces to be plastic laminated.
 - 2. Horizontal and vertical reveals between doors and drawer for reveal overlay design to be 19 mm (3/4 inch) unless otherwise shown.
- C. Provide 1.2 mm (18 gage) sheet steel sloping tops for casework where shown on construction drawings. Fasten sloping tops with oval-head screws inserted from interior. Exposed ends of sloping tops to have flush closures fastened as recommended by manufacturer.
- D. Support Members for Tops of Tables and Countertops:
 - 1. Construct as detailed on construction documents.
 - 2. Provide miscellaneous steel members and anchor as shown on construction drawings.
- E. Legs For Counters:
 - 1. Fabricate legs for counters of 1.6 mm (0.0635 inch) thick, 38 mm (1-1/2 inch) square tubular stainless steel.
 - 2. Secure legs to counter tops and provide legs at bottom with shoes not less than 25 mm (1 inch) in height.
 - 3. Fabricate shoes of stainless steel, aluminum or chromium plated brass.

2.7 PRODUCTS OF OTHER COMPONENTS DIRECTLY RELATED TO CASEWORK:

- A. Refer to Section 07 92 00, JOINT SEALANTS for work related to sealants used in conjunction with joints of countertops, casework systems, and adjacent materials.
- B. Refer to Section 09 65 13, RESILIENT BASE AND ACCESSORIES for work related to rubber base adhered to casework systems.
- C. Refer to Section 09 22 16, NON-STRUCTURAL METAL FRAMING for backing plates used in conjunction with wall assemblies for the attachment of casework systems.

- D. Refer to Section 12 36 11, COUNTERTOPS for work related to plastic laminate, acid-resistant plastic laminate, metal, molded resin, wood, and methyl methacrylic polymer countertops and/or shelving used in conjunction with casework systems. When countertop materials are provided by the casework manufacturer, they are to include the following features:
1. Capable of being suspended from vertical support rails or horizontal wall strips or service modules.
 2. Provided with rounded corners and impact resistant material on exposed edges.
 3. Capable of being easily relocated and installed without tools.
 4. Capable of being suspended and easily changed under counter mounted storage units.
 5. Provide leveling adjustment capability so units can be brought into a level position.
 6. Secured using fasteners. Show detail on shop drawings.
- E. Refer to Section 12 36 11, COUNTERTOPS for work related to and integral with countertop systems such as pegboards, funnel and graduate racks.
- F. Refer to Division 22, PLUMBING for the following work related to casework systems:
1. Sinks, faucets and other plumbing service fixtures, venting, and piping systems.
 2. Compressed air, gas, vacuum and piping systems.
- G. Refer to Division 26, ELECTRICAL for the following work related to casework systems:
1. Connections and wiring devices.
 2. Connections and lighting fixtures except when factory installed by the manufacturer.

PART 3 - EXECUTION

3.1 COORDINATION:

- A. Begin only after work of other trades is complete, including wall and floor finish completed, ceilings installed, light fixtures and diffusers installed and connected and area free of trash and debris.
- B. Verify location and size of mechanical and electrical services as required and perform cutting of components of work installed by other trades.

- C. Verify reinforcement of walls and partitions for support and anchorage of casework.
- D. Coordinate with other Divisions and Sections of the specification for work related to installation of casework systems to avoid interference and completion of service connections.

3.2 INSTALLATION:

- A. Install casework in accordance with manufacturer's written instructions and per SEFA 2.3 recommendations .
 - 1. Install in available space; arranged for safe and convenient operation and maintenance.
 - 2. Align cabinets for flush joints except where shown otherwise.
 - 3. Install with bottom of wall cabinets in alignment and tops of base cabinets aligned level, plumb, true, and straight to a tolerance of 3.2 mm in 2438 mm (1/8 inch in 96 inches).
 - 4. Install corner cabinets with hinges on corner side with filler or spacers sufficient to allow opening of drawers.
- B. Support Rails:
 - 1. Install true to horizontal at heights shown on construction documents; maximum tolerance for uneven floors is plus or minus 13 mm (1/2 inch).
 - 2. Shim as necessary to accommodate variations in wall surface not exceeding 5 mm (3/16 inch) at fastener.
- C. Wall Strips:
 - 1. Install true to vertical and spaced as shown on construction documents.
 - 2. Align slots to assure that hanging units will be level.
- D. Plug Buttons:
 - 1. Install plug buttons in predrilled or prepunched perforations not used.
 - 2. Use chromium plate plug buttons or buttons finish to match adjacent surfaces.
- E. Seal junctures of casework systems with mildew-resistant silicone sealants as specified in Section 07 92 00, JOINT SEALANTS.

3.3. CLOSURES AND FILLER PLATES:

- A. Close openings larger than 6 mm (1/4 inch) wide between cabinets and adjacent walls with flat, steel closure strips, scribed to required contours, or machined formed steel fillers with returns, and secured

with sheet metal screws to tubular or channel members of units, or bolts where exposed on inside.

- B. Where ceilings interfere with installation of sloping tops, omit sloping tops and provide flat steel filler plates.
- C. Secure filler plates to casework top members, unless shown otherwise on construction documents.
- D. Secure filler plates more than 152 mm (6 inches) in width top edge to a continuous 25 x 25 mm (1 x 1 inch) 0.889 mm (1/16 inch) thick steel formed steel angle with screws.
- E. Anchor angle to ceiling with toggle bolts.
- F. Install closure strips at exposed ends of pipe space and offset opening into concealed space.
- G. Finish closure strips and fillers with same finishes as cabinets.

3.4 FASTENINGS AND ANCHORAGE:

- A. Do not anchor to wood ground strips.
- B. Provide hat shape metal spacers where fasteners span gaps or spaces.
- C. Use 6 mm (1/4 inch) diameter toggle or expansion bolts, or other appropriate size and type fastening device for securing casework to walls or floor. Use expansion bolts shields having holding power beyond tensile and shear strength of bolt and breaking strength of bolt head.
- D. Use 6 mm (1/4 inch) diameter hex bolts for securing cabinets together.
- E. Use 6 mm (1/4 inch) by minimum 38 mm (1-1/2 inch) length lag bolt anchorage to wood blocking for concealed fasteners.
- F. Use not less than No. 12 or 14 wood screws with not less than 38 mm (1-1/2 inch) penetration into wood blocking.
- G. Space fastening devices 305 mm (12 inches) on center with minimum of three (3) fasteners in 915 or 1220 mm (3 or 4 foot) unit width.
- H. Anchor floor mounted cabinets with a minimum of four (4) bolts through corner gussets. Anchor bolts may be combined with or separate from leveling device.
- I. Secure cabinets in alignment with hex bolts or other internal fastener devices removable from interior of cabinets without special tools. Do not use fastener devices which require removal of tops for access.
- J. Where units abut end to end, anchor together at top and bottom of sides at front and back. Where units are back to back, anchor backs together at corners with hex bolts placed inconspicuously inside casework.

K. Where type, size, or spacing of fastenings is not shown on construction documents or specified, show on shop drawings proposed fastenings and method of installation.

3.5 ADJUSTMENTS:

- A. Adjust equipment to insure proper alignment and operation.
- B. Replace or repair damaged or improperly operating materials, components or equipment.

3.6 CLEANING:

- A. Immediately following installation, clean each item, removing finger marks, soil and foreign matter.
- B. Remove from job site trash, debris and packing materials.
- C. Leave installed areas clean of dust and debris.

3.7 INSTRUCTIONS:

- A. Provide operational and cleaning manuals and verbal instructions in accordance with Article INSTRUCTIONS, SECTION 01 00 00, GENERAL REQUIREMENTS.
- B. Provide in service training both prior to and after facility opening. Coordinate in service activities with COR.
- C. Commencing at least seven (7) days prior to opening of facility, provide one (1) four (4) hour day of on-site orientation and technical instruction on use and cleaning procedures application to products and systems specified herein.

- - - E N D - - -

**SECTION 12 36 00
COUNTERTOPS**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies casework countertops with integral accessories.
- B. Integral accessories include:
 - 1. Sinks with traps and drains.
 - 2. Eye and Face Wash Units.

1.2 RELATED WORK

- A. Color and patterns of plastic laminate: Refer to Drawing A-131 FINISH LEGEND
- B. DIVISION 22, PLUMBING.
- C. DIVISION 26, ELECTRICAL.

1.3 SUBMITTALS

- A. Submit in accordance with SECTION 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Shop Drawings
 - 1. Show dimensions of section and method of assembly.
 - 2. Show details of construction at a scale of ½ inch to a foot.
- C. Samples:
 - 1. 150 mm (6 inch) square samples each top.
 - 2. Front edge, back splash, end splash and core with surface material and booking.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. American Hardboard Association (AHA):
 - A135.4-95Basic Hardboard
- C. Composite Panel Association (CPA):
 - A208.1-09Particleboard
- D. American Society of Mechanical Engineers (ASME):
 - A112.18.1-12Plumbing Supply Fittings
 - A112.1.2-12Air Gaps in Plumbing System

A112.19.3-08(R2004)Stainless Steel Plumbing Fixtures (Designed for Residential Use)

E. American Society for Testing and Materials (ASTM):

A167-99 (R2009)Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip

A1008-10Steel, Sheet, Cold-Rolled, Carbon, Structural, High Strength, Low Alloy

D256-10Pendulum Impact Resistance of Plastic

D570-98(R2005)Water Absorption of Plastics

D638-10Tensile Properties of Plastics

D785-08Rockwell Hardness of Plastics and Electrical Insulating Materials

D790-10Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials

D4690-99(2005)Urea-Formaldehyde Resin Adhesives

F. Federal Specifications (FS):

A-A-1936Adhesive, Contact, Neoprene Rubber

G. U.S. Department of Commerce, Product Standards (PS):

PS 1-95Construction and Industrial Plywood

H. National Electrical Manufacturers Association (NEMA):

LD 3-05High Pressure Decorative Laminates

PART 2 - PRODUCTS

2.1 MATERIALS

A. Solid Polymer Material:

1. Filled Methyl Methacrylic Polymer.

2. Performance properties required:

Property	Result	Test
Elongation	0.3% min.	ASTM D638
Hardness	90 Rockwell M	ASTM D785
Gloss (60° Gordon)	5-20	NEMA LD3.1
Color stability	No change	NEMA LD3 except 200 hour
Abrasion resistance	No loss of pattern Max wear depth 0.0762 mm (0.003 in) - 10000 cycles	NEMA LD3

Property	Result	Test
Water absorption weight (5 max)	24 hours 0.9	ASTM D-570
Izod impact	14 N·m/m (0.25 ft-lb/in)	ASTM D256 (Method A)
Impact resistance	No fracture	NEMA LD-3 900 mm (36") drop 1 kg (2 lb.) ball
Boiling water surface resistance	No visible change	NEMA LD3
High temperature resistance	Slight surface dulling	NEMA LD3

3. Cast into sheet form and bowl form.
4. Color throughout with subtle veining through thickness.
5. Joint adhesive and sealer: Manufacturers silicone adhesive and sealant for joining methyl methacrylic polymer sheet.
6. Bio-based products will be preferred.

L. Laminar Flow Control Device

1. Smooth bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
2. Flow Control Restrictor:
 - a. Capable of restricting flow of 7.5 to 8.5 Lpm (2.0 to 2.2 gpm) for sinks provided in paragraph 2.2D.
 - b. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 175 and 550 kPa (25 and 80 psi).
 - c. Operates by expansion and contraction, eliminates mineral/sediment building up with self clearing action, and is capable of easy manual cleaning.

2.2 SINKS

A. Stainless Steel:

1. ANSI/ASME A112.19.3, Type 304.
2. Self rim for plastic laminate or similar tops with concealed fasteners.
3. Flat rim for welded into stainless steel tops.

4. Ledge back or ledge sides with holes to receive required fixtures when mounted on countertop.
5. Apply fire resistant sound deadening material to underside.
- B. Stainless steel circular or oval shaped bowl.
- C. Sinks of Methyl Methacrylic Polymer:
 1. Minimum 19 mm (3/4 inch) thick, cast into bowl shape with overflow to drain.
 2. Provide for underhung installation to countertop.
 3. Provide openings for drain.

2.3 TRAPS AND FITTINGS

- A. Material as specified in DIVISION 22, PLUMBING.
- B. For Molded Resin Sinks:
 1. Chemical resisting P-traps and fittings for chemical waste service.
 2. Provide traps with cleanout plug easily removable without tools.
- C. For Stainless Steel Sinks:
 1. Either cast or wrought brass or stainless steel P-traps and drain fittings; ASME A112.18.1
 2. Flat strainer, except where cup strainer or overflow standpipe specified.
 - a. Provide cup strainer in cabinet type 1B.
 - b. Provide stainless steel overflow stand pipe to within 38 mm (1-1/2 inches) of sink rim.
 3. Exposed surface chromium plated finish.
- D. Plaster traps:
 1. Cast iron body with porcelain enamel exterior finish.
 2. 50 mm (2 inch) female threaded side inlet and outlet.
 3. Removable galvanized cage having integral baffles and replaceable brass screens.
 4. Removable gasketed cover.
 5. Minimum overall dimensions: 350 x 350 x 400 mm high (14 x 14 x 16 inches) with 175 mm (7 inch) water seal.
 6. Non-siphoning and easily accessible for cleaning.
- E. Air Gap Fittings: ASME A112.1.2.
- F. Methyl Methacrylic Polymer Sink Traps:
 1. Cast or wrought brass with flat grid strainer, off-set tail piece, adjustable 38 x 32 mm (1-1/2 x 1 1/4-inch) P trap.
 2. Chromium plated finish.

2.4 FUEL GAS, LABORATORY AIR AND LABORATORY VACUUM FIXTURES

- A. Comply with criteria for faucets except as specified.
- B. Needle valves with stainless steel replaceable cone and valve seat.
- C. Provide valve with a bonnet with exterior packing and packing gland designed to permit valve to be repacked while under pressure.
- D. Valves withstand a minimum pressure of 700 kPa (100 psi) without leakage.
- E. Equip valves with four-arm handles and serrated hose ends. Do not provide laminar flow control device.
- F. Provide duplex fixtures except where otherwise shown.
- G. Factory assembled and tested.

2.5 FIXTURE IDENTIFICATION

- A. Code fixtures with full view plastic index buttons.
- B. Use following colors and codes:

SERVICE	COLOR	CODE	COLOR OF LETTERS
Cold Water	Dark Green	CW	White
Hot Water	Red	HW	White
Laboratory Air	Orange	AIR	Black
Fuel Gas	Dark Blue	GAS	White
Laboratory Vacuum	Yellow	VAC	Black
Distilled Water	White	DW	Black
Deionized Water	White	DI	Black
Oxygen	Light Green	OXY	White
Hydrogen	Pink	H	Black
Nitrogen	Gray	N	Black
All Other Gases	Light Blue	CHEM.SYM.	Black

2.6 COUNTERTOPS

- A. Fabricate in largest sections practicable.
- B. Fabricate with joints flush on top surface.
- C. Fabricate countertops to overhang front of cabinets and end of assemblies 25 mm (one inch) except where against walls or cabinets.
- D. Provide 1 mm (0.039 inch) thick metal plate connectors or fastening devices (except epoxy resin tops).
- E. Join edges in a chemical resistant waterproof cement or epoxy cement, except weld metal tops.

- F. Fabricate with end splashes where against walls or cabinets.
- G. Splash Backs and End Splashes:
1. Not less than 19 mm (3/4 inch) thick.
 2. Height 100 mm (4 inches) unless noted otherwise.
 3. Laboratories and pharmacy heights or where fixtures or outlets occur: Not less than 150 mm (6 inches) unless noted otherwise.
 4. Fabricate epoxy splash back in maximum lengths practical of the same material.
- H. Drill or cutout for sinks, and penetrations.
1. Accurately cut for size of penetration.
 2. Cutout for VL 81 photographic enlarger cabinet.
 - a. Finish cutout to fit flush with vertical side of cabinet, allowing adjustable shelf to fit into cutout space of cabinet at counter top level. Finish cutout surface as an exposed edge.
 - b. Provide braces under enlarger space to support not less than 45 kg (100 pounds) centered on opening side along backsplash.
- I. Metal Counter Tops:
1. Fabricate up to 3600 mm (12 feet) long in one piece, including nosing, backs and ends.
 2. When counter tops exceed 3600 mm (12 feet) in length accurately fitted field joints are acceptable.
 3. Finish thickness at edges 32 mm (1-1/4 inch).
 4. Reinforced with minimum 1.5 mm (0.0598 inch) thick hat channel stiffeners, minimum of two stiffeners for units without sinks and three stiffeners for units with sinks welded or soldered to underside of top full length, except at sink openings.
 5. Apply sound deadening material on underside.
 6. Flange edges of tops down 32 mm (1-1/4 inch) and reinforce with concealed hardwood or with a steel frame.
 7. Grind welds smooth and finished on exposed surfaces to match finish specified.
 8. Stainless Steel Counter or Sink Tops:
 - a. Where noted stainless steel except where specified for nourishment unit, unit kitchen, and medicine cabinet.
 - b. Use 1.5 mm (0.0598 inch) thick stainless steel.

- c. Depth of splash backs and splash ends 25 mm (one inch) and turned down at least 13 mm (1/2 inch) at wall. Where faucets are located in splash backs, fabricate depth of splash backs 50 mm (2 inches) with provision made to receive required fixture.
 - d. Where sinks occur fabricate top with 5 mm (3/16 inch) marine edge and fit flush with adjacent tops of other materials.
 - e. Weld sink flush to counter top and finish to appear seamless.
- J. Methyl Methacrylic Polymer Tops:
- 1. Fabricate countertop of methyl methacrylic polymer cast sheet, 13 mm (1/2 inch) thick.
 - 2. Fabricate back splash and end splash to height shown.
 - 3. Fabricate skirt to depth shown.
 - 4. Fabricate with marine edge where sinks occur.
 - 5. Fabricate in one piece for full length from corner to corner up to 3600 mm (12 feet).
 - 6. Join pieces with adhesive sealant.
 - 7. Cut out countertop for lavatories, plumbing trim.
 - 8. Provide concealed fasteners and epoxy cement for anchorage of sinks to countertop.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Before installing countertops verify that wall surfaces have been finished as specified and that mechanical and electrical service locations are as required.
- B. Secure countertops to supporting rails of cabinets with metal fastening devices, or screws through pierced slots in rails.
 - 1. Where type, size or spacing of fastenings is not shown or specified, submit shop drawings showing proposed fastenings and method of installation.
 - 2. Use round head bolts or screws.
 - 3. Use wood or sheet metal screws for wood or plastic laminate tops; minimum penetration into top 16 mm (5/8 inch), screw size No 8, or 10.
- C. Rubber Moldings:
 - 1. Where shown install molding with butt joints in horizontal runs and mitered joints at corners where ceramic tile occurs omit molding.

2. Fasten molding to wall and to splashbacks and splashends with adhesive.

D. Sinks

1. Install stainless steel sink in plastic laminate tops with epoxy compound to form watertight seal under shelf rim.
 - a. In laboratory and pharmacy fit stainless steel sink with overflow standpipe.
 - b. Install faucets and fittings on sink ledges with watertight seals where shown.
2. Install molded resin sinks with epoxy compound to form watertight seal with underside of molded resin top.
 - a. Install sink with not less than two channel supports with threaded rods and nuts at each end, expansion bolted to molded resin top.
 - b. Design support for a twice the full sink weight.
 - c. Install with overflow standpipes.
3. Install methyl methacrylic polymer sinks in manufacturers recommended adhesive sealer or epoxy compound to underside of methyl methacrylic polymer countertop.
 - a. Bolt or screw to countertop to prevent separation of bowl and fracture of adhesive sealant joint.
 - b. Install drain and traps to sink.

E. Faucets, Fixtures, and Outlets:

1. Seal opening between fixture and top.
2. Secure to top with manufacturers standard fittings.

3.2 PROTECTION AND CLEANING

- A. Tightly cover and protect against dirt, water, and chemical or mechanical injury.
- B. Clean at completion of work.

- - - E N D - - -

SECTION 124840
FOOT GRILLE ENTRANCE SYSTEMS

PART 1 - GENERAL

1.01 SUMMARY

- A. Section includes: Entrance matting systems, recessed aluminum foot grilles
- B. Related Sections: Sections related to this section include:
 - 1. Section 03300 - Cast-In-Place Concrete.

1.02 REFERENCES

- A. Standards listed by reference, including revisions by issuing authority, form a part of this specification section to extent indicated. The Standards listed here are identified with a designation number, title or other designation established by the issuing authority.
- B. American Society for Testing and Materials (ASTM):
 - 1. ASTM B117 Product Corrosion to Salt

1.03 SYSTEM DESCRIPTION

- A. Performance Requirements: Provide recessed aluminum entrance floor mat system, which has been manufactured and installed to maintain performance criteria stated by manufacturer without defects, damage or failure.

1.04 SUBMITTALS

- A. General: Submit listed submittals in accordance with the Conditions of the Contract and Division 1 Submittal Procedures Section.
- B. Product data: Submit product data, including manufacturer's specification sheet and installation instructions for specified products. Include methods of installation and substrate preparation for each type of substrate.
- C. Shop drawings: Submit shop drawings showing layout, profiles and product components, including anchorage, accessories, finish colors, patterns and textures.

- D. Samples: Submit samples for each type and color of exposed entrance mat, frames and accessories required. Provide samples of mat materials.
- E. Quality Assurance Submittals: (1) Certified test reports showing compliance with specified performance characteristics and physical properties, and (2) Manufacturer's Installation Instructions.
- F. Closeout Submittals: (1) Cleaning & Maintenance Data (Include methods for maintaining installed products and precautions against cleaning materials and methods detrimental to finishes and performance), and (2) Warranty.

1.05 QUALITY ASSURANCE

- A. Installer: Installer should be highly experienced in performing work of this section, having previously done work similar to that required for this project.

1.06 SEQUENCING/SCHEDULING

- A. Ordering: Comply with Manufacturer's ordering instructions and lead-time requirements to avoid construction delays.
- B. Delivery: Deliver materials in Manufacturer's original, unopened, undamaged packaging.
- C. Storage: Store materials at temperature and in humidity conditions recommended by manufacturer and protect from exposure to harmful weather conditions.
- D. Installation: Except as otherwise indicated herein, sequencing or scheduling for performance of work of this section in relation with other work is Contractor's option. Delay installation of mats until near time of substantial completion for the project.

1.07 PROJECT CONDITIONS

- A. Temperature: Maintain temperature where products will be installed before, during and after installation as recommended by Manufacturer.
- B. Field Measurements: Where possible, verify actual measurements by field measuring before fabrication and include measurements in shop drawings. To avoid construction delays, coordinate field measurements and fabrication schedule based upon construction progress.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURER

- A. Basis of Design: Provide Dual Track foot grille by Mats Inc., 37 Shuman Avenue, Stoughton, MA, 02072; telephone 800-628-7462 or 781-344-1536; fax 781-344-1537; www.matsinc.com.

2.02 MATERIALS

- A. Product: Dual Track.
1. Construction: Bolt-thru design with individual aluminum spacers. Swedge, welded and key lock fastening of rails is not allowed.
 2. Material: Aluminum Alloy type 6061-T6. Soft Aluminum alloy (such as 6063-T52) is not allowed
 3. Drying Insert: Drying inserts to be Nylon material with 5% post-consumer recycled content.
 4. Recycled Content: Aluminum to be 43.97% pre-consumer and 14.12% post-consumer recycled content
 5. Blades: T-Shaped blades, 1-5/16 x 1/8 x 1-1/2 inch size, combined with T shaped blades 11/16 x 1/8" with anti-slip polymer C9065 insert. Spacing between blades not to exceed 3/16 inch.
 6. Dimension: Grille depth to be 1-1/2", with frame 1-5/8"
 7. Panels: Foot Grille to be supplied in panels not to exceed 48" x 42". One Piece design not allowed. All grille panels to be supplied with individual, prefabricated, factory-assembled frames
 8. Load Capacity: 3,831 lbs per 2 foot span
- B. Framing Accessories for Recessed Aluminum Foot Grille: Framing will have the following characteristics:
1. Recessed Frame for either concrete substrate or finished surface: The perimeter frames shall be an angle AD frame, either "Level" or "Embedded" depending on the installation. For installation with either new construction or retrofits. All aluminum frames shall be pre-assembled at factory incorporating welded construction for all joints. Each grille section shall incorporate an invisible section divider integrated and welded within the frame. Frames and grilles shall be shipped fully assembled in protective wooden crating to each jobsite. For sections larger than 6'-0 by 8'-0 a mechanical joint is to be provided.
- C. Optional Accessories for Recessed Aluminum Foot Grille
1. Recessed Pan: 20 gauge Aluminum
 2. Accessories: Stainless steel hinges keyless-lock downs attached to each grid section.
- D. Product Testing for Recessed Foot Grille
1. ASTM B117 Product Corrosion to Salt: Product withstands 1000 hours of salt fog without any noticeable changes.

PART 3 - EXECUTION

3.01 SUBSTRATE PREPARATION

- A. Examine substrates and conditions where floor mats will be installed. Do not proceed with installation until unsatisfactory conditions are corrected. Sub floor shall be clean and dry, and within acceptable tolerances.

3.02 INSTALLATION

- A. Sizes: Shop-fabricate units of floor mat to greatest extent possible in sizes as indicated. Where not indicated otherwise, provide single unit for each mat installation, but do not exceed manufacturer's maximum size recommendation for units intended for removal and cleaning. Where joints in mats are necessary, space symmetrically and away from normal traffic lanes. Miter corner joints in framing elements with hairline joints or provide prefabricated corner units without joints. Where possible, verify sizes by field measurement before shop fabrication.
- B. Accessories: Where indicated for recessed or wall-to-wall applications, provide aluminum framework as recommended by manufacturer.
- C. General: Strictly comply with manufacturer's installation instructions and recommendations. Coordinate installation with adjacent work to ensure proper clearances and to prevent tripping hazards.

3.03 CLEANING AND PROTECTION

- A. General Cleaning: Refer to Manufacturer's Cleaning and Maintenance Instructions.
- B. Owner's Personnel: Instruct Owner's personnel in proper maintenance procedures.
- C. Protection: Protect installed product and finish surfaces from damage during construction and until acceptance.

END OF SECTION

SECTION 14 24 00
NEW HYDRAULIC ELEVATORS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the engineering, furnishing, and installation of the complete hydraulic elevator system as described herein and as indicated on the contract drawings.
- B. Items listed in the singular apply to each elevator in this specification except where noted.
- C. Passenger Elevator - E1 shall be oil hydraulic, microprocessor control system, and power-operated car and hoistway doors. Elevator shall have Class "A" loading.
- D. Service/Passenger Elevator - E2 shall be oil hydraulic, microprocessor control system, and power operated car and hoistway doors. Elevator shall have Class "C3" loading.

ELEVATOR SCHEDULE	
Elevator Number	
Overall Platform Size	
Clear Inside Platform	
Rated Load - kg (lb)	
Contract Speed - m/s (fpm)	
Total Travel - m (ft)	
Floors Served	
Number of Openings	
Entrance Type & Size	
Plunger Size	

1.2 RELATED WORK

- A. Section 01 33 23 SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR 52.236-21) and, SPECIAL NOTES (VAAR 852.236-91), in GENERAL CONDITIONS.
- B. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-rated construction.

- C. SECTION 09 06 00, SCHEDULE FOR FINISHES: As a master format for construction projects, to identify interior and exterior material finishes for type, texture, patterns, color and placement.
- D. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS: Requirements for seismic restraint of non-structural components.
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section.
- F. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low Voltage power and lighting wiring.
- G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- H. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for cables and wiring.
- I. Section 26 05 73, OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY: Requirements for installing the over-current protective devices to ensure proper equipment and personnel protection.
- J. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low voltage transformers.
- K. Section 26 24 16, PANELBOARDS: Low voltage panelboards.
- L. Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION: Surge suppressors installed in panelboards.
- M. Section 26 51 00, INTERIOR LIGHTING: Fixture and ballast type for interior lighting.

1.3 QUALIFICATIONS

- A. Approval by the Contracting Officer is required for products and services of proposed manufacturers, suppliers, installers, and shall be contingent upon submission of certificates by the Contractor stating the following:
 - 1. Elevator contractor is currently and regularly engaged in the installation of elevator equipment as one of his principal products.
 - 2. Elevator contractor shall have five (5) years of successful experience, trained supervisory personnel, and facilities to install elevator equipment specified herein.
 - 3. Elevator Mechanic (Installer) shall have passed a Mechanic Examination approved by the U.S. Department of Labor and have technical qualifications of at least five years of experience in the

- elevator industry or 10,000 hours of field experience working in the elevator industry with technical update training. Apprentices shall be actively pursuing Certified Elevator Mechanic status. Certification shall be submitted for all workers employed in this capacity.
- B. Welding at the project site shall be performed by certified welders who have previously qualified by test as prescribed in American Welding Society Publications AWS D1.1 to perform the type of work required. Certificates shall be submitted for all workers employed in this capacity. A welding or hot work permit is required for each day and shall be obtained from the VAMC safety department. Request permit one day in advance.
- C. Electrical work shall be performed by a Licensed Master Electrician and Licensed Journeymen Electricians as requirements by NEC. Certificates shall be submitted for all workers employed in this capacity.
- D. Approval will not be given to elevator contractors and manufacturers who have established on prior projects, either government, municipal, or commercial, a record for unsatisfactory elevator installations, have failed to complete awarded contracts within the contract period, and do not have the requisite record of satisfactory performing elevator installations of similar type and magnitude.
- E. Approval of Elevator Contractor's equipment will be contingent upon their providing factory training, engineering and technical support, including all manuals, wiring diagrams, and tools necessary for adjusting, maintenance, repair, and testing of equipment to the VA for use by the VA's designated Elevator Maintenance Service Provider. Identifying an elevator maintenance service provider that shall render services within two hours of receipt of notification, together with certification that the quantity and quality of replacement parts stock is sufficient to warranty continued operation of the elevator installation.
- F. Equipment within a group of hydraulic elevators shall be the product of the same manufacturer.
- G. The Contractor shall provide and install safety devices that have been subjected to tests witnessed and certified by an independent professional testing laboratory that is not a subsidiary of the firm that manufactures supplies or installs the equipment.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification.
Elevator installation shall meet the requirements of the latest editions published and adopted by the United States Department of Veterans Affairs on the date contract is signed.
- B. Federal Specifications (Fed. Spec.):
- J-C-30B - Cable and Wire, Electrical (Power, Fixed Installation)
 - J-C-580 - Cord, Flexible, and Wire, Fixture
 - W-S-610 - Splice Connectors
 - W-C-596F - Connector, Plug, Electrical; Connector, Receptacle, Electrical
 - W-F-406E - Fittings for Cable, Power, Electrical and Conduit, Metal, Flexible
 - HH-I-558C - Insulation, Blankets, Thermal (Mineral Fiber, Industrial Type)
 - W-F-408E - Fittings for Conduit, Metal, Rigid (Thick-Wall and Thin-wall EMT Type)
 - RR-W-410 - Wire Rope and Strand
 - TT-E-489J - Enamel, Alkyd, Gloss, Low VOC Content
 - QQ-S-766 - Steel, Stainless and Heat Resisting, Alloys, Plate, Sheet and Strip
- C. American Society of Mechanical Engineers (ASME):
- A17.1 - Safety Code for Elevators and Escalators
 - A17.2 - Inspectors Manual for Electric Elevators and Escalators
- D. National Fire Protection Association:
- NFPA 13 - Standard for the Installation of Sprinkler Systems
 - NFPA 70 - National Electrical Code (NEC)
 - NFPA 72 - National Fire Alarm and Signaling Code
 - NFPA 101 - Life Safety Code
 - NFPA 252 - Fire Test of Door Assemblies
- E. International Building Code (IBC)
- F. American Society for Testing and Materials (ASTM):
- A1008/A1008M-09 - Steel, Sheet, Cold Rolled, Carbon, Structural, High-Strength Low-Alloy and High Strength Low-Alloy with Improved Formability
 - E1042-02 - Acoustically Absorptive Materials Applied by Trowel or Spray

- G. Manufacturer's Standardization Society of the Valve and Fittings Industry (MSS):
 - SP-58 - Pipe Hangers and Supports
- H. Society of Automotive Engineers, Inc. (SAE):
 - J517-91 - Hydraulic Hose, Standard
- I. Gages: For Sheet and Plate: U.S. Standard (USS)
 - For Wires: American Wire Gauge (AWG)
- J. American Welding Society (AWS):
 - D1.1 - Structured Welding Code - Steel
- K. National Electrical Manufacturers Association (NEMA):
 - LD-3 - High-Pressure Decorative Laminates
- L. Underwriter's Laboratories (UL):
 - 486A - Safety Wire Connectors for Copper Conductors
 - 797 - Safety Electrical Metallic Tubing
- M. Institute of Electrical and Electronic Engineers (IEEE)
- N. Regulatory Standards:
 - VA Barrier Free Design Handbook H-18-13
 - VA Seismic Design Manual H-18-8

1.5 SUBMITTALS

- A. Submit in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Before execution of work, furnish information to evidence full compliance with contract requirements for proposed items. Such information shall include, as required: Manufacturer's Name, Trade Names, Model or Catalog Number, Nameplate Data (size, capacity, and rating) and corresponding specification reference (Federal or project specification number and paragraph). All submitted drawings and related elevator material shall be forwarded to the Contracting Officer.
- C. Shop Drawings:
 - 1. Complete scaled and dimensioned layout in plan and section view showing the arrangement of equipment and all details of each elevator unit specified including:
 - a. Complete layout showing location of storage tank/pump assembly, controller, piping layout, outside diameter of cylinder/plunger assembly, size of car platform, car frame members, and support assembly.

- b. Car, guide rails, brackets, buffers, and other components located in hoistway.
 - c. Rail bracket spacing and maximum vertical forces on guide rails in accordance with H-18-8 for Seismic Risk Zone 2 or greater.
 - d. Reaction at points of support and buffer impact loads.
 - e. Weight of principal parts.
 - f. Top and bottom clearances and over travel of the car.
 - g. Location of main line switch/shunt trip circuit breaker, switchboard panel, light switch, and feeder extension points in the machine room.
2. Drawings of hoistway entrances and doors showing details of construction and method of fastening to the structural members of the building.
 - a. If drywall construction is used to enclose hoistway, submit details of interface fastenings between entrance frames and drywall.
 - b. Sill details including sill support.
- D. Samples:
1. One each of stainless steel, 75 mm x 125 mm (3 in. x 5 in.).
 2. One each of baked enamel, 75 mm x 125 mm (3 in. x 5 in.).
 3. One each of color floor covering.
 4. One each of protection pads, 75 mm x 125 mm (3 in. x 5 in.) if used.
 5. One each car and hoistway Braille plate sample.
 6. One each car and hall button sample.
 7. One each car and hall lantern/position indicator sample.
 8. One each wall and ceiling material finish sample.
 9. One each car lighting sample.
- E. Name of manufacturer, type or style designation, and applicable data of the following equipment shall be shown on the elevator layouts:
1. Storage tank/pump assembly.
 2. Pump and motor, HP and RPM rating, Voltage, Starting and Full Load Ampere, Number of phases, and Gallons per minute.
 3. Controller.
 4. Starters and Overload Current Protection Devices.
 5. Car Safety Device; Rupture Valve and Manual Shut Off Valves.
 6. Electric Door Operator; HP, RPM, Voltage, and Ampere rating of motor.

7. Hoistway Door Interlocks.
8. Car Buffers; maximum and minimum rated load, maximum rated striking speed and stroke.
9. Cab Ventilation Unit; HP rating and CFM rating.
- F. Complete construction drawings of elevator car enclosure, showing dimensioned details of construction, fastenings to platform, car lighting, ventilation, ceiling framing, top exits, and location of car equipment.
- G. Complete dimensioned detail of vibration isolating foundations for storage tank/pump assembly.
- H. Dimensioned drawings showing details of:
 1. All signal and operating fixtures.
 2. Car slide guides/roller guides.
 3. Hoistway door tracks, hangers, and sills.
 4. Door operator, infrared curtain units.
- I. Cut sheets or drawings showing details of controllers and supervisory panels.
- J. Furnish certificates as required under: Paragraph "QUALIFICATIONS".

1.6 WIRING DIAGRAMS

- A Provide three complete sets of paper and one electronic set of field wiring and straight-line wiring diagrams showing all electrical circuits in the hoistway, machine room and fixtures. Install one set coated with an approved plastic sealer and mounted in the elevator machine room as directed by the Resident Engineer.
- B. In the event field modifications are necessary during installation, diagrams shall be revised to include all corrections made prior to and during the final inspection. Corrected diagrams shall be delivered to the Resident Engineer within thirty (30) days of final acceptance.
- C. Provide the following information relating to the specific type of microprocessor controls installed:
 1. Owner's information manual, containing job specific data on major components, maintenance, and adjustment.
 2. System logic description.
 3. Complete wiring diagrams needed for field troubleshooting, adjustment, repair and replacement of components. Diagrams shall be base diagrams, containing all changes and additions made to the equipment during the design and construction period.

4. Changes made during the warranty period shall be noted on the drawings in adequate time to have the finalized drawings reproduced for mounting in the machine room no later than six months prior to the expiration of the warranty period.

1.7 TOOL CABINET

- A. Provide a metal parts/tool cabinet, having two shelves and hinged doors. Cabinet size shall be 1200 mm (48 in.) high, 750 mm (30 in.) wide, and 450 mm (18 in.) deep.

1.8 PERFORMANCE STANDARDS

- A. The elevators shall meet the highest standards of the industry and specifically the following:
 1. Contract speed is high speed in either direction of travel with rated capacity load in the elevator. Speed variation under all load conditions, regardless of direction of travel, shall not vary more than five (5) percent.
 2. The controlled rate of change of acceleration and retardation of the car shall not exceed 0.1G per ft/s/s and the maximum acceleration and retardation shall not exceed 0.2G per ft/s/s.
 3. Starting, stopping, and leveling shall be smooth and comfortable without appreciable steps of acceleration and deceleration.
- B. Passenger/Service door operators shall open the car door and hoistway door at 75 cm (2.5 ft) per second and close at 30 cm (1 ft) per second. Freight door operators shall open and close at 30 cm (1 ft) per second.
- C. Floor level stopping accuracy shall be within 3 mm (.125 in.) above or below the floor, regardless of load condition.
- D. Noise and Vibration Isolation: All elevator equipment including their supports and fastenings to the building, shall be mechanically and electrically isolated from the building structure to minimize objectionable noise and vibration transmission to car, building structure, or adjacent occupied areas of building.
- E. Sound Isolation: Noise level relating to elevator equipment operation in machine room shall not exceed 80 decibels. All db readings shall be taken three (3) feet off the floor and three (3) feet from equipment.
- F. Airborne Noise: Measured noise level of elevator equipment during operation shall not exceed 50 decibels in elevator lobbies and 60 decibels inside car under any condition including door operation and car ventilation exhaust blower on its highest speed.

1.9 WARRANTY

- A. Submit all labor and materials furnished regarding elevator system and installation to terms of "Warranty of Construction" articles of FAR clause 52.246-21. The One-Year Warranty and Guarantee Period of Service shall commence and run concurrent after final inspection, completion of performance test, and upon acceptance of each elevator.
- B. During warranty period if a device is not functioning properly in accordance with specification requirements, more maintenance than the contract requires keeping device operational, device shall be removed and a new device meeting all requirements shall be installed as part of work until satisfactory operation of installation is obtained. Period of warranty shall start anew for such parts from date of completion of each new installation performed, in accordance with foregoing requirements.

1.10 POWER SUPPLY

- A. For power supply in each machine room, see Specification 26 05 19, Electrical specifications, and Electrical drawings.
- B. Main Line Fused Disconnect Switch/Shunt Trip Circuit Breaker for each controller shall be located inside the machine room at the strike side of the machine room door and lockable in the "Off" position.
- C. Provide Surge Suppressors to protect the elevator equipment.

1.11 EMERGENCY POWER SUPPLY

- A. Emergency power supply, its starting means, transfer switch for transfer of elevator supply from normal to emergency power, two pair of conductors in a conduit from an auxiliary contact on the transfer switch (open or close contacts as required by Controller Manufacturer) to terminals in the group elevator controller and other related work shall be provided by the Electrical Contractor.
- B. Upon loss of normal power supply there shall be a delay before transferring to emergency power of 10 seconds minimum to 45 seconds maximum, the delay shall be accomplished through an adjustable timing device.
- C. Prior to the return of normal power an adjustable timed circuit shall be activated that will cause all cars to remain at a floor if already there or stop and remain at the next floor if in flight. Actual transfer of power from emergency power to normal building power shall take place after all cars are stopped at a floor with their doors open.

D. Car lighting circuits shall be connected to the emergency power panel.

1.13 HOISTWAY LIGHTING

- A. Provide lighting throughout the entire hoistway with 3-way switches at the top and bottom of the hoistway accessible from elevator hoistway entrance prior to entering the pit or stepping onto the car top.
- B. Lighting shall illuminate top of elevator cab when it is at the top floor and the pit when at the bottom floor.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Where stainless steel is specified, it shall be corrosion resisting steel complying with Fed. Spec. QQ-S-766, Class 302 or 304, Condition A with Number 4 finish on exposed surfaces. Stainless steel shall have the grain of belting in the direction of the longest dimension and surfaces shall be smooth and without waves. During installation stainless steel surfaces shall be protected with a suitable material.
- B. Where cold rolled steel is specified it shall be low-carbon steel rolled to stretcher level standard flatness, complying with ASTM A109.

2.2 MANUFACTURED PRODUCTS

A. Elevator Basis of Design: OTIS HydroFit 5010R.

Materials, devices, and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items. The elevator equipment, including controllers, door operators, and supervisory system shall be the product of manufacturers of established reputation, provided such items are capably engineered and produced under coordinated specifications to ensure compatibility with the total operating system.

- B. Manufacturers of equipment assemblies which include components made by others shall assume complete responsibility for the final assembled unit. Components shall be compatible with each other and with the total assembly for the intended service.
- C. Mixing of manufactures related to a single system or group of components shall be identified in the submittals.
- D. If key operated switches are furnished in conjunction with component of this elevator installation, furnish four (4) keys for each individual switch or lock. Provide different key tumblers for different switch and lock functions. Each key shall have a tag bearing a stamped or etched legend identifying its purpose.

2.3 CONDUIT AND WIREWAY

- A. Install electrical conductors, except traveling cables, in rigid zinc-coated steel or aluminum conduit, electrical metallic tubing or metal wireways. Rigid conduit smaller than 18.75 mm (.75 in.) or electrical metallic tubing smaller than 12.5 mm (.50 in.) electrical trade size shall not be used. All raceways completely embedded in concrete slabs, walls, or floor fill shall be rigid steel conduit. Wireway (duct) shall be installed in the hoistway and to the controller and between similar apparatus in the elevator machine room. Fully protect self-supporting connections, where approved, from abrasion or other mechanical injury. Flexible metal conduit not less than 9.375 mm (.375 in.) electrical trade size may be used, not exceeding 45 cm (18 in.) in length unsupported, for short connections between risers and limit switches, interlocks, and for other applications permitted by NEC.
- B. All conduits terminating in steel cabinets, junction boxes, wireways, switch boxes, outlet boxes and similar locations shall have approved insulation bushings. Install a steel lock nut under the bushings if they are constructed completely of insulating materials. Protect the conductors at ends of conduits not terminating in steel cabinets or boxes by terminal fittings having an insulated opening for the conductors.
- C. Rigid conduit and EMT fittings using set screws or indentations as a means of attachment shall not be used.
- D. Connect motors or other items subject to movement, vibration or removal to the conduit or EMT systems with flexible, steel conduits.

2.4 CONDUCTORS

- A. Conductors shall be stranded or solid coated annealed copper in accordance with Federal Specification J-C-30B for Type RHW or THW. Where 16 and 18 AWG are permitted by NEC, single conductors or multiple conductor cables in accordance with Federal Specification J-C-580 for Type TF may be used provided the insulation of single conductor cable and outer jacket of multiple conductor cable is flame retardant and moisture resistant. Multiple conductor cable shall have color or number coding for each conductor. Conductors for control boards shall be in accordance with NEC. Joints or splices are not permitted in wiring except at outlets. Tap connectors may be used in wireways provided they meet all UL requirements.

- B. Provide all conduit and wiring between machine room, hoistway, and fixtures.
- C. All wiring must test free from short circuits or ground faults. Insulation resistance between individual external conductors and between conductors and ground shall be a minimum of one megohm.
- D. Where size of conductors is not given, voltage and amperes shall not exceed limits set by NEC.
- E. Provide equipment grounding. Ground the conduits, supports, controller enclosure, motor, platform and car frame, and all other non-current conducting metal enclosures for electrical equipment in accordance with NEC. The ground wires shall be copper, green insulated and sized as required by NEC. Bond the grounding wires to all junction boxes, cabinets, and wire raceways.
- F. Terminal connections for all conductors used for external wiring between various items of elevator equipment shall be solderless pressure wire connectors in accordance with Federal Specification W-S-610. The Elevator Contractor may, at his option, make these terminal connections on #10 gauge or smaller conductors with approved terminal eyelets set on the conductor with a special setting tool, or with an approved pressure type terminal block. Terminal blocks using pierce-through serrated washers are not acceptable.

2.5 TRAVELING CABLES

- A. All conductors to the car shall consist of flexible traveling cables conforming to the requirements of NEC. Traveling cables shall run from the junction box on the car directly to the controller. Junction boxes on the car shall be equipped with terminal blocks. Terminal blocks having pressure wire connectors of the clamp type that meet UL 486A requirements for stranded wire may be used in lieu of terminal eyelet connections. Terminal blocks shall have permanent indelible identifying numbers for each connection. Cables shall be securely anchored to avoid strain on individual terminal connections. Flame and moisture resistant outer covering must remain intact between junction boxes. Abrupt bending, twisting and distortion of the cables shall not be permitted.
- B. Provide spare conductors equal to 10 percent of the total number of conductors furnished, but not less than 5 spare conductors in each traveling cable.

- C. Provide shielded wires for the auto dial telephone system within the traveling cable, five (5) pair shielded wires for card reader, one (1) RG-6 Ethernet cable for Wi-Fi, two (2) pair 14-gauge wires for 110 Volt power supply, and wire for video display monitor if specified.
- D. If traveling cables contact the hoistway or elevator due to sway or change in position, provide shields or pads to the elevator and hoistway to prevent damage to the traveling cables.
- E. Hardware cloth may be installed from the hoistway suspension point to the elevator pit to prevent traveling cables from rubbing or chafing and securely fastened and tensioned to prevent buckling. Hardware cloth is not required when traveling cable is hung against a flat wall.

2.6 CONTROLLER AND SUPERVISORY PANEL

- A. UL/CSA Labeled Controller: Mount all assemblies, power supplies, chassis switches, and relays on a steel frame in a NEMA Type 1 General Purpose Enclosure. Cabinet shall be securely attached to the building structure.
- B. Properly identify each device on all panels by name, letter, or standard symbol which shall be neatly stencil painted or decaled in an indelible and legible manner. Identification markings shall be coordinated with identical markings used on wiring diagrams. The ampere rating shall be marked adjacent to all fuse holders. All spare conductors to controller and supervisory panel shall be neatly formed, laced, and identified.
- C. Controller shall be provided with wiring and components for additional future travel if required.

2.7 MICROPROCESSOR CONTROL SYSTEM

- A. Provide a microprocessor control system with absolute position/speed feedback to control dispatching, signal functions, door operation, pump motor, and hydraulic valve control. Complete details of the components and printed circuit boards, together with a complete operational description, shall be submitted for approval. Provide closed transition SCR soft start.
- B. Controller manufacturer shall provide factory training, engineering and technical support, including all manuals, wiring diagrams, and tools necessary for adjusting, maintenance, repair, and testing of equipment to the VA for use by the VA's designated Elevator Maintenance Service Provider.

- C. Provide low oil and hot oil shutdown features that shall shut off the motor and pump and return the elevator to the lowest landing. Upon reaching the lowest landing, doors will open automatically allowing passengers to leave the elevator, and then doors shall close. All control buttons, except the door open button, alarm bell button, and the call for help button shall be made ineffective.

2.8 MACHINE ROOM MONITOR

- A. Provide a monitor in each machine room, separate monitors for each passenger elevator group, and each service elevator group. Provide one keyboard for each monitor.
- B. The monitor shall contain indicators to provide the following information:
 - 1. The floor where each elevator is currently located.
 - 2. The direction that each elevator is currently traveling or is scheduled to travel.
 - 3. The location and direction of currently registered hall calls.
 - 4. Elevators that are currently out of service.
 - 5. Elevators that are currently bypassing hall calls.
 - 6. Elevators that are currently engaged in passenger transfers.
 - 7. Operations program under which entire group is currently operating.
 - 8. Zone divisions of the entire group.
 - 9. Door positions.
 - 10. Status indication for elevators on independent service, car top inspection, fire service, earthquake protection, and activated stop switch and alarm bell.
- C. The maintenance terminal shall be suitable for all troubleshooting procedures related to the specific type microprocessor installed on this project.

2.9 EMERGENCY POWER OPERATION

- A. The control system for Elevator(s) shall provide for the operation of at least one car per elevator group on emergency power upon failure of the normal power supply.
- B. Auxiliary equipment on elevator controllers, wiring between associated elevator controllers and wiring between elevator controllers and remote selector panel as required to permit the elevators to operate as detailed, shall be provided by the Elevator Contractor.

C. Upon loss of normal power supply there shall be a delay before transferring to emergency power of 10 seconds minimum to 45 seconds maximum, the delay shall be accomplished through an adjustable timing device. After adjusting delay, the associated elevators shall function as follows:

1. Selector switch, Automatic position:

- a. Not more than two elevators at a time in each group shall be automatically selected and returned to the main floor, at contract speed, cycle its car and hoistway doors and shut down, with "Door Open" button remaining operable.
- b. As each elevator reaches the designated floor and shuts down, another elevator shall start and return to the designated floor.
- c. Elevators that have been manually removed from automatic service and are on independent service, fire service or medical emergency shall receive an automatic return signal. Elevators on inspection service or out of service shall not receive a signal.
- d. When an elevator is given a signal to return and it is unable to start its movement to the designated floor within 30 seconds it shall be by-passed. When an elevator is by-passed, another elevator shall start and return.
- e. This process shall continue until all elevators have returned to the designated floor and shut down.
- f. Any elevator or elevators by-passed on initial return signal shall be signaled again.
- g. When all cars in group have returned to designated floor, one elevator in each group shall be designated for automatic operation. Individual cars in each group shall restart at 5 second intervals.
- h. If elevator(s) are keyed on to medical emergency service in the car prior to transfer to auxiliary power operation, medical emergency service shall be retained. This elevator shall be the first automatically selected elevator to operate on emergency power operation and complete its selected call demand. The elevator will return to the designated floor after the key switch is reset to normal position.

2. Selector switch, Manual operation:

- a. Selector switch shall be mechanically and electrically interlocked to prevent the selection of more than one elevator from operating on auxiliary power.
 - b. The selector switch shall have positions marked with the number of each elevator controlled. It shall also have a position marked "Automatic". When the selector switch is set to the automatic position, the medical emergency service car shall operate on emergency power operation, or if none, the last car arriving at the designated floor shall operate on emergency power operation.
 - c. Change in selection of elevators shall be by means of the selection switch and shall occur only when the previous selected elevator is stopped at the designated floor.
 - d. The selector switch shall be locked out of operation when the system is in the normal mode of operation.
 - e. Locate the selector switch above the hall push button at the designated level. The key switch shall be a tumbler type lock furnished with four keys. The enclosure faceplate shall be identified "Emergency Power Control" with 13 mm (.50 in.) engraved letters filled with black paint.
- D. Prior to the return of normal power an adjustable timer circuit shall activate that will cause all cars to remain at a floor if already there or stop and remain at the next floor if in flight. Actual transfer of power from auxiliary power to normal building power shall take place after all cars are stopped at a floor with their doors open.
- E. Emergency Rescue Operation: Provide a power source to send the elevator to the lowest landing. After the elevator has leveled at the lowest landing, provide power to open the car and hoistway doors automatically. After a predetermined time, the doors shall close. Power shall stay applied to the door open button to reopen the doors from the inside of the elevator. The elevator shall remain shut down at the bottom landing until normal power is restored. Install a sign on the controller indicating that power is applied to emergency rescue operator and door operator during loss of normal power.

2.10 FIREFIGHTER'S SERVICE

- A. Provide Firefighter's Service.
 1. Main Floor:
 2. Alternate Floor:

3. Verify main and alternate floors with Resident Engineer's Representative.

2.11 INDEPENDENT SERVICE

- A. Provide an INDEPENDENT SERVICE key switch on the face of the main car operating panel or a toggle switch in the service operating panel that shall have its positions marked "ON" and "OFF". When the switch is in the "ON" position, the car shall respond only to calls registered on its car dispatch buttons and shall bypass all calls registered on landing push buttons. The car shall start when a car call is registered, car call button or door close button is pressed, car and hoistway doors are closed, and interlock circuits are made. When switch is returned to "OFF" position, normal service shall be resumed.

2.12 MEDICAL EMERGENCY SERVICE - PATIENT CARE FACILITIES ONLY

- A. Provisions shall be made for calling elevator(s) to any floor served by the elevator on an emergency basis, operating independently from the dispatch signals and landing call signals.
- B. Install card reader/key switch in the floor landing push button fixture above the push buttons.
- C. Provide a call registered light indicator adjacent to card reader/key switch. The card reader/key switch at the landings and in the car, shall only be operable by authorized personnel with a valid VA ID badge/key.
- D. When card reader/key switch is activated at any floor, the call register light indicator shall illuminate at the call floor and inside the elevator only. The elevator control system shall instantly select an elevator to respond to the medical emergency call. Immediately upon selection, all car calls shall be cancelled. If car is traveling away from the medical emergency call, it shall slow down and stop at the nearest floor, maintain closed doors, reverse direction and proceed nonstop to the medical emergency call floor. If the car is traveling toward the medical emergency call floor, it shall proceed to that floor nonstop. If at the time of selection, it is slowing down for a stop, the car shall stop, maintain doors closed, and start immediately toward the medical emergency floor.
- E. Arriving at the medical emergency floor, the car shall remain with doors open for 30 seconds. After this interval has expired and the car

has not been placed on medical emergency operation inside the car, the car shall automatically return to normal service.

- F. Provide an LED illuminated indicator light next to the Medical Emergency card reader/key switch the same size as the Fire Service indicator.
1. Locate a "Medical Emergency" card reader/key switch above call buttons in the main car operating panel for selecting medical emergency service. Activation of the card reader will allow the car to accept a car call for any floor, close doors, and proceed nonstop to the floor desired.
 2. After medical emergency call has been completed the elevator shall return to normal operation after an adjustable time of 30 to 90 seconds has expired.
- G. In the center of the rear cab panel provide a back lighted "MEDICAL EMERGENCY" LED illuminated display that shall flash on and off continuously when the car is assigned to this operation and until it is restored to normal service. "MEDICAL EMERGENCY" indicator shall be a photographic negative type 1800 mm (72 in.) to center above the floor, 150 mm (6 in.) wide X 75 mm (3 in.) high, with 12.5 mm (.50 in.) high letters legible only when illuminated.
- H. If the car being operated on "Independent Service", the medical emergency service indicator lights in the car operating panel and rear wall shall be illuminated, buzzer shall sound, and the "Audio Voice" system shall direct the attendant to return the car to automatic operation.
- I. If the car is out of service and unable to answer medical emergency calls, the call register light shall not illuminate.
- J. Each card reader/key switch shall have its identity legible and indelible engraved in faceplates. All lettering shall be 6 mm (.25 in.) high, filled with black paint.
- K. When Phase I firefighter's recall is activated it shall over-ride elevators on medical emergency service and return them to the main or alternate fire service recall floor. When the fire emergency floor has been identified the attendants may complete their medical emergency run on Phase II firefighter's operation if life safety is not affected.

2.13 SEISMIC REQUIREMENTS

- A. Meet the requirements of VA Seismic Design Manual H-18-8.

2.14 PUMP, MOTOR, AND VALVE ASSEMBLY

- A. Provide pump assembly for the control of the elevator self-contained in a unit fabricated of structural steel. The unit shall consist of a hydraulic fluid pump, AC motor, oil control valves, muffler, piping, and fittings.
- B. Enclose V-belt power unit on four open sides with not less than 16-gauge steel removable panel sections. Provide a 50 mm (2 in.) minimum, 100mm (4 in.) maximum air space between the top of the panels and bottom of tank. Line panels on the interior side with one-inch rigid acoustical insulation board. Install expanded metal belt guard that can be easily removed with hand tools for servicing and inspection. Submersible motor and pump power units are acceptable but are best suited for lower traffic areas. Submersible pump with motor mounted above the tank are a better choice to eliminate heat from the motor being transferred to the oil.
- C. Control valves shall be electronically controlled. Hydraulic fluid flow shall be controlled to insure speed variation of not more than five (5) percent under all load conditions in either direction of travel. Locate the manual lowering valve, easily accessible, properly identified, and not concealed within the storage tank. Mark the operating handle in red.
- D. Pump shall be designed for hydraulic elevator service, having a steady discharge without pulsation to give smooth and quiet operation. Pump output shall be capable of lifting elevator car with rated capacity, with a speed variation of no more than five (5) percent between no load and full load. Hydraulic fluid by-pass shall discharge directly into storage tank.
- E. Provide motor specifically designed for elevator service, synchronous speed not more than 1800 RPM, not to exceed nameplate full load current by more than 10%, and rated 120 starts per hour without exceeding a rise of 40 degrees C.
- F. Provide isolation pads to prevent transmission of pump and motor vibration to the building.
- G. Install blowout-proof, non-hammering, oil-hydraulic muffler in the hydraulic fluid supply pressure line near power unit in machine room. Design muffler to reduce to a minimum any pulsation or noises that may be transmitted through the hydraulic fluid into the hoistway.

2.15 HYDRAULIC SYSTEM

- A. Construct the storage tank of sheet steel, welded construction, and a steel cover with means for filling, a minimum one-inch protected vent opening, and a valve drain connection. Tank shall be sized to pass through machine room door as shown on drawings. Provide marked gauge to monitor hydraulic fluid level. Tank shall be sized to hold volume of hydraulic fluid required to lift elevator to stop ring, plus a reserve of not less than ten gallons. Provide a baffle in the bottom of the tank to prevent entry of any sediment or foreign particles into hydraulic system. Baffle shall also minimize aeration of hydraulic fluid. Permissible minimum hydraulic fluid level shall be clearly indicated. Hydraulic fluid shall be of good grade to assure free flow when cool and have minimum flash point of 380-400 degrees F. Provide initial supply of hydraulic fluid for operation of elevator.
1. Provide a means to maintain the fluid viscosity in the reservoir, pump, and control valve at a recommended operating temperature.
 2. Provide a data plate on the tank framing indicating the characteristics of the hydraulic fluid used.
- B. Furnish and install connections between the storage tank, pump, muffler, operating valves, and cylinder complete with necessary valves, pipe supports, and fittings. Pipe shall be minimum schedule 40 steel with threaded, flanged, or welded mechanical couplings. Size of pipe and couplings between cylinder and pumping unit shall be such that fluid pressure loss is limited to 10 percent.
- C. Hydraulic system working pressure shall not exceed 500 psi under any load condition. Do not subject valves, piping, and fittings to working pressure greater than those recommended by the manufacturer.
- D. Support all horizontal piping. Place hangers or supports within 300 mm (12 in.) on each side of every change of direction of pipeline and space supports not over 3.0 m (10 ft) apart. Secure vertical runs properly with iron clamps at sufficiently close intervals to carry weight of pipe and contents. Provide supports under pipe to floor.
1. Provide all piping from machine room to hoistway, including necessary supports or hangers. If remote piping is underground or in damp inaccessible areas, install hydraulic piping thru PVC sleeve.

- E. Install pipe sleeves where pipes pass through walls or floors. Set sleeves during construction. After installation of piping, equip the sleeves with snug fitting inner liner of fire rated insulation.
- F. Provide an automatic shut-off valve in the oil supply line at the cylinder inlet. Weld inlet pipe to cylinder, threaded to receive shut-off valve. Activate the automatic shut-off valve when there is more than a ten percent increase in high speed in the down direction. When activated, this device shall immediately stop the descent of the elevator and hold the elevator. The exposed adjustments of the automatic shut-off valve shall have their means of adjustment sealed after being set to their correct position.
- G. Provide external tank shut-off valve to isolate hydraulic fluid during maintenance operations.
- H. Provide shut-off valves in the pit near the cylinder and in the machine room capable of withstanding 150 percent of design operating pressure. Each manual valve shall have an attached handle.
- I. Provide oil-tight drip pan for assembled pumping unit, including storage tank. Pan shall be not less than 16-gauge sheet steel, with one-inch sides.
- J. Components of the hydraulic system shall be factory certified to withstand pressure equal to twice the calculated working pressure.

2.16 HYDRAULIC PLUNGER ASSEMBLY

- A. Cylinder and plunger shall be sized to lift gross load the height specified. Factory test the plunger assembly at a pressure equal to twice the calculated working pressure, for strength and to insure freedom from leakage. Provide bottom of cylinder head with internal guide bearing and top of cylinder head with removable packing gland. Victaulic type packing gland head shall not be permitted.
 - 1. Provide a bleeder valve located below the cylinder flange to release air or other gases from the system.
 - 2. Equip cylinder with drip ring below the packing gland to collect leakage of hydraulic fluid.
 - 3. Bolt the cylinder mounting brackets to footing channels that support the buffers.
- B. Install a flexible tubing scavenger line with an electrically operated pump between the piston drip ring and oil storage tank. Scavenger line, pump and strainers shall operate independently of hydraulic fluid

pressure. Equip scavenger pump with a water float designed to prevent operation of the pump should the pit flood and designed to be manually reset. Secure pump and reservoir to the pit channels.

- C. Plunger shall be heavy seamless steel tubing, turned smooth and true to within plus or minus .38 mm (0.015 in.) tolerance and no diameter change greater than .07 mm (0.003 in.) per-inch of length. Where plunger is multi-piece construction, machine the joints to assure perfectly matching surfaces.
1. Secure plunger to underside of platform supporting beams with fastenings capable of supporting four times the weight of the plunger. The platen plate shall incorporate piston to car vibration isolation.
 2. Provide a stop ring welded or screwed to the bottom of plunger that shall prevent the plunger from leaving its cylinder. //For plunger units that include future travel, locate the stop ring to permit only the actual travel and required run by.
 3. Isolate plunger head from the platen plate to prevent corrosion or electrolysis.
 4. Protect plunger, repair or replace if gouged, nicked or scored.

2.17 HYDRAULIC CYLINDER CASING AND WELL HOLE

- A. The casing shall be iron or steel not less than 9.375 mm (.375-in.) thick, at least 15 cm (6 in.) larger in diameter than the cylinder.
- B. Provide PVC casing liner to fit inside steel casing. Fabricate liner with watertight bottom and a top flange gasket to seal plunger flange and form a complete, watertight, electrically non-conductive encasement of the entire unit.
- C. Provide suitable well hole to accommodate casing. Coordinate the drilling of well hole and setting of the cylinder with construction of concrete pit. Provide watertight joint between the casing and the pit floor at bottom of pit.
- D. Base bid on drilling hole in dirt, sand, rock, gravel, loam, boulders, hardpan, water, or other obstacles. Include the removal of all dirt and debris.

2.18 CAR BUFFERS

- A. Provide a minimum of two spring buffers for each elevator. Securely fasten buffers and supports to the pit channels and in the alignment with striker plates on elevator. Buffers shall have a permanently

attached metal plate indicating its stroke and load rating. Buffer anchorage shall not puncture pit waterproofing.

- B. Furnish pipe stanchions and struts as required to properly support the buffer.

2.19 GUIDE RAILS, SUPPORTS, AND FASTENINGS

- A. Guide rails for car shall be planed steel T-sections and weigh 27.5 kg/m (18.5 lb/ft).
- B. Securely fasten guide rails to the brackets or other supports by heavy duty steel rail clips.
- C. Provide car rail brackets of sufficient size and design to insure substantial rigidity to prevent spreading or distortion of rails under any condition.
- D. Guide rails shall extend from channels on pit floor to within 76 mm (3 in.) of the underside of the concrete slab or grating at top of hoistway with a maximum deviation of 3.2 mm (.125 in.) from plumb in all directions. Provide a minimum of 19 mm (.75 in.) clearance between bottom of rails and top of pit channels.
- E. Guide rail anchorages in pit shall be made in a manner that will not reduce effectiveness of the pit waterproofing.
- F. In the event inserts or bond blocks are required for the attachment of guide rails, the Contractor shall furnish such inserts or bond blocks and shall install them in the forms before the concrete is poured. Use inserts or bond blocks only in concrete or block work where steel framing is not available for support of guide rails. Expansion-type bolting for guide rail brackets will not be permitted.
- G. Guide rails shall be clean and free of any signs of rust, grease, or abrasion before final inspection. Paint the shank and base of the T-section with two field coats of manufacturer's standard enamel.

2.20 NORMAL AND FINAL TERMINAL STOPPING DEVICES

- A. Mount terminal slowdown switches and direction limit switches on the elevator or in hoistway to reduce speed and bring car to an automatic stop at the terminal landings.
 - 1. Switches shall function with any load up to and including 100 percent of rated elevator capacity at any speed obtained in normal operation.
 - 2. Switches, when opened, shall permit operation of elevator in reverse direction of travel.

- B. Mount final terminal stopping switches in the hoistway.
 - 1. Switches shall be positively opened should the car travel beyond the terminal direction limit switches.
 - 2. Switches shall be independent of other stopping devices.
 - 3. Switches, when opened, shall remove power from pump motor and control valves preventing operation of car in either direction.

2.21 CROSSHEAD DATA PLATE AND CODE DATA PLATE

- A. Permanently attach a non-corrosive metal Data Plate to car crosshead.
- B. Permanently attach a Code Data Plate, in plain view, to the controller.

2.22 WORKMAN'S LIGHTS AND OUTLETS

- A. Provide duplex GFCI protected type receptacles and lamp, with guards on top of elevator car and beneath platform. The receptacles shall be in accordance with Fed. Spec. W-C-596 for Type D7, 2-pole, 3-wire grounded type rated for 15 amperes and 125 volts.

2.23 CARTOP OPERATING DEVICE

- A. Provide a cartop operating device.
- B. The device shall be activated by a toggle switch mounted in the device. The switch shall be clearly marked "INSPECTION" and "NORMAL" on the faceplate, with 6 mm (.25 in.) letters.
- C. Movement of the elevator shall be accomplished by the continuous pressure on a direction button and a safety button.
- D. Provide an emergency stop switch, push to stop/pull to run.
- E. Provide permanent identification for the operation of all components in the device.
- F. The device shall be permanently attached to the elevator crosshead on the side of the elevator nearest to the hoistway doors used for accessing the top of the car.

2.24 CAR LEVELING DEVICE

- A. Car shall be equipped with a two-way leveling device to automatically bring the car to within 3 mm (.125 in.) of exact level with the landing for which a stop is initiated regardless of load in car or direction.
- B. If the car stops short or travels beyond the floor, the leveling device, within its zone shall automatically correct this condition and maintain the car within 3 mm (.125 in.) of level with the floor landing regardless of the load carried.

2.25 EMERGENCY STOP SWITCHES

- A. Provide an emergency stop switch, push to stop/pull to run, for each top-of-car device, pit, machine spaces, service panel and firefighter's control panel inside the elevator. Mount stop switches in the pit adjacent to pit access door, at top of the pit ladder 1200 mm (48 in.) above the bottom landing sill and 1200 mm (48 in.) above the pit floor adjacent to the pit ladder.
- B. Each stop switch shall be red in color and shall have "STOP" and "RUN" positions legibly and indelibly identified.

2.26 MAIN CAR OPERATING PANEL

- A. Locate the main car operating panel in the car enclosure on the front return panel for passenger/service elevators and the front of the side wall for freight elevators. The top floor car call push button shall not be more than 1200 mm (48 in.) above the finished floor. Car call push buttons and indicator lights shall be round with a minimum diameter of 25 mm (1 in.), LED white light illuminated.
- B. One-piece hinged front faceplate with edges beveled 15 degrees hinged swing return panel tilt panel shall have the firefighter's service panel recessed into the upper section and the service operation panel recessed into the lower section fitted with hinged doors. Doors shall have concealed hinges, be in the same front plane as the faceplate and fitted with key operated locks. Secure the faceplate with stainless steel tamperproof screws.
- C. All terminology and tactile symbols on the faceplate shall be on square or rectangular plates recessed into the faceplate with its surface flush with the surface of the faceplate. Use 6 mm (.25 in.) letters to identify all devices in the faceplate. The handicapped markings with contrasting background shall be 12.5 mm (.50 in.) high raised .075 mm (.030 in.) on the plate. Surface mounted plates are not acceptable.
- D. The upper section shall contain the following items in order listed from top to bottom:
 - 1. Elevator number, 12.5 mm (.50 in.) high with black paint for contrast.
 - 2. Capacity plate information with black paint for contrast with freight loading class and number of passengers allowed.
 - 3. LED illuminated digital car position indicator with direction arrows.

4. Emergency car lighting system consisting of a rechargeable battery, charger, controls, and LED illuminated light fixture. The system shall automatically provide emergency light in the car upon failure or interruption of the normal car lighting service, and function irrespective of the position of the light control switch in the car. The system shall maintain a minimum illumination of 1.0 foot-candle when measured 1220 mm (48 in.) above the car floor and approximately 300 mm (12 in.) in front of the car operating panel, for not less than four (4) hours.
5. Firefighter's Emergency Operation Panel shall be 1650 mm (66 in.) minimum to 1800 mm (72 in.) maximum to the top of the panel above finished floor.
6. Firefighter's Emergency Indicator Light shall be round with a minimum diameter of 25 mm (1 in.).
7. Medical Emergency card reader/key switch marked "MEDICAL EMERGENCY" with two positions labeled "ON" and "OFF" and Medical Emergency Indicator Light located next to the card reader/key switch shall be round with a minimum diameter of 25 mm (1 in.). Instruction for Medical Emergency operation shall be engraved below the card reader/key switch and light.
8. Key operated Independent Service Switch on the face of panel or toggle switch inside service panel.
9. Provide a Door Hold Button on the faceplate next to the Independent Service Key Switch. It shall have "DOOR HOLD" indelibly marked on the button. Button shall light when activated. When activated, the door shall stay open for a maximum of one minute. To override hold timer, push a car call button or door close button.
10. Complete set of round car call push buttons, minimum diameter of 25 mm (1 in.), and LED white light illuminated, corresponding to the floors served. Car call buttons shall be legibly and indelibly identified by a floor number and/or letter not less than 12.5 mm (.50 in.) high in the face of the call button.
11. Door Open and Door Close buttons shall be located below the car call buttons. They shall have "OPEN" and "CLOSE" legibly and indelibly identified by letters in the face of the respective button. The Door Open button shall be located closest to the door jamb.

- a. Rear Door Open and Rear Door Close buttons shall be located below the Front Door Open and Front Door Close buttons. They shall have "REAR OPEN" and "REAR CLOSE" legibly and indelibly identified by letters in the face of the respective button.
 12. Red Emergency Alarm button that shall be located below the car operating buttons. Mount the emergency alarm button not lower than 875 mm (35 in.) above the finished floor. It shall be connected to audible signaling devices. Provide audible signaling devices including the necessary wiring.
 13. Emergency Help push button shall activate two-way communications by Auto Dial telephone system that is compatible with the VAMC's telephone system. Help button shall be LED white light illuminated and flash when call is acknowledged. Legibly and indelibly label the button "HELP" in the face of the button with 12.5 mm (.50 in.) high letters.
- E. The service operation panel, in the lower section shall contain the following items:
1. Light switch labeled "LIGHTS" for controlling interior car lighting with its two positions marked "ON" and "OFF".
 2. Inspection switch that will disconnect normal operation and activate hoistway access switches at terminal landings. Switch shall be labeled "ACCESS ENABLE" with its two positions marked "ON" and "OFF".
 3. Three position switch labeled "FAN" with its positions marked "HIGH", "LOW" and "OFF" for controlling car ventilating blower.
 4. Two position, spring return, toggle switch or push button to test the emergency light and alarm device. It shall be labeled "TEST EMERGENCY LIGHT AND ALARM".
 5. Independent service switch labeled "ON" AND "OFF".
 6. Two-position emergency stop switch, when operated, shall interrupt power supply and stop the elevator independently of regular operating devices. Emergency stop switch shall be marked "PUSH TO STOP" and "PULL TO RUN".

2.27 AUXILIARY CAR OPERATING PANEL

- A. Provide an auxiliary car operating panel in the front return panel opposite the main car operating panel rear return panel of the elevator between the handrails immediately adjacent to the front

entrance column strike jamb. The auxiliary car operating panel shall contain only those controls essential to passenger (public) operation. The auxiliary car operating panel faceplate shall match the main car operating panel faceplate in material and general design. Secure the faceplate with stainless steel tamperproof screws.

1. Complete set of round car call push buttons, minimum diameter 25 mm (1 in.), and LED white light illuminated, corresponding to the floors served. Car call button shall be legibly and indelibly identified by a floor number and/or letter not less than 12.5 mm (.50 in.) high in the face of the call button corresponding to the numbers of the main car panel operating buttons.
 2. Mount door "OPEN" and door "CLOSE" buttons closest to the door jamb and mount the alarm button no lower than 875 mm (35 in.) above the finished floor. The Door Open button shall be located closest to the door.
 3. Cross-connect all buttons in the auxiliary car operating panels to their corresponding buttons in the main car operating panel. Registration of a car call shall cause the corresponding button to illuminate in the main and auxiliary car operating panel.
 4. Emergency Help push button shall activate two-way communications by auto dial telephone that is compatible with the VAMC's telephone system. Help button shall be LED white light illuminated and flash when call is acknowledged. Legibly and indelibly label the button "HELP" in the face of the button with 12.5 mm (.50 in.) high letters.
- B. All terminology and tactile symbols on the faceplate shall be on square or rectangular plates recessed into the faceplate with its surface flush with the surface of the faceplate. Use 6 mm (.25 in.) letters to identify all devices in the faceplate. The tactile symbols with contrasting background shall be 12.5 mm (0.5 in.) high raised .075 mm (.030 in.) on the plate. Surface mounted plates are not acceptable.

2.28 CAR POSITION INDICATOR

- A. Provide an alpha-numeric digital car position indicator in the main car operating panel, consisting of numerals and arrows not less than 63 mm (2.5 in.) high, to indicate position of car and direction of car travel. Locate position indicator at the top of the main car operating panel, illuminated by light emitting diodes.

2.29 AUDIO VOICE SYSTEM

- A. Provide digitized audio voice system activated by stopping at a floor. Audio voice shall announce floor designations, direction of travel, and special announcements. The voice announcement system shall be a natural sounding human voice that receives messages and shall comply with ADA requirements for audible car position indicators. The voice announcer shall have two separate volume controls, one for the floor designations and direction of travel, and another for special announcements. The voice announcer shall have a full range loudspeaker, located on top of the cab. The audio voice unit shall contain the number of ports necessary to accommodate the number of floors, direction messages, and special announcements. Install voice announcer per manufacturer's recommendations and instructions. The voice system shall be the product of a manufacturer of established reputation. Provide manufacturer literature and list of voice messages.

2.30 AUTO DIAL TELEPHONE SYSTEM

- A. Furnish and install a complete ADA compliant auto dial telephone that is compatible with the VAMC's telephone system.
- B. Provide a two-way communication device in the car with automatic dialing, tracking and recall features with shielded wiring to car controller in machine room. Provide dialer with automatic rollover capability with two numbers.
- C. "HELP" button shall illuminate and flash when call is acknowledged. Button shall match floor push button design.
- D. Provide "HELP" button tactile symbol signage and Braille adjacent to button mounted integral with car operating panels.
- E. The auto dial system may be in the main or auxiliary car operating panel. The speaker and unit shall be mounted on the backside of the perforated stainless-steel plate cover.
- F. Each elevator shall have individual phone numbers.
- G. If the operator ends the call, the passenger shall be able to redial the telephone immediately.

2.31 CORRIDOR OPERATING DEVICES

- A. Fabricate faceplates for elevator operating and signal devices from not less than 3 mm (.125 in.) thick flat stainless steel with all edges beveled 15 degrees.

- B. Corridor push button faceplates shall be sized to accommodate corridor pictograph on faceplate. The centerline of the landing push buttons shall be 105 cm (42 in.) above the corridor floor.
- C. Elevator Corridor Call Station Pictograph shall be engraved in the faceplate.
- D. Fasten all car and corridor operating device and signal device faceplates with stainless steel tamperproof screws.
- E. All terminology and tactile symbols on the faceplate shall be raised .030 inch with contrasting background, on square or rectangular plates recessed into the faceplate with its surface flush with the surface of the faceplate. The handicapped markings with contrasting background shall be 12.5 mm (0.5 in.) high raised .075 mm (.030 in.) on the plate, square or rectangular. Use 6 mm (.25 in.) letters to identify all other devices in the faceplate. Surface mounted plates are not acceptable.
- F. Provide one risers of landing call buttons for each elevator or group of elevators as shown on contract drawings.
- G. Each button shall contain an integral registration LED white light which shall illuminate upon registration of a call and shall extinguish when that call is answered.
- H. The direction of each button shall be legibly and indelibly identified by arrows not less than 12.5 mm (.50 in.) high in the face of each button. Provide a corresponding Braille plate on the left side of each button.
- I. Landing push buttons shall not re-open the doors while the car and hoistway doors are closing at that floor, the call shall be registered for the next available elevator. Calls registered shall be canceled if closing doors are re-opened by means of "DOOR OPEN" button or infrared curtain unit.
- J. Provide emergency power indicator light, medical emergency card reader/key switch and indicator light, fire service recall key switch and indicator light, fire recall instruction, communication failure light, audible enunciator, and reset key switch in a separate fixture at the designated main floor.
- K. Submit design of hall pushbutton fixtures for approval.

2.32 DIGITAL CORRIDOR ARRIVAL LANTERN/POSITION INDICATOR

- A. Provide elevator with combination corridor lantern/position indicator digital display mounted over the hoistway entrances at each floor in

healthcare facilities. For non-healthcare facilities provide combination fixtures only at main and alternate fire recall floors. Provide each terminal landing with "UP" or "DOWN", minimum 63 mm (2.5 in.) high digital arrow lanterns and each intermediate landing with "UP" and "DOWN" digital arrow lanterns. Each lens shall be LED illuminated of proper intensity, so shielded to illuminate individual lens only. The lenses in each lantern shall be illuminated green to indicate "UP" travel and red to indicate "DOWN" travel. Lanterns shall signal in advance of car arrival at the landing indicating the direction of travel. Corridor lanterns shall not be illuminated when a car passes a floor without stopping. Each lantern shall be equipped with an audible electronic chime which shall sound once for "UPWARD" bound car and twice for "DOWNWARD" bound car. Audible signal shall not sound when a car passes the floor without stopping. Provide adjustable sound level on audible signal. Car riding lanterns are not acceptable.

- B. Install alpha-numeric digital position indicator between the arrival lanterns. Indicator faceplate shall be stainless steel. Numerals shall be not less than 63 mm (2.5 in.) high with direction arrows. Cover plates shall be readily removable for re-lamping. The appropriate direction arrow shall be illuminated during entire travel of car in corresponding direction.

2.33 HOISTWAY ACCESS

- A. Provide hoistway access switches for elevator at top terminal landing to permit access to top of car, and at bottom terminal landing to permit access to pit. Elevators with side slide doors, mount the access key switch 180 cm (6 ft) above the corridor floor in the wall next to the strike jamb.
- B. Exposed portion of each access switch or its faceplate shall have legible, indelible legends to indicate "UP", "DOWN", and "OFF" positions.
- C. Each access switch shall be a constant pressure cylinder type lock having not less than five pins or five stainless steel disc combination with key removable only when switch is in the "OFF" position.
- D. Lock shall not be operable by any other key which will operate any other lock or device used for any other purpose at the VA Medical Center.

- E. Arrange the hoistway switch to initiate and maintain movement of the car. When the elevator is operated in the down direction from the top terminal landing, limit the zone of travel to a distance not greater than the top of the car crosshead level with the top floor. Submit design and location of access switches for approval.
- F. Provide emergency access for all hoistway entrances, keyways for passenger and service elevators.

2.34 HOISTWAY ENTRANCES: PASSENGER/SERVICE ELEVATORS

- A. Provide complete entrances with sills, sill supports, hangers, hanger supports, tracks, angle struts, unit frames, door panels, fascia plates, toe guards, hardware, bumpers, sight guards, and wall anchors.
- B. Provide one piece extruded stainless steel sills grooved for door guides and recessed for fascia plates. Sills shall have overall height of not less than 19 mm (.75 in.) set true, straight, and level, with hoistway edges plumb over each other, and top surfaces flush with finished floor. Hoistway entrance frames and sills shall be grouted solid full length after installation.
- C. Construct hanger supports of not less than 9.375 mm (.375 in.) thick steel plate and bolted to strut angles.
- D. Structural steel angles 75 mm x 75 mm x 9.375 mm (3 in. x 3 in. x .375 in.) shall extend from top of sill to bottom of floor beam above and shall be securely fastened at maximum 45 cm (18 in.) on center and at each end with two bolts.
- E. Provide jambs and head soffits, of not less than 14-gauge stainless steel. Jambs and head soffits shall be bolted/welded construction and provided with three anchors each side. Side jambs shall be curved. Radius of curvature shall be 88 mm (3.5 in.). Head jamb shall be square and shall overhang corridor face of side jambs by 6 mm (.25 in.). Rigidly fasten jambs and head soffits to building structure and grouted solid. After installation, protect jambs and head soffits to prevent damage to finish during construction.
- F. Provide raised numerals or letters on cast, rear mounted plates for all openings. Numerals shall be a minimum of 50 mm (2 in.) high, located on each side of entrance frame, with centerline of 150 cm (5 ft) above the landing sill. The number plates shall contain Braille.
- G. Provide unique car number on every elevator entrance at designated main fire service floor level, minimum 75 mm (3 in.) in height.

- H. Provide passenger entrances with single speed center opening horizontal sliding doors and service entrances with center or side opening horizontal sliding doors.
1. Door panels shall be flush hollow metal construction, not less than 32 mm (1.25 in.) thick, consisting of one continuous piece 16-gauge stainless steel on corridor side wrapped around the leading edge. Separate two plates by a sound-deadening material and reinforce by steel shapes welded to the plates at frequent intervals. Reinforce panels as required for installation of hangers, power-operating and door-opening devices. Top and bottom of door panels shall have continuous stiffener channels welded in place. Reinforcement of the door panels shall be a minimum of 1.0 mm (0.04 in.) in thickness and of the hat section type.
 2. Hang doors on two-point suspension hangers having sealed ball-bearing sheaves not less than 75 mm (3 in.) in diameter, made of non-metallic sound-reducing material. Equip hangers with adjustable ball-bearing rollers to take upward thrust of panels. Upthrust rollers shall be capable of being locked in position after adjustment to a maximum of .38 mm (.015625 in.) clearance. Provide the hanger sheaves with steel fire stops to prevent disengagement from tracks. Do not use hangers that are constructed integrally with the door panels.
 3. Provide two removable laminated phenolic gibs or other approved material guides and a separate fire gib at the bottom of door panel.
 4. Reinforce each door panel for interlock mechanism, drive assembly, and closer. Provide relating devices to transmit motion from one door panel to the other.
 5. One door panel for each entrance shall bear a BOCA label, Underwriters' label or labels from other accredited test laboratories may be furnished provided they are based on fire test reports and factory inspection procedures acceptable to the COR.
 6. Fasten sight guard of 14-gauge stainless steel, extending full height of panel, to leading edge of fast speed panel of two-speed doors each panel of center opening doors.
- I. Provide 14-gauge sheet steel fascia plates in hoistway to extend vertically from head of hanger support housing to sill above. Plates shall be three (3) inches wider than door opening of elevator and

reinforced to prevent waves and buckles. Below bottom terminal landing and over upper terminal landing provide shear guards beveled back to and fastened to the wall.

- J. Equip each hoistway door with an electrical/mechanical interlock, functioning as hoistway unit system, to prevent operation of car until all hoistway doors are locked in closed position.
- K. Wiring installed from the hoistway riser to each door interlock shall be NEC type SF-2 or equivalent.

2.35 CAR GUIDES

- A. Install on car frame four adjustable roller guides , each assembled on a substantial metal base, to permit individual alignment to the guide rails.
- B. Each guide shall consisting of not less than three (3) wheels, each with a durable, resilient oil-resistant material tire rotating on ball bearings having sealed-in lubrication. Assemble rollers on a substantial metal base and mount to provide continuous spring pressure contact of all wheels with the corresponding rail surfaces under all conditions of loading and operation. Secure the roller guides at top and bottom on each side of car frame and counterweight frame. All mounting bolts shall be fitted with nuts, flat washers, split lock washers, and if required, beveled washers.
- C. Provide sheet metal guards to protect rollers on top of car and counterweight.
- D. Minimum diameter of car rollers shall be 150 mm (6 in.). The entire elevator car shall be properly balanced to equalize pressure on all guide rollers. Cars shall be balanced in post-wise and front-to-back directions. Test for this balanced condition shall be witnessed at time of final inspection.
- E. Equip car with an auxiliary guiding device for each guide shoe/roller which shall prevent the car from leaving the rails if the normal guides fail. These auxiliary guides shall not, during normal operation, touch the guiding surfaces of the rails. Fabricate the auxiliary guides from hot rolled steel plate and mount between the normal guide shoes and the car frames. The auxiliary guides may be an extension of the normal guide shoe mounting plate if that plate is fabricated from hot rolled steel. The portion of the auxiliary guide which shall contacts the rail guiding surfaces in the event of loss of the normal guides shall be

lined with an approved bearing material to minimize damage to the rail guiding surfaces.

- F. Alternate Guide Shoes for service and freight elevators:
1. Provide each shoe with renewable non-metallic gibs of durable material having low coefficient of friction and long-wearing qualities, when operated on guide rails receiving infrequent, light applications of rail lubricant. Gibs containing graphite or other solid lubricants are not acceptable.
 2. Flexible guide shoes of approved design, other than swivel type, may be used provided they are self-aligning on all three faces of the guide rails.
 3. Provide spring take-up in car guide shoes for side play between rails.

2.36 CAR FRAME: PASSENGER/SERVICE ELEVATORS

- A. Car frame shall be constructed of channel stiles, crosshead, gussets, and braces securely bolted and/or welded. The entire assembly shall be constructed to withstand unequal loading of platform. Car frame members shall be constructed to relieve the car enclosure of all strains.

2.37 CAR PLATFORM: PASSENGER/SERVICE ELEVATORS

- A. Construct the car platform to meet the requirements of class loading specified. The platform shall be designed to withstand the forces developed under the loading conditions specified. Provide car entrances with extruded aluminum sill or better with machined or extruded guide grooves. Cover underside and all exposed edges of wood filled platform with sheet metal of not less than 27-gauge, with all exposed joints and edges folded under. Fire resistant paint is not acceptable. Platform shall have flexible composition flooring not less than 3 mm (.125 in.) thick. For color, see Section 09 06 00, SCHEDULE FOR FINISHES. Adhesive material shall be type recommended by manufacturer of flooring. Lay flooring flush with threshold plate and base.
- B. Provide a platform guard (toe guard) of not less than 12-gauge sheet-steel on the entrance side, extend 75 mm (3 in.) beyond each side of entrance jamb. Securely brace platform guard to car platform, and bevel bottom edge at a 60-75-degree angle from horizontal. Install platform in the hoistway, so that the clearance between front edge and landing threshold shall not exceed 32 mm (1.25 in.).

- C. Isolate the platform from the car frame by approved rubber pads or other equally effective means.
- D. Provide adjustable diagonal brace rods to hold platform firmly within car suspension frame.
- E. Balance car front to back and side to side. Provide balancing frame and weights, properly located, to achieve the required true balance.
- F. Provide a bonding wire between frame and platform.

2.38 CAR ENCLOSURE: PASSENGER/SERVICE ELEVATORS

- A. Car enclosure shall have a dome height inside the cab of 2400 mm (8 ft).
- B. Securely fasten car enclosure to platform by through bolts located at intervals of not more than 450 mm (18 in.) running through an angle at the base of panels to underside of platform.
- C. Front return wall panel, entrance columns, entrance head-jamb, and transom shall be 14-gauge stainless steel. Transom shall be full width of cab. Side and rear walls shall be constructed of 14-gauge cold rolled steel. Coat exterior of walls with mastic sound insulation material approximately 2.5 mm (.10 in.) thick followed by a prime coat of paint.
- D. Side and rear walls of passenger elevators may have raised panels covered in fire rated materials approved for use in elevator interior.
- E. Side and rear walls of service elevators, up to the center line of the top handrail, shall be covered with stainless steel. Side and rear walls to the ceiling shall be covered with high pressure plastic laminate panels applied directly to the cab walls or raised panels. Submit a method of fastening panels to steel walls.
- F. Construct canopy of not less than 12-gauge steel.
- G. Provide car top railings.
- H. Provide a hinged top emergency exit cover. Exit shall be unobstructed when open and shall have mechanical stops on the cover. Provide an exit switch to prevent operation of the elevator when the emergency exit is open.
- I. Provide duplex, GFCI protected receptacle in car. Locate flush-mounted receptacle on the centerline of the main car operating panel, 150 mm (6 in.) above the car floor.
- J. Lighting for passenger/service elevators:

1. Provide stainless steel hanging ceiling frame. Construct frame of 3.125 mm (.125 in.) thick x 37.5 mm (1.50 in.) wide x 37.5 mm (1.50 in.) high "T" and "L" sections, divide ceiling into six panels.
 2. Provide LED illuminated car light fixtures above the ceiling panels. Maintain a minimum light level of 50-foot candles at 90 cm (36 in.) above the finished floor.
- K. Optional lighting for service elevators:
1. Provide car with indirect LED lamps mounted front to rear in lighting coves along each side of the cab ceiling, no hanging ceiling.
 2. Equip the lighting cove with asymmetrical reflectors having specular finish. Maintain a minimum light level of 50-foot candles 90 cm (36 in.) above finished floor at the car operating panels.
 3. Enclose the entire vertical space between the light trough outer edge and the cab canopy with approved opaque white or clear lumicite sheeting. Lumicite sheeting shall be removable for cleaning and re-lamping.
- L. Provide a blower unit arranged to exhaust through an opening in the canopy. Provide a stainless or chrome plated fan grill around the opening. Provide 2-speed fan with rated air displacement of 250 cfm and 400 cfm at respective speeds. Mount fan on top of car with rubber isolation to prevent transmission of vibration to car structure. Provide screening over intake and exhaust end of blower. Provide a 3-position switch to control the unit in the service panel.
- M. Provide car enclosure with two sets of handrails with centerlines 75 cm and 105 cm (30 in. and 42 in.) above the car floor.
1. Locate handrails 37.5 mm (1.50 in.) from cab wall. Install handrails on side walls only for front and rear openings. Conceal all handrail fastenings. Handrails shall be removable from inside the car enclosure.
 2. Provide service elevators with flat stock handrails with the ends at the entrance turned back to the wall.
- N. Provide passenger car with center opening horizontal sliding doors and service car with center or side opening horizontal sliding doors constructed the same as hoistway doors.
- O. Provide one set of protective pads for service elevator of sufficient length to completely cover two sides, rear walls and front return of

cab interior. Pads shall consist of a minimum of 6 mm (.25 in.) thick glass fiber insulation securely sewn between flame resistant vinyl coated coverings. Color of the covering shall be approved by the Resident Engineer. Provide stainless steel pad buttons or hooks, spaced at intervals of not more than 150 mm (18 in.) to adequately support pads.

2.39 POWER DOOR OPERATORS: PASSENGER/SERVICE ELEVATORS

- A. Provide a high-speed heavy-duty door operator to automatically open the car and hoistway doors simultaneously when the car is level with the floor, and automatically close the doors simultaneously at the expiration of the door-open time. Provide microprocessor door control with circuitry to constantly monitor and automatically adjust door operation based upon velocity, position, and motor current. Motor shall be of the high-internal resistance type, capable of withstanding high currents resulting from stall without damage to door operator/motor. The door operator shall open the car door and hoistway door simultaneously, at a speed of 75 cm (2.5 ft) per second. Closing speed of the doors shall be 30 cm (1 ft) per second. Reversal of direction of the doors from the closing to opening operation, whether initiated by obstruction of the infrared curtain or the door "OPEN" button, shall be accomplished within 37.5 mm (1.5 in.) maximum of door movement. Emphasis is placed on obtaining quiet interlock and door operation; smooth, fast, dynamic braking for door reversals, and stopping of the doors at extremes of travel.
- B. Equip car doors with electric contact that prevents operation of car until doors are closed unless car is operating in leveling zone or hoistway access switch is used. Locate door contact to prevent its being tampered with from inside of car.
- C. Car and hoistway doors shall be manually operable in an emergency without disconnecting the power door operating equipment unless the car is outside the unlocking zone.
 1. It shall not be possible for the doors to open by power unless the elevator is within the leveling zone.
 2. Provide infrared curtain unit. The device shall cause the car and hoistway doors to reverse automatically to the fully open position should the unit be actuated while the doors are closing. Unit shall

function when the doors are not closed, except during firefighter's operation.

- D. Should the doors be prevented from closing for more than a predetermined adjustable interval of 20 to 60 seconds by operation of the curtain unit, the doors shall stay open, the audio voice message and a buzzer located on the car shall sound only on automatic operation. Do not provide door nudging.
 - 1. If an obstruction of the doors should not activate the photo-electric door control device and prevent the doors from closing for more than a predetermined adjustable interval of 15 to 30 seconds, the doors shall reverse to the fully open position and remain open until the "Door Close" button re-establishes the closing cycle.
- E. Provide door "OPEN" and "CLOSE" buttons. When the door "OPEN" button is pressed and held, the doors, if in the open position, shall remain open and if the doors are closing, they shall stop, reverse and re-open. Momentary pressure of the door "CLOSE" button shall initiate the closing of the doors prior to the expiration of the normal door open time.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Examine work of other trades on which the work of this Specification depends. Report defects to the Resident Engineer in writing that may affect the work of elevator contractor.
- B. Examine elevator hoistway openings for plumb, level, in line, and that elevator pit is proper size, waterproofed and drained with necessary access door, and ladder.
- C. Examine machine room for proper illumination, heating, ventilation, electrical equipment, and beams are correctly located complete with access stairs and door.
- D. If the Elevator Contractor requires changes in size or location of trolley beams or their supports and trap doors, etc., to accomplish their work, he must justify the changes, subject to approval of the Contracting officer, and include additional cost in their bid.
- E. Work required prior to the completion of the elevator installation:
 - 1. Supply of electric feeder wires to the terminals of the elevator control panel, including circuit breaker.
 - 2. Provide light and GFCI outlets in the elevator pit and machine room.

3. Furnish electric power for testing and adjusting elevator equipment.
 4. Furnish circuit breaker panel in machine room for car and hoistway lights and receptacles.
 5. Supply power for cab lighting and ventilation from an emergency power panel specified in Division 26, ELECTRICAL.
 6. Machine room enclosed and protected from moisture, with self-closing, self-locking door and access stairs.
 7. Provide fire extinguisher in machine room.
- F. Provide to General Contractor for installation; inserts, anchors, bearing plates, brackets, supports and bracing including all setting templates and diagrams for placement.

3.2 ARRANGEMENT OF EQUIPMENT

- A. Arrange equipment in machine room so that major equipment components can be removed for repair or replacement without dismantling or removing other equipment in the same machine room. Locate controller near and visible to its respective hoisting machine.

3.3 WORKMANSHIP, INSTALLATION, AND PROTECTION

- A. Installations shall be performed by Certified Elevator Mechanics and Apprentices to best possible industry standards. Details of the installation shall be mechanically and electrically correct. Materials and equipment shall be new and without imperfections.
- B. Recesses, cutouts, slots, holes, patching, grouting, refinishing to accommodate installation of equipment shall be included in the Contractor's work. All new holes in concrete shall be core drilled.
- C. Structural members shall not be cut or altered. Work in place that is damaged or defaced shall be restored equal to original new condition.
- D. Finished work shall be straight, plumb, level, and square with smooth surfaces and lines. All machinery and equipment shall be protected against dirt, water, or mechanical injury. At completion, all work shall be thoroughly cleaned and delivered in perfect unblemished condition.
- E. Sleeves for conduit and other small holes shall project 50 mm (2 in.) above concrete slabs.
- F. Hoist cables that are exposed to accidental contact in the machine room and pit shall be completely enclosed with 16-gauge sheet metal or expanded metal guards.

- G. Exposed gears, sprockets, and sheaves shall be guarded from accidental contact.

3.4 CLEANING

- A. Upon completion of installation and prior to final inspection, all equipment shall be thoroughly cleaned of grease, oil, cement, plaster, dust, and other debris.
- B. CLEAN MACHINE ROOM AND EQUIPMENT.
- C. Perform hoistway clean down.
- D. Prior to final acceptance remove protective coverings from finished or ornamental surfaces. Clean and polish surfaces with regarding type of material.

3.5 PAINTING AND FINISHING

- A. All equipment, except specified as architectural finish, shall be painted one coat of approved color, conforming to manufacturer's standard.
- B. Hoist machine, motor, shall be factory painted with manufacturer's standard finish and color.
- C. Controller, sheave, car frame and platform, counterweight, beams, rails and buffers except their machined surfaces, cams, brackets and all other uncoated ferrous metal items shall be painted one factory primer coat or approved equal.
- D. Stencil or apply decal floor designations not less than 100 mm (4 in.) high on hoistway doors, fascia or walls within door restrictor areas. The color of paint used shall contrast with the color of the surfaces to which it is applied.
- E. Elevator pump/motor machine, controller, main line switch/shunt trip circuit breaker, bolster channel, and cross head of car shall be identified by 100 mm (4 in.) high numerals and letters located as directed. Numerals shall contrast with surrounding color and shall be stenciled or decaled.
- F. Hoistway Entrances of Passenger, and Service Elevators:
 - 1. Door panels shall be given rust resistant treatment and a factory finish of one coat of baked-on primer and one factory finish coat of baked-on enamel.
 - 2. Fascia plates, top and bottom shear guards, dust covers, hanger covers, and other metalwork, including built-in or hidden work and structural metal, (except stainless steel entrance frames and

surfaces to receive baked enamel finish) shall be given one approved prime coat in the shop, and one field coat of paint of approved color.

G. Hoistway Entrances of Freight Elevators:

1. Metal surfaces of doors and frames shall receive shop prime coat.
2. Finish painting, after installation, shall be one coat of paint of approved color.

H. Elevator Cabs for Passenger and Service Elevators:

1. Interior and exterior steel surfaces shall be given rust resistant treatment before finish is applied.
2. Interior steel surfaces shall be factory finished with one coat of paint of approved color.
3. Give exterior faces of car doors one finish coat of paint of approved color.

I. Elevator Cabs for Freight Elevators:

1. Give interior of cab one prime coat and a minimum of one coat of paint of approved color.
2. Give exterior of cab one prime coat and one finish coat of paint of approved color.
3. All surfaces of door frames, door panels, and cab interior surfaces that become damaged or marred shall be restored to original condition before final acceptance of work.

3.6 PRE-TESTS AND TESTS

A. Pre-test the elevators and related equipment in the presence of the Resident Engineer or his authorized representative for proper operation before requesting final inspection. Conduct final inspection at other than normal working hours, if required by Resident Engineer.

1. The VA shall obtain the services of an Independent QEI Certified Elevator Inspector. The QEI must utilize an Elevator Acceptance Inspection Form to record the results of inspection and all testing and to identify safety code and contract deficiencies. Specific values must be provided for all tests required by ASME A17.1, ASME A17.2, and contract documents. Upon completion of inspection and testing, the QEI must sign a copy of the completed form and provide it to the Contracting Officer. Within 2 weeks of the inspection, the QEI must also prepare a formal inspection report, including all test results and deficiencies. Upon successful completion of inspection

- and testing, the QEI will complete, sign, and provide a certificate of compliance provide by the VA.
2. Government shall furnish electric power including necessary current for starting, testing, and operating machinery of each elevator.
 3. Contractor shall furnish the following test instruments and materials on-site and at the designated time of inspection: properly marked certified test weights, voltmeter, amp probe, thermometers, direct reading tachometer, megohm meter, vibration meter, sound meter, light meter, stopwatch, and a means of two-way communication.
- B. Inspection of workmanship, equipment furnished, and installation for compliance with specification.
- C. Full-Load Run Test: Elevators shall be tested for a period of one-hour continuous run with full contract load in the car. The test run shall consist of the elevator stopping at every floor, in either direction of travel, for not less than five or more than ten seconds per floor.
- D. Speed Test: The actual speed of the elevator shall be determined in both directions of travel with full contract load and no load in the elevator. Speed shall be determined by certified tachometer. The actual measured speed of the elevator with all loads in either direction shall be within five (5) percent of specified rated speed. Full speed runs shall be quiet and free from vibration and sway.
- E. Temperature Rise Test: The temperature rise of the pump motor shall be determined during the full load test run. Temperatures shall be measured using thermometers. Under these conditions, the temperature rise of the equipment shall not exceed 50 degrees Centigrade above ambient temperature. Test shall start when all machine room equipment is within 5 degrees Centigrade of the ambient temperature. Other tests for heat run on motors shall be performed as prescribed by the Institute of Electrical and Electronic Engineers.
- F. Car Leveling Test: Elevator car leveling devices shall be tested for accuracy of leveling at all floors with no load in car and with contract load in car in both directions of travel. Accuracy of floor level shall be within plus or minus 3 mm (.125 in.) of level with landing floor for which the stop has been initiated regardless of load in car or direction of travel. The car leveling device shall automatically correct over travel as well as under travel and shall

maintain the car floor within plus or minus 3 mm (.125 in.) of level with the landing floor regardless of change in load.

- G. Insulation Resistance Test: The elevator's complete wiring system shall be free from short circuits and ground faults and the insulation resistance of the system shall be determined by use of megohm meter, at the discretion of the Elevator Inspector conducting the test.
- H. Overload Devices: Test all overload current protection devices in the system at final inspection.
- I. Limit Stops:
1. The position of the car when stopped by each of the normal limit switches with no load and with contract load in the car shall be accurately measured.
 2. Final position of the elevator relative to the terminal landings shall be determined when the elevator has been stopped by the final limits. The lower limit stop shall be made with contract load in the elevator. Elevator shall be operated at inspection speed for both tests. Normal limit stopping devices shall be inoperative for the tests.
- J. Working Pressure: Verify working pressure of the hydraulic system by pressure gauge placed in the system line. Take readings with no load and full load in car.
- K. Test automatic shut-off valve for proper operation.
- L. Operating and Signal System: The elevator shall be operated by the operating devices provided and the operation signals and automatic floor leveling shall function in accordance with requirements specified. Starting, stopping and leveling shall be smooth and comfortable without appreciable steps of acceleration or deceleration.
- M. Performance of the Elevator supervisory system shall be witnessed and approved by the elevator inspector and a representative of the Resident Engineer.
- N. Evidence of malfunction in any tested system or parts of equipment that occurs during the testing shall be corrected, repaired, or replaced at no additional cost to the Government, and the test repeated.
- O. If equipment fails test requirements and a re-inspection is required, the Contractor shall be responsible for the cost of re-inspection; salaries, transportation expenses, and per-diem expenses incurred by the elevator inspector and the representative of the Resident Engineer.

3.7 INSTRUCTION OF VA PERSONNEL

- A. Provide competent instruction to VA personnel regarding the operation of equipment and accessories installed under this contract, for a period equal to one eight-hour workday. Instruction shall commence after completion of all work and at the time and place directed by the Resident Engineer.
- B. Written instructions in triplicate relative to care, adjustments and operation of all equipment and accessories shall be furnished and delivered to the Resident Engineer in independently bound folders. DVD recordings will also be acceptable. Written instructions shall include correct and legible wiring diagrams, nomenclature sheet of all electrical apparatus including location of each device, complete and comprehensive sequence of operation, complete replacement parts list with descriptive literature, and identification and diagrams of equipment and parts. Information shall also include electrical operation characteristics of all circuits, relays, timers, electronic devices, and related characteristics for all rotating equipment.
- C. Provide supplementary instruction for any new equipment that may become necessary because of changes, modifications or replacement of equipment or operation under requirements of paragraph entitled "Warranty of Construction".

3.8 ELEVATOR GUARANTEE PERIOD OF SERVICE: MAINTENANCE SERVICE AND INSPECTIONS

- A. Furnish complete maintenance service and inspections on each elevator installation for a period of one (1) year after completion and acceptance of each elevator in this specification by the Resident Engineer. This maintenance service shall run concurrently with the warranty. Maintenance work shall be performed by Certified Elevator Mechanics and Apprentices.
- B. This contract will cover full maintenance including emergency call back service, inspections and servicing the elevators listed in the schedule of elevator. The Elevator Contractor shall be required to perform the following:
 - 1. Monthly systematic examination of equipment.
 - 2. During each maintenance visit the Elevator Contractor shall clean, lubricate, adjust, repair and replace all parts as necessary to keep the equipment in like new condition and proper working order.

3. Furnishing all lubricant, cleaning materials, parts and tools necessary to perform the work required. Lubricants shall be only those products recommended by the manufacturer of the equipment.
 4. As required, motors, controllers, selectors, leveling devices, operating devices, switches on cars and in hoistways, hoistway doors and car doors or gate operating device, interlock contacts, guide shoes, guide rails, car door sills, hangers for doors, car doors or gates, and signal system shall be cleaned, lubricated and adjusted.
 5. Guide rails and bottom of platforms shall be cleaned every three months. Car tops and machine room floors shall be cleaned monthly. Accumulated rubbish shall be removed from the pits monthly. A general cleaning of the entire installation including all machine room equipment and hoistway equipment shall be accomplished quarterly. Cleaning supplies and vacuum cleaner shall be furnished by the Contractor.
 6. Maintain the performance standards set forth in this specification.
 7. The operational system shall be maintained to the standards specified hereinafter including any changes or adjustments required to meet varying conditions of hospital occupancy.
 8. Maintain smooth starting and stopping and accurate leveling.
- C. Maintenance service shall not include the performance of work required because if improper use, accidents, and negligence for which the Elevator Contractor is not directly responsible.
- D. Provide 24-hour emergency call-back service that shall consist of promptly responding to calls within two hours for emergency service should a shutdown or emergency develop between regular examinations. Overtime emergency call-back service shall be limited to minor adjustments and repairs required to protect the immediate safety of the equipment and persons in and about the elevator.
- E. Service and emergency personnel shall report to the Resident Engineer or his authorized representative upon arrival at the hospital and again upon completion of the required work. A copy of the work ticket containing a complete description of the work performed shall be given to the Resident Engineer.
- F. The Elevator Contractor shall maintain a logbook in the machine room. The log shall list the date and time of all bi-weekly examinations and all trouble calls. Each trouble call shall be fully described including

the nature of the call, necessary correction performed, or parts replaced.

- G. Written "Maintenance Control Program" shall be in place to maintain the equipment in compliance with ASME A17.1.

- - - E N D - - -