

**VAMHCS MEDICAL CENTER
WILMINGTON, DELAWARE**

**LIGHT POLE FOOTING
DESIGN**

CALCULATIONS

100% Submission

February 21, 2024

Prepared by:



**WHITNEY BAILEY COX & MAGNANI, LLC
300 East Joppa Road, Suite 200
Baltimore, MD 21286
wbcm.com
2022.0714.00**

Table of Contents

Basis of Design	1
Wind Speed.....	13
Wind Load Computation.....	14
Seismic Parameters	15
Seismic Load Computation.....	16
Light Pole Footing Size & Embedment Design	17
Light Pole Footing Reinforcement Design	18

\\A-e\balto\Projects\2023\23023600\Design\Structural\Calculation PACKAGE - 100% Submission - 02.21.2024\2023.0236.00 - VAMHCS MEDICAL CENTER WILMINGTON DE - 100% Submission - Structural Calculation Package.DOCX

Job Name: _____	Client Name: _____
Job Location - City: _____ State: _____	Created By: _____ Date: _____
Product: DS330 Quote: _____	Customer Approval: _____ Date: _____

SPECIFICATIONS

Pole Shaft - The pole shaft is fabricated from hot rolled welded steel tubing of one-piece construction with a minimum yield strength of 55 KSI.

Pole Top - A removable pole cap is provided for poles receiving drilling patterns for side-mount luminaire arm assemblies. For top mount luminaire and/or bracket consult the factory. Consult the luminaire manufacturer for correct tenon size or drill pattern. Other pole top options include pole cap only (PC) or plain top (PL) which is typical when the pole top diameter matches the necessary slip fit dimensions.

Handhole - A reinforced handhole with grounding provision is provided at 1'-6" from the base end of the pole assembly. Each handhole includes an easy to install, self-contained Swing Latch handhole cover assembly. U.S. Patent Swing Latch cover is fabricated from durable polycarbonate/ABS blend plastic. All pole assemblies are provided with a 2.50" x 5.00" rectangular handhole. Handhole dimensions are nominal.


Base Cover - A two-piece full base cover fabricated from ABS plastic is provided with each pole assembly. Additional base cover options, including the dart square (2T) cast aluminum cover, are available upon request.

Anchor Bolts - Anchor bolts conform to ASTM F1554 Grade 55 and are provided with two hex nuts and two flat washers. Bolts have an "L" bend on one end and are galvanized a minimum of 12" on the threaded end.

Hardware - All structural fasteners are galvanized high strength carbon steel. All non-structural fasteners are galvanized or zinc-plated carbon steel or stainless steel.

Finish - Standard finishes are either Galvanized (GV) or Finish Painted (FP). Additional finish options including Finish Paint over Galvanizing (FPGV) or any of the V-PRO™ Finish Coating Systems are available upon request. See the product ordering code for color options.

Design Criteria - Please reference Design Criteria Specification for appropriate design conditions.

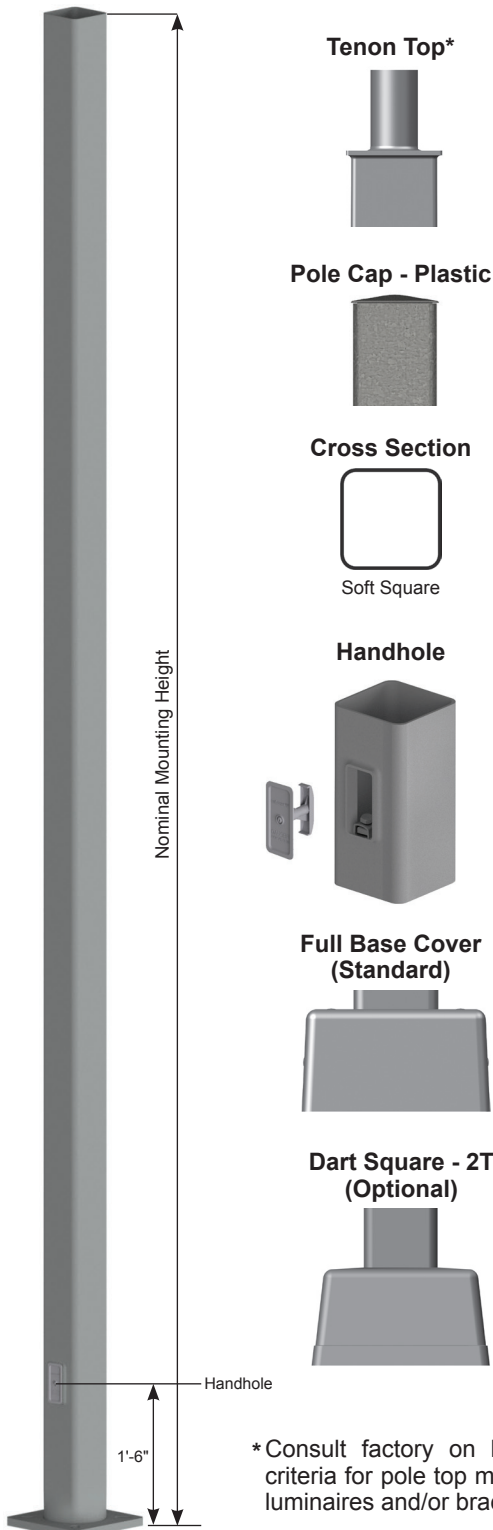

*Consult factory on loading criteria for pole top mounted luminaires and/or brackets.


DS330

Fatigue Resistant Soft Square Steel Post

Job Name: _____	Client Name: _____
Job Location - City: _____ State: _____	Created By: _____ Date: _____
Product: DS330 Quote: _____	Customer Approval: _____ Date: _____

ANCHORAGE DATA

POLE POLE BASE SQUARE (IN)	WALL THK (GA)	BOLT CIRCLE		BASE PLATE		ANCHOR BOLTS			
		DIA (IN)	± (IN)	SQUARE (IN)	THK (IN)	DIA x LENGTH x HOOK (IN)	PROJECTION (IN)	± (IN)	
4.00	11	8.50	0.50	8.25	0.750	0.75 x 17.00 x 3.00	3.50	0.25	
4.00	7	8.50	0.50	8.25	0.875	0.75 x 17.00 x 3.00	3.63	0.25	
5.00	11	11.00	1.00	11.00	1.000	0.75 x 17.00 x 3.00	3.75	0.25	
5.00	7	11.00	1.00	11.00	1.000	0.75 x 17.00 x 3.00	3.75	0.25	
6.00	7	12.00	1.00	12.50	1.000	1.00 x 36.00 x 4.00	4.25	0.25	

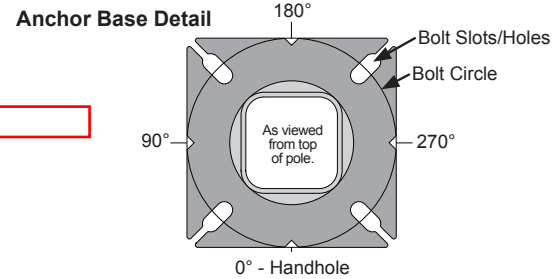

DESIGNATION, LOAD AND DIMENSIONAL DATA






DESIGN INFORMATION							POLE DIMENSIONS ³				DESIGNATION
NOMINAL MOUNTING HEIGHT	80 MPH w/1.3 GUST		90 MPH w/1.3 GUST		100 MPH w/1.3 GUST		SHAFT BASE SQUARE ³ (IN)	SHAFT TOP SQUARE (IN)	WALL THK (GA)	STRUCTURE WEIGHT ² (LBS)	
	MAX EPA ¹ (SQ FT)	MAX WEIGHT ¹ (LBS)	MAX EPA ¹ (SQ FT)	MAX WEIGHT ¹ (LBS)	MAX EPA ¹ (SQ FT)	MAX WEIGHT ¹ (LBS)					
10'-0"	30.6	765	23.8	595	18.9	473	4.00	4.00	11	75	400Q100
12'-0"	24.4	610	18.8	470	14.8	370	4.00	4.00	11	90	400Q120
14'-0"	19.9	498	15.1	378	11.7	293	4.00	4.00	11	100	400Q140
16'-0"	15.9	398	11.8	295	8.9	223	4.00	4.00	11	115	400Q160
18'-0"	12.6	315	9.2	230	6.7	168	4.00	4.00	11	125	400Q180
20'-0"	9.6	240	6.7	167	4.5	150	4.00	4.00	11	140	400Q200
	17.7	443	12.7	343	9.4	235	5.00	5.00	11	185	500Q200
	28.1	703	21.4	535	16.2	405	5.00	5.00	7	265	500W200
25'-0"	4.8	150	2.6	100	1.0	50	4.00	4.00	11	170	400Q250
	10.8	270	7.7	188	5.4	135	4.00	4.00	7	245	400W250
	9.8	245	6.3	157	3.7	150	5.00	5.00	11	225	500Q250
	18.5	463	13.3	333	9.5	238	5.00	5.00	7	360	500W250
30'-0"	6.7	168	4.4	110	2.6	65	4.00	4.00	7	291	400W300
	4.7	150	2.0	50	N/A	N/A	5.00	5.00	11	265	500Q300
	10.7	267	6.7	167	3.9	100	5.00	5.00	7	380	500W300
	19.0	475	13.2	330	9.0	225	6.00	6.00	7	520	600W300
35'-0"	5.9	150	2.5	100	N/A	N/A	5.00	5.00	7	440	500W350
	12.4	310	7.6	190	4.2	105	6.00	6.00	7	540	600W350
40'-0"	7.2	180	3.0	75	N/A	N/A	6.00	6.00	7	605	600W400

- Maximum EPA (Effective Projected Area) and weight values are based on side mounted fixtures only. Consult factory on loading criteria for pole top mounted luminaires and/or brackets. Variations from sizes above are available upon inquiry at the factory. Satisfactory performance of poles is dependent upon the pole being properly attached to a supporting foundation of adequate design.
- Structure weight is a nominal value which includes the pole shaft and base plate only.
- Belled-bottom will have reduced thickness due to the cold-working process. However, the belled-bottom meets or exceeds the structural capacity of the original square section. In addition, the rounded section provides better fatigue resistance.

PRODUCT ORDERING CODES

MODEL	DESIGNATION	FIXTURE MOUNTING	FINISH SYSTEM	STANDARD COLOR OPTIONS	BASE COVER	ANCHOR BOLTS	SUPPLEMENTAL INFO
DS330	400Q200	D2	FP	--	FBC	AB	
Select Correct Designation from the Load and Dimensional Data Chart.		Drill Mounting (See Orientation) D1 = (1) Drilling @ 270° D2 = (2) Drillings @ 90° & 270° D4 = (4) Drillings @ 0°, 90°, 180°, & 270° D5 = (2) Drillings @ 180° & 270° D6 = (3) Drillings @ 90°, 180°, & 270° Tenon Mounting P2 = 2.38" OD x 4" tenon P4 = 4.00" OD x 6" tenon P5 = 2.88" OD x 4" tenon P6 = 2.88" OD x 5" tenon P7 = 2.38" OD x 5" tenon P9 = Special Size (Specify) Other Options PC = Pole Cap PL = Plain Top (No Cap)	GV = Galvanized FP = Finish Painted ----- OPTIONAL FPGV = Finish Paint over Galvanizing VP30 = V-PRO™ 30 System VP32 = V-PRO™ 32 System VP53 = V-PRO™ 53 System VP54 = V-PRO™ 54 System VP57 = V-PRO™ 57 System VP100 = V-PRO™ 100 System VP105 = V-PRO™ 105 System	GV = Galvanized BK = Black DB = Dark Bronze MB = Medium Bronze WH = White LG = Light Gray CB = Bronze DG = Dark Green ST = Sandstone HTG = Hunter Green SG = Slate Gray SL = Silver SC = Special Color (Specify)	FBC = Full Base Cover ----- OPTIONAL 2T = Square Dart Cover	AB = With Anchor Bolts LAB = Without Anchor Bolts	

DS330 - Fatigue Resistant Square Non-Tapered Steel Pole

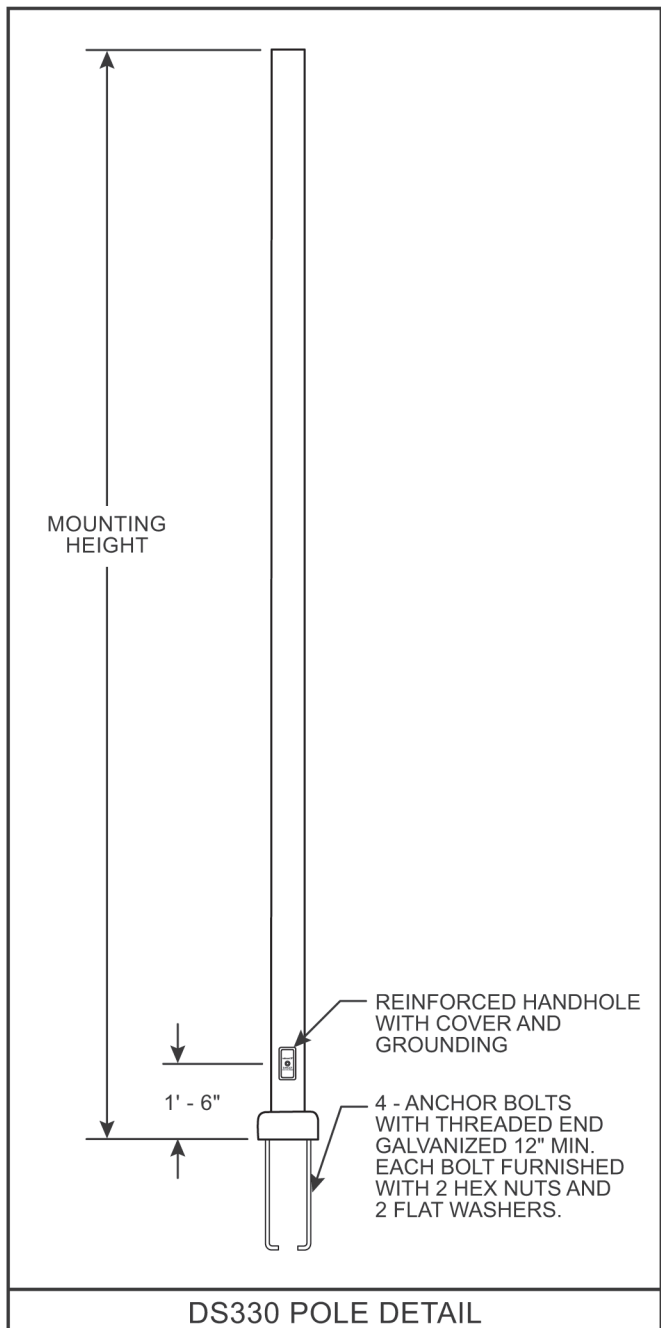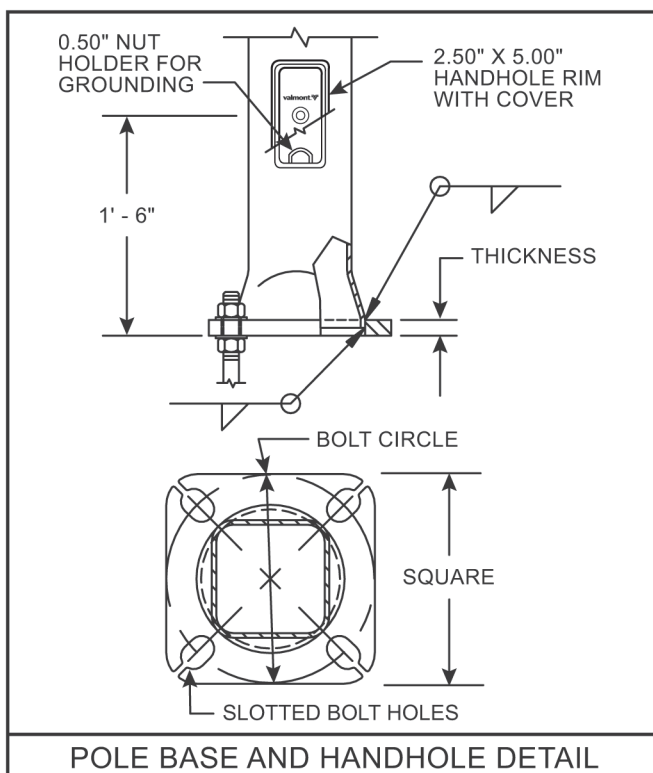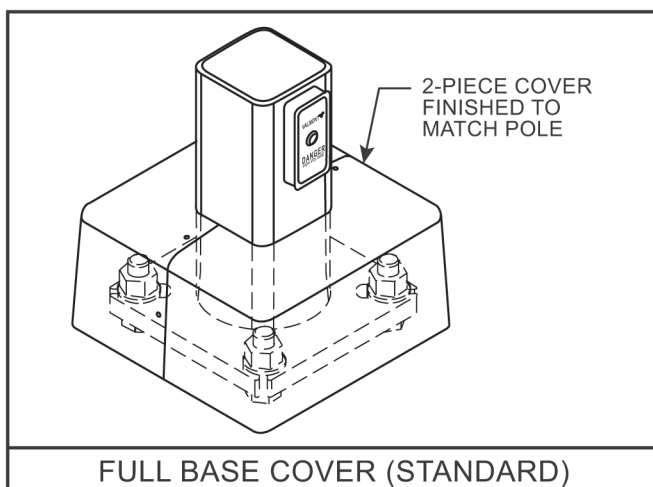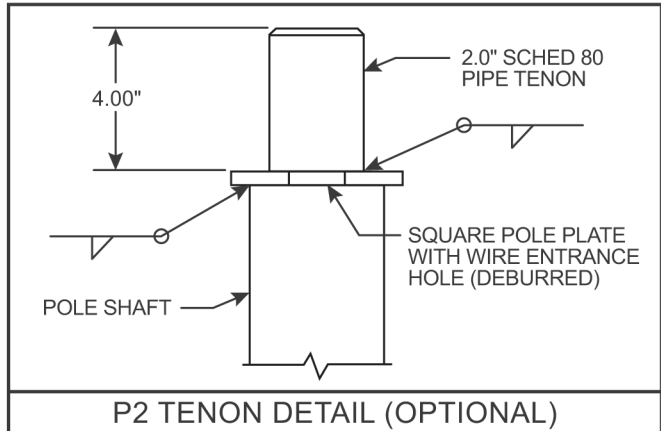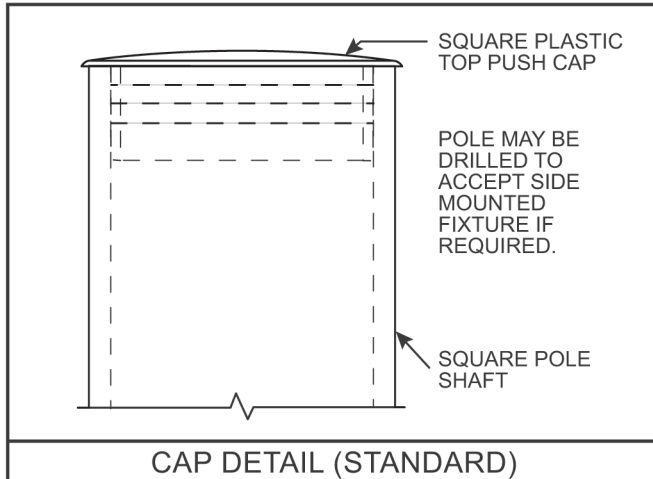



Gardco EcoForm Gen-2 combines economy with performance in an LED area luminaire. Capable of delivering up to 27,800 lumens or more in a compact, low profile LED luminaire, EcoForm offers a new level of customer value. EcoForm features an innovative retrofit arm kit, simplifying site conversions to LED by eliminating the need to drill additional holes in most existing poles. Integral control systems available for further energy savings. Includes Service Tag, our innovative way to provide assistance throughout the life of the product.

Project: _____
 Location: _____
 Cat.No: _____
 Type: _____
 Lamps: _____ Qty: _____
 Notes: _____

Ordering guide

example: ECF-S-64L-900-NW-G2-AR-5-120-HIS-MGY

Prefix		Number of LEDs		Drive Current		LED Color - Generation		Mounting		Distribution				Voltage	
ECF-S															
ECF-S	EcoForm site and area, small	32L	32 LEDs (2 modules)	365	365 mA	WW-G2	Warm White 3000K, 70CRI Generation 2	AR ²	Arm Mount (standard)	Type 2 2 Type 2 AFR Auto Front Row 2-90 Rotated left 90° AFR-90 Auto Front Row, Rotated left 90° 2-270 Rotated right 270° AFR-270 Auto Front Row, Rotated right 270°				120	120V
				530	530 mA									208	208V
		700	700 mA	NW-G2	Neutral White 4000K, 70CRI Generation 2	The following mounting kits must be ordered separately (See accessories)				240	240V				
		1A	1050 mA							277	277V				
				1.2A	1200 mA	CW-G2	Cool White 5000K, 70CRI Generation 2	SF ³	Slip Fitter Mount (fits to 2 3/8" O.D. tenon)	Type 3 3 Type 3 BLC Back Light Control 3-90 Rotated left 90° BLC-90 Back Light Control rotated at 90° 3-270 Rotated right 270° BLC-270 Back Light Control rotated at 270°				347	347V
														480	480V
														UNV	120-277V (50/60Hz)
		48L	48 LEDs (3 modules)	900	900 mA			WS	Wall mount with surface conduit rear entry permitted	Type 4 4 Type 4 LCL ¹⁹ LEED Corner Optic Left 4-90 Rotated left 90° 4-270 Rotated right 270° RCL ¹⁹ LEED Corner Optic Right				HVU	347-480V (50/60Hz)
				1A	1050 mA										
		64L	64 LEDs (4 modules)	900	900 mA			RAM ²	Retrofit arm mount kit	Type 5 5 Type 5 5W Type 5W					
				1A ¹⁹	1050 mA										

Options					
Dimming controls	Motion sensing lens	Photo-sensing	Electrical	Luminaire	Finish
DD^{4,18} 0-10V External dimming (for controls by others) DCC^{4,5,6,18} Dual Circuit Control FAWS^{4,5,18} Field Adjustable Wattage Selector LLC^{4,6,7,8,18} Integral wireless module BL^{14,7,18} Bi-level functionality SRDR^{4,5,6,8,17} SR driver connected to Zhaga socket DynaDimmer: Automatic Profile Dimming CS50^{4,8} Safety 50% Dimming, 7 hours CM50^{4,8} Median 50% Dimming, 8 hours CS30^{4,8} Safety 30% Dimming, 7 hours CM30^{4,8} Median 30% Dimming, 8 hours	IMRI3¹⁵ Integral with #3 lens IMRI7¹⁶ Integral with #7 lens	PCB^{8,9} Photocontrol Button TLRD5^{10,17} Twist Lock Receptacle 5 Pin TLRD7^{10,17} Twist Lock Receptacle 7 Pin TLRPC^{9,10,11,17} Twist Lock Receptacle w/ Photocell	Fusing F1⁹ Single (120, 277, 347VAC) F2⁹ Double (208, 240, 480VAC) Pole Mount Fusing FP1⁹ Single (120, 277, 347VAC) FP2⁹ Double (208, 240, 480VAC) FP3⁹ Canadian Double Pull (208, 240, 480VAC) Surge Protection (10kA standard) SP2 Increased 20kA	Square Pole Adapter included in standard product TB¹² Terminal Block RPA¹³ Round Pole Adapter (fits to 3"- 3.9" O.D. pole) HIS¹⁴ Internal House Side Shield	Textured BK Black WH White BZ Bronze DGY Dark Gray MGY Medium Gray Customer specified RAL Specify optional color or RAL (ex: RAL7024) CC Custom color (Must supply color chip for required factory quote)

- BL-IMRI3/7 equipped with out-boarded sensor housing when voltage is HVU (347-480V)
- Mounts to a 4" round pole with adapter included for square poles.
- Limited to a maximum of 45 degrees aiming above horizontal.
- Not available with other dimming control options.
- Not available with motion sensor.
- Not available with photocell.
- Must specify a motion sensor lens.
- Not available in 347 or 480V
- Must specify input voltage.
- TLRD5, TLRD7 and TLRPC receptacle pins 4 & 5 are capped off when ordered with any of the Dimming controls DD or FAWS or LLC.
- Not available in 480V. Order photocell separately with TLRD5/7.
- Not available with DCC.
- Not available with SF and WS. RPAs provided with black finish standard.
- HIS not available with Type 5, 5W, BLC, BLC-90, BLC-270, LCL or RCL optics.
- Not available with DD, DCC, and FAWS dimming control options.
- Not available with DD, DCC, FAWS and LLC dimming control options.
- When ordering SRDR, controller (by others) to be used on socket must be SR compatible (See specifications for more details). Consult factory for lead time. All 7 pins in NEMA receptacle are connected to SR driver. SRDR not available with TLRD5 or TLRPC.
- 0-10V dimming driver standard.
- LCL and RCL not available with 48L-1.2A or 64L-1A.

ECF-S EcoForm small

Area luminaire

EcoForm Accessories²¹ (ordered separately, field installed)

Shielding Accessories

Footnotes

20. Not available with Type 5 or 5W optics

21. Consult Signify to confirm whether specific accessories are BAA-compliant.

House Side shield

Standard optic orientation:

HIS-32-H²⁰ Internal House Side Shield for 32 LEDs (2 modules)

HIS-48-H²⁰ Internal House Side Shield for 48 LEDs (3 modules)

HIS-64-H²⁰ Internal House Side Shield for 64 LEDs (4 modules)

Optic at 90 or 270 orientation:

HIS-32-V²⁰ Internal House Side Shield for 32 LEDs (2 modules)

HIS-48-V²⁰ Internal House Side Shield for 48 LEDs (3 modules)

HIS-64-V²⁰ Internal House Side Shield for 64 LEDs (4 modules)

Luminaire Accessories

ECF-BD-G2 Bird deterrent
ECF-RAM-G2-(F) Retrofit Arm mount kit
ECF-SF-G2-(F) Slip Fitter Mount (fits to 2 3/8" O.D. tenon)
ECF-WS-G2-(F) Wall mount with surface conduit rear entry permitted

EcoForm PTF2
(pole top fitter fits 23/8-21/2" OD x 4" depth tenon)

PTF2-ECF-S/L-1-90-(F) 1 luminaire at 90°
PTF2-ECF-S/L-2-90-(F) 2 luminaires at 90°
PTF2-ECF-S/L-2-180-(F) 2 luminaires at 180°
PTF2-ECF-S/L-3-90-(F) 3 luminaires at 90°
PTF2-ECF-S/L-4-90-(F) 4 luminaires at 90°
PTF2-ECF-S/L-3-120-(F) 3 luminaires at 120°

(F) = Specify finish

EcoForm PTF3
(pole top fitter fits 3-31/2" OD x 6" depth tenon)

PTF3-ECF-S/L-1-90-(F) 1 luminaire at 90°
PTF3-ECF-S/L-2-90-(F) 2 luminaires at 90°
PTF3-ECF-S/L-2-180-(F) 2 luminaires at 180°
PTF3-ECF-S/L-3-90-(F) 3 luminaires at 90°
PTF3-ECF-S/L-4-90-(F) 4 luminaires at 90°
PTF3-ECF-S/L-3-120-(F) 3 luminaires at 120°

EcoForm PTF4
(pole top fitter fits 31/2-4" OD x 6" depth tenon)

PTF4-ECF-S/L-1-90-(F) 1 luminaire at 90°
PTF4-ECF-S/L-2-90-(F) 2 luminaires at 90°
PTF4-ECF-S/L-2-180-(F) 2 luminaires at 180°
PTF4-ECF-S/L-3-90-(F) 3 luminaires at 90°
PTF4-ECF-S/L-4-90-(F) 4 luminaires at 90°
PTF4-ECF-S/L-3-120-(F) 3 luminaires at 120°

Ready to Go configurations (when ordered with the "RS-" catalog code, the following configurations will ship in 2 weeks):

Catalog Number	12NC
RS-ECF-S-32L-1A-NW-G2-AR-3-UNV-BZ	912401466002
RS-ECF-S-32L-1A-NW-G2-AR-3-UNV-MGY	912401466003
RS-ECF-S-32L-1A-NW-G2-AR-3-UNV-BK	912401534554
RS-ECF-S-32L-1A-NW-G2-AR-4-UNV-BZ	912401466004
RS-ECF-S-32L-1A-NW-G2-AR-4-UNV-MGY	912401466005
RS-ECF-S-32L-1A-NW-G2-AR-4-UNV-BK	912401534555
RS-ECF-S-32L-1A-NW-G2-AR-5-UNV-BZ	912401466006
RS-ECF-S-32L-1A-NW-G2-AR-5-UNV-MGY	912401466007
RS-ECF-S-32L-1A-NW-G2-AR-5-UNV-BK	912401534556
RS-ECF-S-48L-1A-NW-G2-AR-3-UNV-BZ	912401466008
RS-ECF-S-48L-1A-NW-G2-AR-3-UNV-MGY	912401466009
RS-ECF-S-48L-1A-NW-G2-AR-3-UNV-BK	912401534557
RS-ECF-S-48L-1A-NW-G2-AR-4-UNV-BZ	912401466010
RS-ECF-S-48L-1A-NW-G2-AR-4-UNV-MGY	912401466011
RS-ECF-S-48L-1A-NW-G2-AR-4-UNV-BK	912401534558
RS-ECF-S-48L-1A-NW-G2-AR-5-UNV-BZ	912401466012
RS-ECF-S-48L-1A-NW-G2-AR-5-UNV-MGY	912401466013
RS-ECF-S-48L-1A-NW-G2-AR-5-UNV-BK	912401534559
RS-ECF-S-64L-1A-NW-G2-AR-3-UNV-BZ	912401466014
RS-ECF-S-64L-1A-NW-G2-AR-3-UNV-MGY	912401466015

Catalog Number	12NC
RS-ECF-S-64L-1A-NW-G2-AR-3-UNV-BK	912401534560
RS-ECF-S-64L-1A-NW-G2-AR-4-UNV-BZ	912401466016
RS-ECF-S-64L-1A-NW-G2-AR-4-UNV-MGY	912401466017
RS-ECF-S-64L-1A-NW-G2-AR-4-UNV-BK	912401534561
RS-ECF-S-64L-1A-NW-G2-AR-5-UNV-BZ	912401466018
RS-ECF-S-64L-1A-NW-G2-AR-5-UNV-MGY	912401466019
RS-ECF-S-64L-1A-NW-G2-AR-5-UNV-BK	912401534562
RS-ECF-RAM-G2-DGY	912401466487
RS-ECF-RAM-G2-MGY	912401466488
RS-ECF-RAM-G2-WH	912401466485
RS-ECF-RAM-G2-BZ	912401466486
RS-ECF-RAM-G2-BK	912401466484
RS-HIS-32-H	912401466489
RS-HIS-48-H	912401466491
RS-HIS-64-H	912401466493

ECF-S EcoForm small

Area lumineaire


Predicted Lumen Depreciation Data

Predicted performance derived from LED manufacturer's data and engineering design estimates, based on IESNA LM-80 methodology. Actual experience may vary due to field application conditions. L70 is the predicted time when LED performance depreciates to 70% of initial lumen output. Calculated per IESNA TM21-11. Published L70 hours limited to 6 times actual LED test hours

Ambient Temperature °C	Driver mA	Calculated L70 Hours	L70 per TM-21	Lumen Maintenance % at 60,000 hrs
25°C	up to 1200 mA	>100,000 hours	>120,000 hours	>99%

Optical Distributions

Based on configuration ECF-S-48L-1A-NW-G2 (159W) mounted at 20ft.

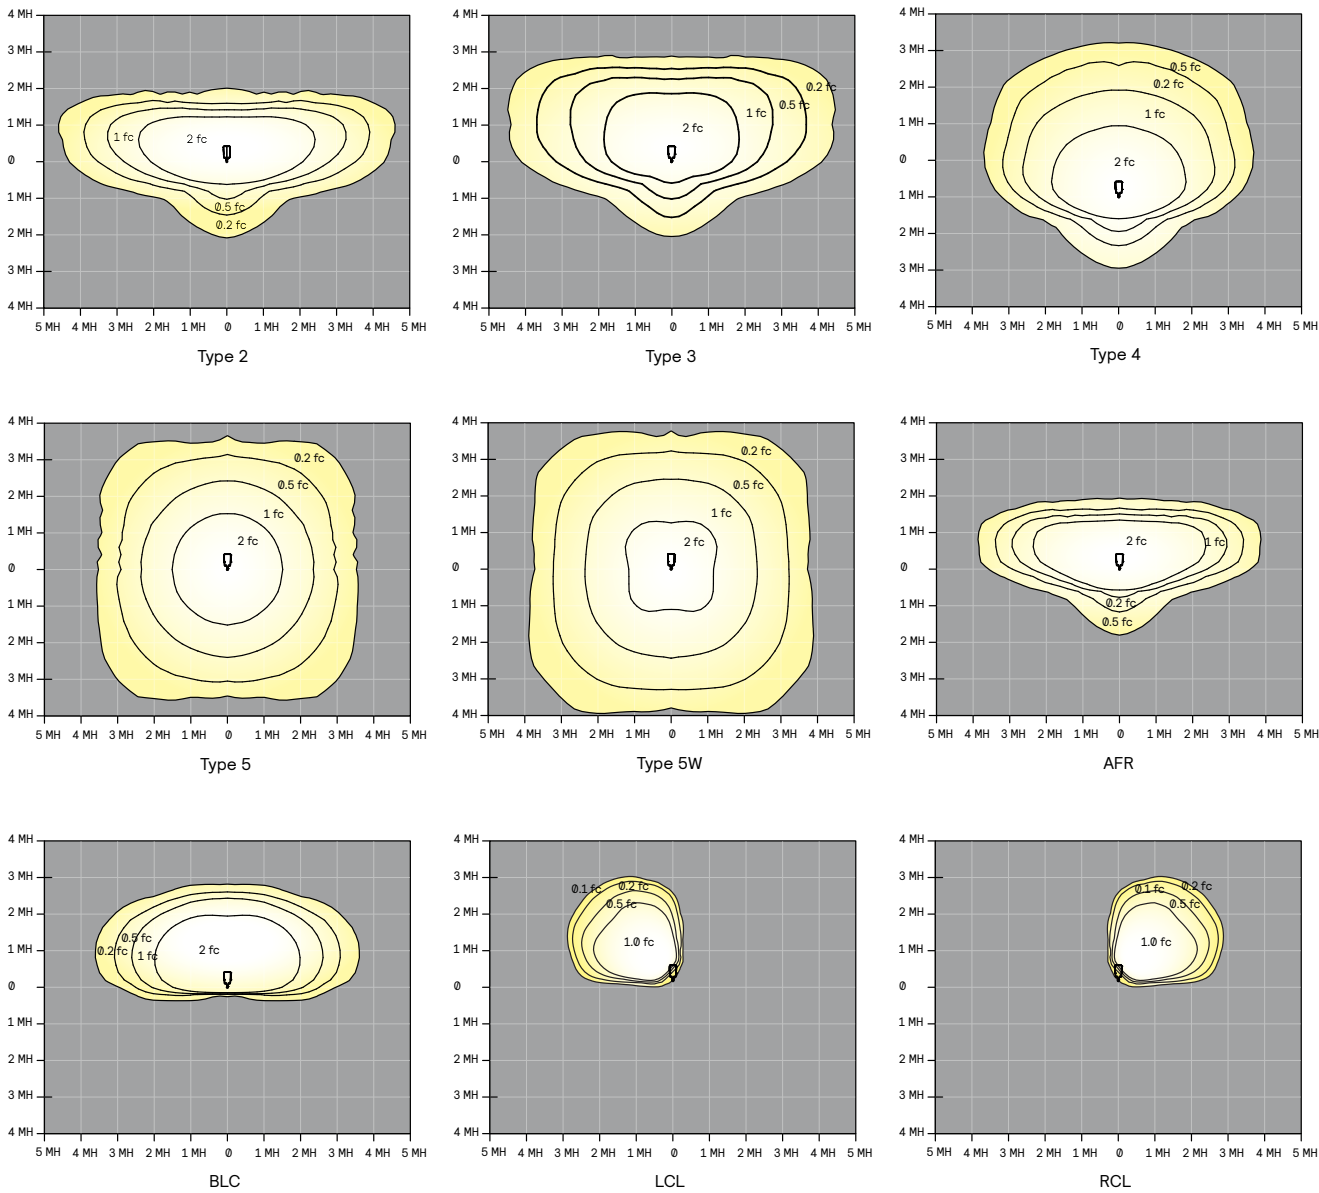

ECF-S EcoForm small

Area luminaire

3000K LED Wattage and Lumen Values

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type 2			Type 3			Type 4			Type 5			Type 5W		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-WW-G2-x	32	365	3000	40	5,508	B1-U0-G1	138	5,428	B1-U0-G2	136	5,637	B1-U0-G2	141	5,790	B3-U0-G1	145	5,604	B3-U0-G1	140
ECF-S-32L-530-WW-G2-x	32	530	3000	56	7,159	B2-U0-G2	129	7,055	B1-U0-G2	127	7,327	B1-U0-G2	132	7,526	B3-U0-G2	135	7,284	B3-U0-G2	131
ECF-S-32L-700-WW-G2-x	32	700	3000	73	9,234	B2-U0-G2	127	9,034	B2-U0-G2	124	9,452	B2-U0-G2	130	9,707	B4-U0-G2	133	9,395	B4-U0-G2	129
ECF-S-32L-1A-WW-G2-x	32	1050	3000	106	13,001	B3-U0-G2	123	12,719	B2-U0-G2	120	13,306	B2-U0-G3	126	13,665	B4-U0-G2	129	13,227	B4-U0-G2	125
ECF-S-32L-1.2A-WW-G2-x	32	1200	3000	122	14,421	B3-U0-G3	119	14,108	B2-U0-G3	116	14,760	B2-U0-G3	121	15,158	B4-U0-G2	125	14,671	B4-U0-G2	121
ECF-S-48L-900-WW-G2-x	48	900	3000	135	17,115	B3-U0-G3	127	16,744	B3-U0-G3	124	17,518	B2-U0-G3	130	17,990	B4-U0-G2	133	17,413	B5-U0-G3	129
ECF-S-48L-1A-WW-G2-x	48	1050	3000	159	19,381	B3-U0-G3	122	18,960	B3-U0-G3	119	19,836	B3-U0-G4	125	20,372	B5-U0-G3	128	19,717	B5-U0-G3	124
ECF-S-48L-1.2A-WW-G2-x	48	1200	3000	183	21,515	B3-U0-G3	118	21,048	B3-U0-G4	115	22,020	B3-U0-G4	121	22,616	B5-U0-G3	124	21,888	B5-U0-G3	120
ECF-S-64L-900-WW-G2-x	64	900	3000	178	22,652	B3-U0-G3	127	22,161	B3-U0-G4	125	23,185	B3-U0-G4	130	23,810	B5-U0-G3	134	23,045	B5-U0-G3	130
ECF-S-64L-1A-WW-G2-x	64	1050	3000	206	25,520	B3-U0-G3	124	24,966	B3-U0-G4	121	26,120	B3-U0-G4	127	26,150	B5-U0-G3	127	25,964	B5-U0-G4	126

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type AFR			BLC			LCL or RCL		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-WW-G2-x	32	365	3000	40	5,706	B2-U0-G1	143	3,691	B0-U0-G1	94	2,449	B0-U0-G1	62
ECF-S-32L-530-WW-G2-x	32	530	3000	56	7,417	B2-U0-G1	133	5,005	B0-U0-G2	91	3,183	B0-U0-G1	58
ECF-S-32L-700-WW-G2-x	32	700	3000	73	9,567	B2-U0-G2	131	6,409	B0-U0-G2	89	4,106	B0-U0-G1	57
ECF-S-32L-1A-WW-G2-x	32	1050	3000	106	13,467	B3-U0-G2	128	9,024	B1-U0-G2	87	5,793	B0-U0-G2	56
ECF-S-32L-1.2A-WW-G2-x	32	1200	3000	122	14,939	B3-U0-G2	123	10,010	B1-U0-G2	84	6,426	B0-U0-G2	54
ECF-S-48L-900-WW-G2-x	48	900	3000	135	17,731	B3-U0-G2	131	11,880	B1-U0-G2	89	7,626	B0-U0-G2	57
ECF-S-48L-1A-WW-G2-x	48	1050	3000	159	20,076	B3-U0-G2	127	13,453	B1-U0-G2	86	8,636	B0-U0-G2	55
ECF-S-48L-1.2A-WW-G2-x	48	1200	3000	183	22,288	B3-U0-G2	122	14,934	B1-U0-G3	83			
ECF-S-64L-900-WW-G2-x	64	900	3000	178	23,465	B3-U0-G2	132	15,723	B1-U0-G3	90	10,093	B0-U0-G2	58
ECF-S-64L-1A-WW-G2-x	64	1050	3000	206	26,437	B4-U0-G3	128	17,714	B1-U0-G3	87			

4000K LED Wattage and Lumen Values

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type 2			Type 3			Type 4			Type 5			Type 5W		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-NW-G2-x	32	365	4000	40	5,798	B1-U0-G1	145	5,713	B1-U0-G2	143	5,934	B1-U0-G2	148	6,094	B3-U0-G1	152	5,898	B3-U0-G2	147
ECF-S-32L-530-NW-G2-x	32	530	4000	56	7,536	B2-U0-G2	135	7,426	B1-U0-G2	133	7,713	B1-U0-G2	138	7,922	B3-U0-G2	142	7,667	B3-U0-G2	138
ECF-S-32L-700-NW-G2-x	32	700	4000	73	9,720	B2-U0-G2	133	9,509	B2-U0-G2	130	9,949	B2-U0-G2	136	10,218	B4-U0-G2	140	9,889	B4-U0-G2	136
ECF-S-32L-1A-NW-G2-x	32	1050	4000	106	13,685	B3-U0-G2	130	13,388	B2-U0-G3	127	14,006	B2-U0-G3	133	14,384	B4-U0-G2	136	13,923	B4-U0-G2	132
ECF-S-32L-1.2A-NW-G2-x	32	1200	4000	122	15,180	B3-U0-G3	125	14,851	B2-U0-G3	122	15,537	B2-U0-G3	128	15,956	B4-U0-G2	131	15,443	B4-U0-G2	127
ECF-S-48L-900-NW-G2-x	48	900	4000	135	18,016	B3-U0-G3	133	17,625	B3-U0-G3	130	18,440	B3-U0-G3	136	18,937	B4-U0-G3	140	18,329	B5-U0-G3	136
ECF-S-48L-1A-NW-G2-x	48	1050	4000	159	20,401	B3-U0-G3	129	19,958	B3-U0-G4	126	20,880	B3-U0-G4	132	21,444	B5-U0-G3	135	20,755	B5-U0-G3	131
ECF-S-48L-1.2A-NW-G2-x	48	1200	4000	183	22,647	B3-U0-G3	124	22,156	B3-U0-G4	121	23,179	B3-U0-G4	127	23,806	B5-U0-G3	130	23,040	B5-U0-G3	126
ECF-S-64L-900-NW-G2-x	64	900	4000	178	23,844	B3-U0-G3	134	23,327	B3-U0-G4	131	24,405	B3-U0-G4	137	25,063	B5-U0-G3	141	24,258	B5-U0-G4	136
ECF-S-64L-1A-NW-G2-x	64	1050	4000	206	26,863	B3-U0-G3	130	26,280	B3-U0-G4	128	27,495	B3-U0-G4	134	27,526	B5-U0-G3	134	27,330	B5-U0-G4	133

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type AFR			BLC			LCL or RCL		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-NW-G2-x	32	365	4000	40	6,006	B2-U0-G1	150	3,991	B0-U0-G1	101	2,633	B0-U0-G1	67
ECF-S-32L-530-NW-G2-x	32	530	4000	56	7,807	B2-U0-G1	140	5,412	B0-U0-G2	99	3,423	B0-U0-G1	62
ECF-S-32L-700-NW-G2-x	32	700	4000	73	10,070	B2-U0-G2	138	6,930	B0-U0-G2	96	4,415	B0-U0-G1	61
ECF-S-32L-1A-NW-G2-x	32	1050	4000	106	14,176	B3-U0-G2	134	9,756	B1-U0-G2	94	6,229	B0-U0-G2	60
ECF-S-32L-1.2A-NW-G2-x	32	1200	4000	122	15,725	B3-U0-G2	129	10,822	B1-U0-G2	90	6,910	B0-U0-G2	58
ECF-S-48L-900-NW-G2-x	48	900	4000	135	18,664	B3-U0-G2	138	12,843	B1-U0-G2	96	8,200	B0-U0-G2	62
ECF-S-48L-1A-NW-G2-x	48	1050	4000	159	21,133	B3-U0-G2	133	14,544	B1-U0-G3	93	9,286	B0-U0-G2	59
ECF-S-48L-1.2A-NW-G2-x	48	1200	4000	183	23,461	B3-U0-G2	128	16,145	B1-U0-G3	90			
ECF-S-64L-900-NW-G2-x	64	900	4000	178	24,700	B3-U0-G2	139	16,998	B1-U0-G3	97	10,853	B0-U0-G2	62
ECF-S-64L-1A-NW-G2-x	64	1050	4000	206	27,828	B4-U0-G3	135	19,150	B1-U0-G3	94			

ECF-S EcoForm small

Area luminaire

5000K LED Wattage and Lumen Values

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type 2			Type 3			Type 4			Type 5			Type 5W		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-CW-G2-x	32	365	5000	40	5,798	B1-U0-G1	145	5,713	B1-U0-G2	143	5,934	B1-U0-G2	148	6,094	B3-U0-G1	152	5,898	B3-U0-G2	147
ECF-S-32L-530-CW-G2-x	32	530	5000	56	7,536	B2-U0-G2	135	7,426	B1-U0-G2	133	7,713	B1-U0-G2	138	7,922	B3-U0-G2	142	7,667	B3-U0-G2	138
ECF-S-32L-700-CW-G2-x	32	700	5000	73	9,720	B2-U0-G2	133	9,509	B2-U0-G2	130	9,949	B2-U0-G2	136	10,218	B4-U0-G2	140	9,889	B4-U0-G2	136
ECF-S-32L-1A-CW-G2-x	32	1050	5000	106	13,685	B3-U0-G2	130	13,388	B2-U0-G3	127	14,006	B2-U0-G3	133	14,384	B4-U0-G2	136	13,923	B4-U0-G2	132
ECF-S-32L-1.2A-CW-G2-x	32	1200	5000	122	15,180	B3-U0-G3	125	14,851	B2-U0-G3	122	15,537	B2-U0-G3	128	15,956	B4-U0-G2	131	15,443	B4-U0-G2	127
ECF-S-48L-900-CW-G2-x	48	900	5000	135	18,016	B3-U0-G3	133	17,625	B3-U0-G3	130	18,440	B3-U0-G3	136	18,937	B4-U0-G3	140	18,329	B5-U0-G3	136
ECF-S-48L-1A-CW-G2-x	48	1050	5000	159	20,401	B3-U0-G3	129	19,958	B3-U0-G4	126	20,880	B3-U0-G4	132	21,444	B5-U0-G3	135	20,755	B5-U0-G3	131
ECF-S-48L-1.2A-CW-G2-x	48	1200	5000	183	22,647	B3-U0-G3	124	22,156	B3-U0-G4	121	23,179	B3-U0-G4	127	23,806	B5-U0-G3	130	23,040	B5-U0-G3	126
ECF-S-64L-900-CW-G2-x	64	900	5000	178	23,844	B3-U0-G3	134	23,327	B3-U0-G4	131	24,405	B3-U0-G4	137	25,063	B5-U0-G3	141	24,258	B5-U0-G4	136
ECF-S-64L-1A-CW-G2-x	64	1050	5000	206	26,863	B3-U0-G3	130	26,280	B3-U0-G4	128	27,495	B3-U0-G4	134	27,526	B5-U0-G3	134	27,330	B5-U0-G4	133

Ordering Code	Total LEDs	LED Current (mA)	Color Temp.	Average System Watts	Type AFR			BLC			LCL or RCL		
					Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)	Lumen Output	BUG Rating	Efficacy (LPW)
ECF-S-32L-365-CW-G2-x	32	365	5000	40	6,006	B2-U0-G1	150	3,991	B0-U0-G1	101	2,633	B0-U0-G1	67
ECF-S-32L-530-CW-G2-x	32	530	5000	56	7,807	B2-U0-G1	140	5,412	B0-U0-G2	99	3,423	B0-U0-G1	62
ECF-S-32L-700-CW-G2-x	32	700	5000	73	10,070	B2-U0-G2	138	6,930	B0-U0-G2	96	4,415	B0-U0-G1	61
ECF-S-32L-1A-CW-G2-x	32	1050	5000	106	14,176	B3-U0-G2	134	9,756	B1-U0-G2	94	6,229	B0-U0-G2	60
ECF-S-32L-1.2A-CW-G2-x	32	1200	5000	122	15,725	B3-U0-G2	129	10,822	B1-U0-G2	90	6,910	B0-U0-G2	58
ECF-S-48L-900-CW-G2-x	48	900	5000	135	18,664	B3-U0-G2	138	12,843	B1-U0-G2	96	8,200	B0-U0-G2	62
ECF-S-48L-1A-CW-G2-x	48	1050	5000	159	21,133	B3-U0-G2	133	14,544	B1-U0-G3	93	9,286	B0-U0-G2	59
ECF-S-48L-1.2A-CW-G2-x	48	1200	5000	183	23,461	B3-U0-G2	128	16,145	B1-U0-G3	90			
ECF-S-64L-900-CW-G2-x	64	900	5000	178	24,700	B3-U0-G2	139	16,998	B1-U0-G3	97	10,853	B0-U0-G2	62
ECF-S-64L-1A-CW-G2-x	64	1050	5000	206	27,828	B4-U0-G3	135	19,150	B1-U0-G3	94			


ECF-S EcoForm small

Area lumineuse

Dimensions


Standard Arm (AR)

Weight: 22 Lbs (9.9 Kg) EPA: 0.21ft² (.019m²)

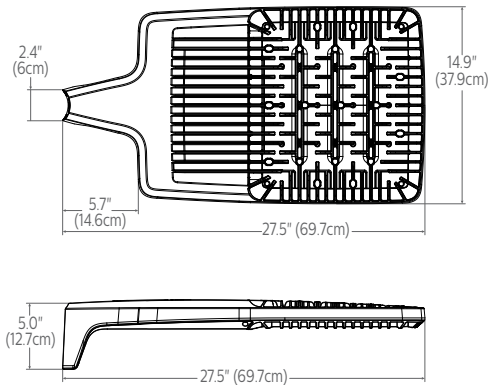


Wall (WS)

Weight: 27 Lbs. (12. 2Kg)EPA: 0.27ft² (.025m²)

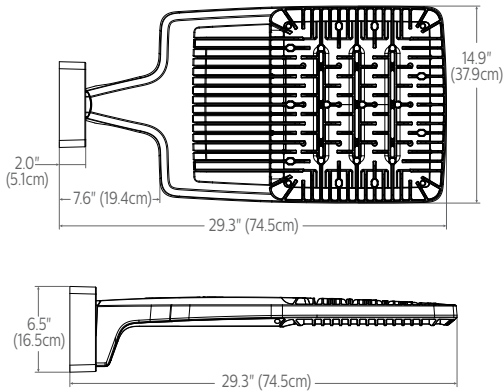


Retrofit Arm (RAM)

Weight: 24 Lbs (10.9 Kg) EPA: 0.24ft² (.022m²)

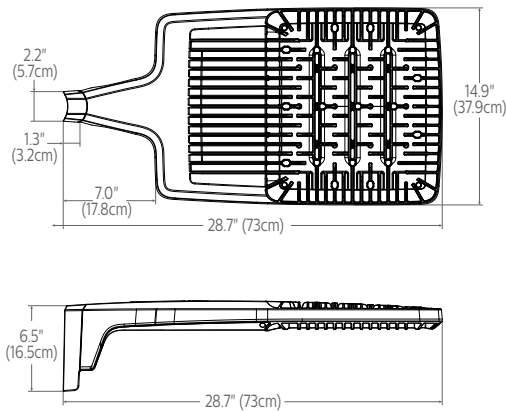


Slip fitter (SF)


Weight: 27 Lbs (12.2 Kg) EPA: 0.33ft² (.031m²)

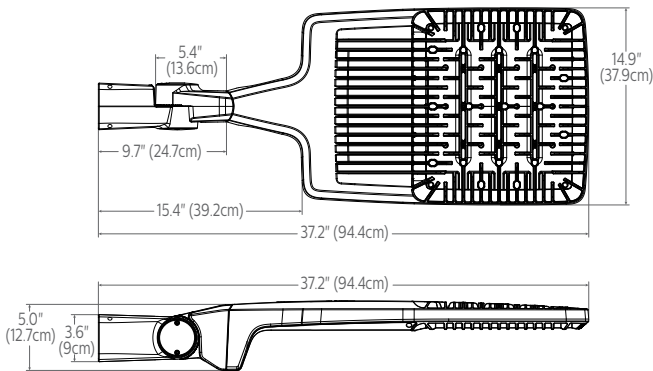


Outboard IMR-HVU sensor

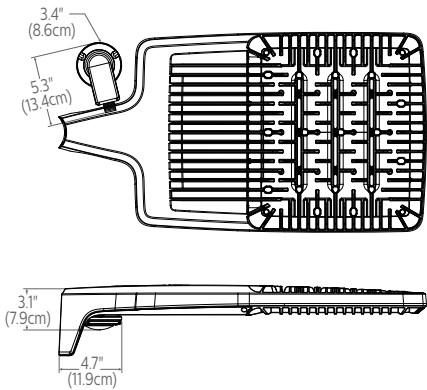

Standard Arm (AR) drill pattern



Retrofit Arm (RAM) drill pattern

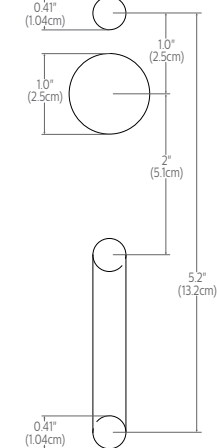


ECF-S EcoForm small

Area luminaire

Optical Orientation Information

Standard Optic Position


Luminaires ordered with asymmetric optical systems in the standard optic position will have the optical system oriented as shown below:

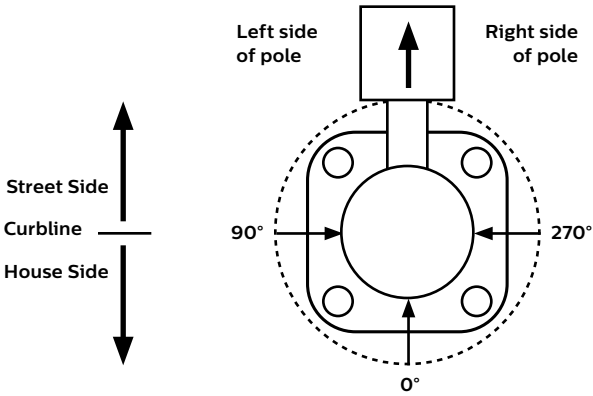

Note: The hand hole will normally be located on the pole at the 0° point.

Optic Rotated Left (90°) Optic Position


Luminaires ordered with optical systems in the Optic Rotated Left (90°) optic position will have the optical system oriented as shown below (Type 5 and 5W optics are not available with factory set rotatable optics):

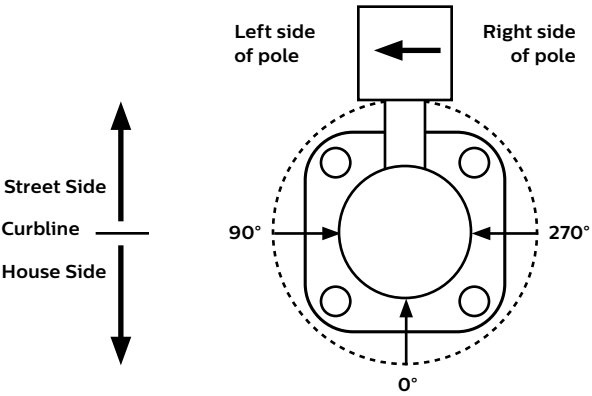

Note: The hand hole will normally be located on the pole at the 0° point.

Optic Rotated Right (270°) Optic Position


Luminaires ordered with optical systems in the Optic Rotated Right (270°) optic position will have the optical system oriented as shown below (Type 5 and 5W optics are not available with factory set rotatable optics):

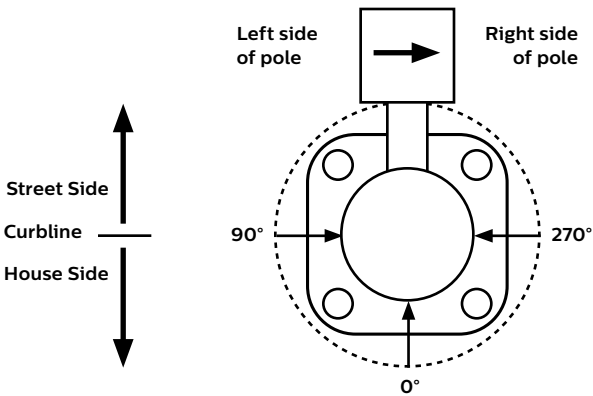

Note: The hand hole will normally be located on the pole at the 0° point.

Twin Luminaire Assemblies with Type-90/Type-270 Rotated Optical Systems

Twin luminaire assemblies installed with rotated optical systems are an excellent way to direct light toward the interior of the site (Street Side) without additional equipment. It is important, however, that care be exercised to insure that luminaires are installed in the proper location.

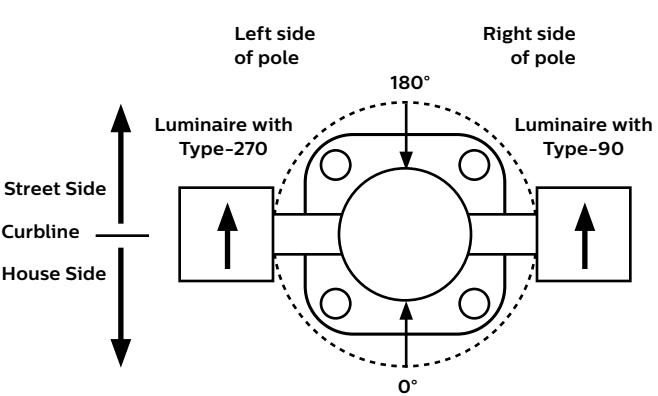

Luminaires with Optic Rotated Right (270°) are installed on the LEFT Side of Pole

Luminaires with Optic Rotated Left (90°) are installed on the RIGHT Side of Pole

Note: The hand hole location will depend on the drilling configuration ordered for the pole.

ECF-S EcoForm small

Area luminaire

Specifications

Housing

One-piece die cast aluminum housing with integral arm and separate, self-retained hinged, one-piece die cast door frame. Luminaire housing rated to IP65, tested in accordance to Section 9 of IEC 60598-1.

Vibration resistance

Luminaire is tested and rated 3G over 100,000 cycles conforming to standards set forth by ANSI C136.31-2018. Testing includes vibration in three axes, all performed on the same luminaire.

Light engine

Light engine comprises of a module of 16-LED aluminum metal clad board fully sealed with optics offered in multiples of 2, 3, and 4 modules or 32, 48, and 64 LEDs. Module is RoHS compliant. Color temperatures: 3000K +/-125K, 4000K, 5000K +/- 200K. Minimum CRI of 70. LED light engine is rated IP66 in accordance to Section 9 of IEC 60598-1.

Energy saving benefits

System efficacy up to 152 lms/W with significant energy savings over Pulse Start Metal Halide luminaires. Optional control options provide added energy savings during unoccupied periods.

Optical systems

Type 2, 3, 4, 5, 5W, and AFR distributions available. Internal Shield option mounts to LED optics and is available with Type 2, 3, 4, and AFR distributions, including a dedicated BLC, LCL, and RCL optics to provide the best backlight control possible for those stringent requirements around property lines. Types 2, 3, 4, AFR, and BLC when specified and used as rotated, are factory set only. Performance tested per LM-79 and TM-15 (IESNA) certifying its photometric performance. Luminaire designed with 0% uplight (U0 per IESNA TM-15).

Mounting

Standard luminaire arm mounts to 4" O.D. round poles. Can also be used with 5" O.D. poles. Square pole adapter included with every luminaire. Round Pole Adapter (RPA) required for 3-3.9" poles. EcoForm features a retrofit arm kit. When specified with the retrofit arm (RAM) option, EcoForm seamlessly simplifies site conversions to LED by eliminating the need for additional pole drilling on most existing poles. RAM will be boxed separately. Also optional are slipfitter and wall mounting accessories. Note that only fixed mounts (AR, RAM, WS) are required to meet IDA compliance. SF mounting will not meet IDA.

Control options

0-10V dimming (DD): Access to 0-10V dimming leads supplied through back of luminaire (for secondary dimming controls by others). Cannot be used with other control options.

Dual Circuit Control (DCC): Luminaire equipped with the ability to have two separate circuits controlling drivers and light engines independently. Permits separate switching of separate modules controlled by use of two sets of leads, one for each circuit. Not recommended to be used with other control options, motion response, or photocells.

Sensor Ready Zhaga Socket Connector (SRDR): Product equipped with Sensor Ready drivers connected to 4-pin Zhaga Book 18 compliant receptacle designed for sensor and other control system applications. Receptacle is rated IP66 assembly in a compact design that provides a sealed electrical interface and rated UV resistance, mounted on underside of the luminaire, protective dust cap included. When a controller not provided by Signify is used with Sensor Ready Zhaga socket connector, the controller must be certified to work with the Xitanium SR LED drivers as part of the SR certified program. SRDR can be used with NEMA 7-pin twist lock receptacle, which is mounted on top of the luminaire.

Automatic Profile Dimming (CS/CM/CE/CA): Standard dimming profiles provide flexibility towards energy savings goals while optimizing light levels during specific dark hours. Dimming profiles include two dimming settings including dim to 30% or 50% of the total lumen output. When used in combination with not programmed motion response it overrides the controller's schedule when motion is detected. After 5 minutes with no motion, it will return to the automatic dimming profile schedule. Automatic dimming profile scheduled with the following settings:

- **CS50/CS30:** Security for 7 hours night duration (Ex., 11 PM – 6 AM)
- **CM50/CM30:** Median for 8 hours night duration (Ex., 10 PM – 6 AM)

All above profiles are calculated from mid point of the night. Dimming is set for 6 hours after the mid point and 1 or 2 hours before depending of the duration of dimming. Cannot be used with other dimming control options.


Field Adjustable Wattage Selector (FAWS): Luminaire equipped with the ability to manually adjust the wattage in the field to reduce total luminaire lumen output and light levels. Comes pre-set to the highest position at the lumen output selected. Use chart below to estimate reduction in lumen output desired. Cannot be used with other control options or motion response.

FAWS Position	Percent of Typical Lumen Output
1	25%
2	50%
3	55%
4	65%
5	75%
6	80%
7	85%
8	90%
9	95%
10	100%

Note: Typical value accuracy +/- 5%

Wireless system (LLC): Optional wireless controller integral to luminaire ready to be connected to a Limelight system (sold by others). The system allows you to wirelessly manage the entire site, independent lighting groups or individual luminaires while on-site or remotely. Based on a high-density mesh network with an easy to use web-based portal, you can conveniently access, monitor and manage your lighting network remotely. Wireless controls can be combined with site and area, pedestrian, and parking garage luminaires as well, for a completely connected outdoor solution. Equipped with motion response with #3 lens for 8-25' mounting heights. Also available with remote pod accessory where pod is mounted separate from luminaire to pole or wall.

LLC wireless controller with #3 lens

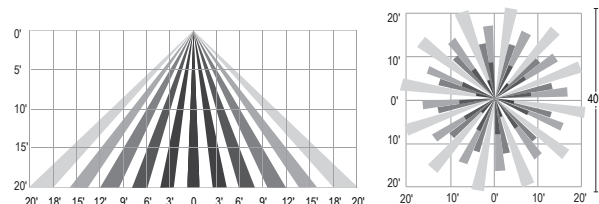

Motion response options

Bi-Level Infrared Motion Response (BL-IMRI): Motion Response module is mounted integral to luminaire factory pre-programmed to 50% dimming when not ordered with other control options. BL-IMRI is set/operates in the following fashion: The motion sensor is set to a constant 50%. When motion is detected by the PIR sensor, the luminaire returns to full power/light output. Dimming on low is factory set to 50% with 5 minutes default in "full power" prior to dimming back to low. When no motion is detected for 5 minutes, the motion response system reduces the wattage by 50%, to 50% of the normal constant wattage reducing the light level. Other dimming settings can be provided if different dimming levels are required. This can also be done with FSIR-100 Wireless Remote Programming Tool (contact Technical Support for details).

Infrared Motion Response with Other Controls: When used in combination with other controls (Automatic Dimming Profile), motion response device will simply override controller's schedule with the added benefits of a combined dimming profile and sensor detection. In this configuration, the motion response device cannot be re-programmed with FSIR-100 Wireless Remote Programming Tool. The profile can only be re-programmed via the controller.


ECF-S EcoForm small

Area luminaire


Specifications

Infrared Motion Response Lenses (IMRI3/IMRI7): Infrared Motion Response Integral module is available with two different sensor lens types to accommodate various mounting heights and occupancy detection ranges. Lens #3 (IMRI3) is designed for mounting heights up to 20' with a 40' diameter coverage area. Lens #7 is designed for higher mounting heights up to 40' with larger coverage areas up to 100' diameter coverage area. See charts for approximate detection patterns:

IMRI3 Luminaire or remote mount controller with #3 lens

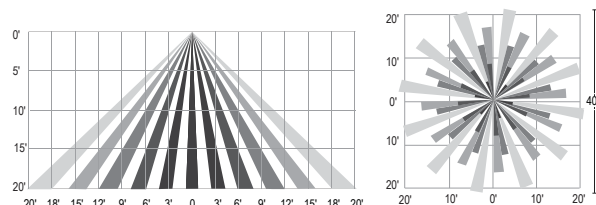

IMRI7 Luminaire or remote mount controller with #7 lens

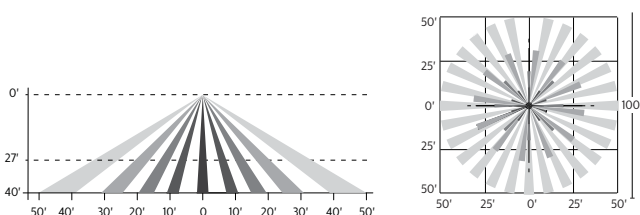

Electrical

Twist-Lock Receptacle (TLRD5/TLRD7/TLRPC): Twist Lock Receptacle with 5 pins enabling dimming or with 7 pins with additional functionality (by others) can be used with a twistlock photoelectric cell or a shorting cap. Dimming Receptacle Type B (5-pin) and Type D-24 (7-pin) in accordance to ANSI C136.41. Can be used with third-party control system. Receptacle located on top of luminaire housing. When specifying receptacle with twistlock photoelectric cell, voltage must be specified. When ordering 7-pin Twist-lock receptacle (TLRD7), all 7 pins are wired to respective pins with the Sensor Ready (SR) driver, and photocell or shorting cap is not included. When ordering a twist-lock receptacle with a photocell (TLRPC), the receptacle used is a 5-pin receptacle, so pins 6 and 7 are not available (no SR driver). 0-10V dimming leads (pins 4 and 5) are connected if not ordered with any other dimming option.

Buy American Act of 1933 (BAA):

This product is manufactured in one of our US factories and, as of the date of this document, this product was considered a commercially available off-the-shelf (COTS) item meeting the requirements of the BAA. This BAA designation hereunder does not address (i) the applicability of, or availability of a waiver under, the Trade Agreements Act, or (ii) the "Buy America" domestic content requirements imposed on states, localities, and other non-federal entities as a condition of receiving funds administered by the Department of Transportation or other federal agencies. Prior to ordering, please visit www.signify.com/baa to view a current list of BAA-compliant products to confirm this product's current compliance.

Driver: Driver efficiency (>90% standard). 120-480V available (restrictions apply). Open/short circuit protection. All drivers are 0-10V dimming to 10% power standard, except when using Sensor Ready (SR) drivers, which uses DALI protocol (options CS50/CM50/CS30/CM30, SRDR, and TR7). Drivers are RoHS and FCC Title 47 CFR Part 15 compliant.

Button Photocontrol (PCB): Button style design for internal luminaires mounting applications. The photocontrol is constructed of a high impact UV stabilized polycarbonate housing. Rated voltage of 120V or 208-277V with a load rating of 1000 VA. The photocell will turn on with 1-4Fc of ambient light.

Surge protection (SP1/SP2): Surge protection device tested in accordance with ANSI/IEEE C62.45 per ANSI/IEEE C62.41.2 Scenario I Category C High Exposure 10kV/10kA waveforms for Line-Ground, Line-Neutral and Neutral-Ground, and in accordance with DOE MSSLC Model Specification for LED Roadway Luminaires Appendix D Electrical Immunity High test level 10kV/10kA. 20kV / 10kA surge protection device that provides extra protection beyond the SP1 10kV/10kA level.

Listings

UL/cUL wet location listed to the UL 1598 standard, suitable for use in ambient temperatures from -40° to 40°C (-40° to 104°F). Most EcoForm configurations are qualified under Premium and Standard DesignLights Consortium® categories. Consult DLC Qualified Products list to confirm your specific luminaire selection is approved. CCTs 3000K and warmer are Dark Sky Approved.

Finish

Each standard color luminaire receives a fade and abrasion resistant, electrostatically applied, thermally cured, triglycidal isocyanurate (TGIC) textured polyester powdercoat finish. Standard colors include bronze (BZ), black (BK), white (WH), dark gray (DGY), and medium gray (MGY). Consult factory for specs on optional or custom colors.

Service Tag

Each individual luminaire is uniquely identifiable, thanks to the Service tag application. With a simple scan of a QR code, placed on the inside of the mast door, you gain instant access to the luminaire configuration, making installation and maintenance operations faster and easier, no matter what stage of the luminaire's lifetime. Just download the APP and register your product right away. For more details visit: signify.com

Warranty


EcoForm luminaires feature a 5-year limited warranty. See signify.com/warranties for complete details and exclusions.



ATC Hazards by Location

Search Information

Address: 1601 Kirkwood Hwy, Wilmington, DE 19805
Coordinates: 39.7402063, -75.6065325
Elevation: 90 ft
Timestamp: 2023-10-19T15:31:20.019Z
Hazard Type: Wind

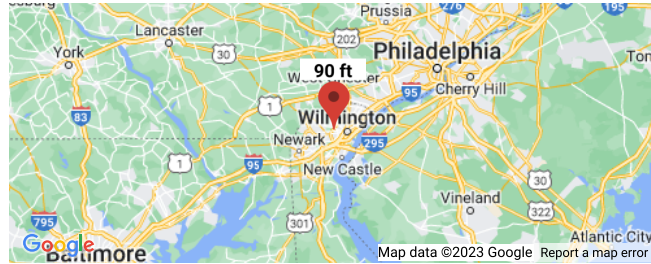

ASCE 7-16

MRI 10-Year 76 mph
 MRI 25-Year 82 mph
 MRI 50-Year 88 mph
 MRI 100-Year 94 mph
Risk Category I 104 mph
 Risk Category II 112 mph
 Risk Category III 122 mph
 Risk Category IV 125 mph

ASCE 7-10

MRI 10-Year 76 mph
 MRI 25-Year 84 mph
 MRI 50-Year 90 mph
 MRI 100-Year 96 mph
Risk Category I 105 mph
 Risk Category II 115 mph
 Risk Category III-IV 120 mph

ASCE 7-05

ASCE 7-05 Wind Speed 90 mph

The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.

Please note that the ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

Disclaimer

Hazard loads are interpolated from data provided in ASCE 7 and rounded up to the nearest whole integer. Per ASCE 7, islands and coastal areas outside the last contour should use the last wind speed contour of the coastal area – in some cases, this website will extrapolate past the last wind speed contour and therefore, provide a wind speed that is slightly higher. NOTE: For queries near wind-borne debris region boundaries, the resulting determination is sensitive to rounding which may affect whether or not it is considered to be within a wind-borne debris region.


Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.

While the information presented on this website is believed to be correct, ATC and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in the report should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. ATC does not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the report provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the report.

By A.H. Subject VAMC WILMINGTON
Date 6/19/23 Chk _____ Date _____ LIGHT POST WIND LOAD

WIND ON STRUCTURE

RISK I, $V = 105 \text{ MPH (ULT.)}$, $V = 81 \text{ MPH (DESIGN)}$

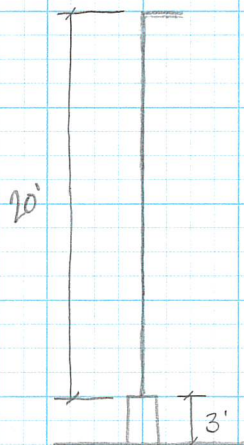

FROM POLE CUTSHEET PROVIDED BY VALMONT (400Q200):

$$\text{POLE WIND AREA} = \frac{4}{12} \cdot 20' \Rightarrow 6.7 \text{ ft}^2$$

$$\text{FIXTURE WIND AREA} = 9.6 \text{ ft}^2 (\text{MAX.})$$

$$\text{POLE WEIGHT} = 140 \#$$

$$\text{FIXTURE WEIGHT} = 240 \# (\text{MAX.})$$

DETERMINE WIND FORCE W/ ASCE 7-16 CHAP. 29 & AASHTO LRFD
(CONSIDER LIGHT POLE AS SQUARE CHIMNEY/TANK/SIMILAR)

$$K_d = 0.9, \text{ EXPOSURE C, } K_{zt} = 1.0, K_e = 1.0, G = 0.85$$

$$K_{z5} = 0.94, C_d(\text{POLE}) = 1.2, C_d(\text{LUM}) = 1.2$$

$$\text{PRESSURE ON POLE + LUMINAIRES} = 0.00256 \cdot 0.94 \cdot 0.9 \cdot 0.85 \cdot (105)^2 \cdot 1.2 \Rightarrow$$

$$\underline{q_{25} = 25 \text{ PSF}}$$

$$\text{LOAD ON POLE} = 170 \#$$

$$\text{LOAD ON LIGHT FIX.} = 240 \#$$


$$\text{SHEAR @ BASE} = 410 \#$$

$$\text{MOMENT @ BASE} = 8125 \text{ ft} \cdot \#$$


ATC Hazards by Location

Search Information


Address: 1601 Kirkwood Hwy, Wilmington, DE 19805, USA
Coordinates: 39.7402063, -75.6065325
Elevation: 90 ft
Timestamp: 2023-11-28T21:53:46.267Z
Hazard Type: Seismic
Reference Document: ASCE7-16
Risk Category: I
Site Class: D

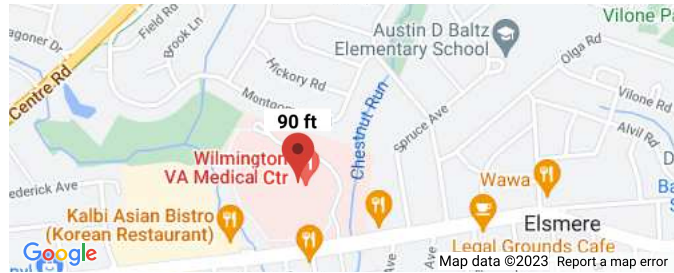

MCER Horizontal Response Spectrum

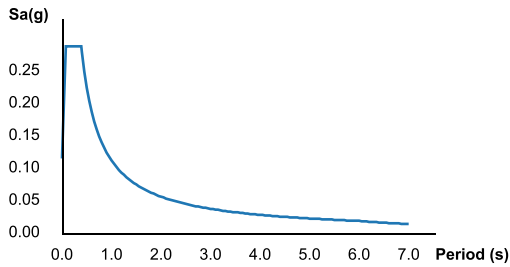

Design Horizontal Response Spectrum

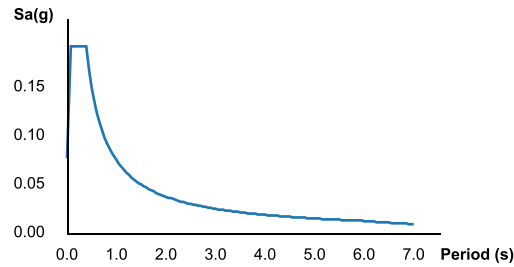

Basic Parameters

Name	Value	Description
S_S	0.18	MCE_R ground motion (period=0.2s)
S_1	0.047	MCE_R ground motion (period=1.0s)
S_{MS}	0.288	Site-modified spectral acceleration value
S_{M1}	0.112	Site-modified spectral acceleration value
S_{DS}	0.192	Numeric seismic design value at 0.2s SA
S_{D1}	0.075	Numeric seismic design value at 1.0s SA

Additional Information

Name	Value	Description
SDC	B	Seismic design category
F_a	1.6	Site amplification factor at 0.2s
F_v	2.4	Site amplification factor at 1.0s
CR_S	0.951	Coefficient of risk (0.2s)
CR_1	0.938	Coefficient of risk (1.0s)
PGA	0.1	MCE_G peak ground acceleration
F_{PGA}	1.599	Site amplification factor at PGA
PGA_M	0.16	Site modified peak ground acceleration
T_L	6	Long-period transition period (s)
$SsRT$	0.18	Probabilistic risk-targeted ground motion (0.2s)
$SsUH$	0.189	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
SsD	1.5	Factored deterministic acceleration value (0.2s)
$S1RT$	0.047	Probabilistic risk-targeted ground motion (1.0s)
$S1UH$	0.05	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
$S1D$	0.6	Factored deterministic acceleration value (1.0s)

SEISMIC FORCE FOR COMPONENTS**IBC 2018 - ASCE 7-16 Specifications****Electrical Components**

Job Name:	VAMC Wilmington	Subject:	LIGHTPL SEIS. BASE SHEAR		
Job Number:	20230236.00 (A720023236)	Originator:	WBCM	Checker:	WBCM

Input Data:

Risk Category =	I	IBC 2018 Table 1604.5
Soil Site Class =	D	IBC 2018 Table 1613.5.2
Location Zip Code =	19805	
Spectral Accel., S_s =	0.180	ASCE 7-16 Figures 22-1 to 22-6
Spectral Accel., S_1 =	0.047	ASCE 7-16 Figures 22-2 to 22-6
Height, h =	25.000	ft.
Height of attachment, z =	25.000	ft. CONSERVATIVE
Importance Factor, I_p =	1.00	ASCE 7-16 Section 13.1.3
Component Weight, W_p =	500.00	lbs., ASCE 7-16 Section 13.3.1
Component Type =	$R_p = 1.5$	Lighting fixtures ASCE 7-16 Table 13.6-1

Results:**Site Coefficients:**

F_a =	1.600	IBC 2018 Table 1613.2.3(1)
F_v =	2.400	IBC 2018 Table 1613.2.3(2)

Maximum Spectral Response Accelerations for Short and 1-Second Periods:

S_{MS} =	0.288	$S_{MS} = F_a \cdot S_s$, IBC 2018 Eqn. 16-36
S_{M1} =	0.113	$S_{M1} = F_v \cdot S_1$, IBC 2018 Eqn. 16-37

Design Spectral Response Accelerations for Short and 1-Second Periods :

S_{DS} =	0.192	$S_{DS} = 2 \cdot S_{MS} / 3$, IBC 2018 Eqn. 16-38
S_{D1} =	0.075	$S_{D1} = 2 \cdot S_{M1} / 3$, IBC 2018 Eqn. 16-39

Seismic Design Category:

Category(for S_{DS}) =	B	ASCE 7-16 TABLE 11.6-1
Category(for S_{D1}) =	B	ASCE 7-16 TABLE 11.6-2
Use Category =	D	CONSERVATIVE (B)

Amplification Factor and Response Modification Coefficient:

Amplification Factor, a_p =	1.00	ASCE 7-16 TABLE 13.6-1
Response Mod. Coef., R_p =	1.50	ASCE 7-16 TABLE 13.6-1

Component Horizontal Seismic Force:

F_{ph} =	76.80	lbs., $F_{ph} = (0.4 \cdot a_p \cdot S_{DS} \cdot W_p) \cdot (1 + 2 \cdot z/h) / (R_p / I_p)$, Eqn. 13.3-1
$F_{ph(max)}$ =	153.60	lbs., $F_{ph} = 1.6 \cdot S_{DS} \cdot I_p \cdot W_p$, Eqn. 13.3-2
$F_{ph(min)}$ =	28.80	lbs., $F_{ph} = 0.3 \cdot S_{DS} \cdot I_p \cdot W_p$, Eqn. 13.3-3
Use: F_{ph} =	76.80	lbs. <i>Note: F_{ph} is to be applied independently in both transverse and longitudinal directions relative to seismic restraint.</i>

Comments: VALMONT LIGHTPOLE

Pole Footing Embedded in Soil

Project File: VAMC Wilmington 2023.11.29.ec6

LIC#: KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Light Pole Footing

Code References

Calculations per IBC 2018 1807.3, CBC 2019, ASCE 7-16

Load Combinations Used : IBC 2021

General Information

Pole Footing Shape Circular
Pole Footing Diameter 24.0 in
Calculate Min. Depth for Allowable Pressures
No Lateral Restraint at Ground Surface
Allow Passive 150.0 psf
Max Passive 1,500.0 psf

Controlling Values


Governing Load Combination **D+0.60W**
Lateral Load 0.2685 k
Moment 5.156 k-ft

NO Ground Surface Restraint

Pressures at 1/3 Depth
Actual **274.105 psf**
Allowable **275.220 psf**

Minimum Required Depth 5.625 ft

Footing Base Area 3.142 ft²
Maximum Soil Pressure 0.1592 ksf

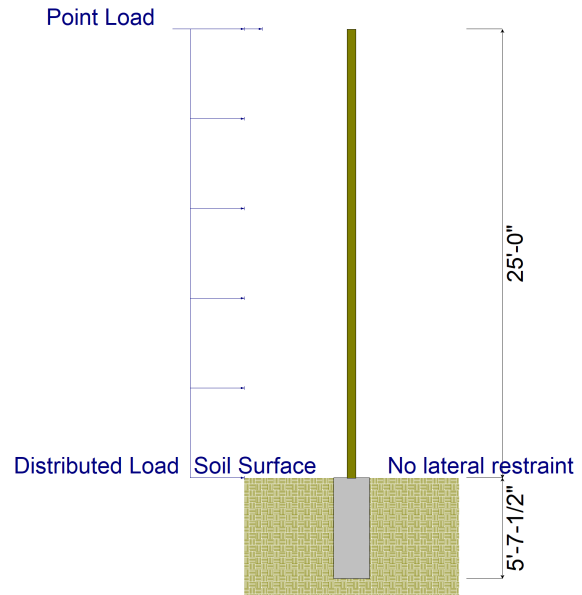

Applied Loads

Lateral Concentrated Load (k)		Lateral Distributed Loads (k)		Vertical Load (k)
D : Dead Load	k		k/ft	0.50 k
Lr : Roof Live	k		k/ft	k
L : Live	k		k/ft	k
S : Snow	k		k/ft	k
W : Wind	0.240 k	0.00830	k/ft	k
E : Earthquake	0.0770 k		k/ft	k
H : Lateral Earth	k		k/ft	k
Load distance above ground surface	25.0 ft	TOP of Load above ground surface	ft	
		25.0		
		BOTTOM of Load above ground surface	ft	

Load Combination Results

Load Combination	Forces @ Ground Surface		Required Depth - (ft)	Pressure at 1/3 Depth		Soil Increase Factor
	Loads - (k)	Moments - (ft-k)		Actual - (psf)	Allow - (psf)	
D Only	0.000	0.000	0.13	0.0	0.0	1.000
+D+0.60W	0.269	5.156	5.63	274.1	275.2	1.000
+D+0.70E	0.054	1.348	3.50	168.2	169.5	1.000
+D+0.450W	0.201	3.867	5.00	247.3	248.4	1.000
+D+0.5250E	0.040	1.011	3.13	152.6	153.3	1.000
+0.60D+0.60W	0.269	5.156	5.63	274.1	275.2	1.000
+0.60D+0.70E	0.054	1.348	3.50	168.2	169.5	1.000

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6

LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Code References

Calculations per ACI 318-14, IBC 2018, CBC 2019, ASCE 7-16
Load Combinations Used : IBC 2021

General Information


f'_c : Concrete 28 day streng = 4.0 ksi
E = 3,605.0 ksi
Density = 150.0 pcf
 β = 0.850
 f_y - Main Rebar = 60.0 ksi
E - Main Rebar = 29,000.0 ksi
Allow. Reinforcing Limits *ASTM A615 Bars Used*
Min. Reinf. = 0.50 %
Max. Reinf. = 8.0 %

Overall Column Height = 6.0 ft
End Fixity Top Free, Bottom Fixed
Brace condition for deflection (buckling) along column
X-X (width) axis :
Unbraced Length for buckling ABOUT Y-Y Axis = 6.0 ft, K = 1.0
Y-Y (depth) axis :
Unbraced Length for buckling ABOUT X-X Axis = 6.0 ft, K = 1.0

Column Cross Section

Column Dimensions : 24.0in Diameter, Column Edge to Rebar Edge Cover = 3.0in

Column Reinforcing : 8 - #5 bars

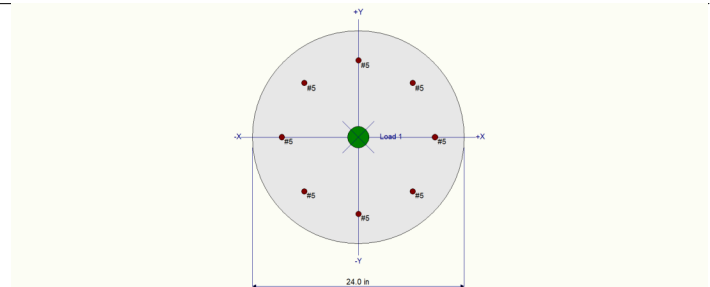

Entered loads are factored per load combinations specified by user.

Applied Loads

Column self weight included : 2,827.43 lbs * Dead Load Factor

AXIAL LOADS . . .

Axial Load at 6.0 ft above base, D = 0.50 k

BENDING LOADS . . .

Load on Light Fixture: Moment acting about X-X axis at 6.0 ft, W = 9.0 k-ft

DESIGN SUMMARY

Load Combination +0.90D+W
Location of max. above base 5.960 ft
Maximum Stress Ratio 0.064 : 1
Ratio = $(P_u^2 + M_u^2)^{0.5} / (\Phi P_n^2 + \Phi M_n^2)^{0.5}$
 P_u = 2.995 k $\Phi * P_n$ = 47.771 k
 M_u -x = 9.0 k-ft $\Phi * M_n$ -x = 142.150 k-ft
 M_u -y = 0.0 k-ft $\Phi * M_n$ -y = 0.0 k-ft
 M_u Angle = 0.0 deg
 M_u at Angle = 9.0 k-ft ΦM_n at Angle = 140.026 k-ft

Pn & Mn values located at Pu-Mu vector intersection with capacity curve

Column Capacities . .

P_{nmax} : Nominal Max. Compressive Axial Capacity 1,678.49 k
 P_{nmin} : Nominal Min. Tension Axial Capacity k
 ΦP_n , max : Usable Compressive Axial Capacity 998.70 k
 ΦP_n , min : Usable Tension Axial Capacity k

Maximum SERVICE Load Reactions .

Top along Y-Y 0.0 k Bottom along Y-Y 0.0 k
Top along X-X 0.0 k Bottom along X-X 0.0 k

Maximum SERVICE Load Deflections . .

Along Y-Y -0.004736 in at 6.0 ft above base
for load combination : W Only
Along X-X 0.0 in at 0.0 ft above base
for load combination :

General Section Information $\phi = 0.70$ $\beta = 0.850$ $\theta = 0.850$

ρ : % Reinforcing 0.5482 % Rebar % Ok
Reinforcing Area 2.480 in²
Concrete Area 452.389 in²

Governing Load Combination Results

Governing Factored Load Combination	Moment		Dist. from base ft	Axial Load k Pu	Bending Analysis k-ft										Utilization Ratio
	X-X	Y-Y			$\phi * P_n$	δx	$\delta x * M_{ux}$	δy	$\delta y * M_{uy}$	Alpha (deg)	δM_u	ϕM_n			
+1.40D			5.96	4.66	998.70						0.000			0.005	

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6

LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Governing Load Combination Results

Governing Factored Load Combination	Moment		Dist. from base ft	Axial Load k			Bending Analysis k-ft						Utilization	
	X-X	Y-Y		Pu	ϕ	Pn	δx	$\delta x * Mux$	δy	$\delta y * Muy$	Alpha (deg)	δMu	ϕMn	Ratio
+1.20D			5.96	3.99		998.70					0.000			0.004
+1.20D+0.50W	Actual		5.96	3.99		206.20	1.000	4.50			0.000	4.50	232.50	0.019
+1.20D+W	Actual		5.96	3.99		67.43	1.000	9.00			0.000	9.00	152.64	0.059
+0.90D+W	Actual		5.96	2.99		47.77	1.000	9.00			0.000	9.00	140.03	0.064
+0.90D			5.96	2.99		998.70					0.000			0.003

Maximum Reactions

Note: Only non-zero reactions are listed.

Load Combination	X-X Axis Reaction		k	Y-Y Axis Reaction		Axial Reaction	Mx - End Moments k-ft		My - End Moments	
	@ Base	@ Top		@ Base	@ Top		@ Base	@ Top	@ Base	@ Top
D Only						3.327				
+D+0.60W						3.327	-5.400			
+D+0.450W						3.327	-4.050			
+0.60D+0.60W						1.996	-5.400			
+0.60D						1.996				
W Only							-9.000			

Maximum Moment Reactions




Note: Only non-zero reactions are listed.

Load Combination	Moment About X-X Axis		k-ft	Moment About Y-Y Axis		k-ft
	@ Base	@ Top		@ Base	@ Top	
D Only						
+D+0.60W	-5.400		k-ft			k-ft
+D+0.450W	-4.050		k-ft			k-ft
+0.60D+0.60W	-5.400		k-ft			k-ft
+0.60D			k-ft			k-ft
W Only	-9.000		k-ft			k-ft

Maximum Deflections for Load Combinations

Load Combination	Max. X-X Deflection		Max. Y-Y Deflection	
	Distance		Distance	
D Only	0.0000 in	0.000 ft	0.000 in	0.000 ft
+D+0.60W	0.0000 in	0.000 ft	-0.003 in	6.000 ft
+D+0.450W	0.0000 in	0.000 ft	-0.002 in	6.000 ft
+0.60D+0.60W	0.0000 in	0.000 ft	-0.003 in	6.000 ft
+0.60D	0.0000 in	0.000 ft	0.000 in	0.000 ft
W Only	0.0000 in	0.000 ft	-0.005 in	5.960 ft

Sketches

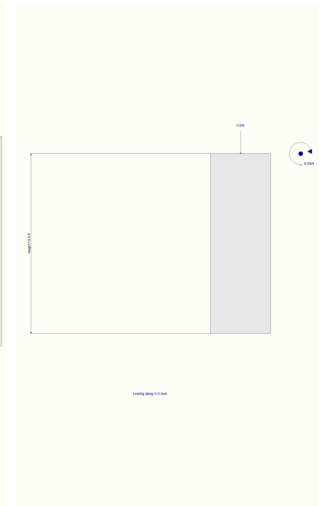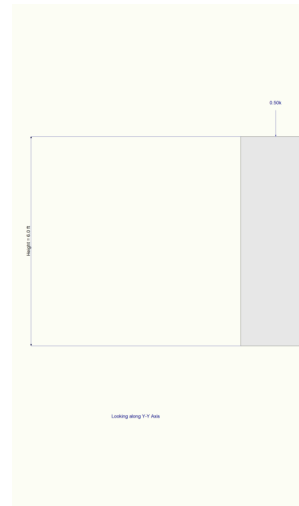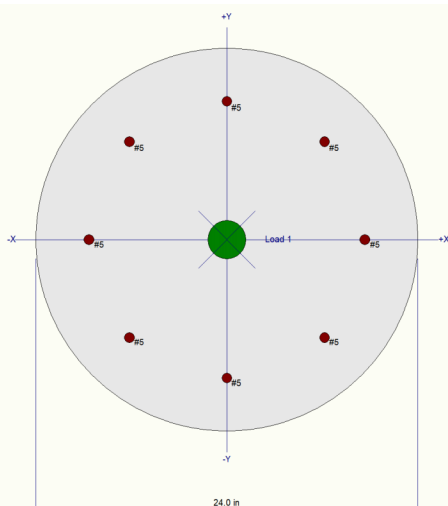

Interaction Diagrams

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6


LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram

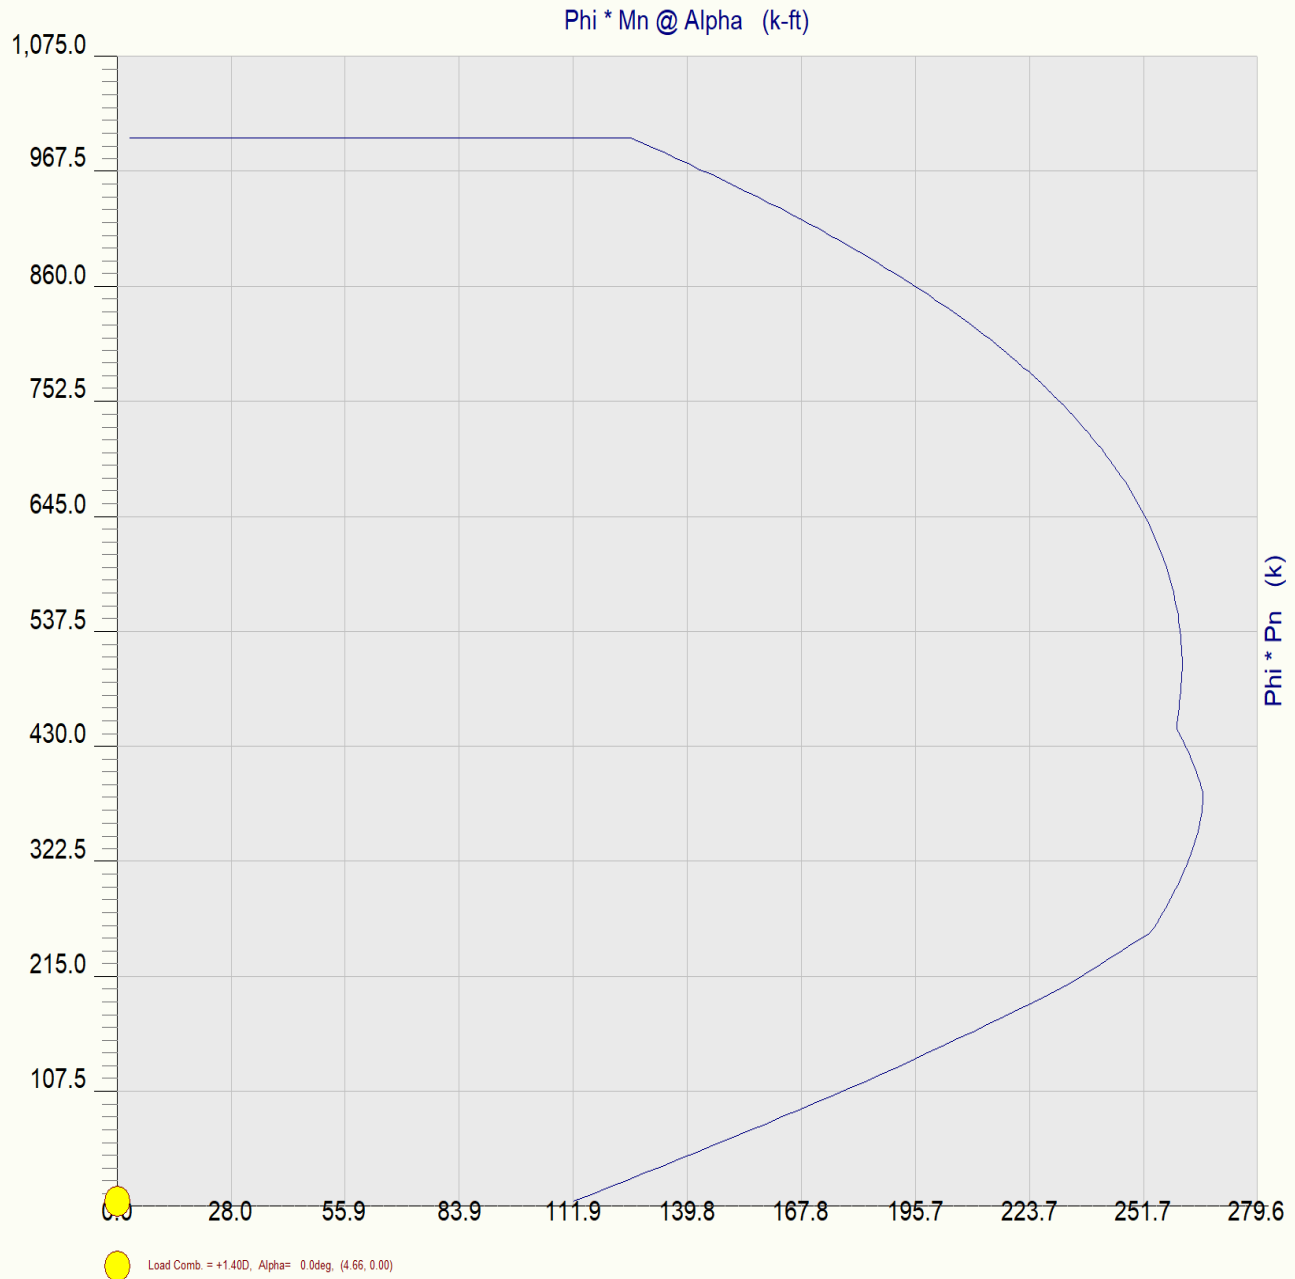

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6


LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram

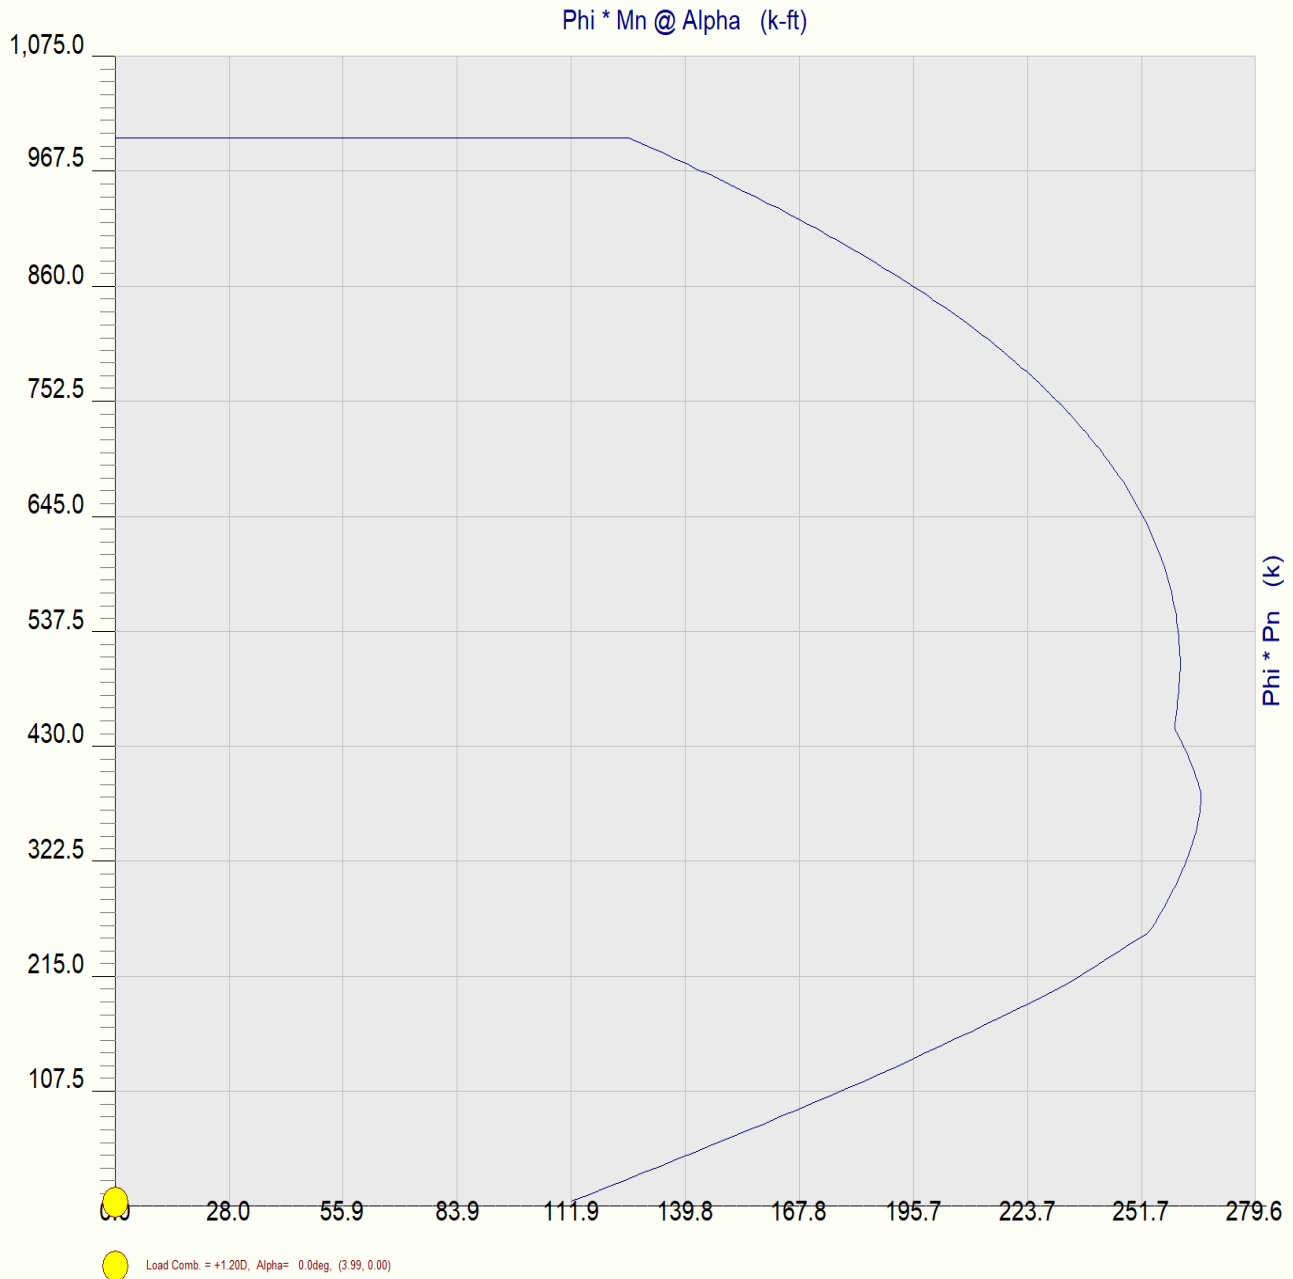

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6

LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram



Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6


LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram

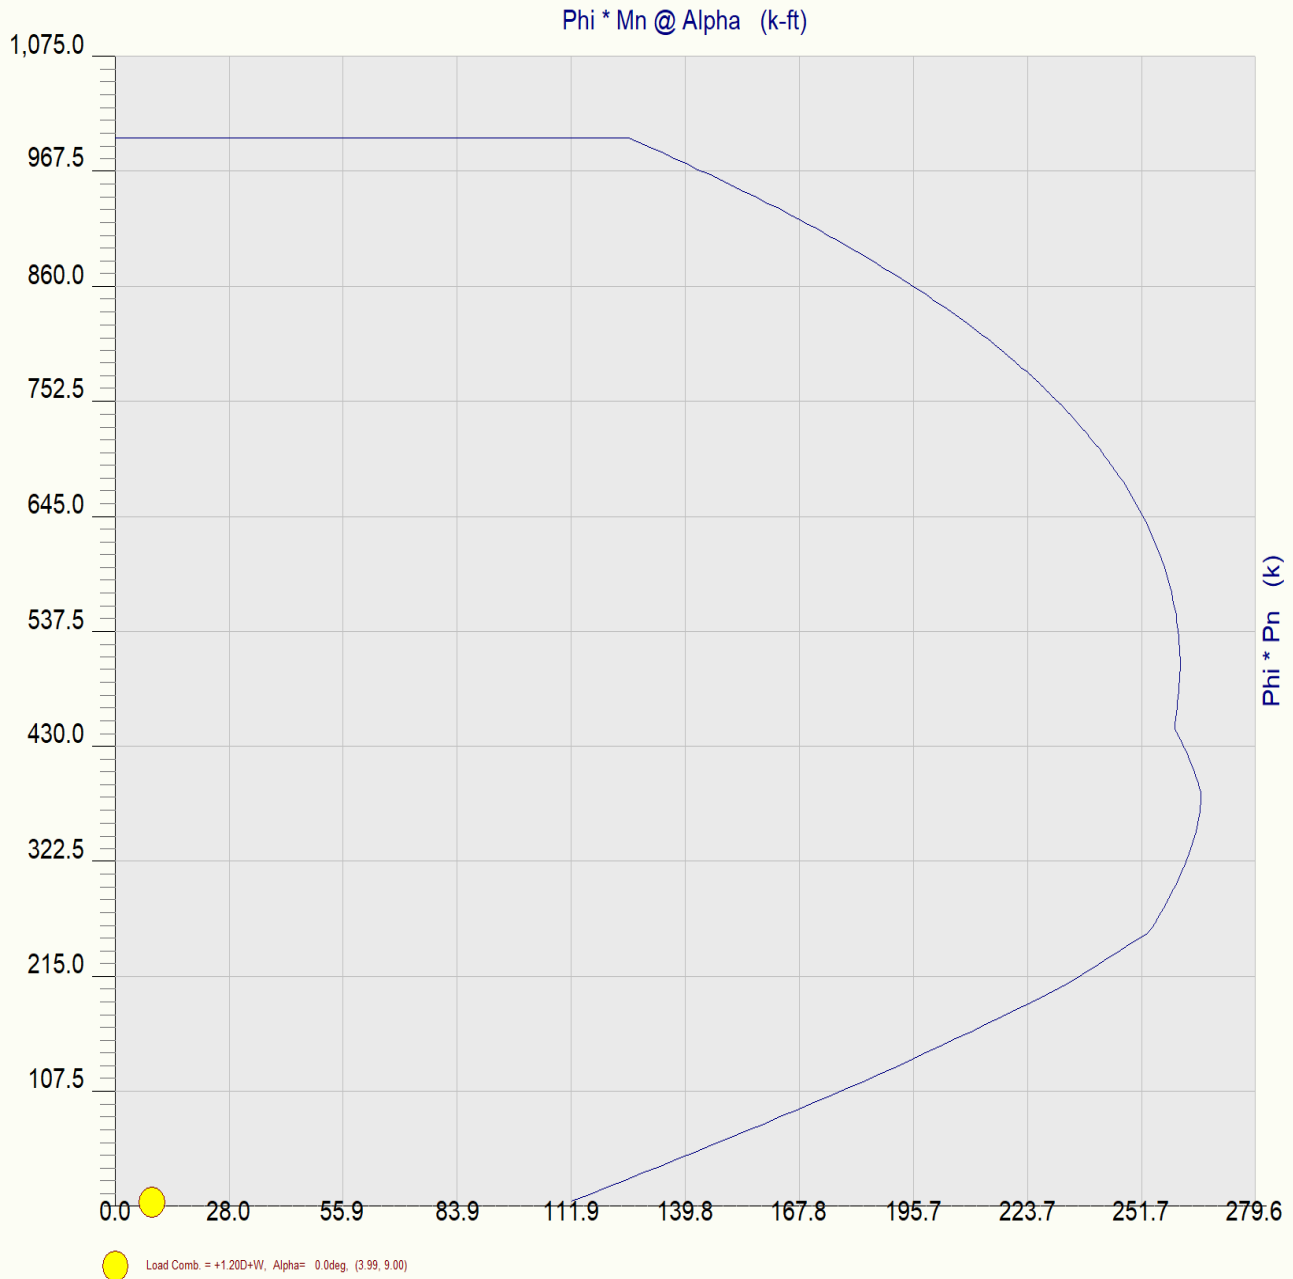

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6


LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram

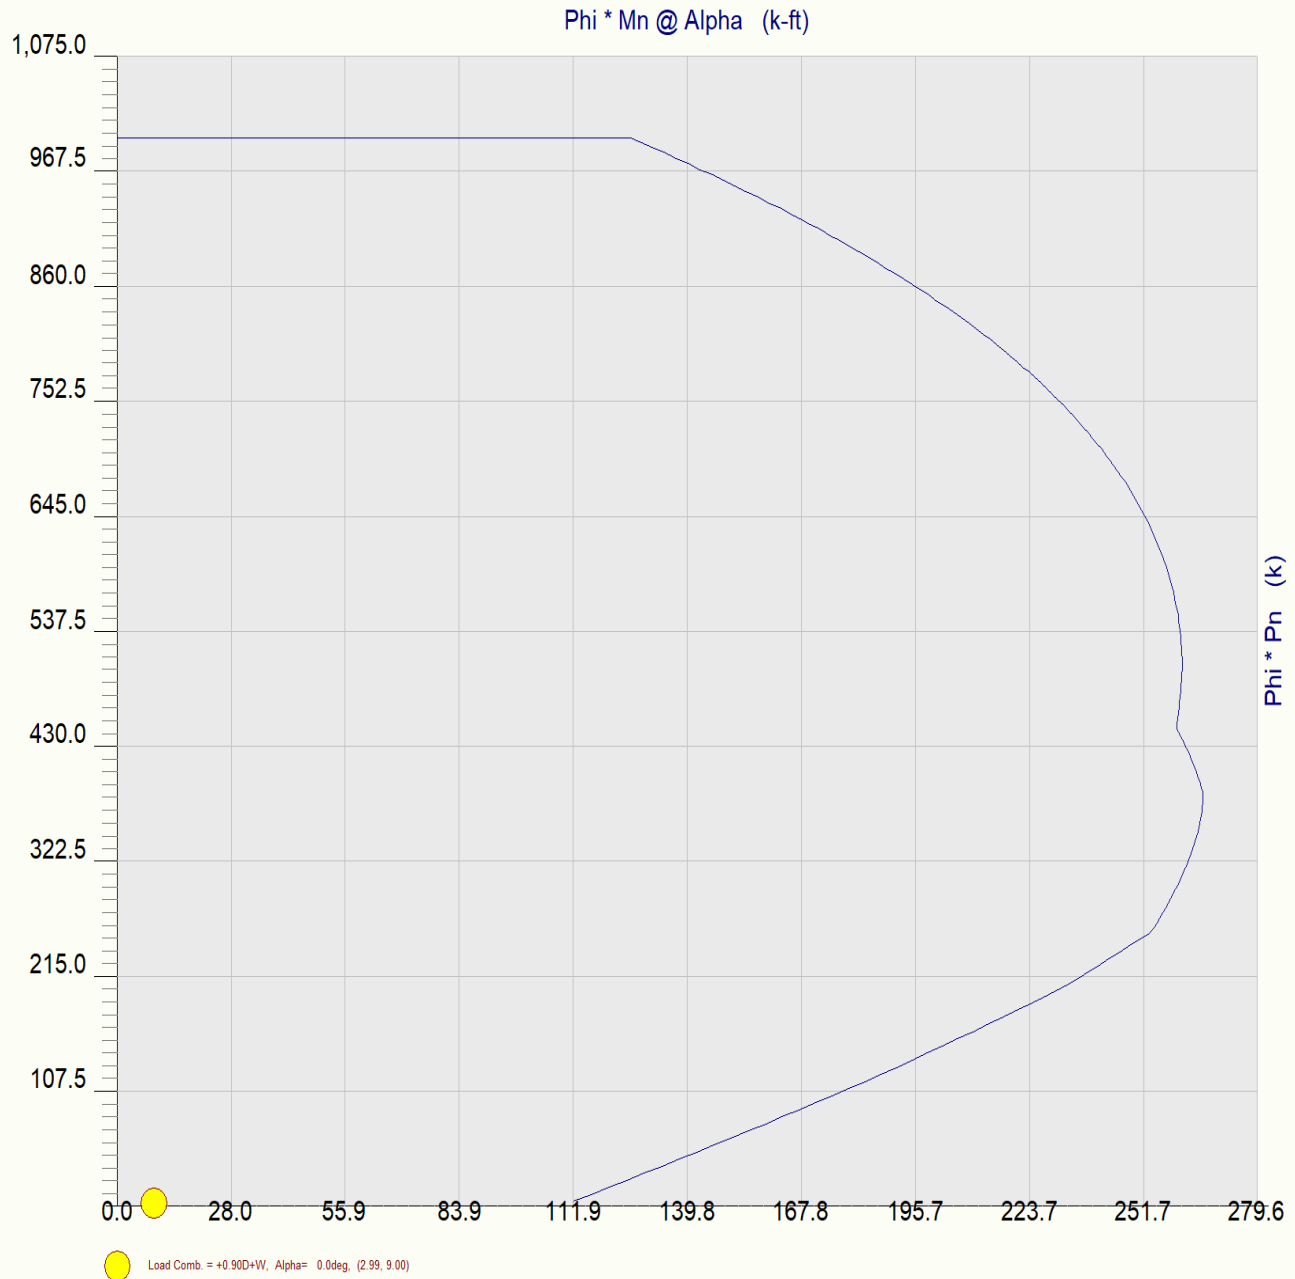

Concrete Column

Project File: VAMC Wilmington 2023.11.29.ec6

LIC# : KW-06015984, Build:20.23.04.05

WHITNEY BAILEY COX & MAGNANI

(c) ENERCALC INC 1983-2023

DESCRIPTION: Pole Footing Reinforcement

Concrete Column P-M Interaction Diagram

